

ENGINEERING SCHEDULE

CERTIFIED STEEL PORTAL FRAME SHED DESIGN IN ACCORDANCE WITH NCC 2022 FOR SITE WIND SPEED "40.93m/s", WIND REGION "A2", TERRAIN CATEGORY "2", IMPORTANCE LEVEL "2"
Internal Pressure: 0.5
Design Snow Load: 0.00 KPa, Roof Snow Load: 0.00 KPa
Customer: Brady Hogan
Site Address: 28 Wakaya Cl, Vacy NSW 2421
Main Building: Span: 9, Length: 12, Height: 3.6, Roof Pitch: 11 degrees
The length being comprised of 3 bays, the largest bay is 4m bays.
Left LeanTo: NA
Right LeanTo: NA
Total Kit Weight: 2876.87kg

INTERNAL PORTALS	END PORTALS
Column: 2C15024 Rafter: 2C15024 Knee Brace:2C10010 Knee Brace Length:1600 Apex Brace:2C10010 Apex Brace Length:4000	Column: C15024 Rafter: C15024 Knee Brace:NA Knee Brace Length:NA Apex Brace:NA Apex Brace Length:NA Endwall Mullion:C15024

LEFT LEAN TO PORTALS	RIGHT LEAN TO PORTALS
Internal Column:NA Internal Rafter:NA End Column:NA End Rafter:NA Knee Brace:NA Knee Brace Length:NA	Internal Column:NA Internal Rafter:NA End Column:NA End Rafter:NA Knee Brace:NA Knee Brace Length:NA

NOTE: All unclad intermediate columns are always back to back (refer to drawing: Floor Plan).

PURLINS AND GIRTS		
Eave Purlin:C10010 Side Wall Girts:TH64100 Front End Wall Girts:TH64100 Back End Wall Girts:TH64100 Roof Purlins:TH64100	Max Spacing:1250 Max Spacing:1250 Max Spacing:1250 Max Spacing:1000	Overlap: 10% Overlap: 10% Overlap: 10% Overlap: 10%

NOTE: Girt spacing will vary to a maximum 1.25m where window/s are located.

FASTENERS
Sleeve Anchor Bolts:M12x75 Sleeve Anchor Yellow Zinc Frame Bolts:M12x30 Purlin Assembly Zinc (Mild) Frame Screws:Frame Screw 14x14x22 Cross Bracing Strap:NA Open Bay Header Height:NA

COLOUR SCHEDULE
Roof Sheets:Colour External Wall Sheets:Colour Roller Doors:Colour Flashings: Colour PA Doors:Colour Windows: NA

DOMESTIC & LIGHT INDUSTRIAL STEEL PORTAL FRAME SHED STRUCTURES
This structure is designed in compliance with AS4600, AS3600 and AS1170 1 to 4 as Importance Level 2 with a Live Load of 0.25kPa as "Air Leaky Structures" providing stability when openings are prevalent.

The structures are clad with corrugated pre-painted finish, 0.42mm walls and 0.42mm roof (compliant with AS1562.1 Metal) over cold formed 450 to 550mPa galvanized steel C sections primary frames.
Primary framing is fastened together with 4.6 Class galvanized bolts adequately tensioned on ground prior to erection.

Secondary framing steel bracing, with purlins and girts lapped, are all tek fastened to primary steel with a minimum of two (2) teks per connection as specified in details.
All rainwater products are compliant with AS2179.1 (Metal).

ENGINEERING
The undersigning engineer has checked that the design of the structure complies with relevant current Australian Standards as ~~stated above~~ and the following i.e AS4671- 2001 Steel Reinforcing materials, AS3600 - Concrete structures. However, he will not be present during construction, neither will he conduct inspections nor construction supervision.
The class 10a buildings are designed for erection on pad footings or slab based on soil of classification "A"- "P" with minimum bearing capacity 100kPa (i.e. organic soil is to be removed to a suitable material below natural surface).
Where (suitable) fill is required to level the site, it should be placed and compacted in layers of 150mm maximum.


Concrete pad footings and slab supply and placement is to be in compliance with AS2870-2011 Residential Slabs & Footings, AS3600-2009 Concrete Structures for A2 and B2 exposure (i.e. 25mPa strength @ 28 days strength) with recommended slump 75 to 80mm for light pneumatic tyred traffic all trafficable floors.


25mm deep concrete saw cut, to be made into the surface of the concrete slab every 6m in width or length as crack control joints.

For sites where these conditions are considered to be inadequate, a customized foundation design for the structure can be supplied to suit a specific purpose.
CONSTRUCTION
Erection of the structure is to be in compliance with local and state ordinances, Occupational Health and Safety Regulations and with plans provided.

GENERAL
The designs as portrayed on the drawings remain the intellectual property of Best Sheds Pty Ltd and are provided for building approval and construction purposes only.


SNOW LOAD
Following conditions only apply to buildings with snow loading:
• No maintenance or roof traffic permitted on the roof while there is snow present.
• No other structure to be erected within 500mm of the gutters of this building.

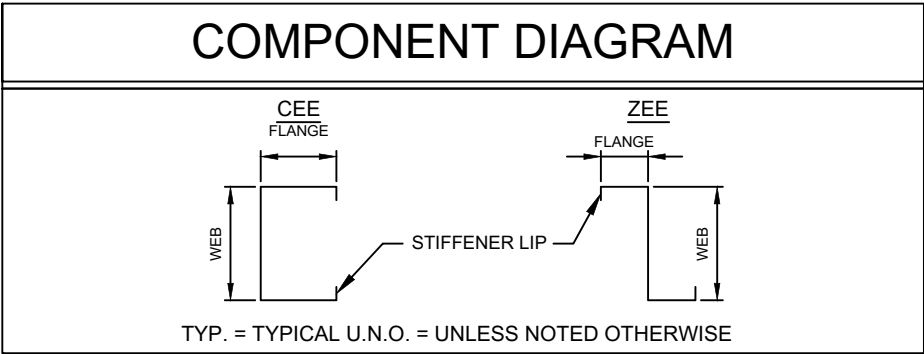

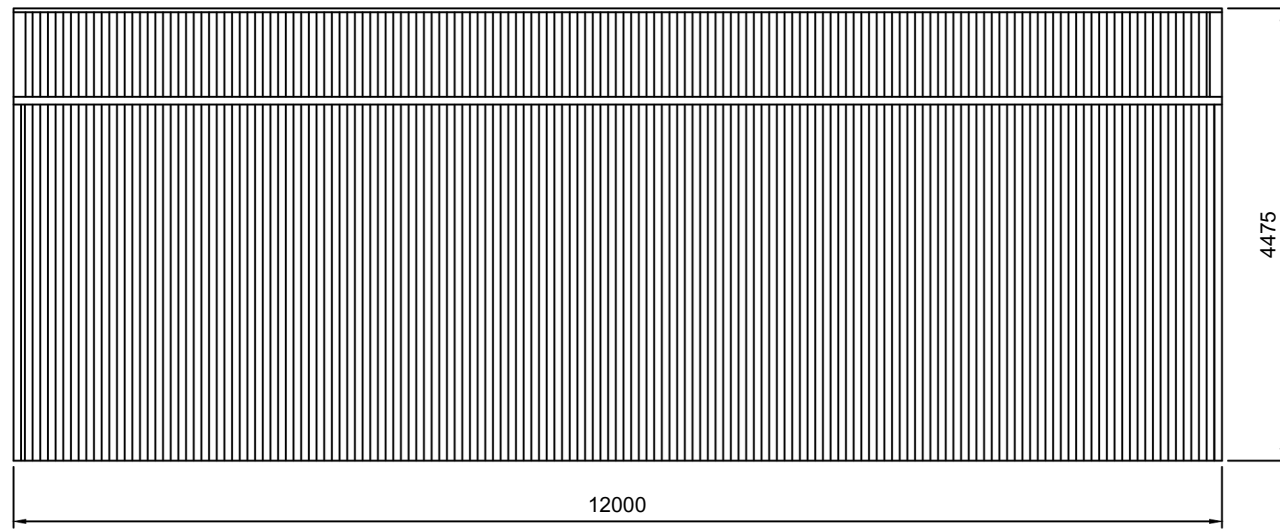

2 LEFT ELEVATION/ WEST ELEVATION


SCALE: 1:75

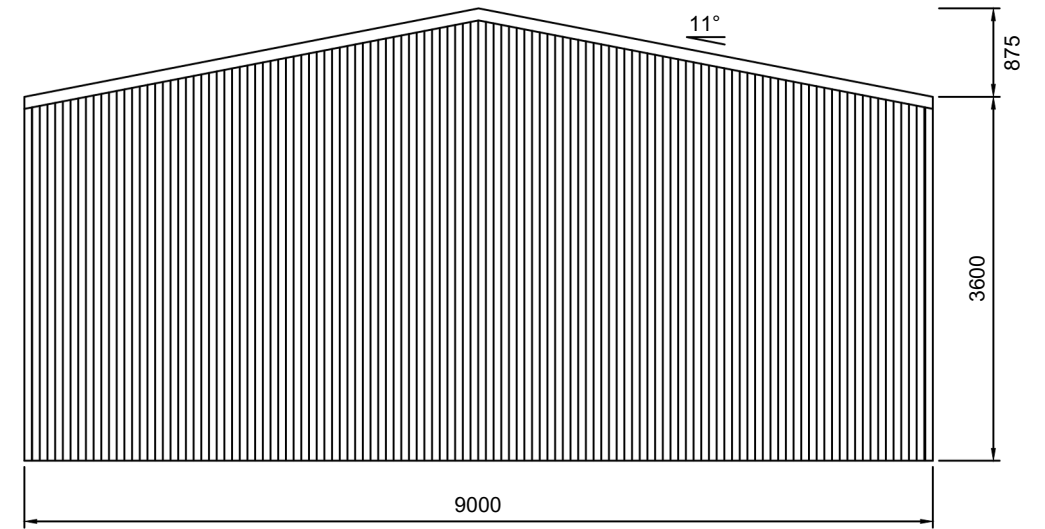

3 REAR ELEVATION/ NORTH ELEVATION


SCALE: 1:75

FRAME #4

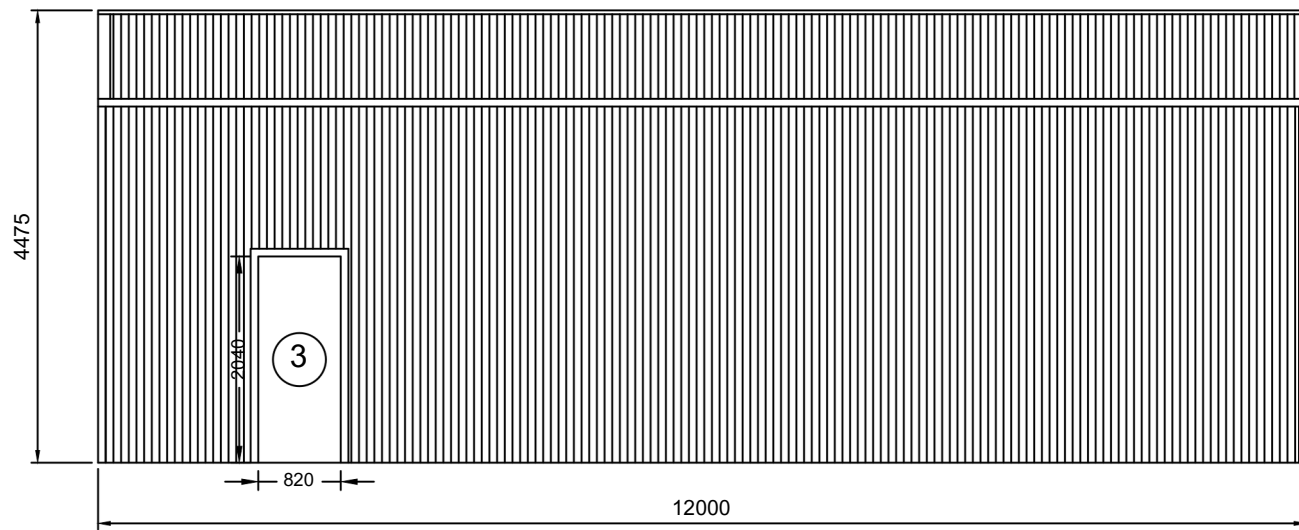

1 RIGHT ELEVATION/ EAST ELEVATION


SCALE: 1:75

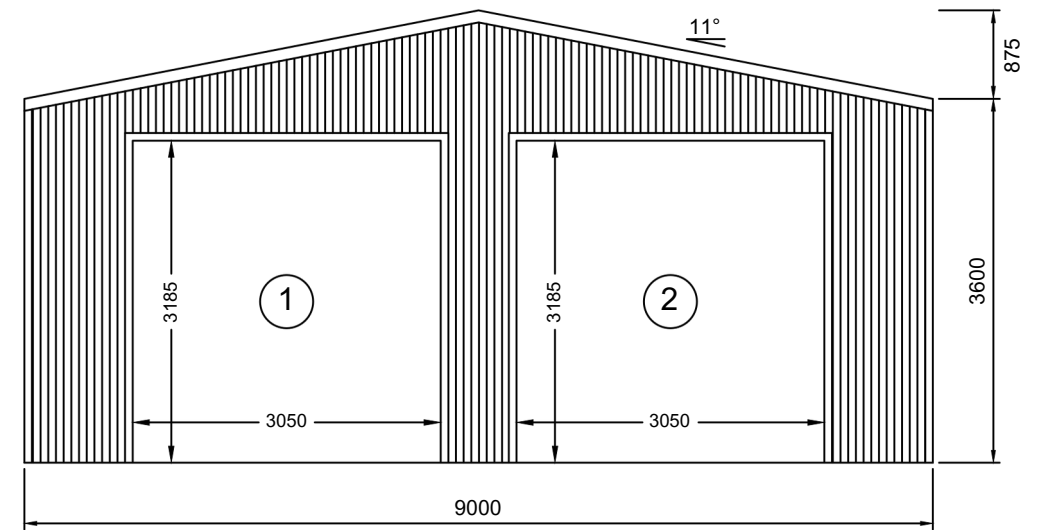


4 FRONT ELEVATION/ SOUTH ELEVATION

SCALE: 1:75


FRAME #1

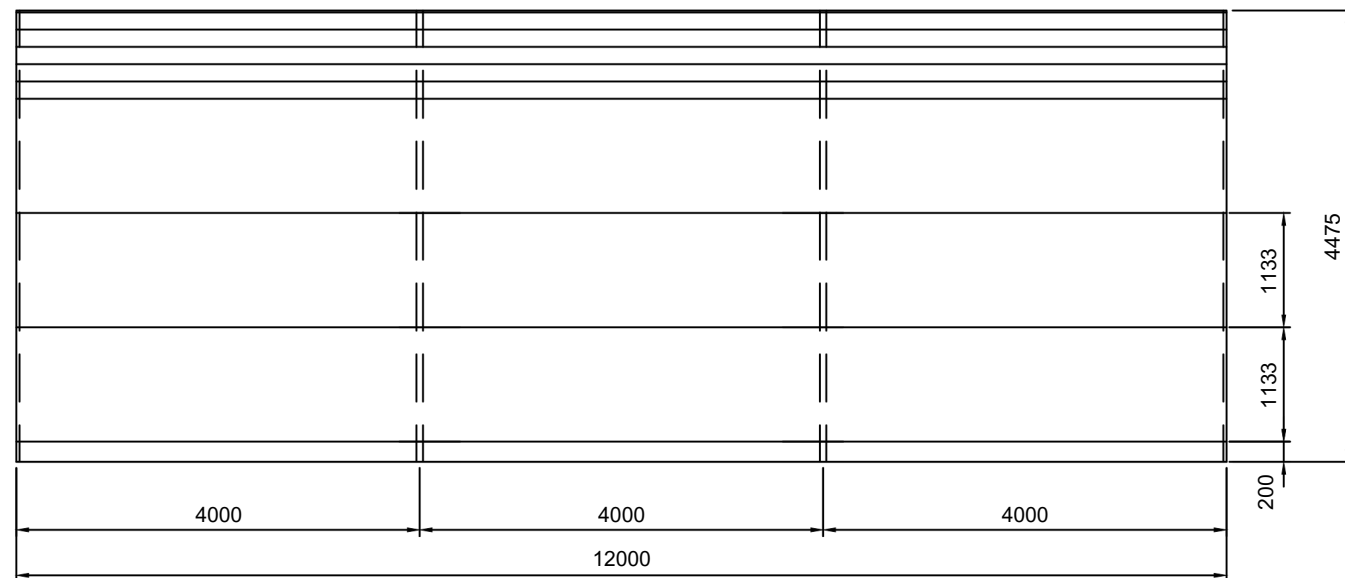


2 LEFT ELEVATION/ EAST ELEVATION
3 SCALE: 1:75

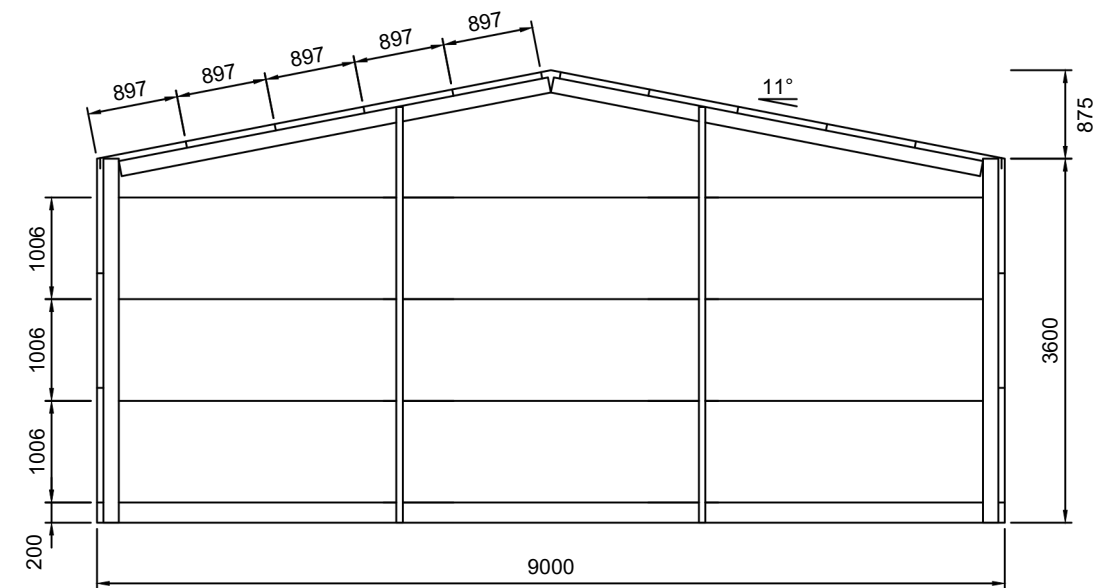


3 REAR ELEVATION/ NORTH ELEVATION
3 SCALE: 1:75 FRAME #4

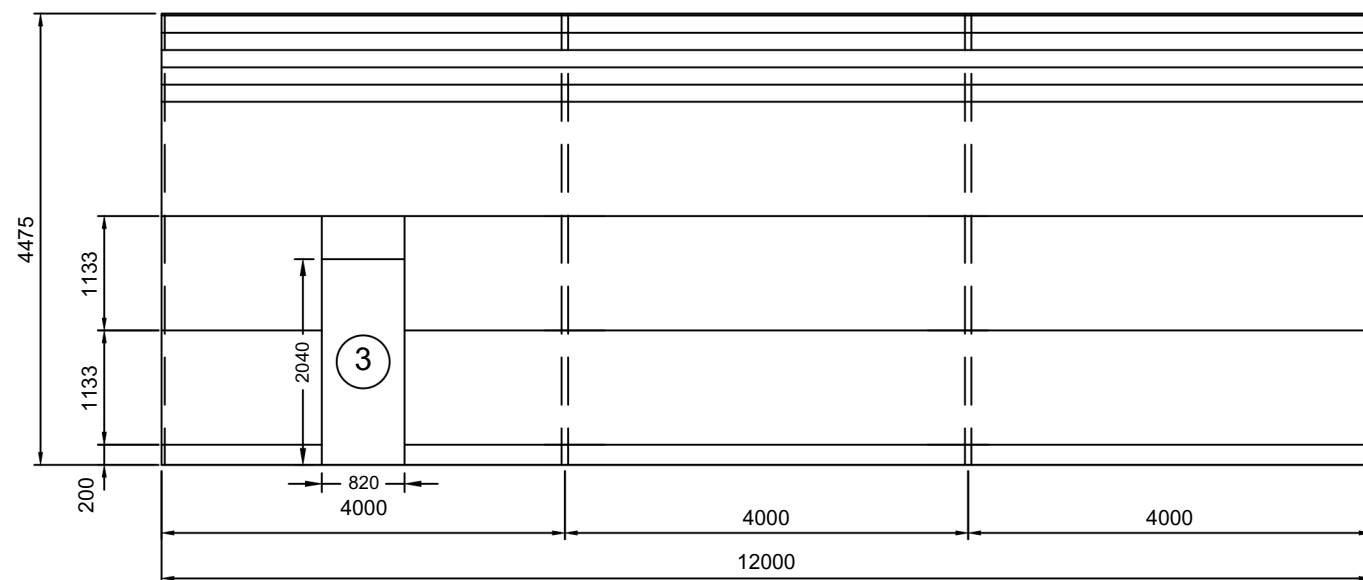


1 RIGHT ELEVATION/ WEST ELEVATION
3 SCALE: 1:75

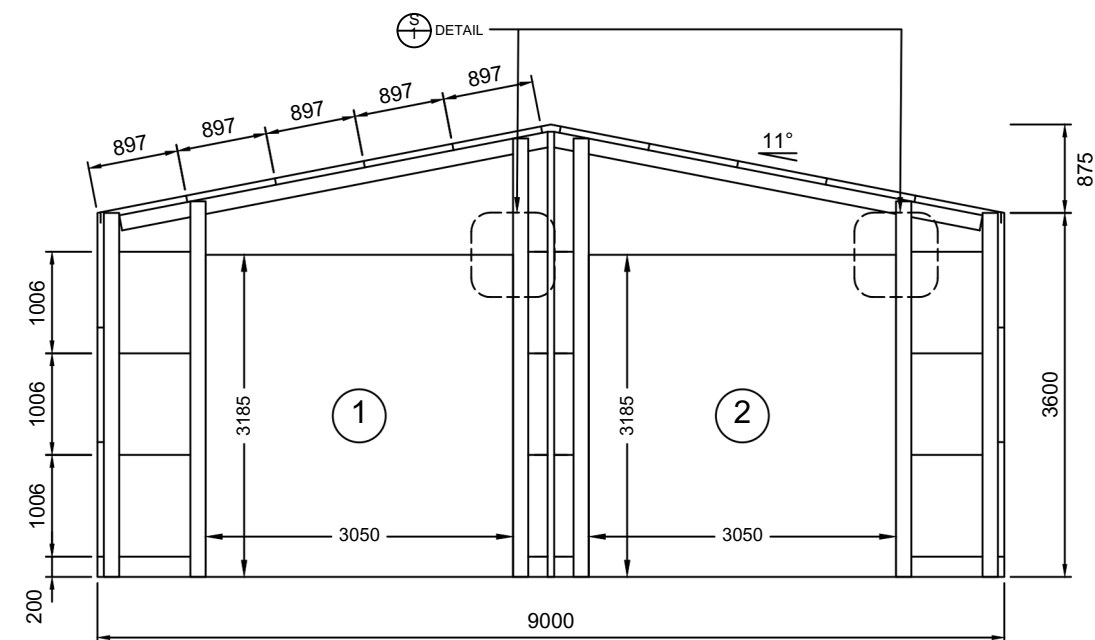

4 FRONT ELEVATION/ SOUTH ELEVATION
3 SCALE: 1:75 FRAME #1

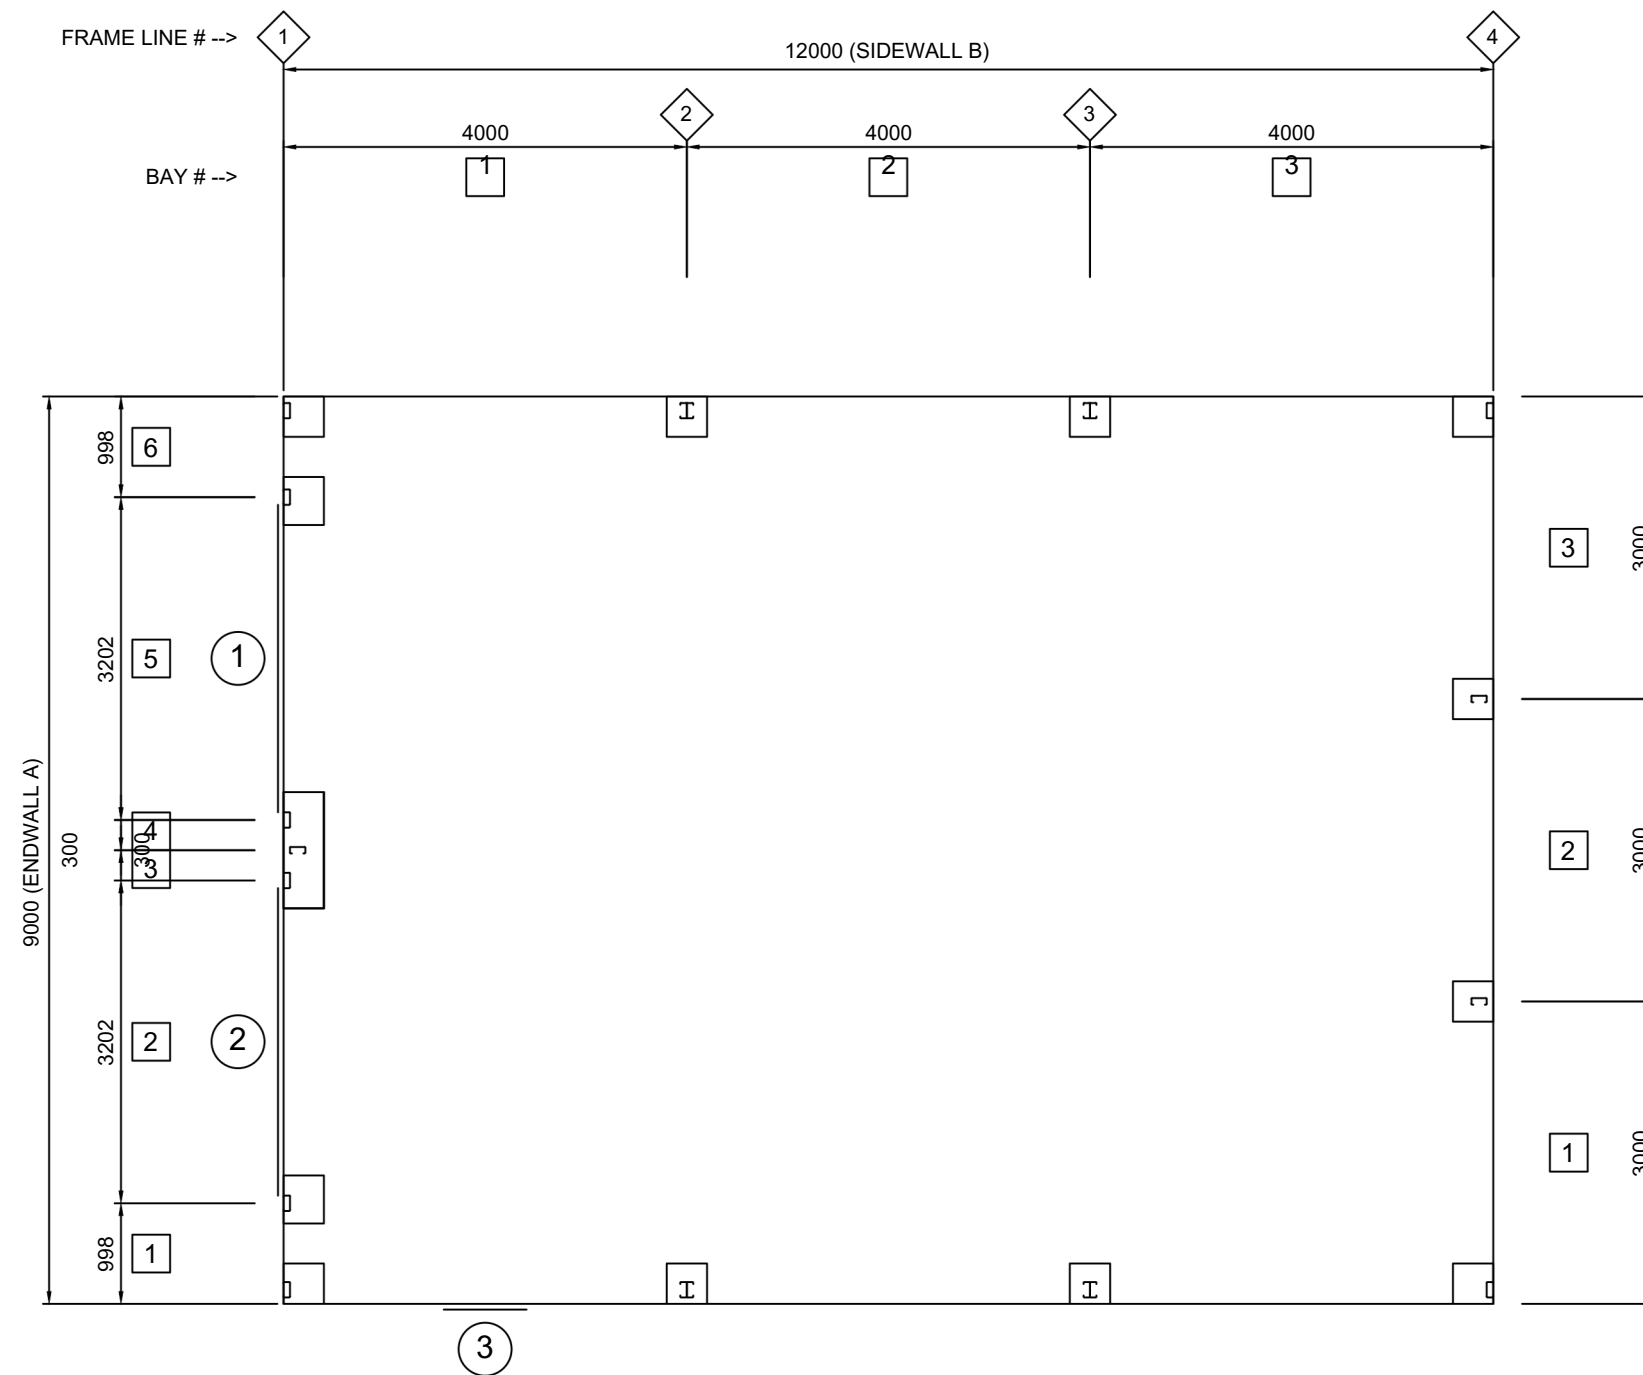

1 FLOOR PLAN
4 SCALE: 1:75






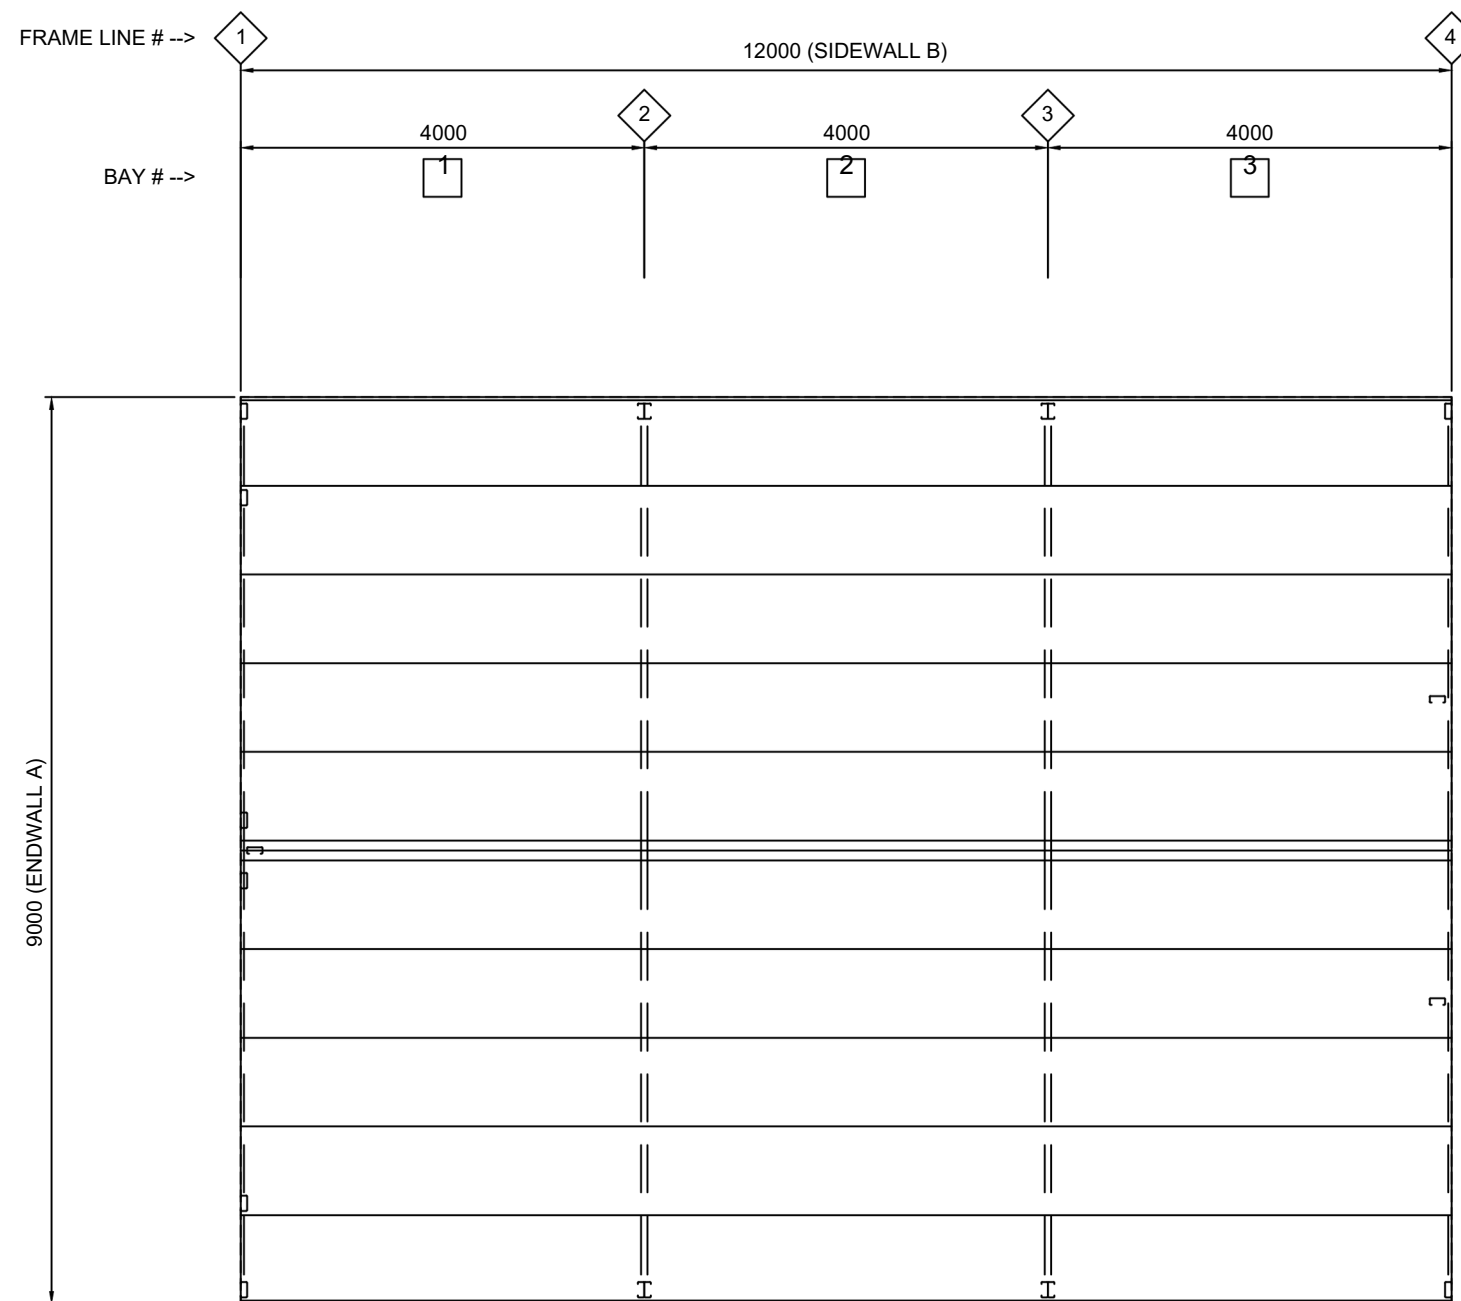

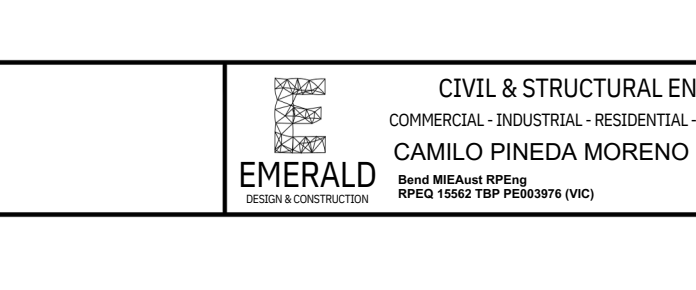
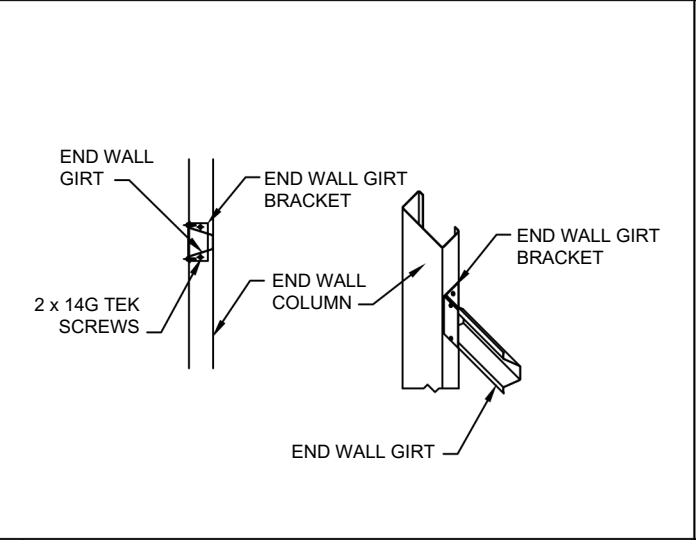
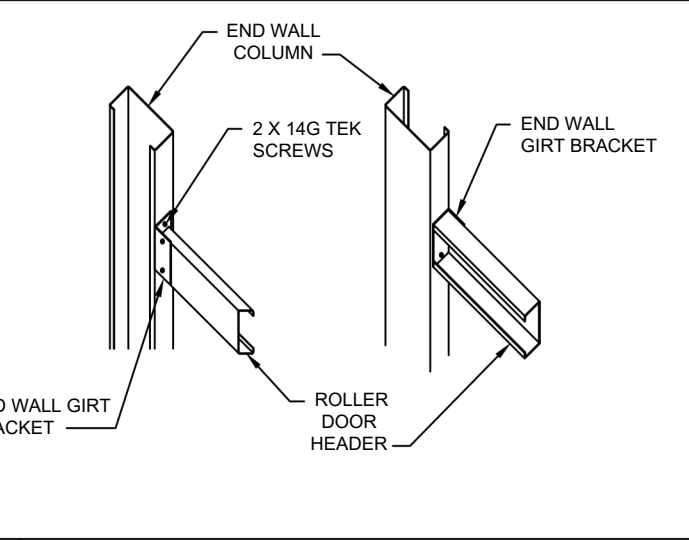



1 5

ROOF FRAMING PLAN

SCALE: 1:75

<div> <div>SLAB FOUNDATIONS DOMESTIC / LIGHT INDUSTRIAL</div> <div>(100mm MINIMUM CONCRETE SLAB INCLUDED)</div> <table> <tr> <th>SOIL CLASSIFICATION (COMPACTED)</th><th>REINFORCING IN SLAB</th><th>EDGE BEAM</th><th>PIER</th><th colspan="2">EDGE BEAM (slab thickness not included)</th></tr> <tr> <th></th><th>MESH REINFORCING</th><th>TRENCH MESH</th><th>Ø x DEPTH</th><th>DEPTH</th><th>WIDTH</th></tr> <tr> <td>A, S, & M</td><td>SL72</td><td>---</td><td>450 x 400</td><td>---</td><td>---</td></tr> <tr> <td>M - D</td><td>SL82</td><td>L11TM3</td><td>---</td><td>300</td><td>300</td></tr> <tr> <td>H TO H - D</td><td>SL82</td><td>L11TM3</td><td>---</td><td>400</td><td>300</td></tr> <tr> <td>E TO E - D</td><td>SL82</td><td>L11TM4</td><td>---</td><td>400</td><td>400</td></tr> <tr> <td>P (DROP EDGE BEAM OR STANDARD EDGE BEAM WITH PIERS UNDER COLUMNS 300 INTO FIRM GROUND)</td><td>SL82</td><td>L11TM4</td><td>450Ø</td><td>400</td><td>400</td></tr> </table> <div> <div>THICKNESS: 100MM WITH MINIMUM 30MM COVER. REFER TO SLAB FOUNDATION TABLE FOR REINFORCING SPECIFICATION</div> <div>STRENGTH: 25mPa</div> </div> </div>						SOIL CLASSIFICATION (COMPACTED)	REINFORCING IN SLAB	EDGE BEAM	PIER	EDGE BEAM (slab thickness not included)			MESH REINFORCING	TRENCH MESH	Ø x DEPTH	DEPTH	WIDTH	A, S, & M	SL72	---	450 x 400	---	---	M - D	SL82	L11TM3	---	300	300	H TO H - D	SL82	L11TM3	---	400	300	E TO E - D	SL82	L11TM4	---	400	400	P (DROP EDGE BEAM OR STANDARD EDGE BEAM WITH PIERS UNDER COLUMNS 300 INTO FIRM GROUND)	SL82	L11TM4	450Ø	400	400
SOIL CLASSIFICATION (COMPACTED)	REINFORCING IN SLAB	EDGE BEAM	PIER	EDGE BEAM (slab thickness not included)																																											
	MESH REINFORCING	TRENCH MESH	Ø x DEPTH	DEPTH	WIDTH																																										
A, S, & M	SL72	---	450 x 400	---	---																																										
M - D	SL82	L11TM3	---	300	300																																										
H TO H - D	SL82	L11TM3	---	400	300																																										
E TO E - D	SL82	L11TM4	---	400	400																																										
P (DROP EDGE BEAM OR STANDARD EDGE BEAM WITH PIERS UNDER COLUMNS 300 INTO FIRM GROUND)	SL82	L11TM4	450Ø	400	400																																										
<div> <div>Y</div> <div>SLAB DETAIL</div> </div>		<div> <div>Z</div> <div>ALTERNATE PIER DETAIL</div> </div>		<div> <div>G</div> <div>TOP HAT CONNECTION</div> </div>																																											
<div> <div>Y</div> <div>SLAB DETAIL</div> </div>		<div> <div>D</div> <div>ENDWALL MULLION ROTATED</div> </div>		<div> <div>E</div> <div>PURLIN CONNECTION</div> </div>																																											
<div> <div>A</div> <div>HAUNCH CONNECTION</div> </div>		<div> <div>B</div> <div>APEX CONNECTION</div> </div>		<div> <div>C1</div> <div>ENDWALL MULLION TO RAFTER</div> </div>																																											
<div> <div>H</div> <div>EAVE CONNECTION</div> </div>		<div> <div>F</div> <div>GIRT CONNECTION</div> </div>		<div> <div>C3</div> <div>ENDWALL MULLION TO RAFTER PEAK CONDITION</div> </div>																																											

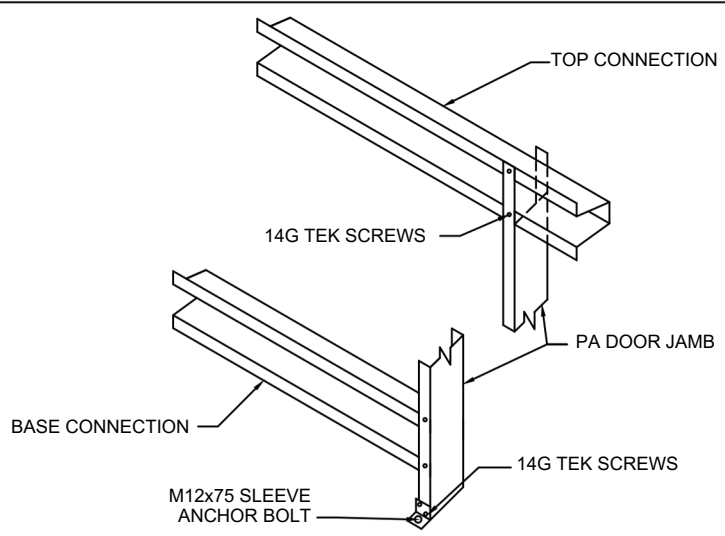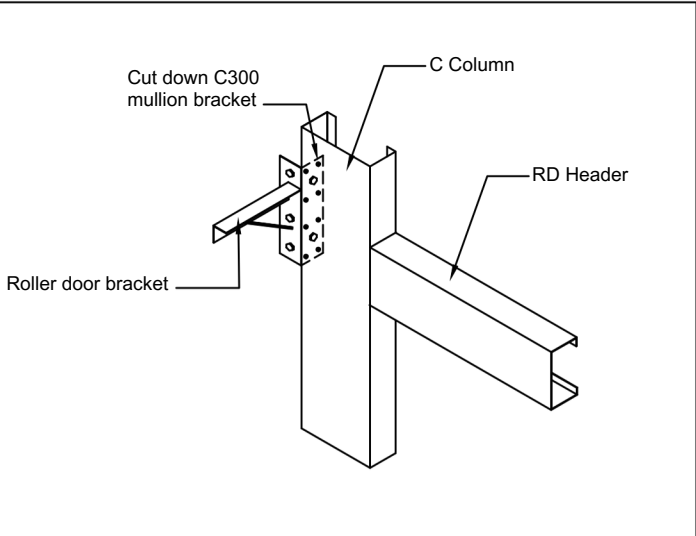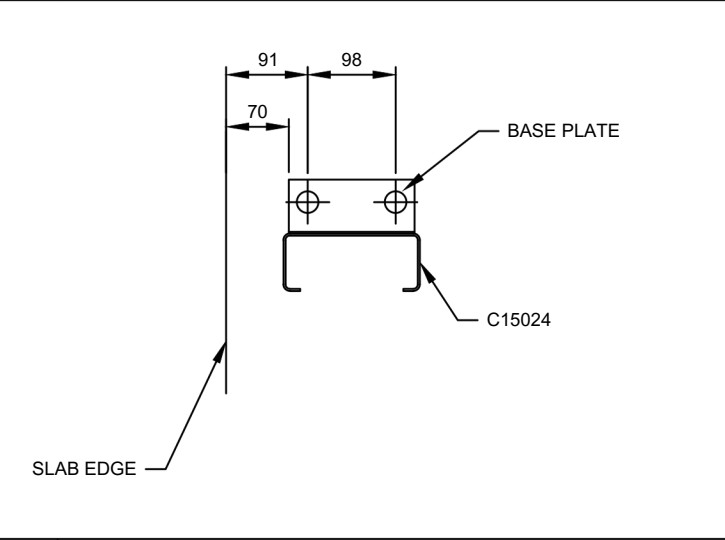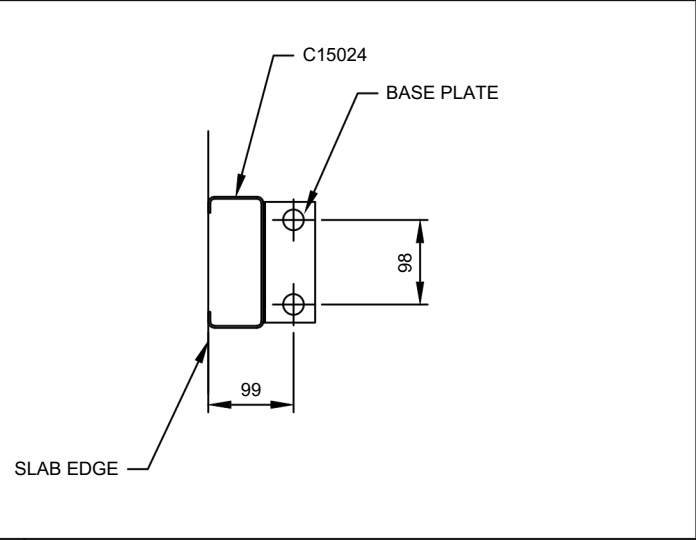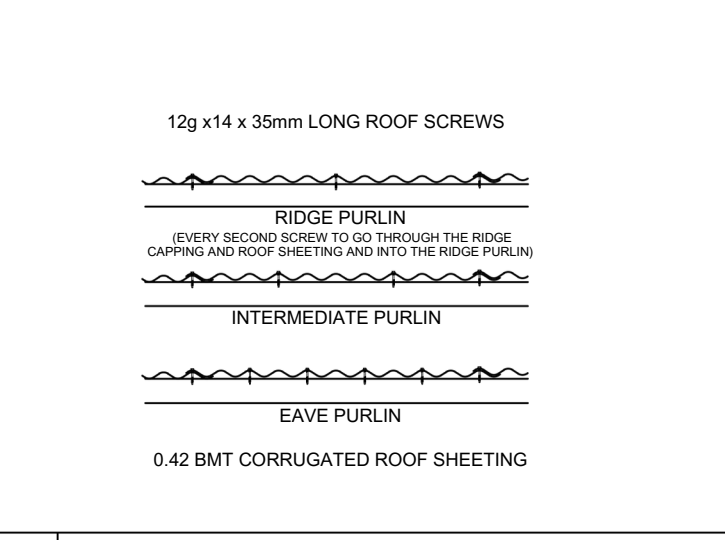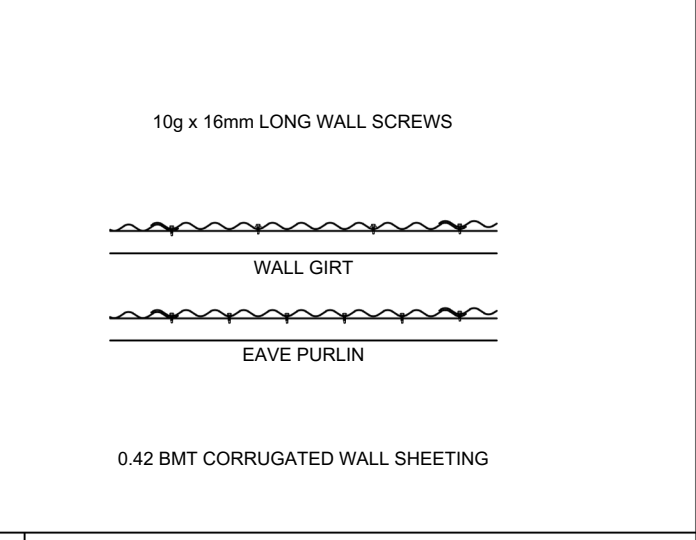			
Q	PA DOOR STYLE CONNECTION	S1	CUT DOWN C300 MULLION BRACKET FOR INDUSTRIAL ROLLER DOOR
			
M	ENDWALL MULLION BASE	N	ROTATED ENDWALL MULLION BASE
			
I	ROOF SHEETING	J	WALL SHEETING
			
K	CORNER COLUMN BASE	L	INTERNAL COLUMN BASE
			
O		ENDWALL GIRT BRACKET	
P		END DOOR HEADER AND JAMB	

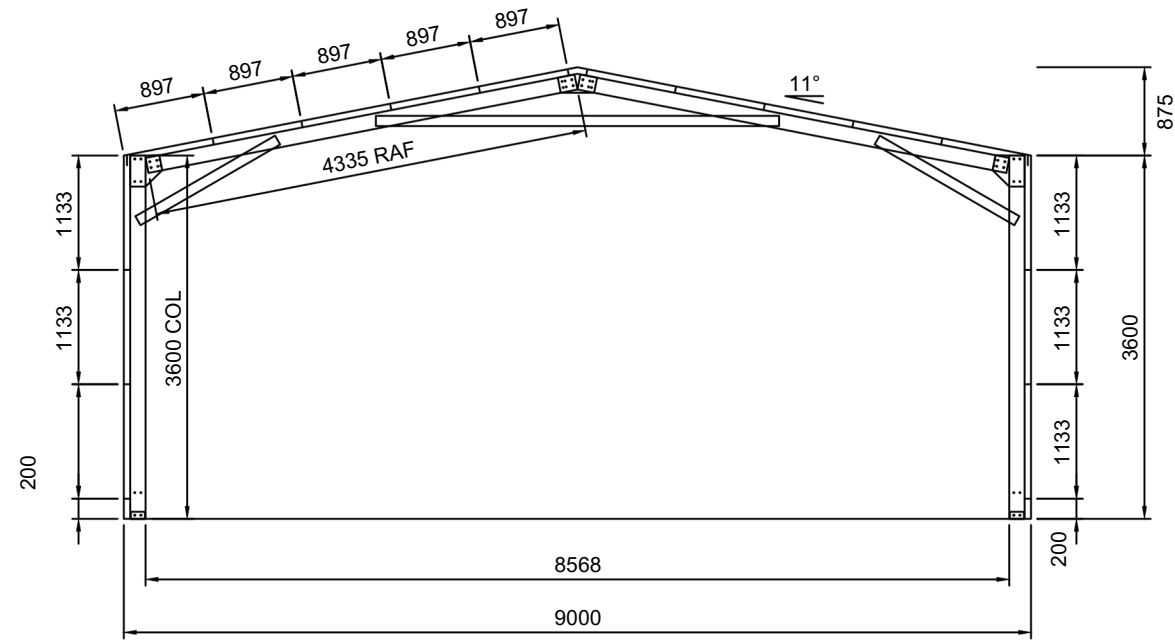

1
8 TYP. FRAME CROSS-SECTION
SCALE: 1:75 FRAMES 2, 3