

MOREE BATTERY ENERGY STORAGE SYSTEM

Construction & Operational Noise & Vibration Assessment

20 August 2025

NGH Consulting

TN563-01F02 Construction & Operational Noise & Vibration Assessment (r5).docx

Document details

Detail	Reference
Doc reference:	TN563-01F02 Construction & Operational Noise & Vibration Assessment (r5).docx
Prepared for:	NGH Consulting
Address:	Suite 11, 89-91 Auckland St Bega NSW 2550
Attention:	Steph Kurta

Document control

Date	Revision history	Non-issued revision	Issued revision	Prepared	Instructed	Reviewed / Authorised
21.03.2024	Draft report	0	1	W. Chan	M. Chung	M. Chung
15.05.2024	Final	-	2	W. Chan	M. Chung	M. Chung
24.06.2024	Updated layout and increase BESS modules	-	3	W. Chan	M. Chung	M. Chung
28.06.2024	Update for SAP	-	4	W. Chan	M. Chung	M. Chung
20.08.2025	Update for traffic volumes	-	5	W. Chan	M. Chung	M. Chung
File Path: R:\AssocSydProjects\TN551-TN600\TN563 wc Moree BESS\1 Docs\TN563-01F02 Construction & Operational Noise & Vibration Assessment (r5).docx						

Important Disclaimers:

The work presented in this document was carried out in accordance with the Renzo Tonin & Associates Quality Assurance System, which is based on Australian/New Zealand Standard AS/NZS ISO 9001.

This document is issued subject to review and authorisation by the suitably qualified and experienced person named in the last column above. If no name appears, this document shall be considered as preliminary or draft only and no reliance shall be placed upon it other than for information to be verified later.

This document is prepared for the particular requirements of our Client referred to above in the 'Document details' which are based on a specific brief with limitations as agreed to with the Client. It is not intended for and should not be relied upon by a third party and no responsibility is undertaken to any third party without prior consent provided by Renzo Tonin & Associates. The information herein should not be reproduced, presented, or reviewed except in full. Prior to passing on to a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.

In preparing this report, we have relied upon, and presumed accurate, any information (or confirmation of the absence thereof) provided by the Client and/or from other sources. Except as otherwise stated in the report, we have not attempted to verify the accuracy or completeness of any such information. If the information is subsequently determined to be false, inaccurate, or incomplete then it is possible that our observations and conclusions as expressed in this report may change.

We have derived data in this report from information sourced from the Client (if any) and/or available in the public domain at the time or times outlined in this report. The passage of time, manifestation of latent conditions or impacts of future events may require further examination and re-evaluation of the data, findings, observations and conclusions expressed in this report.

We have prepared this report in accordance with the usual care and thoroughness of the consulting profession, for the sole purpose described above and by reference to applicable standards, guidelines, procedures and practices at the date of issue of this report. For the reasons outlined above, however, no other warranty or guarantee, whether expressed or implied, is made as to the data, observations and findings expressed in this report, to the extent permitted by law.

The information contained herein is for the purpose of acoustics only. No claims are made and no liability is accepted in respect of design and construction issues falling outside of the specialist field of acoustics engineering including and not limited to structural integrity, fire rating, architectural buildability and fit-for-purpose, waterproofing and the like. Supplementary professional advice should be sought in respect of these issues.

External cladding: No claims are made and no liability is accepted in respect of any external wall and/or roof systems (eg facade / cladding materials, insulation etc) that are: (a) not compliant with or do not conform to any relevant non-acoustic legislation, regulation, standard, instructions or Building Codes; or (b) installed, applied, specified or utilised in such a manner that is not compliant with or does not conform to any relevant non-acoustic legislation, regulation, standard, instructions or Building Codes.

Contents

1	Introduction	5
2	Project Description	6
2.1	Background Information	6
2.2	Regulatory Requirements	7
2.3	Receiver Locations	7
2.4	Hours of Operation	8
2.4.1	Construction	8
2.4.2	Operation	8
3	Existing Noise Environment	10
4	Construction Noise Assessment	11
4.1	Construction Noise Management Levels	11
4.2	Construction Noise Sources	13
4.3	Construction Noise Assessment	13
5	Operational Noise Assessment	17
5.1	Operational Noise Criteria	17
5.1.1	Intrusive Noise Impacts	17
5.1.2	Protecting Noise Amenity	17
5.1.3	Summary of Project Noise Trigger Levels	19
5.2	Operational Noise Sources	19
5.3	'Modifying Factor' Adjustments	19
5.4	Operational Noise Assessment	20
5.5	Sleep Disturbance Assessment	21
6	Vibration Assessment	23
6.1	Vibration Criteria	23
6.2	Potential Vibration Impacts	25
7	Road Traffic Noise Assessment	26
7.1	Road Traffic Noise Criteria	26
7.2	Predicted Road Traffic Noise	27
8	Conclusion	29
APPENDIX A	Glossary of Terminology	30

List of Tables

Table 2-1 – Receiver Locations	7
Table 3-1 – Applicable RBL, dB(A)	10
Table 4-1 – Noise Management Levels (NML) at Residential Receivers, dB(A)	12
Table 4-2 – Construction Noise Management Levels (NML) at Residential Receivers, dB(A)	12

Table 4-3 – Noise management levels at other noise sensitive land uses	13
Table 4-4 – Typical Construction Equipment & Sound Power Levels, dB(A) re. 1pW	13
Table 4-5 – Predicted $L_{Aeq,15min}$ Construction Noise Levels at Receiver Locations, dB(A)	15
Table 5-1 – NPfl Intrusive Noise Level at Residential Receivers, dB(A)	17
Table 5-2 – Amenity noise levels (Table 2.2 NPfl)	18
Table 5-3 – NPfl Project Amenity Noise Levels, dB(A)	18
Table 5-4 – Project Noise Trigger Levels, dB(A)	19
Table 5-5 – Typical Operational Plant and Equipment & Sound Power Levels	19
Table 5-6 – Predicted $L_{Aeq,15min}$ Operational Noise Levels at Sensitive Receiver Locations, dB(A)	21
Table 5-7 – Sleep disturbance assessment noise levels, dB(A)	22
Table 6-1 – Types of Vibration	23
Table 6-2 – Preferred and Maximum Levels for Human Comfort	24
Table 6-3 – Acceptable Vibration Dose Values for Intermittent Vibration ($m/s^{1.75}$)	24
Table 6-4 – Potential Vibration Impacts for Identified Receivers	25
Table 7-1 – Summary of the Estimated Construction Traffic Volumes During Peak Construction	26
Table 7-2 – RNP Road Traffic Noise Criteria, dB(A)	27
Table 7-3 – Predicted Road Traffic Noise Contribution Levels Along Public Roads, dB(A)	27

List of Figures

Figure 2-1 – Site, Surrounds and Receiver Locations	9
Figure 6-1 – Orthogonal Axes for Human Exposure to Vibration	24

1 Introduction

Renzo Tonin & Associates was engaged to conduct an environmental noise and vibration assessment for the proposed Moree Battery Energy Storage System (BESS) Project, located within the Moree Plains Local Government Area (LGA) in New South Wales (NSW), as part of the Environmental Impact Statement (EIS) for the project. Noise and vibration impacts from the construction and operation phases of the project are addressed in this report in accordance with relevant Council and NSW Environment Protection Authority's (EPA) requirements and guidelines.

The work documented in this report was carried out in accordance with the Renzo Tonin & Associates Quality Assurance System, which is based on Australian Standard / NZS ISO 9001. Appendix A contains a glossary of acoustic terms used in this report.

2 Project Description

2.1 Background Information

'AE BESS 2 Pty Ltd as Trustee for AE BESS 2 Unit Trust' (the proponent) intends to develop a 120MW/480MWh lithium-ion Battery Energy Storage System (BESS) at Bulluss Drive, Moree. The BESS would connect to the national electricity market (NEM) via TransGrid's 132kV Moree Bulk Supply Point substation, located immediately to the north of the development site (leased developable area). The connection would be via underground transmission line to a new 132kV connection bay at the substation.

The subject land (the full area of all involved lots) comprises Lot 82 DP 751780 and part of Lot 144 DP751780, which totals 17.58 hectares (ha) of privately-owned land. The area to be developed would comprise approximately 4.06 ha.

The proposed development sits within the Moree Special Activation Precinct (SAP), located in the far north of NSW and known for its productive soils. In December 2019, the Moree SAP was announced, followed by the adoption of the Master Plan and Delivery Plan in 2022. The Moree SAP currently comprises mostly of industrial and agri-industrial development.

The subject land is currently undeveloped and is devoid of stands of remnant vegetation. An existing borrow pit turned farm dam is present in the north-western portion. As indicated above, the subject land is adjacent to the Moree Bulk Supply Point substation and fronts Bulluss Drive.

The key elements of the proposed development would include:

- Approximately 125 x 20ft battery containers, containing lithium-ion technology.
- Approximately 50 associated 20ft skid-mounted Power Conversion Systems (PCS) comprising of the inverters, which convert direct current (DC) to alternating current (AC); the medium-voltage transformer, which converts the inverter output voltage to the medium-voltage of the system (33 kilovolt); and the medium voltage switchgear, which contains the medium voltage circuit breakers and disconnectors for the PCS.
- A 33 kilovolt (kV) switch room, which collects all the individual medium voltage cables from the PCS units in one location before connection to the high-voltage transformer. The auxiliary power is also supplied from the low-voltage room that is connected to the medium-voltage switch room.
- A control room, which will contain battery-monitoring equipment and allows operators to control the plant remotely.
- A short overhead or underground transmission line which connects the proposed BESS to the adjacent Moree substation. The connection type is subject to Transgrid requirements.

2.2 Regulatory Requirements

Noise and vibration impacts are assessed in accordance with a number of policies, guidelines and standards, including:

- NSW 'Interim Construction Noise Guideline' (ICNG – DECC, 2009)
- NSW 'Noise Policy for Industry' (NPfI – EPA, 2017)
- 'Assessing Vibration: A Technical Guideline' (DECC, 2006)
- NSW 'Road Noise Policy' (RNP – DECCW, 2011).

This assessment generally conforms with the requirements of the Moree Special Activation Precinct – Delivery Plan (SAP – Regional Growth NSW Development Corporation, 2022) in particular the noise requirements in Section 6.3.3.3. It is noted that the 'SAP Assessment Framework – NOISE' was available at the time of this assessment, however acceptable solutions for noise nominated in the SAP also draw from the NPfI which is considered in this assessment.

2.3 Receiver Locations

The nearest affected receivers were identified through aerial maps and are presented in Table 2-1.

Table 2-1 – Receiver Locations

ID	Address	Description
R1	Tycannah Street, Moree (DP1117043)	Industrial property located approximately 120 m southwest of the subject site
R2	Bulluss Drive, Moree (DP999486)	Industrial property located approximately 70 m north of the subject site
R3	2 Bulluss Drive, Moree	Industrial property located approximately 210 m north of the subject site. It is noted that a dwelling is located at this address but as the property is zoned industrial, the dwelling also adopts the same criteria as industrial usage.
R4	10 Bulluss Drive, Moree	Industrial property located approximately 210 m north of the subject site
R5	10 Industrial Drive, Moree (DP607739)	Industrial property located approximately 245 m south of the subject site
R6	89 Tycannah Street, Moree	Industrial property located approximately 250 m west of the subject site
R7	37 Bulluss Drive, Moree	Industrial property located approximately 270 m northeast of the subject site
R9	10 Industrial Drive, Moree (DP635190)	Industrial property located approximately 325 m southeast of the subject site
R15	75 Tycannah Street, Moree	Industrial property located approximately 330 m northeast of the subject site
R18	4 Amaroo Drive, Moree (Gwydir Thermal Pools Motel & Caravan Park)	Residential property located approximately 380 m west of the subject site
R21	40-52 Industrial Drive, Moree	Industrial property located approximately 395 m southeast of the subject site

Figure 1 provides details of the site, surrounds and receiver locations.

2.4 Hours of Operation

2.4.1 Construction

Construction will occur during the following standard hours of construction:

- Monday to Friday: 7:00am to 6:00pm
- Saturday: 8:00am to 1:00pm
- No work on Sundays or public holidays

2.4.2 Operation

There will be staff on site during the following operational hours:

- Monday to Friday: 9:00am to 5:00pm

Figure 2-1 – Site, Surrounds and Receiver Locations



3 Existing Noise Environment

Background noise varies over the course of any 24 hour period, typically from a minimum at 3am in the morning to a maximum during morning and afternoon traffic peak hours. Therefore, the NPfI requires that the level of background and ambient noise be assessed separately for the daytime, evening and night-time periods. The NPfI defines these periods as follows:

- **Day** is defined as 7:00am to 6:00pm, Monday to Saturday and 8:00am to 6:00pm Sundays & Public Holidays.
- **Evening** is defined as 6:00pm to 10:00pm, Monday to Sunday & Public Holidays.
- **Night** is defined as 10:00pm to 7:00am, Monday to Saturday and 10:00pm to 8:00am Sundays & Public Holidays.

The identified receivers surrounding the subject site are all classified as rural under NPfI guidelines. Based on Table 2.1 on page 10 of the NPfI, for a conservative assessment the minimum assumed Rating Background Levels (RBLs) are adopted instead for all receiver locations. Therefore, the applicable RBLs use for this assessment are presented in Table 3-1 below.

Table 3-1 – Applicable RBL, dB(A)

Time of Day	Minimum RBLs, dB(A) ¹	Applicable RBL, dB(A)
Day	35	35
Evening	30	30
Night	30	30

Notes: 1. In accordance with Table 2.1 of the NSW NPfI

4 Construction Noise Assessment

4.1 Construction Noise Management Levels

The NSW 'Interim Construction Noise Guideline' (ICNG, 2009) provides guidance for assessing noise generated during the construction phase of developments.

The key components of the guideline that are incorporated into this assessment include:

- *Use of L_{Aeq} as the descriptor for measuring and assessing construction noise*

NSW noise policies, including the NPfI, RNP and RING have moved to the primary use of L_{Aeq} over any other descriptor. As an energy average, L_{Aeq} provides ease of use when measuring or calculating noise levels since a full statistical analysis is not required as when using, for example, the L_{A10} descriptor.

- *Application of reasonable and feasible noise mitigation measures*

As stated in the ICNG, a noise mitigation measure is feasible if it is capable of being put into practice and is practical to build given the project constraints.

Selecting reasonable mitigation measures from those that are feasible involves making a judgement to determine whether the overall noise benefit outweighs the overall social, economic and environmental effects.

The ICNG provides two methods for assessment of construction noise, being either a quantitative or a qualitative assessment. A quantitative assessment is recommended for major construction projects of significant duration, and involves the measurement and prediction of noise levels, and assessment against set criteria. A qualitative assessment is recommended for small projects with duration of less than three weeks and focuses on minimising noise disturbance through the implementation of reasonable and feasible work practices, and community notification.

Given the length of the construction works proposed is approximately nine (9) months, a quantitative assessment is carried out herein, consistent with the ICNG requirements.

Table 4-1 reproduced from the ICNG, sets out the noise management levels and how they are to be applied for residential receivers.

Table 4-1 – Noise Management Levels (NML) at Residential Receivers, dB(A)

Time of Day	Management Level L_{Aeq} (15 min)	How to Apply
Recommended standard hours: Monday to Friday 7 am to 6 pm Saturday 8 am to 1 pm No work on Sundays or public holidays	Noise affected RBL + 10dB(A)	The noise affected level represents the point above which there may be some community reaction to noise. Where the predicted or measured $L_{Aeq}(15 \text{ min})$ is greater than the noise affected level, the proponent should apply all feasible and reasonable work practices to meet the noise affected level. The proponent should also inform all potentially impacted residents of the nature of works to be carried out, the expected noise levels and duration, as well as contact details.
	Highly noise affected 75dB(A)	The highly noise affected level represents the point above which there may be strong community reaction to noise. Where noise is above this level, the relevant authority (consent, determining or regulatory) may require respite periods by restricting the hours that the very noisy activities can occur, taking into account: • times identified by the community when they are less sensitive to noise (such as before and after school for works near schools, or mid-morning or mid-afternoon for works near residences) • if the community is prepared to accept a longer period of construction in exchange for restrictions on construction times.
Outside recommended standard hours	Noise affected RBL + 5dB(A)	A strong justification would typically be required for works outside the recommended standard hours. The proponent should apply all feasible and reasonable work practices to meet the noise affected level. Where all feasible and reasonable practices have been applied and noise is more than 5dB(A) above the noise affected level, the proponent should negotiate with the community. For guidance on negotiating agreements see section 7.2.2 of the ICNG.

* Noise levels apply at the property boundary that is most exposed to construction noise, and at a height of 1.5 m above ground level. If the property boundary is more than 30 m from the residence, the location for measuring or predicting noise levels is at the most noise-affected point within 30 m of the residence. Noise levels may be higher at upper floors of the noise affected residence.

Table 4-2 presents the construction noise management levels established for the nearest noise sensitive residential receivers based upon the nominated RBLs presented in Table 2-1, the proposed construction hours and the above ICNG requirements. Given that construction works are to occur during the daytime period as presented in Section 2.4.1, only the daytime period will be assessed.

Table 4-2 – Construction Noise Management Levels (NML) at Residential Receivers, dB(A)

Location Description	Day L_{A90} Background Noise Level (RBL)	Day Noise Management Level $L_{Aeq}(15 \text{ min})$
All residential receivers	35 ¹	45

Notes: 1. Construction works occur during the daytime period only; hence, only the day period is assessed

Table 4-3 sets out the ICNG noise management levels for other noise sensitive receiver locations. As identified for residential receivers, a 'highly affected' noise objective of $L_{Aeq}(15 \text{ min})$ 75dB(A) is adopted for all noise sensitive receivers, with exceedances addressed as described in Table 4-1.

Table 4-3 – Noise management levels at other noise sensitive land uses

Land use	Where objective applies	Management level L_{Aeq} (15 min)
Industrial premises	External noise level	75 dB(A)

Notes: 1. Noise management levels apply when receiver areas are in use only.

4.2 Construction Noise Sources

The following tables lists typical plant and equipment likely to be used by the contractor to carry out the necessary construction works for the BESS project.

Table 4-4 – Typical Construction Equipment & Sound Power Levels, dB(A) re. 1pW

Plant Item	Plant Description	L_{Aeq} Sound Power Levels, dB(A) re. 1pW (single item)
1	Crane	110
2	Drum roller	109
3	Padfoot roller	109
4	Wheeled loader	109
5	Dump truck	108
6	30t Excavator	107
7	Grader	107
8	Chain trencher	104
9	Water truck	104
10	Telehandler	98
11	Forklift	90

The sound power levels for the majority of activities presented in the above table are provided by the client, based on maximum levels given in Table A1 of Australian Standard 2436 - 2010 'Guide to Noise Control on Construction, Demolition and Maintenance Sites', the ICNG, information from past projects and/or information held in our library files.

4.3 Construction Noise Assessment

Noise emissions were predicted by modelling the noise sources, receiver locations, topographical features of the intervening area, and possible noise control treatments using the CadnaA (version 2023) noise modelling computer program. The program calculates the contribution of each noise source at each specified receptor point and allows for the prediction of the total noise from a site.

The noise prediction models takes into account:

- Location of noise sources and receiver locations;
- Height of sources and receivers;
- Separation distances between sources and receivers;

- Ground type between sources and receivers (soft); and
- Attenuation from barriers (natural and purpose built).

Noise levels at any receptors resulting from construction would depend on the above and the type and duration of construction being undertaken. Furthermore, noise levels at receivers would vary substantially over the total construction program due to the transient nature and large range of plant and equipment that could be used.

Table 4.4 presents construction noise levels likely to be experienced at the nearby affected receivers based on the construction activities and plant and equipment associated with the proposed development site. It is noted that the predicted noise levels represent a worst case scenario where all plant and equipment are operating for each corresponding construction stage. This worst case scenario would not be typical and is unlikely to occur in practice.

The noise level ranges presented in the table represent the noise source being located at the furthest to the closest proximity to each receiver location.

Table 4-5 – Predicted $L_{Aeq,15min}$ Construction Noise Levels at Receiver Locations, dB(A)

Plant Item	Plant Description	Predicted $L_{eq,15\ min}$ Construction Noise Levels										
		R1	R2	R3	R4	R5	R6	R7	R9	R15	R18	R21
Noise Management Level ¹		75	75	75	75	75	75	75	75	75	45	75
1	Crane	<20-51	<20-50	<20-46	<20-45	<20-44	<20-44	<20-43	<20-41	<20-40	<20-40	<20-40
2	Drum roller	<20-50	<20-49	<20-45	<20-44	<20-43	<20-43	<20-42	<20-40	<20-39	<20-39	<20-39
3	Padfoot roller	<20-50	<20-49	<20-45	<20-44	<20-43	<20-43	<20-42	<20-40	<20-39	<20-39	<20-39
4	Wheeled loader	<20-50	<20-49	<20-45	<20-44	<20-43	<20-43	<20-42	<20-40	<20-39	<20-39	<20-39
5	Dump truck	<20-49	<20-48	<20-44	<20-43	<20-42	<20-42	<20-41	<20-39	<20-38	<20-38	<20-38
6	30t Excavator	<20-48	<20-47	<20-43	<20-42	<20-41	<20-41	<20-40	<20-38	<20-37	<20-37	<20-37
7	Grader	<20-48	<20-47	<20-43	<20-42	<20-41	<20-41	<20-40	<20-38	<20-37	<20-37	<20-37
8	Chain trencher	<20-45	<20-44	<20-40	<20-39	<20-38	<20-38	<20-37	<20-35	<20-34	<20-34	<20-34
9	Water truck	<20-45	<20-44	<20-40	<20-39	<20-38	<20-38	<20-37	<20-35	<20-34	<20-34	<20-34
10	Telehandler	<20-39	<20-38	<20-34	<20-33	<20-32	<20-32	<20-31	<20-29	<20-28	<20-28	<20-28
11	Forklift	<20-31	<20-30	<20-26	<20-25	<20-24	<20-24	<20-23	<20-21	<20-20	<20-20	<20-20
Up to 3 (noisiest) plant operating concurrently		<20-55	<20-54	<20-50	<20-49	<20-48	<20-48	<20-47	<20-45	<20-44	<20-44	<20-44

Table 4-5 indicates that the predicted construction noise levels comply with the construction noise management levels for all receiver locations. Therefore no further mitigation and/or management measures are required for construction noise.

5 Operational Noise Assessment

5.1 Operational Noise Criteria

Noise impact from the general operation of the Proposal is assessed against the NSW 'Noise Policy for Industry' (NPfI). The assessment procedure in terms of the NPfI has two components:

- Controlling intrusive noise impacts in the short-term for residences; and
- Maintaining noise level amenity for residences and other land uses.

In accordance with the NPfI, noise impact should be assessed against the project noise trigger level which is the lower value of the project intrusiveness noise levels and project amenity noise levels.

5.1.1 Intrusive Noise Impacts

According to the NPfI, the intrusiveness of a noise source may generally be considered acceptable if the equivalent continuous (energy-average) A-weighted level of noise from the source (represented by the $L_{Aeq,15min}$ descriptor) does not exceed the background noise level measured in the absence of the source by more than 5dB(A). The project intrusiveness noise level, which is only applicable to residential receivers, is determined as follows:

$$L_{Aeq,15minute} \text{ Intrusiveness noise level} = \text{Rating Background Level (RBL) plus 5dB(A)}$$

Based on the RBLs set in Table 3-1, the intrusiveness noise levels for the residential receivers are determined in Table 5-1.

Table 5-1 – NPfI Intrusive Noise Level at Residential Receivers, dB(A)

Period	RBL, dB(A)	Intrusiveness Noise Level, $L_{Aeq,15min}$, dB(A)
Daytime	35	$35+5 = 40$
Evening	30	$30+5 = 35$
Night-time	30	$30+5 = 35$

5.1.2 Protecting Noise Amenity

The project amenity noise levels for different time periods of a day are determined in accordance with Section 2.4 of the NSW NPfI. The NPfI recommends amenity noise levels ($L_{Aeq, period}$) for various receivers including residential, commercial, industrial receivers and sensitive receivers such as schools, hotels, hospitals, churches and parks. These "recommended amenity noise levels" represent the objective for **total** industrial noise experienced at a receiver location. However, when assessing a **single** industrial development and its impact on an area, "project amenity noise levels" apply.

The recommended amenity noise levels applicable for the subject area are reproduced in Table 5-2 below.

It is noted that the residential receivers in the vicinity of the site have been categorised as being in a 'rural' area in accordance with Table 2.3 of the NPfl.

Table 5-2 – Amenity noise levels (Table 2.2 NPfl)

Receiver	Noise Amenity Area	Time of Day	L _{Aeq} , dB(A)
(see Table 2.3 to determine which residential receiver category applies)			Recommended amenity noise level,
Residential	Rural	Day	50
		Evening	45
		Night	40
Industrial premises	All	When in use	70

To ensure that the total industrial noise level (existing plus new) remain within the recommended amenity noise levels for an area, the project amenity noise level that applies for each new industrial noise source is determined as follows:

$$L_{Aeq,period} \text{ Project amenity noise level} = L_{Aeq,period} \text{ Recommended amenity noise level} - 5\text{dB(A)}$$

Furthermore, given that the intrusiveness noise level is based on a 15 minute assessment period and the project amenity noise level is based on day, evening and night assessment periods, the NPfl provides the following guidance on adjusting the $L_{Aeq,period}$ level to a representative $L_{Aeq,15minute}$ level in order to standardise the time periods.

$$L_{Aeq,15min} = L_{Aeq,period} + 3\text{dB(A)}$$

The policy, in accordance with the NPfl, applies an adjustment of (+3 dB) to the recommended noise levels ($L_{Aeq, period}$) in order to standardise the time periods for the intrusiveness and amenity noise levels. The project amenity noise levels ($L_{Aeq, 15min}$) applied for this project are reproduced in Table 5-3.

Table 5-3 – NPfl Project Amenity Noise Levels, dB(A)

Type of Receiver	Indicative Noise Amenity Area	Time of Day	Recommended Noise Level	
			L _{Aeq, Period}	L _{Aeq, 15min}
Residence	Rural	Day	50 – 5 = 45	45 + 3 = 48
		Evening	45 – 5 = 40	40 + 3 = 43
		Night	40 – 5 = 35	35 + 3 = 38
Industrial	All	When in use	70 – 5 = 65	65 + 3 = 68

Notes: 1. The L_{Aeq} index corresponds to the level of noise equivalent to the energy average of noise levels occurring over a measurement period.

5.1.3 Summary of Project Noise Trigger Levels

In accordance with the NPfI the project noise trigger level, which is the lower (i.e. more stringent) value of the project intrusiveness noise level and project amenity noise level, has been determined and reproduced in Table 5-4 below.

Table 5-4 – Project Noise Trigger Levels, dB(A)

Receiver ID	Address	L _{Aeq, 15min} Project Noise Trigger Levels		
		Day	Evening	Night
R1	Tycannah Street, Moree (DP1117043)		68 (When in use)	
R2	Bulluss Drive, Moree (DP999486)		68 (When in use)	
R3	2 Bulluss Drive, Moree		68 (When in use)	
R4	10 Bulluss Drive, Moree		68 (When in use)	
R5	10 Industrial Drive, Moree (DP607739)		68 (When in use)	
R6	89 Tycannah Street, Moree		68 (When in use)	
R7	37 Bulluss Drive, Moree		68 (When in use)	
R9	10 Industrial Drive, Moree (DP635190)		68 (When in use)	
R15	75 Tycannah Street, Moree		68 (When in use)	
R18	4 Amaroo Drive, Moree (Gwydir Thermal Pools Motel & Caravan Park)	40	35	35
R21	40-52 Industrial Drive, Moree		68 (When in use)	

5.2 Operational Noise Sources

The following table lists associated plant and equipment likely to be used for the operation of the proposed BESS and their corresponding sound power levels.

Table 5-5 – Typical Operational Plant and Equipment & Sound Power Levels

Plant Item	Plant Description	L _{Aeq} Sound Power Levels, dB(A) re. 1pW
1	Battery containers (140 in total)	79 (each)
2	Power Conversion Systems (42 in total)	84 (each)
3	HV transformer (1 in total)	95 (each)

The sound power levels for the plant and equipment presented in the above table have been provided by the manufacturer, information from past projects and/or information held in our library files. The plant and equipment included are all packaged units and all sound power levels include the noise component from associated fans/cooling systems.

5.3 ‘Modifying Factor’ Adjustments

Further to the above and in accordance with the NPfI, where the character of the noise in question is assessed as particularly annoying (i.e. if it has an inherently tonal, low frequency, impulsive or

intermittent characteristic), then an adjustment of 5dB(A) for each annoyance aspect, up to a total of 10dB(A), is to be added to the predicted value to penalise the noise for its potential increase in annoyance. Table C1 in Fact Sheet C of the NSW NPfI provides definitive procedures for determining whether a penalty or adjustment should be applied from increased annoyance.

For the assessment of the Proposal, the noise from the power conversion systems are considered to be tonal in nature. Therefore, a 5dB(A) penalty has been applied to the predicted noise contributions from the power conversion systems as noted in Table 5.4.

5.4 Operational Noise Assessment

Noise emissions were predicted by modelling the noise sources, receiver locations, topographical features of the intervening area, and possible noise control treatments using the CadnaA (version 2023) noise modelling computer program. The program calculates the contribution of each noise source at each specified receptor point and allows for the prediction of the total noise from a site.

The noise prediction models takes into account:

- Location of noise sources and receiver locations;
- Height of sources and receivers;
- Separation distances between sources and receivers;
- Ground type between sources and receivers (soft); and
- Attenuation from barriers (natural and purpose built).

Furthermore, in accordance with Fact Sheet D, Table D.1 of the NPfI noise predictions were prepared for the following standard and noise-enhancing meteorological conditions:

1. Standard meteorological conditions – 0.5m/s wind velocity at 10m from ground level between each noise source and each noise receiver. Wind direction was based on wind travelling from the source to the receiver
2. Slight to gentle breeze – 3m/s wind velocity at 10m from ground level between each noise source and each noise receiver (as per NPfI default wind conditions). Wind direction was based on wind travelling from the source to the receiver
3. Moderate temperature inversion – applicable for noise predictions during night time periods only. F-class temperature inversion with 2m/s wind velocity at 10m from ground level between each noise source and each noise receiver

Table 5.5 below present the predicted noise levels for the worst case scenario based on concurrent operation of all the plant and equipment shown in Table 5-5.

Table 5-6 – Predicted $L_{Aeq,15min}$ Operational Noise Levels at Sensitive Receiver Locations, dB(A)

Receiver Location	Project Noise Trigger Levels			Predicted Operational Noise Levels			Comply? (Yes/No)
	Day	Evening	Night	Calm & Isothermal Conditions	Slight to Gentle Breeze	Moderate Temperature Inversion ¹	
Receiver R1		68 (When in use)		40	41	41	Yes
Receiver R2		68 (When in use)		43	44	44	Yes
Receiver R3		68 (When in use)		39	40	40	Yes
Receiver R4		68 (When in use)		37	39	39	Yes
Receiver R5		68 (When in use)		40	41	41	Yes
Receiver R6		68 (When in use)		34	36	36	Yes
Receiver R7		68 (When in use)		33	35	35	Yes
Receiver R9		68 (When in use)		37	39	39	Yes
Receiver R15		68 (When in use)		32	33	33	Yes
Receiver R18	40	35	35	35	35	35	Yes
Receiver R21		68 (When in use)		35	37	37	Yes

Notes: 1. Applicable for the night time period only

Table 5.5 indicates that the predicted operational noise levels comply with the project noise trigger levels for all time periods for all receiver locations. Therefore no further mitigation and/or management measures are required for operational noise.

5.5 Sleep Disturbance Assessment

To assess the likelihood of sleep disturbance, the potential of maximum noise level events from the Proposal during the night-time period has been considered. In accordance with the NPfI, a detailed maximum noise level event assessment should be undertaken where the subject development night-time noise levels at a residential location exceed:

- $L_{Aeq,15min}$ 40dB(A) or the prevailing RBL plus 5dB, whichever is the greater, and/or
- L_{AFmax} 52dB(A) or the prevailing RBL plus 15dB, whichever is the greater.

Where there are noise events found to exceed the initial screening level, further analysis is undertaken to identify:

- The likely number of events that might occur during the night assessment period,
- The extent to which the maximum noise level exceeds the rating background noise level.

Based on the NPfI and the RBL for the night time period as presented in Table 3-1, the sleep disturbance assessment noise levels for the residential receivers are presented in Table 5-7.

Table 5-7 – Sleep disturbance assessment noise levels, dB(A)

Receiver type	Assessment Level $L_{Aeq,15min}$	Assessment Level L_{AFmax}
Residential	40	52

During the night time period, only mechanical plant will be operating. Noise emissions from these plant items are considered to be continuous with no potential for high peak noise level events. Therefore, the L_{Amax} noise levels experienced at the identified receivers will be similar to the predicted $L_{Aeq,15min}$ noise levels shown in Table 5.5. Hence, it is expected that both the $L_{Aeq,15min}$ and L_{AFmax} will be well below the nominated sleep disturbance criteria of 40dB(A) and 52dB(A), respectively, for all residential receiver locations.

6 Vibration Assessment

Vibration generating activities would occur only during the construction phase of the project. There are no vibration generating activities expected during the operational phase. Assessment for construction vibration impact on structural damage and human comfort is assessed in accordance with EPA requirements.

6.1 Vibration Criteria

Assessment of potential disturbance from vibration on human occupants of buildings is made in accordance with the EPA's 'Assessing Vibration; a technical guideline' (DECC, 2006). The guideline provides criteria which are based on British Standard BS 6472-1992 'Evaluation of human exposure to vibration in buildings (1-80Hz)'. Sources of vibration are defined as either 'Continuous', 'Impulsive' or 'Intermittent'. Table 6-1 provides definitions and examples of each type of vibration.

Table 6-1 – Types of Vibration

Type of Vibration	Definition	Examples
Continuous vibration	Continues uninterrupted for a defined period (usually throughout the day-time and/or night-time)	Machinery, steady road traffic, continuous construction activity (such as tunnel boring machinery).
Impulsive vibration	A rapid build-up to a peak followed by a damped decay that may or may not involve several cycles of vibration (depending on frequency and damping). It can also consist of a sudden application of several cycles at approximately the same amplitude, providing that the duration is short, typically less than 2 seconds	Infrequent: Activities that create up to 3 distinct vibration events in an assessment period, e.g. occasional dropping of heavy equipment, occasional loading and unloading.
Intermittent vibration	Can be defined as interrupted periods of continuous or repeated periods of impulsive vibration that varies significantly in magnitude	Trains, nearby intermittent construction activity, passing heavy vehicles, forging machines, impact pile driving, jack hammers. Where the number of vibration events in an assessment period is three or fewer, this would be assessed against impulsive vibration criteria.

Source: Assessing Vibration; a technical guideline, Department of Environment & Climate Change, 2006


The vibration criteria are defined as a single weighted root mean square (rms) acceleration source level in each orthogonal axis. Section 2.3 of the guideline states:

"Evidence from research suggests that there are summation effects for vibrations at different frequencies. Therefore, for evaluation of vibration in relation to annoyance and comfort, overall weighted rms acceleration values of the vibration in each orthogonal axis are preferred (BS 6472)."

When applying the criteria, it is important to note that the three directional axes are referenced to the human body, i.e. x-axis (back to chest), y-axis (right side to left side) or z-axis (foot to head). Vibration may enter the body along different orthogonal axes and affect it in different ways. Therefore, application of the criteria requires consideration of the position of the people being assessed, as

illustrated in Figure 6-1. For example, vibration measured in the horizontal plane is compared with x- and y-axis criteria if the concern is for people in an upright position, or with the y- and z- axis criteria if the concern is for people in the lateral position.

Figure 6-1 – Orthogonal Axes for Human Exposure to Vibration

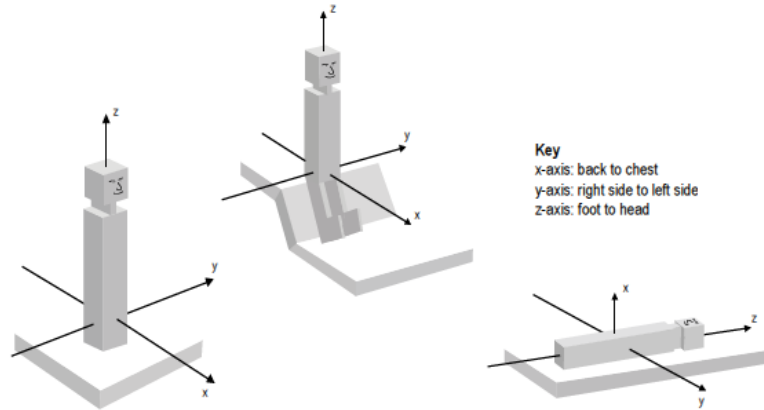

The preferred and maximum values for continuous and impulsive vibration are defined in Table 2.2 of the guideline and are reproduced in Table 6-2 for the applicable receivers.

Table 6-2 – Preferred and Maximum Levels for Human Comfort

Location	Assessment Period ¹	Preferred Values		Maximum Values	
		z-axis	x- and y-axis	z-axis	x- and y-axis
Continuous vibration (weighted RMS acceleration, m/s ² , 1-80Hz)					
Residences	Daytime	0.010	0.0071	0.020	0.014
	Night-time	0.007	0.005	0.014	0.010
Workshops	Day- or night-time	0.04	0.029	0.080	0.058
Impulsive vibration (weighted RMS acceleration, m/s ² , 1-80Hz)					
Residences	Daytime	0.30	0.21	0.60	0.42
	Night-time	0.10	0.071	0.20	0.14
Workshops	Day- or night-time	0.64	0.46	1.28	0.92

Notes: 1. Daytime is 7:00am to 10:00pm and Night-time is 10:00pm to 7:00am

The acceptable vibration dose values (VDV) for intermittent vibration are defined in Table 2.4 of the guideline and are reproduced in Table 6-3 for the applicable receiver type.

Table 6-3 – Acceptable Vibration Dose Values for Intermittent Vibration (m/s^{1.75})

Location	Daytime ¹		Night-time ¹	
	Preferred Value	Maximum Value	Preferred Value	Maximum Value
Residences	0.20	0.40	0.13	0.26
Workshops	0.80	1.60	0.80	1.60

Notes: 1. Daytime is 7:00am to 10:00pm and Night-time is 10:00pm to 7:00am

6.2 Potential Vibration Impacts

Based on the proposed plant items presented in Table 4-4, vibration generated by construction plant was estimated and potential vibration impacts are summarised in Table 6-4 below. The assessment is relevant to the identified receiver locations.

Table 6-4 – Potential Vibration Impacts for Identified Receivers

Receiver Location	Approx. Distance to Nearest Buildings from Works	Type of Nearest Sensitive Buildings	Assessment on Potential Vibration Impacts	Vibration Monitoring
Receiver R1	120m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R2	70m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R3	210m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R4	210m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R5	245m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R6	250m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R7	270m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R9	325m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R15	330m	Industrial	Very low risk of structural damage and/or adverse comments	Not required
Receiver R18	380m	Residential	Very low risk of structural damage and/or adverse comments	Not required
Receiver R21	395m	Industrial	Very low risk of structural damage and/or adverse comments	Not required

Table 6.4 indicates that there is very low risk of structural damage and/or adverse comments on potential vibration impacts for all receiver locations. Therefore no further mitigation and/or management measures are required for potential vibration impacts.

7 Road Traffic Noise Assessment

Noise impact from the potential increase in traffic on the surrounding road network due to construction and operational activities is assessed against the NSW 'Road Noise Policy' (RNP). The RNP sets out criteria to be applied to particular types of road and land uses. These noise criteria are to be applied when assessing noise impact and determining mitigation measures for sensitive receivers that are potentially affected by road traffic noise associated with the construction and operation of the subject site, with the aim of preserving the amenity appropriate to the land use.

Based on information provided by the client, the peak vehicle movements during the construction stage of the project are presented in the following table. Furthermore, vehicle movements will only occur during the day time period when construction works occur.

Table 7-1 – Summary of the Estimated Construction Traffic Volumes During Peak Construction

Vehicle Type	Vehicle Movements (two-way)	
	Daily	Peak hour
Light Vehicles	96	38
Shuttle Bus	4	2
Rigid Trucks	16	5
Truck and Dog	52	13
Semitrailers	10	4
B-Doubles	6	0
Special Purpose Vehicle	2	0
Other OSOM Vehicle	8	0
Total	194	62

During the operational stage, vehicle access to the site will be maintenance vans or delivery trucks which would occur on an irregular basis. Traffic noise impacts during the operational stage of the project would be minimal and insignificant and will not be assessed further.

7.1 Road Traffic Noise Criteria

Access to the site will be from Bulluss Drive via Newell Highway. It is noted that Bulluss Drive is a local road servicing an industrial area with no residences along Bulluss Drive. Newell Highway is classified as an arterial road. For existing residences affected by additional traffic on existing arterial roads generated by land use developments, the following RNP road traffic noise criteria would apply.

Table 7-2 – RNP Road Traffic Noise Criteria, dB(A)

Road Category	Type of Project/Land Use	Assessment Criteria, dB(A)	
		Day 7am – 10pm	Night 10pm – 7am
Freeway/arterial/sub-arterial roads	3. Existing residences affected by additional traffic on existing freeways/arterial/sub-arterial roads generated by land use developments	L _{Aeq} (15 hour) 60 (external)	L _{Aeq} (9 hour) 55 (external)

As construction works are to occur only during the day time period, only the traffic noise criteria for the day period are assessed against.

Further to the above, the RNP states the following for land use developments generating additional traffic:

*“For existing residences and other sensitive land uses affected by **additional traffic on existing roads generated by land use development**, any increase in the total traffic noise level should be limited to 2 dB above that of the corresponding ‘no build option’.”*

7.2 Predicted Road Traffic Noise

Results of the road traffic noise predictions are presented in the table below. It is noted that the predicted noise levels represent the traffic noise contribution from the vehicle movements associated with the construction works and does not take into account traffic noise levels due to existing general traffic flows as existing daily traffic volumes along Newell Highway are unknown.

Table 7-3 – Predicted Road Traffic Noise Contribution Levels Along Public Roads, dB(A)

Receiver	Criteria	Traffic Movements	Speed (km/h) ¹	Distance to Road ²	Predicted Noise Level	Exceed?
Residences on Newell Highway	L _{Aeq} (15 hour) 60	As per Table 7.1	60/80	20m	53	No

Notes: 1. Based on posted speed limit
2. Based on closest typical distance from facade of dwelling to the road

From the above table, it can be seen that road traffic noise level contributions from the vehicle movements associated with the construction works are well within the applicable noise criteria based on dwellings being at the closest typical distance from the road.

Traffic counts undertaken at the Bulluss Drive and Newell Highway intersection recorded 1,924 vehicle movements along Newell Highway during the morning and afternoon peak periods (6:00 to 9:00 and 15:00 to 18:00). This is significantly higher than the proposed daily construction traffic volumes during peak construction. Therefore, it is not expected that the traffic noise contribution from the construction vehicles would result in an exceedance of the traffic noise criterion and/or increase the existing traffic noise levels by more than 2dB(A).

Therefore, traffic noise levels as a result of the construction works for the project would not adversely contribute to the existing traffic noise levels at the most affected residences along the surrounding roads.

8 Conclusion

Renzo Tonin and Associates has completed an environmental noise and vibration assessment of the proposed Moree Battery Energy Storage System project.

Noise emissions from the construction and operational phases of the project were predicted to comply with the nominated criteria at all existing nearest affected receivers.

Given the large separation distance between most of the affected receivers and the subject site, vibration impacts resulting in structural damage to buildings at the nearest affected receivers are determined to be negligible and there is a very low risk of adverse comments from occupants of sensitive receivers due to construction vibration.

Road traffic noise impacts due to additional traffic generated during the construction phase of the project on residential properties along the access route were found to comply with the relevant RNP criteria. Road traffic noise impacts from traffic associated with the operation of the project were considered to be negligible due to the minimal traffic movements.

APPENDIX A Glossary of Terminology

The following is a brief description of the technical terms used to describe noise to assist in understanding the technical issues presented.

Adverse weather	Weather effects that enhance noise (that is, wind and temperature inversions) that occur at a site for a significant period of time (that is, wind occurring more than 30% of the time in any assessment period in any season and/or temperature inversions occurring more than 30% of the nights in winter).
Ambient noise	The all-encompassing noise associated within a given environment at a given time, usually composed of sound from all sources near and far.
Assessment period	The period in a day over which assessments are made.
Assessment point	A point at which noise measurements are taken or estimated. A point at which noise measurements are taken or estimated.
Background noise	Background noise is the term used to describe the underlying level of noise present in the ambient noise, measured in the absence of the noise under investigation, when extraneous noise is removed. It is described as the average of the minimum noise levels measured on a sound level meter and is measured statistically as the A-weighted noise level exceeded for ninety percent of a sample period. This is represented as the L90 noise level (see below).
Decibel [dB]	The units that sound is measured in. The following are examples of the decibel readings of every day sounds: 0dB The faintest sound we can hear 30dB A quiet library or in a quiet location in the country 45dB Typical office space. Ambience in the city at night 60dB CBD mall at lunch time 70dB The sound of a car passing on the street 80dB Loud music played at home 90dB The sound of a truck passing on the street 100dB The sound of a rock band 110dB Operating a chainsaw or jackhammer 120dB Deafening
dB(A)	A-weighted decibels. The A-weighting noise filter simulates the response of the human ear at relatively low levels, where the ear is not as effective in hearing low frequency sounds as it is in hearing high frequency sounds. That is, low frequency sounds of the same dB level are not heard as loud as high frequency sounds. The sound level meter replicates the human response of the ear by using an electronic filter which is called the "A" filter. A sound level measured with this filter switched on is denoted as dB(A). Practically all noise is measured using the A filter.
dB(C)	C-weighted decibels. The C-weighting noise filter simulates the response of the human ear at relatively high levels, where the human ear is nearly equally effective at hearing from mid-low frequency (63Hz) to mid-high frequency (4kHz), but is less effective outside these frequencies.
Frequency	Frequency is synonymous to pitch. Sounds have a pitch which is peculiar to the nature of the sound generator. For example, the sound of a tiny bell has a high pitch and the sound of a bass drum has a low pitch. Frequency or pitch can be measured on a scale in units of Hertz or Hz.
Impulsive noise	Having a high peak of short duration or a sequence of such peaks. A sequence of impulses in rapid succession is termed repetitive impulsive noise.
Intermittent noise	The level suddenly drops to that of the background noise several times during the period of observation. The time during which the noise remains at levels different from that of the ambient is one second or more.
L _{Max}	The maximum sound pressure level measured over a given period.
L _{Min}	The minimum sound pressure level measured over a given period.

L ₁	The sound pressure level that is exceeded for 1% of the time for which the given sound is measured.
L ₁₀	The sound pressure level that is exceeded for 10% of the time for which the given sound is measured.
L ₉₀	The level of noise exceeded for 90% of the time. The bottom 10% of the sample is the L90 noise level expressed in units of dB(A).
L _{eq}	The "equivalent noise level" is the summation of noise events and integrated over a selected period of time.
Reflection	Sound wave changed in direction of propagation due to a solid object obscuring its path.
SEL	Sound Exposure Level (SEL) is the constant sound level which, if maintained for a period of 1 second would have the same acoustic energy as the measured noise event. SEL noise measurements are useful as they can be converted to obtain L _{eq} sound levels over any period of time and can be used for predicting noise at various locations.
Sound	A fluctuation of air pressure which is propagated as a wave through air.
Sound absorption	The ability of a material to absorb sound energy through its conversion into thermal energy.
Sound level meter	An instrument consisting of a microphone, amplifier and indicating device, having a declared performance and designed to measure sound pressure levels.
Sound pressure level	The level of noise, usually expressed in decibels, as measured by a standard sound level meter with a microphone.
Sound power level	Ten times the logarithm to the base 10 of the ratio of the sound power of the source to the reference sound power.
Tonal noise	Containing a prominent frequency and characterised by a definite pitch.