



ACCESS REPORT

Independent living units for seniors living
29-35 Lochnivar Road, Revesby NSW



Date
10th October 2024

Prepared for
DTA Architects

Reference No.
24132-DA

TABLE OF CONTENTS

TABLE OF CONTENTS	2
1.0 INTRODUCTION	3
1.1 General	3
1.2 Purpose	3
1.3 Documentation Relied Upon	3
1.4 Exclusions & Limitations	3
1.5 Relevant Legislation	4
1.6 Building Classification Assessment	4
2.0 TECHNICAL ASSESSMENT – BCA ACCESS PROVISIONS	6
2.1 General	6
2.2 Part D4: Access for People with a Disability	7
2.3 Part E3: Lift Installations	11
2.4 Part F4: Sanitary & Other Facilities	13
3.0 TECHNICAL ASSESSMENT – SEPP (HOUSING) 2021 – ‘SCHEDULE 4’	14
4.0 TECHNICAL ASSESSMENT – SEPP (HOUSING) 2021 – ‘S93(3)&(4)’	24
5.0 CONCLUSION	25

AUTHOR		REVIEWER	
 <u>Michael Zora</u> Director Dip. Access Consulting Grad Dip. Build Surv. B. Construction Mgmt (Hons) ACAA Accredited Member No. 596 LHA Assessor No. 20298		 <u>Anthony Banham</u> Director Grad Dip Build Surv. Certificate in Access Appraisal Associate Dip. Environment, Health & Building Surveying ACAA Member – No. 291	
Revision	Date	Status	
R1.0	28.6.24	Draft	
R1.1	10.10.24	Final	

The intellectual content contained within this report remains the property of Ai Consultancy (Aust) and has been prepared and may only be used for the development / buildings being the subject of this report.

1.0 INTRODUCTION

1.1 General

This Access Report has been prepared at the request of *DTA Architects* for the purpose of completing an assessment of the Part 5 Activity architectural drawings associated with the proposed construction of a 2-storey residential building comprising of 19 dwellings & associated on-grade carpark for seniors living to be located at 29-35 Lochnivar Rd, Revesby NSW.

1.2 Purpose

The purpose of this report is to identify the compliance status of the architectural design documentation against the following (as relevant to the project):

- The accessibility provisions under the Building Code of Australia (BCA) 2022 – Volume 1, as includes:
 - All of Part D4.
 - Clauses F4D5, F4D6, D4D7, F4D12, E3D7 and E3D8.
 - Schedule 5 – NSW variations to the BCA.
- AS 1428.1-2009, AS 1428.4.1-2009 and AS 2890.6-2009.
- Disability (Access to Premises — Buildings) Standards 2010 and Standards 2020.
- State Environmental Planning Policy (Housing) 2021 – version date 23/09/2024 – Section 93(3)&(4) and Schedule 4 only.

1.3 Documentation Relied Upon

This report has been prepared on the basis of the following:

- Architectural plans prepared by DTA Architects; project no. 2022.016 listed as follows:

Drawing No.	Revision	Date	Title
4 of 18	A	9.10.24	Demolition plan
6 of 18	A	9.10.24	Site plan
7 of 18	A	9.10.24	Ground floor plan
8 of 18	A	9.10.24	First floor plan
9 of 18	A	9.10.24	Roof plan

- Survey prepared by S.J Surveying Services Pty Ltd, listed as follows:

Drawing No.	Revision	Date	Title
1 of 1	-	17.6.23	Footpath gradient

1.4 Exclusions & Limitations

The content of this report relates only to the matters directly nominated in this report and does not assess / include any of the following –

- Any parts of the BCA or standards not directly referenced by this report.
- Any federal, state, and local: policies / guidelines / legislations (except where directly referenced by this report).
- Assessment of SDA / SEPP 65
- Disability Discrimination Act 1992 (*DDA focuses on results. Does not offer prescriptive compliance options*).
- Technical assessment for door operating forces, lighting levels, slip resistance ratings and luminance contrast levels.
- Gradients and crossfalls for ramps, landings and walkways unless provided on referenced drawings.
- Review of any fixtures &/or fittings unless detail provided.

- Work Health & Safety considerations.
- Services & equipment operating capacity &/or design.
- Any loose furniture shown on plan is treated as indicative only. The person/s responsible for furnishing the building should ensure their furnishing layout/s do not cause AS 1428.1-2009 circulation deficiencies.

1.5 Relevant Legislation

Disability Discrimination Act 1992

The Disability Discrimination Act 1992 (DDA) prohibits discrimination against people with disabilities in employment, education, access to premises, provisions of goods, services & facilities, accommodation, buying land, sport clubs and incorporated associations.

The 'access to premises' component of the DDA is captured by Section 23 of the DDA which states as follows (paraphrased):

"It is unlawful for a person to discriminate against another person on the ground of the other persons disability in relation to the provision of means of access to such premises."

The DDA per se is philosophical in approach and provides no measurable standards by which an existing built structure can be considered against to determine whether unlawful discrimination is occurring or is likely to occur.

The Act is enforced primarily through a complaint's mechanism, which allows individuals who have directly or indirectly experienced unlawful discrimination to seek a conciliated outcome through the Australian Human Rights Commission.

Compliance with the DDA is a decision for the building owner / occupier to enhance access on matters which are not covered by the applicable prescriptive requirements.

Disability (Access to Premises — Buildings) Standards 2010

On the 1st of May 2011, the DDA adopted the Disability (Access to Premises – Buildings) Amendment Standards 2010 (DAPS) which partially codified the 'access to premises' principles of the DDA by setting mandatory prescriptive requirements for the provision of access to new, and in some cases, existing buildings.

DAPS is limited to those aspects of the built environment which are governed by the BCA.

Access matters not addressed in the Premises Standards / BCA continue to be subject to possible discrimination complaints under the DDA if a person with disability experiences an access barrier.

The key parts under DAPS are as follows:

Affected Part

When new works to an existing building is proposed, the Premises Standards require that, in some situations, upgrading what is called the 'affected part' of a building.

Schedule 1 Access Code for Buildings

Schedule 1 of the Premises Standards contains the prescriptive deemed-to-satisfy provisions / Performance Requirements which new works must comply with.

Building Code of Australia

In NSW, the Environmental Planning and Assessment Act & Regulation contains the legislation applicable to the development of buildings.

The EP&A Act & Reg applies the Building Code of Australia as the technical requirement to be met for all new buildings and new building work to or within an existing building.

An existing part of a building, that is not subject to new works, is not required to comply with the BCA retrospectively unless specifically required by a State Environmental Planning Policy, DAPS or a condition of development consent.

1.6 Building Classification Assessment

Listed below is our assessment of the relevant BCA classification(s) in relation to the subject building.

BCA Building Classification(s)*: Class 2 | Residential with on-grade carpark.

Note 1 – BCA Consultant / Certifier shall have the final say in determining building classifications.

2.0 TECHNICAL ASSESSMENT – BCA ACCESS PROVISIONS

2.1 General

This section incorporates the access related provisions contained in the BCA (Part D4, Clauses F4D5, F4D6, D4D7, F4D12, E3D7 and E3D8) and as reciprocated in the Premises Standards 'Schedule 1 – Access code for buildings'.

A summary of the compliance status of the architectural design is subsequently provided relevant to each clause.

Alongside each clause heading; compliance shall be indicated by using one (or more) of the following compliance categories –

Complies	Indicates that design compliance has been achieved with the Deemed-to-Satisfy provisions.
Performance Solution	Indicates that compliance is achieved with the Performance Requirements (by way of performance solution).
Capable of compliance	Specific details not provided; however, compliance is readily achievable.
Does not comply	Indicates that design compliance has not been achieved with the Deemed-to-Satisfy provisions.
Design Detail	Compliance commentary is provided. Such should not be considered deficiencies but matters for consideration by the design team / assessment authority at relevant / nominated stages of design.
Not applicable	The Deemed-to-Satisfy provision is neither applicable nor relevant.
For Info	For information purposes only.

2.2 Part D4: Access for People with a Disability

Clause D4D2: General building access requirements

Buildings and parts of buildings must be accessible as follows (unless exempt by Clause D4D5):

Class 2

Common areas

- From a pedestrian entrance required to be accessible to at least 1 floor containing sole-occupancy units and to the entrance doorway of each sole-occupancy unit located on that level.
- To and within not less than 1 of each type of room or space for use in common by the residents, including a cooking facility, sauna, gymnasium, swimming pool, common laundry, games room, individual shop, eating area, or the like.
- Where a ramp complying with AS 1428.1 or a passenger lift is installed:
 - (A) to the entrance doorway of each sole-occupancy unit; and
 - (B) to and within rooms or spaces for use in common by the residents.

Sole-Occupancy Units

- No requirements.

Compliance Status	
Capable of compliance	Access is suitably design detailed to achieve compliance with the requirements of this clause. The finer design aspects shall be reviewed at the detailed design phase.
For Info	The following rooms / spaces are not provided for use in common by the residents and therefore are not required to be accessible by this clause: <ul style="list-style-type: none"> - Service cupboards.

Clause D4D3: Access to buildings

An accessway must be provided to a building required to be accessible:

- a. From the main points of pedestrian entry at the allotment boundary; and
- b. From another accessible building connected by a pedestrian link; and
- c. From any required accessible carparking space on the allotment.

An accessway must be provided through the principal pedestrian entrance, and:

- a. through not less than 50% of all pedestrian entrances including the principal pedestrian entrance; and
- b. in a building with a floor area more than 500m², a pedestrian entrance which is not accessible must not be located more than 50m from an accessible pedestrian entrance.

Doors on an accessway having multiple leaves must have a clear opening width of not less than 850mm for a single leaf.

Compliance Status	
Complies	<ol style="list-style-type: none"> 1. An accessway has been provided from the main points of pedestrian entry at the allotment boundary. 2. An accessway has been provided to the building from the accessible carparking spaces.

Clause D4D4: Parts of buildings to be accessible

In a building required to be accessible:

- a. every ramp & walkway (except a fire-isolated ramp) must comply with Clause 10 of AS1428.1-2009.
- b. every stairway (except a fire-isolated stairway) must comply with Clause 11 of AS1428.1-2009.
- c. all fire-isolated stairways are required to comply with Clause 11.1(f) and (g) of AS 1428.1-2009.

- d. passing spaces must be provided as per Clause 6.4 of AS 1428.1-2009 at maximum 20m intervals on those parts of an accessway where a direct line of sight is not available.
- e. turning spaces must be provided as per Clause 6.5 of AS 1428.1-2009 as follows:
 - Within 2m of the end of accessways; and
 - At maximum 20m intervals along the accessway.
- f. carpet installed in an accessway must comply with clause D4D4(g) and (h)

Concession – A ramp complying with AS 1428.1-2009 or a passenger lift need not be provided to serve a storey or level other than the entrance storey in a Class 5, 6, 7b or 8 building:

- containing not more than 3 storeys; and
- with a floor area for each storey, excluding the entrance storey, of not more than 200m².

Compliance Status	
Capable of compliance	<ol style="list-style-type: none"> 1. The non-fire-isolated stairways are suitably detailed to comply with Cl. 11 & 12 of AS 1428.1-2009. The finer design details shall be reviewed at the detailed design phase. 2. The ramps / walkways are suitably detailed to comply with Cl. 10 of AS 1428.1-2009. The finer design details shall be reviewed at the detailed design phase.
Complies	3. Suitable passing & turning spaces provided.

Clause D4D5: Exemptions

An area where access would be inappropriate because of the particular purpose for which the area is used or would pose a health or safety risk for people with a disability; such area is not required to be accessible nor the path of travel providing access to such area.

Compliance Status	
For Info	No areas or rooms seeking access exemption under this clause.

Clause D4D6: Accessible carparking

Compliance Status	
Not applicable	<p>No requirement for accessible car parking in Class 2 developments.</p> <p>Refer to Section 3.0 for SEPP (Housing) 2021 carparking requirements.</p>

Clause D4D7: Signage

In a building required to be accessible:

- a. Braille and tactile signage complying with BCA Spec 15 must:
 - incorporate the international symbol of access or deafness, as appropriate, in accordance with AS 1428.1-2009 and identify each:
 - Sanitary facility, except a sanitary facility associated with a bedroom in a Class 1b or a SOU in a Class 3 or 9c building.
 - space with a hearing augmentation system.
 - identify each door required by BCA Clause E4D5 to be provided with an exit sign and state the word "Exit" followed by the "Level".
- b. signage incorporating the international symbol of deafness, must be provided within a room containing a hearing augmentation system identifying the hearing augmentation type, area covered and location to obtain receivers (if being provided).
- c. signage in accordance with AS 1428.1-2009 must be provided for accessible unisex sanitary facilities to identify left or right handed use.
- d. signage to identify an ambulant accessible sanitary facility in accordance with AS 1428.1-2009 must be located on the door of the facility.

- e. directional signage where a pedestrian entrance is not accessible (incorporating international symbol of access).
- f. directional signage at bank of toilets not incorporating an accessible unisex sanitary facility.
- g. In a building subject to Clause F4D12, directional signage complying with Spec 15 shall be provided at each bank of sanitary facilities and accessible unisex sanitary facility, other than one that incorporates an accessible adult change facility, to direct a person to the location of the nearest accessible adult change facility within that building.

Compliance Status	
Capable of compliance	Signage shall be required as per subclause (a) above only. A signage schedule shall be provided at the detailed design phase. Compliance is readily achievable.

Clause D4D8: Hearing augmentation

Compliance Status	
Not applicable	This clause does not apply to the subject development.

Clause D4D9: Tactile indicators

For a building required to be accessible, Tactile Ground Surface Indicators (TGSIs) complying with Sections 1 & 2 of AS/NZS 1428.4.1-2009 shall be required to warn people who are blind or have a vision impairment that they are approaching:

- A stairway (other than fire-isolated),
- An escalator,
- A passenger conveyor or moving walkway,
- A ramp (other than fire-isolated ramp, step ramp, kerb ramp or swimming pool ramp),
- In the absence of a suitable barrier, any overhead obstruction less than 2m above floor level,
- An accessway meeting a vehicular way adjacent to any pedestrian entrance to a building (excluding pedestrian entrance serving an area exempt by Clause D4D5, if there is no kerb or kerb ramp at that point, except for areas exempted by Clause D4D5).

Compliance Status	
Capable of compliance	Tactiles have been indicatively shown. Compliance is readily achievable at the detailed design phase.

Clause D4D10: Wheelchair seating spaces in Class 9b assembly buildings

Compliance Status	
Not applicable	No class 9b proposed.

Clause D4D11: Swimming pools

Compliance Status	
Not applicable	No swimming pools proposed.

Clause D4D12: Ramps

On an accessway:

- a. a series of connected ramps must not have a combined vertical rise of more than 3.6m; and
- b. a landing for a step ramp must not overlap a landing for another step ramp or ramp.

Compliance Status	
Complies	No step ramps proposed or series of ramps exceeding a vertical rise of 3.6m.

Clause D4D13: Glazing on accessway

On an accessway, where there is no chair rail, handrail or transom, all frameless or fully glazed doors, sidelights and any glazing capable of being mistaken for a doorway or opening, must be clearly marked in accordance with AS 1428.1-2009.

Compliance Status	
Capable of compliance	<p>All full height glazed walls, doors and sidelights within common areas shall be marked as per Cl. 6.6 of AS 1428.1-2009.</p> <p>A door & glazing schedule shall be provided at the detailed design phase.</p> <p>Compliance is readily achievable.</p>

2.3 Part E3: Lift Installations

Clause E3D7: Passenger lift types and their limitations

In an accessible building, every passenger lift must be one of the following lift types, subject to the limitations (if any) of each lift type:

- a. There are no limitations on the use of electric passenger lifts, electrohydraulic passenger lifts or inclined lifts.
- b. Stairway platform lifts must not:
 - be used to serve a space in a building accommodating more than 100 persons calculated according to BCA Clause D2D18; or
 - be used in a high traffic public use area such as a theatre, cinema, auditorium, transport interchange, shopping centre or the like; or
 - be used where it is possible to install another type of passenger lift; or
 - connect more than 2 storeys; or
 - where more than 1 stairway lift is installed, serve more than 2 consecutive storeys; or
 - when in the folded position, encroach on the minimum width of a stairway required by BCA Clause D2D8 to D2D11.
- c. A low-rise platform lift must not travel more than 1000mm.
- d. A low-rise, low-speed constant pressure lift must not—
 - for an enclosed type, travel more than 4 m; or
 - for an unenclosed type, travel more than 2 m; or
 - be used in a high traffic public use areas in buildings such as a theatre, cinema, auditorium, transport interchange, shopping complex or the like.
- e. A small-sized, low-speed automatic lift must not travel more than 12 m

Note – The above passenger lifts must not rely on a constant pressure device for its operation if the lift car is fully enclosed.

Compliance Status	
Capable of compliance	<p>The proposed lift is readily capable of compliance with this clause.</p> <p>A design certificate for the lift confirming compliance with this clause shall be provided at the detailed design phase.</p>

Clause E3D8: Accessible features required for passenger lifts

In an accessible building, every passenger lift must have the following features, where applicable:

- a. A handrail complying with the provisions for a mandatory handrail in AS 1735.12 for all lifts except:
 - A stairway platform lift; and
 - A low-rise platform lift.
- b. Lift floor dimensions of not less than 1400 mm wide x 1600 mm deep for all lifts which travel more than 12 m.
- c. Lift floor dimensions of not less than 1100 mm wide x 1400 mm deep for all lifts which travel not more than 12m, except a stairway platform lift.
- d. Lift floor dimensions of not less than 810 mm wide x 1200 mm deep for a stairway platform lift.
- e. Minimum clear door opening complying with AS 1735.12 for all lifts except a stairway platform lift.
- f. Passenger protection system complying with AS 1735.12 for all lifts with power-operated doors.
- g. Lift landing doors at the upper landing for all lifts except a stairway platform lift.
- h. Lift car and landing control buttons complying with AS 1735.12 for all lifts except:
 - A stairway platform lift; and
 - A low-rise platform lift.
- i. Lighting in accordance with AS 1735.12 for all enclosed lift cars.

- j. For all lifts serving more than 2 levels:
 - automatic audible information within the lift car to identify the level each time the car stops; and
 - audible and visual indication at each lift landing to indicate the arrival of the lift car; and
 - audible information and audible indication required by (i) and (ii) is to be provided in a range of between 20- 80 dB(A) at a maximum frequency of 1500 Hz
- k. Emergency hands-free communication, including a button that alerts a call centre of a problem and a light to signal that the call has been received, for all lifts except a stairway platform lift.
- l. Lift call buttons on landings must not be located less than 500mm from an internal corner.

Compliance Status	
Capable of compliance	<p>The proposed lift is readily capable of compliance with this clause.</p> <p>A design certificate for the lift confirming compliance with this clause shall be provided at the detailed design phase.</p>

2.4 Part F4: Sanitary & Other Facilities

Clause F4D5: Accessible sanitary facilities

Compliance Status	
Not applicable	No communal sanitary facilities proposed.

Clause F4D6: Accessible unisex sanitary compartments

Compliance Status	
Not applicable	No communal sanitary facilities proposed.

Clause F4D7: Accessible unisex showers

Compliance Status	
Not applicable	No communal sanitary facilities proposed.

Clause F4D12: Accessible adult change facilities

Compliance Status	
Not applicable	This clause does not apply to the subject development.

3.0 TECHNICAL ASSESSMENT – SEPP (HOUSING) 2021 – 'SCHEDULE 4'

The below schedule covers all the essential features required for determining compliance with the SEPP (Housing) 2021– Schedule 4:

Note/s:

1. In accordance with Section 85 of the SEPP, an independent living unit, located above the ground floor in a multi-storey building need not comply with the requirements in Schedule 4, sections 2, 5-13 and 15-21 if the development application is made by, or by a person jointly with, a social housing provider or Landcom.
We understand that Homes NSW (a social housing provider) is the proponent for the proposed activity for the subject development and therefore shall qualify for the above concession.
2. Any reference to AS 1428.1 in the table below is a reference to AS 1428.1-**2021**.
3. The table below is reflective of Schedule 4 under the State Environmental Planning Policy (Housing) 2021 – Version 13/05/24.

REQUIREMENT	COMMENTARY
PART 1 – STANDARDS APPLYING TO HOSTELS AND INDEPENDENT LIVING UNITS	
1. APPLICATION OF STANDARDS IN THIS PART	
The standards set out in this Part apply to any seniors housing that consists of hostels or independent living units.	Noted.
1A. DEFINITIONS	
In this schedule— <ul style="list-style-type: none"> ▪ 'circulation space' has the same meaning as in AS 1428.1. ▪ 'continuous accessible path of travel' has the same meaning as in AS 1428.1. ▪ 'general power outlet' means a general power outlet that complies with AS 1428.1. ▪ AS 4586—2013 means the Australian Standard entitled AS 4586—2013, Slip resistance classification of new pedestrian surface materials, published on 28 June 2013. 	Noted.
2. SITTING STANDARDS	
Wheelchair access <ol style="list-style-type: none"> (1) If the whole of the site has a gradient of less than 1:10, 100% of the dwellings must have wheelchair access by a continuous accessible path of travel to an adjoining public road. (2) If the whole of the site does not have a gradient of less than 1:10: <ol style="list-style-type: none"> (a) the percentage of dwellings that must have wheelchair access must equal the proportion of the site that has a gradient of less than 1:10, or 50%, whichever is the greater, and 	<ol style="list-style-type: none"> 1. All dwellings in this development have been provided with wheelchair access. 2. N/A

REQUIREMENT	COMMENTARY
<p>(b) the wheelchair access provided must be by a continuous accessible path of travel to an adjoining public road or an internal road or a driveway that is accessible to all residents.</p> <p>Common areas</p> <p>Access must be provided in accordance with AS 1428.1 so that a person using a wheelchair can use common areas and common facilities associated with the development.</p>	<p>3. The gradient & crossfalls for the external pathways have been suitably detailed to comply with AS 1428.1.</p>
3. LETTERBOXES	
<p>Letterboxes:</p> <p>(a) must be located on a hard standing area, and</p> <p>(b) must have wheelchair access by a continuous accessible path of travel from the letterbox to the relevant dwelling, and</p> <p>(c) must be lockable by a lock that faces a wheelchair accessible path.</p>	<p>The proposed letterbox locations demonstrate compliance with the requirements of this clause.</p>
<p>If a structure contains multiple letterboxes, the structure must be in a prominent location.</p>	<p>The proposed letterboxes demonstrate compliance with the requirements of this clause.</p>
<p>At least 20% of the letterboxes on the site must be more than 600mm and less than 1,200mm above ground level (finished).</p>	<p>The requirements of this clause are readily capable of compliance and shall be reviewed in the next design phase.</p>
4. PRIVATE CAR ACCOMMODATION	
<p>If parking spaces attached to or integrated with a class 1 building under the Building Code of Australia are provided for use by occupants who are seniors or people with a disability, at least 1 parking space must:</p> <p>(a) be at least 3.2m wide, and</p> <p>(b) be at least 2.5m high, and</p> <p>(c) have a level surface with a maximum gradient of 1:40 in any direction, and</p> <p>(d) be capable of being widened to 3.8m without requiring structural modifications to a building.</p>	<p>The subject development is Class 2; hence the requirements of this clause do not apply.</p>
<p>If parking spaces associated with a class 1, 2 or 3 building under the Building Code of Australia are provided in a common area for use by occupants who are seniors or people with a disability, the following applies:</p> <p>(a) for a parking space not in a group—the parking space must comply with AS/NZS 2890.6,</p> <p>(b) for a group of 2–7 parking spaces—</p> <p>(i) at least 1 of the parking spaces must comply with AS/NZS 2890.6, and</p>	<p>We have received expert advice from Homes NSW Planning and Assessment, which includes the following explicit instruction on the interpretation & application of this clause:</p> <p><i>"Only parking spaces required under clause 108(2)(j) of the Housing SEPP, being 1 space per 5 units, need to meet the requirements outlined in Clause 4 of Schedule 4"</i></p> <p>This development provides 4x carparking spaces designed to comply with AS 2890.6-2009.</p>

REQUIREMENT	COMMENTARY
<p>(ii) 50% of the parking spaces must—</p> <p>(A) comply with AS/NZS 2890.6, or</p> <p>(B) be at least 3.2m wide and have a level surface with a maximum gradient of 1:40 in any direction,</p> <p>(c) for a group of 8 or more parking spaces—</p> <p>(i) at least 15% of the parking spaces must comply with AS/NZS 2890.6, and</p> <p>(ii) at least 50% of the parking spaces must:</p> <p>(A) comply with AS/NZS 2890.6, or</p> <p>(B) be at least 3.2m wide and have a level surface with a maximum gradient of 1:40 in any direction,</p> <p>Note 1 – In this section, a parking space is in a common area if it is not attached to or integrated with a hostel or independent living unit.</p> <p>Note 2 – To avoid doubt, a parking space that complies with AS/NZS 2890.6 is only counted toward 1 of the requirements in (b)(i) or (ii) or (c)(i) or (ii) in this subclause.</p>	<p>The finer design elements of the accessible carparking spaces shall be reviewed against AS 2890.6-2009 in the next design phase.</p>
<p>At least 5% of any visitor parking spaces must comply with AS/NZS 2890.6.</p>	<p>N/A – No visitor carparking detailed.</p>
<p>If multiple parking spaces are accessible by a common access point, the access point must be secured by a power-operated garage door, vehicle gate, vehicle barrier or similar device.</p> <p>A parking space, other than a multi parking space under the clause directly above, must be:</p> <p>(a) secured by a power-operated door, or</p> <p>(b) capable of accommodating the installation of a power-operated door, including by having—</p> <p>(i) access to a power point, and</p> <p>(ii) an area for motor or control rods for a power-operated door.</p>	<p>We have previously received advice from Homes NSW Planning and Assessment stating as follows in relation to the requirements of this clause:</p> <p><i>“Power operated doors, gates, barriers and the like are not being provided as they pose a maintenance issue.”</i></p> <p>Compliance with this clause is therefore at the discretion of Homes NSW.</p>
<p>A parking space required by this section to comply with AS/NZS 2890.6, other than a visitor parking space, is not required to include the international symbol of access.</p>	<p>Noted.</p>
<p>A requirement in this section for a parking space to comply with AS/NZS 2890.6 extends to the associated shared area within the meaning of AS/NZS 2890.6.</p>	<p>Noted.</p>
<p>5. ACCESSIBLE ENTRY</p>	
<p>The main entrance to a dwelling must have:</p> <p>(a) a clear opening that complies with AS 1428.1, and</p>	<p>All dwelling entry doors are detailed with circulation space and clear door opening as per AS 1428.1.</p>

REQUIREMENT	COMMENTARY
<p>(b) a circulation space in front of the door and behind the door that complies with AS 1428.1.</p> <p>Note – This section does not apply to an entry for employees.</p>	
6. INTERIORS	
<p>An internal doorway must have an unobstructed opening that complies with AS 1428.1.</p>	<p>The requirements of this clause are readily capable of compliance and shall be reviewed in the next design phase.</p>
<p>An internal corridor must have an unobstructed width of at least 1,000 mm.</p>	<p>The unobstructed internal corridor width in every dwelling is readily capable of compliance with AS 1428.1</p>
<p>The circulation spaces in front of and behind an internal doorway in the following areas must comply with AS 1428.1:</p> <ul style="list-style-type: none"> (a) a kitchen, (b) a laundry (<i>except to laundry facilities in a cupboard</i>), (c) a bathroom, (d) a toilet, (e) a bedroom, (f) a living area, (g) the main area of private open space. 	<p>The circulation space to internal doorways in the areas referenced by this clause all appear to be suitably provided.</p>
7. BEDROOM	
<p>At least one bedroom within each dwelling must have the following:</p> <ul style="list-style-type: none"> (a) A clear area, not including a circulation space, sufficient to accommodate— <ul style="list-style-type: none"> (i) for a hostel—a wardrobe and a single-size bed, or (ii) for an independent living unit—a wardrobe and a queen-size bed, (b) a clear area around the area for the bed of at least: <ul style="list-style-type: none"> (i) 1,200 mm at the foot of the bed, and (ii) 1,000 mm on each side of the bed. (c) At least 2 double general power outlets on the wall where the head of the bed is likely to be, and (d) at least one general power outlet on the wall opposite the wall where the head of the bed is likely to be. <p>N.B. – Queen size bed dimensions:</p> <ul style="list-style-type: none"> ▪ Width 1.53m ▪ Length 2.03m 	<p>The bedroom layout in each dwelling is suitably detailed for compliance with this clause subject to a detailed review of subclauses (c) & (d) at the next design phase.</p>
8. BATHROOM	

REQUIREMENT	COMMENTARY
<p>At least one bathroom in a dwelling must be located on:</p> <ul style="list-style-type: none"> (a) The same floor as the entry to the dwelling, or (b) A floor serviced by a private passenger lift accessible only from inside the dwelling. 	<p>The bathrooms in each dwelling comply with the requirements of this clause.</p>
<p>The bathroom must have the following:</p> <ul style="list-style-type: none"> (a) a slip resistant floor surface that achieves a minimum rating of P3 in accordance with AS 4586—2013, (b) a washbasin with tap ware capable of complying with AS 1428.1, including by future adaptation if the washbasin and tapware continue to use existing hydraulic lines, (c) a shower that: <ul style="list-style-type: none"> (i) is accessible without a shower-hob or step, and (ii) complies with the requirements of AS 1428.1 for the entry, circulation space, floor gradient to the wastewater outlet and location of the mixer tap, and (iii) is in the corner of a room, and (iv) has a wall capable of accommodating the installation of a grab rail, portable shower head with supporting grab rail and shower seat, in accordance with AS 1428.1, (d) a wall cabinet with shelving illuminated by an illumination level of at least 300 lux, (e) a double general power outlet in an accessible location, in accordance with AS 1428.1. <p>Note – A shower screen that can easily be removed to enable compliance with AS 1428.1 is permissible.</p>	<p>A detailed review of this clause is required at the next design phase.</p> <p>Compliance is readily achievable.</p>
9. TOILET	
<p>At least one toilet in a dwelling must be located on:</p> <ul style="list-style-type: none"> (a) the same floor as the entry to the dwelling, or (b) a floor serviced by a private passenger lift accessible only from inside the dwelling. 	<p>The toilets in each dwelling comply with the requirements of this clause.</p>
<p>The toilet must have the following:</p> <ul style="list-style-type: none"> (a) a water closet pan— <ul style="list-style-type: none"> (i) in the corner of the room, and (ii) with a centreline set-out in accordance with AS 1428.1, (b) a circulation space in front of the water closet pan that is— 	<p>The toilet pans in each dwelling comply with the requirements of subclause (a)(i), (b) & (c).</p> <p>A detailed review of subclauses (a)(ii), (d) & (e) shall be undertaken at the next design phase.</p> <p>Compliance is readily achievable.</p>

REQUIREMENT	COMMENTARY
<ul style="list-style-type: none"> (i) at least 1,200mm long and at least 900mm wide, and (ii) clear of door swings and fixtures, other than a toilet paper dispenser or grab rails, (c) a circulation space around the water closet pan that complies with AS 1428.1, (d) a slip resistant floor surface that achieves a minimum rating of P3 in accordance with AS 4586—2013, (e) a wall capable of accommodating the installation of a back rest and grab rail that will comply with AS 1428.1. <p>Note - A removable shower screen may be located in the toilet circulation space.</p>	
10. SURFACES OF BALCONIES AND EXTERNAL PAVED AREAS	
<p>Balconies and external paved areas must have surfaces that are slip resistant and comply with:</p> <ul style="list-style-type: none"> (a) the Building Code of Australia, or (b) the Standards Australia Handbook SA HB 198:2014, Guide to the specification and testing of slip resistance of pedestrian surfaces, published on 16 June 2014. 	<p>To be detailed & reviewed at the next design phase.</p> <p>Compliance is readily achievable.</p>
11. DOOR HARDWARE	
<p>Door handles and hardware for all doors, including entry doors and external doors, must comply with AS 1428.1.</p> <p>Note – The above does not apply to cabinetry.</p>	<p>To be detailed & reviewed at the next design phase.</p> <p>Compliance is readily achievable.</p>
12. SWITCHES AND POWER POINTS	
<p>Switches and power points must:</p> <ul style="list-style-type: none"> (a) comply with AS 1428.1, or (b) be capable of complying with AS 1428.1 through future adaptation. <p>Note – The above does not apply to remote controls or power points likely to serve appliances that are not regularly moved or turned off.</p>	<p>To be detailed & reviewed at the next design phase.</p> <p>Compliance is readily achievable.</p>
13. PRIVATE PASSENGER LIFTS	
<p>This section applies to a private passenger lift that is required by this schedule to be accessible only from inside a particular dwelling.</p>	<p>Private passenger lifts have not been proposed nor required.</p>
<p>The private passenger lift must:</p> <ul style="list-style-type: none"> (a) be at least 1,100mm wide and at least 1,400mm long, measured from the lift car floor, and (b) have a clear indoor landing on all floors serviced by the lift, other than the floor on which the main area of private open space 	<p>Private passenger lifts have not been proposed nor required.</p>

REQUIREMENT	COMMENTARY
<p>is located, at least 1,540mm long and at least 2,070mm wide, and</p> <p>(c) have controls that comply with—</p> <p>(i) AS 1735.12:2020, Lifts, escalators and moving walks, Part 12: Facilities for persons with disabilities, published on 26 June 2020, or</p> <p>(ii) AS 1735.15:2021, Lifts, escalators and moving walks, Part 15: Safety rules for the construction and installation of lifts — Special lifts for the transport of persons and goods — Vertical lifting platforms intended for use by persons with impaired mobility, published on 23 July 2021.</p>	
The width of the door opening of the private passenger lift must be at least 900mm.	Private passenger lifts have not been proposed nor required.
The private passenger lift must not be a stairway platform lift.	Private passenger lifts have not been proposed nor required.

PART 2 – ADDITIONAL STANDARDS FOR INDEPENDENT LIVING UNITS

14. APPLICATION OF STANDARDS IN THIS PART

The standards set out in this Part apply in addition to the standards set out in Part 1 to any seniors housing consisting of independent living units.	Noted.
--	--------

15. BEDROOM

<p>At least one bedroom in an independent living unit that complies with this schedule, section 7 must be located on:</p> <p>(a) the same floor as the entry to the unit, or</p> <p>(b) a floor serviced by a private passenger lift accessible only from inside the unit.</p>	The bedroom in each dwelling complies with the requirements of this clause.
--	---

16. LIVING ROOM

<p>A living room in an independent living unit must be located on:</p> <p>(a) the same floor as the entry to the dwelling, or</p> <p>(b) a floor serviced by a private passenger lift accessible only from inside the dwelling.</p>	The living room in each dwelling comply with the requirements of this clause.
<p>The living room must have:</p> <p>(a) a circulation space that:</p> <p>(i) is clear of all fixtures, and</p> <p>(ii) has a diameter of at least 2,250mm, and</p> <p>(b) a telecommunications or data outlet adjacent to a general power outlet.</p>	<p>To be detailed & reviewed at the next design phase.</p> <p>Compliance is readily achievable.</p>

17. MAIN AREA OF PRIVATE OPEN SPACE

The main area of private open space for an independent living unit must be located on:	The POS in each ground floor dwelling comply with the requirements of this clause.
--	--

REQUIREMENT	COMMENTARY
(a) the same floor as the entry to the dwelling, or (b) a floor serviced by a private passenger lift accessible only from inside the dwelling.	
18. KITCHEN	
A kitchen in an independent living unit must be located on: (a) the same floor as the entry to the dwelling, or (b) a floor serviced by a private passenger lift accessible only from inside the dwelling.	The kitchen in each dwelling complies with the requirements of this clause.
The kitchen must have a circulation space with a diameter of at least 1,200mm between each bench top, cupboard or large appliance and each other bench top, cupboard or large appliance.	All kitchens are open / L shape type.
Each circulation space specified above must be capable of being increased to a diameter of 1,550mm without: (a) relocating the sink, or (b) moving a load-bearing wall, or (c) breaching another circulation requirement.	All kitchens are the open / L shape type.
The kitchen must have the following fittings: (a) a bench that includes at least one work surface that is: (i) at least 800mm long, and (ii) clear of obstructions, and (iii) not in the corner of the room, (b) a lever tap set with the lever and water source that is within 300mm of the front of the bench, (c) a cooktop next to the work surface, (d) an isolating switch for the cooktop, (e) an oven that: (i) has operative elements between 450mm and 1,250mm above the finished floor level, and (ii) is next to the work surface, (f) at least one double general power outlet located within 300mm of the front of a work surface.	The plans suitably demonstrate kitchen compliance with the requirements of subclause (a), (c) & e(iii). The requirements of subclause (b), (d), (e)(i) and (f) shall be detailed for review in the next design phase. We note compliance is readily achievable.
The cupboards must: (a) not be entirely located in the corner of the bench or the corner of the room, and (b) face where the user of the fixture is likely to be.	The kitchen layout is readily capable of compliance with the requirements of this clause.

REQUIREMENT	COMMENTARY
An overhead cupboard in the kitchen must be capable of being fitted with “D” pull cupboard handles towards the bottom of the cupboard.	To be detailed at the next design phase for review. Compliance is readily achievable.
A below-bench cupboard in the kitchen must be capable of being fitted with “D” pull cupboard handles towards the top of the cupboard.	To be detailed & reviewed at the next design phase. Compliance is readily achievable.
The lever tap set, cooktop, isolating switch, oven and double general power outlet must: (a) not be in the corner of the bench or the corner of the room, and (b) face where the user of the fixture is likely to be.	To be detailed & reviewed at the next design phase. Compliance is readily achievable.
Cabinetry below a work surface must be able to be easily removed to allow wheelchair access to the work surface.	To be detailed & reviewed at the next design phase. Compliance is readily achievable.
19. LAUNDRY	
A laundry in this section includes laundry facilities in a cupboard.	Noted.
A laundry in an independent living unit must be located on: (a) the same floor as the entry to the dwelling, or (b) floor serviced by a private passenger lift accessible only from inside the dwelling.	The laundry in each dwelling complies with the requirements of this clause.
The laundry must have the following: (a) a circulation space that complies with AS 1428.1 at the approach to any external doors, (b) an appropriate space for an automatic washing machine and a clothes dryer, (c) a clear space in front of each appliance of at least 1,550mm, Note - This space may overlap with a door swing or the circulation space for a door. (d) a slip resistant floor surface that achieves a minimum rating of P3 in accordance with AS 4586—2013, (e) a continuous accessible path of travel to the main area of private open space or any clothesline provided for the dwelling.	The plans suitably demonstrate laundry compliance with the requirements of subclause (a), (b), (c) and (e). The requirements of subclause (d) shall be detailed for review in the next design phase. Compliance is readily achievable
For laundry facilities in a cupboard, the cupboard must be capable of being fitted with “D” pull cupboard handles in the following locations: (a) for below-bench cupboards—towards the top,	To be detailed & reviewed at the next design phase. Compliance is readily achievable.

REQUIREMENT	COMMENTARY
(b) for overhead cupboards—towards the bottom, (c) for floor-to-ceiling doors—between 900mm and 1,100mm above the finished floor level.	
20. LINEN STORAGE	
An independent living unit must have a floor-to-ceiling linen storage cupboard that: (a) is at least 600mm wide, and (b) has adjustable shelving.	A linen cupboard of 600mm minimum width has been detailed in every dwelling. The height of the cupboard and the shelves shall be reviewed at the next design phase. Compliance is readily achievable.
21. LIFT ACCESS IN MULTI-STOREY BUILDING	
An independent living unit on a storey above the ground storey must be accessible by a lift that complies with the Building Code of Australia, Volume 1, Part E3.	The proposed lift is readily capable of compliance with this clause. A design certificate shall be provided at the next design phase.
22. GARBAGE RECYCLING	
A garbage storage area and a recycling storage area provided for an independent living unit must be accessible by a continuous accessible path of travel from the dwelling entrance.	The location of the bin store is connected to a continuous accessible path of travel back to every dwelling.

4.0 TECHNICAL ASSESSMENT – SEPP (HOUSING) 2021 – 'S93(3) & (4)'

We have undertaken an assessment of the referenced footpath survey in the context of section 93, subclause 3 & 4 of the SEPP (Housing) 2021, see relevant clause extract below:

- (3) For the purposes of subsections (1) and (2), access is adequate if—
- (a) the facilities and services are, or the transport service is, located at a distance of not more than 400m from the site, and
 - (b) the distance is accessible by means of a suitable access pathway, and
 - (c) the gradient along the pathway complies with subsection (4)(c).
- (4) In subsection (3)—
- (a) a **suitable access pathway** is a path of travel by means of a sealed footpath or other similar and safe means that is suitable for access by means of an electric wheelchair, motorised cart or the like, and
 - (b) the distance is to be measured by reference to the length of the pathway, and
 - (c) the overall average gradient must be not more than 1:14 and the gradients along the pathway must be not more than—
 - (i) 1:12 for a maximum length of 15m at a time, or
 - (ii) 1:10 for a maximum length of 5m at a time, or
 - (iii) 1:8 for a maximum length of 1.5m at a time.

Following our assessment of the survey, we conclude as follows:

1. The pathway between the subject site & the relevant bus stops does not exceed a distance of 400m.
2. The pathway achieves gradients & distances as per the above Section 93(4)(c) requirements.
3. A cursory Google Street review was undertaken & the following compliance matters have been identified:
 - Footpath damage / service pit exists at approximately chainage 175.05 which affects the suitability of the path.
 - Footpath damage exists at approximately chainage 243.55 which affects the suitability of the path.
 - Footpath damage exists at approximately chainage 330.2 which affects the suitability of the path.
 - No sealed footpath between kerb & footpath at Bus Stop 2.

The above footpath matters are to be rectified along with any other existing footpath damage.

Note - Assessment of s93(1)(2)&(5) under the SEPP is required to be completed by the relevant expert/s.

5.0 CONCLUSION

This report identifies the compliance status of the Part 5 Activity architectural design with the following –



- a. The accessibility provisions under the Building Code of Australia (BCA) 2022 – Volume 1, as includes:
 - All of Part D4.
 - Clauses F4D5, F4D6, D4D7, F4D12, E3D7 and E3D8.
 - Schedule 5 – NSW variations to the BCA.
- b. AS 1428.1-2009, AS 1428.4.1-2009 and AS 2890.6-2009.
- c. Disability (Access to Premises — Buildings) Standards 2010 and Standards 2020.
- d. State Environmental Planning Policy (Housing) 2021 – *version date 23/09/2024* – Sections 93(3)&(4) and Schedule 4 only.

The outcome of this report highlights that the fundamental aspects of the design are capable of compliance with the DTS provisions of the above codes.

The finer design details to be reviewed at the detailed design stage.



L.G.A CANTERBURY-BANKSTOWN

LONGITUDINAL SECTION
HORIZONTAL: 1 : 200
VERTICAL: 1 : 200

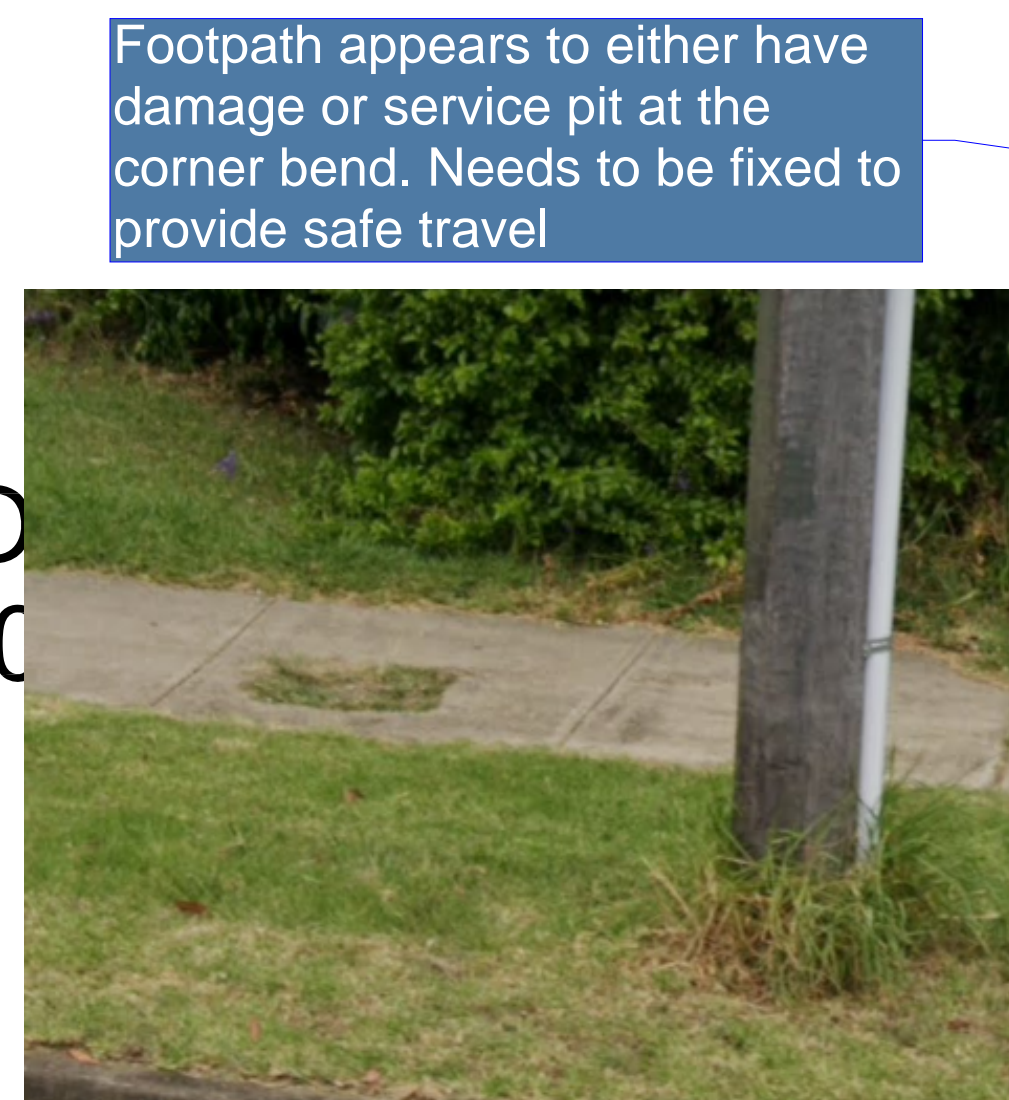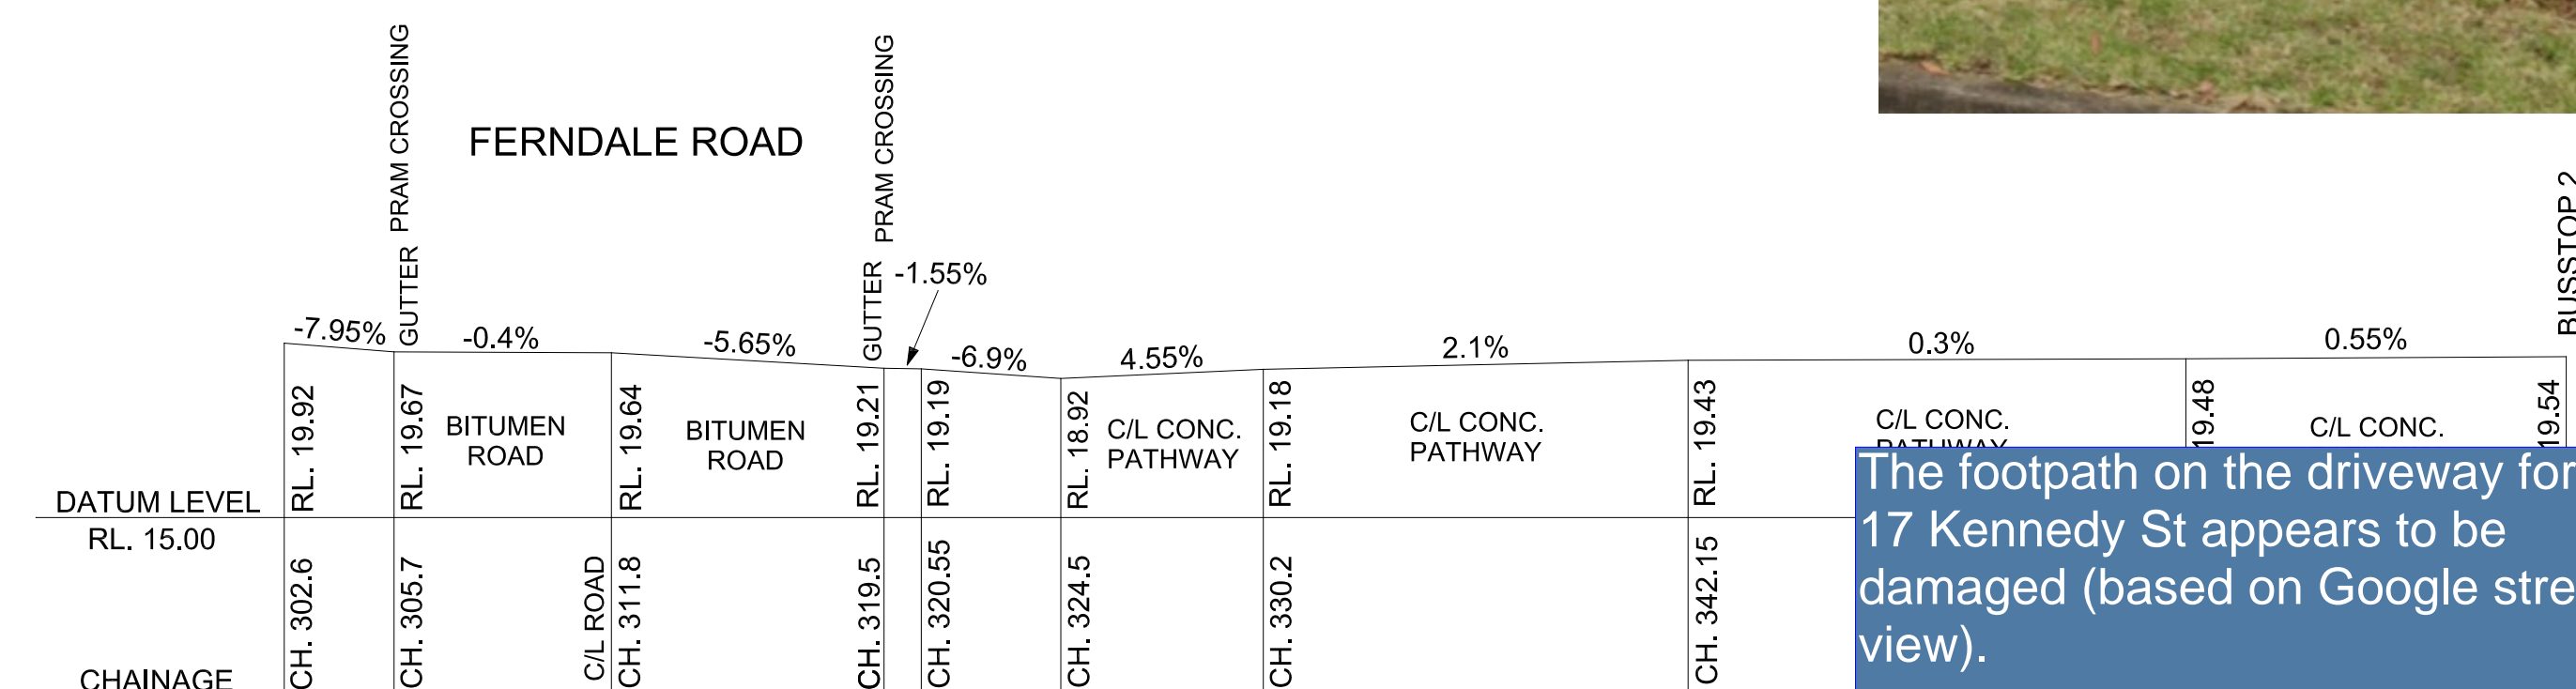


The footpath on the driveway for 17 Kennedy St appears to be damaged (based on Google street view).

Footpath must be rectified to provide safe travel.

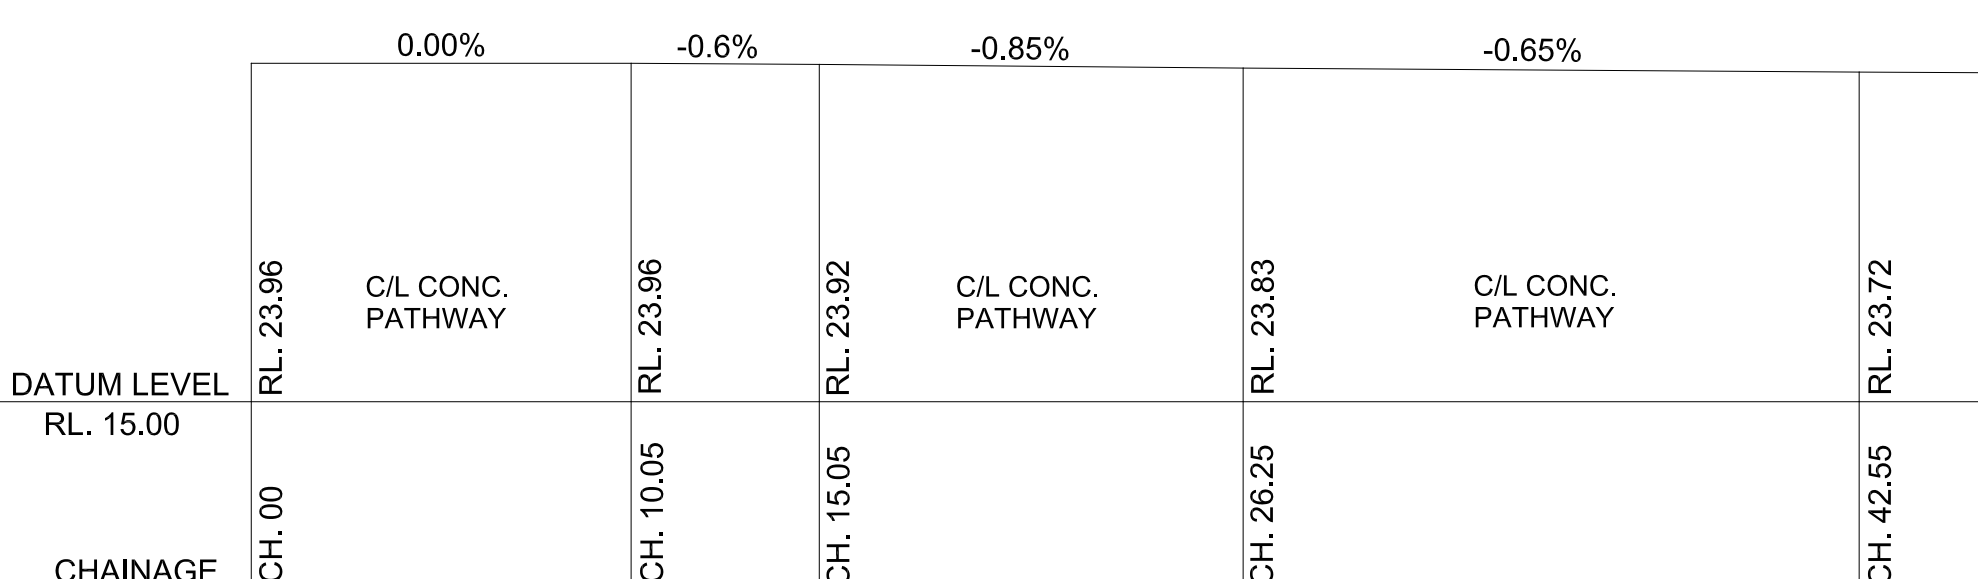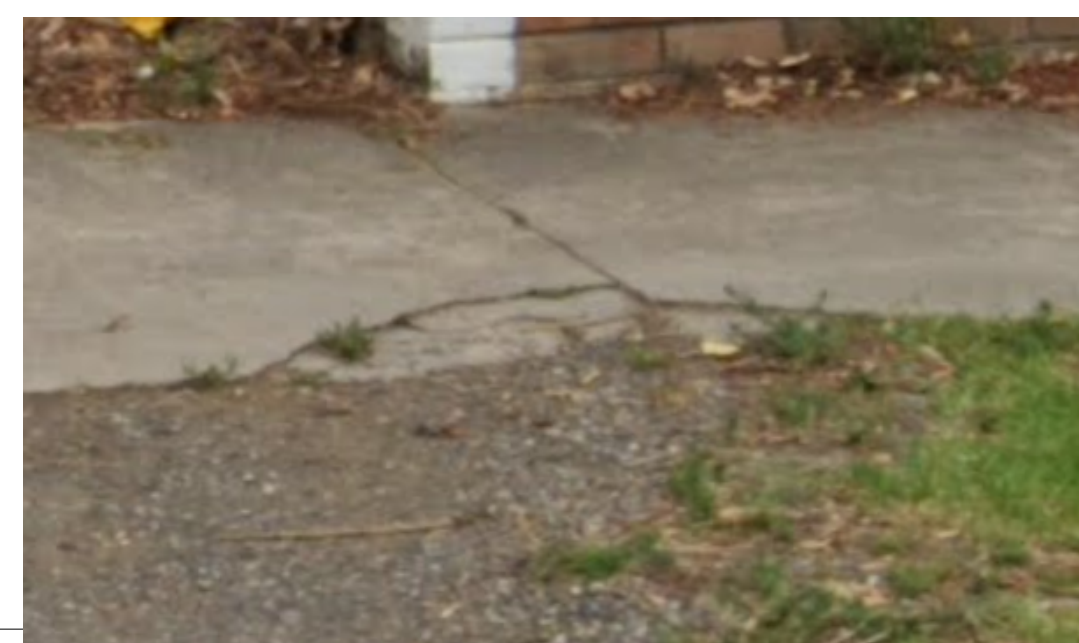


Footpath appears to be damaged at the bend.

Footpath must be rectified to provide safe travel.

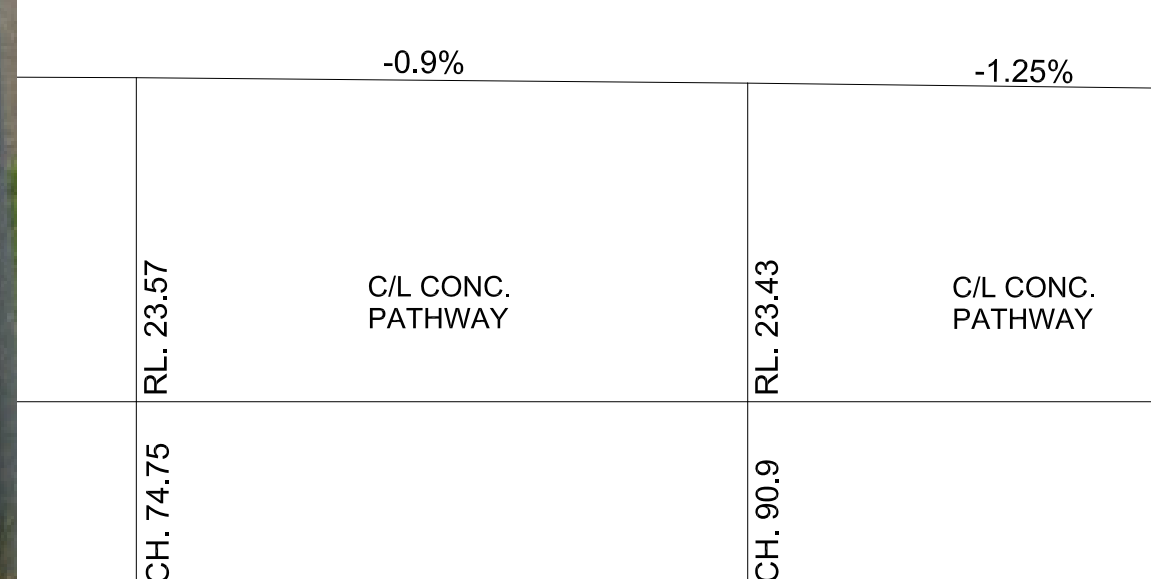


Bus stop 2 is within a nature strip (based on Google street view).

Need a sealed footpath similar to Bus stop 1

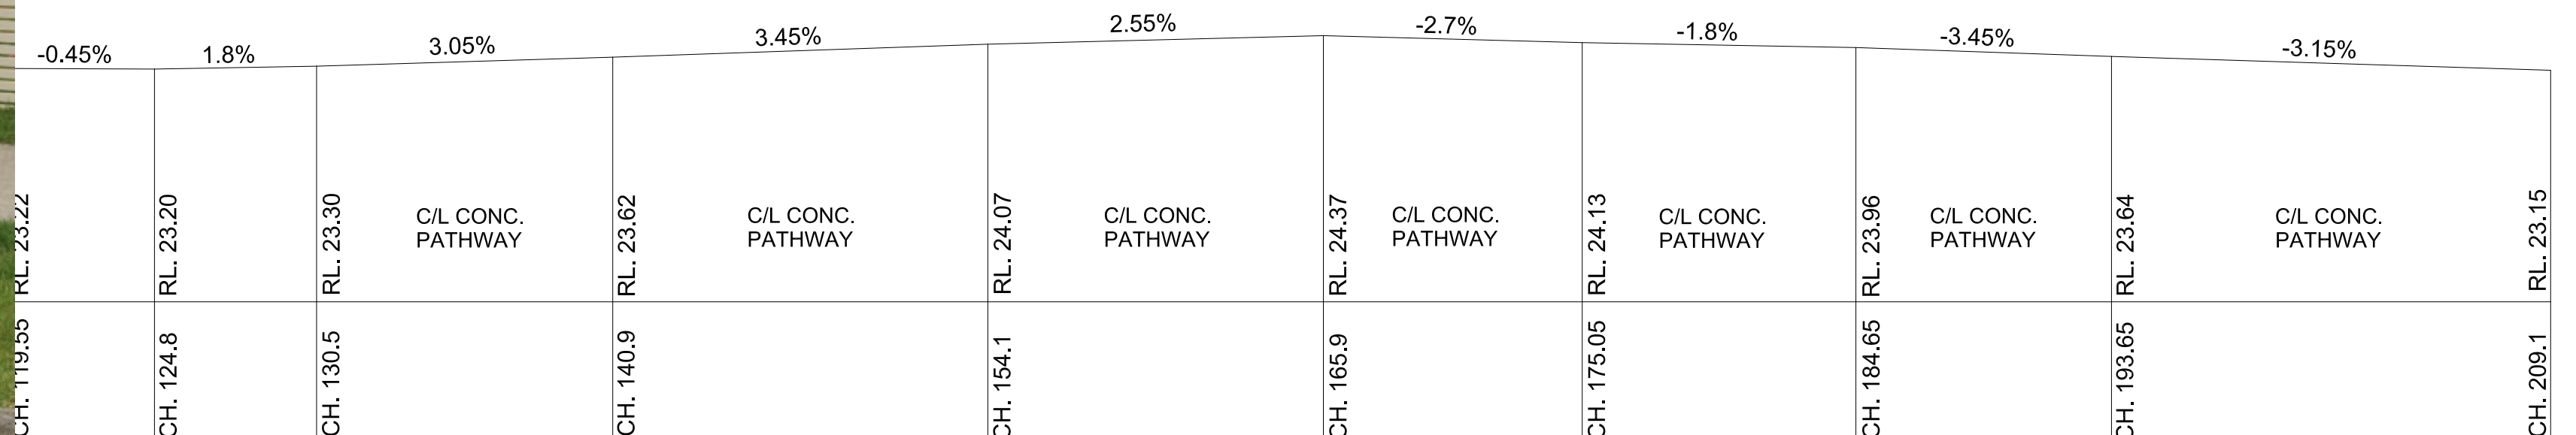

LS1A | LS1B
OR CONTINUATION
SEE BELOW
LONGITUDINAL
SECTION 1B


LONGITUDINAL SECTION 1B
HORIZONTAL: 1 : 200
VERTICAL: 1 : 200

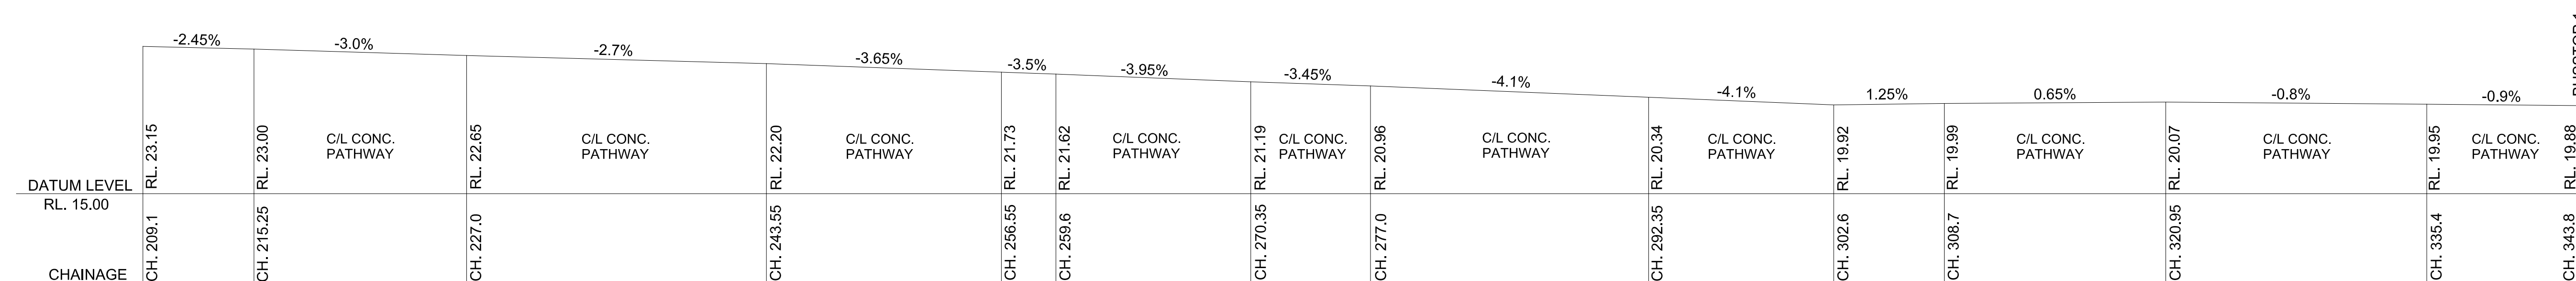

LS1A | LS1B
 FOR CONTINUATION
 SEE ABOVE
 LONGITUDINAL
 SECTION 1A


[illegible]

CONTOUR INTERVAL: N/A
 DATUM: AHD
 ORIGIN OF DATUM:
 SSM 167412 RL. 24.409
 CLASS LB SOURCE: SCIM:
 100 YEAR FLOOD RL:
 RECOMMENDED MINIMUM
 FLOOR RL:
 SOURCE OF FLOOD INFO:

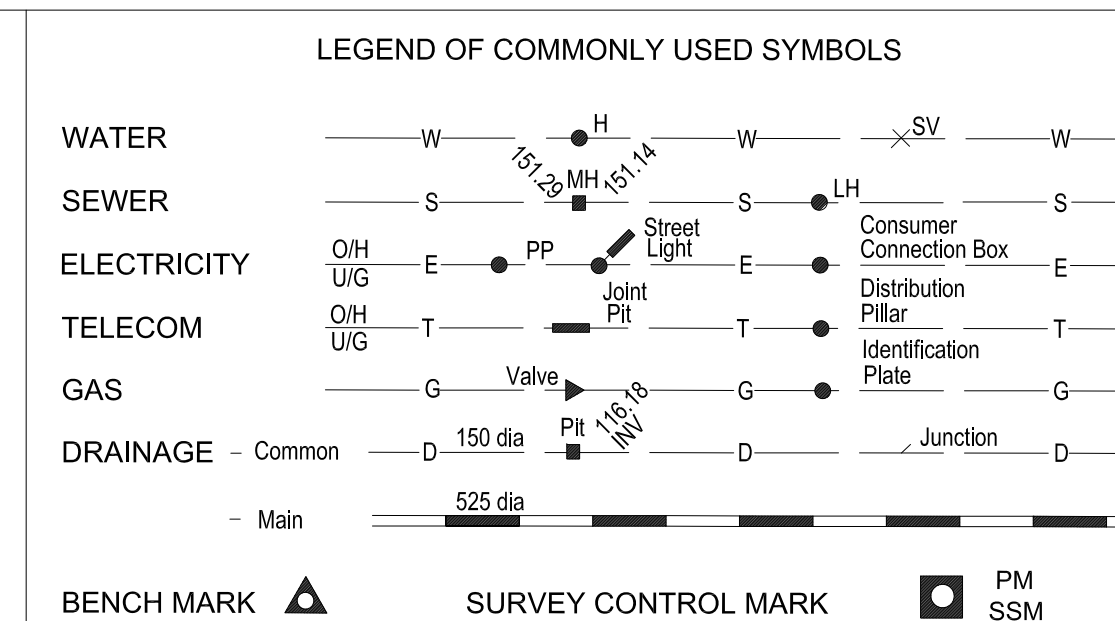

REDUCTION RATIO 1 : 200 (A0)

0 2 4 6 8 10 20



LAND TITLE INFORMATION

: 52, 53, 54 & 55


NO : DP36467

R:


A: N/A

DATE OF SURVEY: 17 / 06 / 2023

SURVEY CONSULTANT:

 S.J SURVEYING SERVICES PTY LTD
LAND & ENGINEERING SURVEYORS
ASBURY RD RD 8000
P.O. BOX 139
MORTDALE, NSW 2223
PHONE Mob: 0408 671 199
EMAIL: sash@sjsurveying.com
www.sjsurveying.com

.....


Registered Surveyor

SURVEYORS

REF: 3711/23



LOCATION	REVESBY		
STREET ADDRESS	NO. 29 - 35 LOCHINVAR ROAD		TYPE S
	SITE	LAYOUT JOB	SHT. 1
	/	/	OF 1