

# GEOTECHNICAL INVESTIGATION

FOR

## HOMES NSW

*37 – 39 Munro Road, Crestwood, New South Wales (BH2NN)*

*Report No: 24/1224*

*Project No: 32670/8654D-G*

May 2024

# Table of Contents

1. INTRODUCTION.....	2
2. NATURE OF THE INVESTIGATION .....	2
2.1. Fieldwork .....	2
2.2. Laboratory Testing.....	3
3. GEOLOGY AND SITE CONDITIONS.....	3
4. SUBSURFACE CONDITIONS .....	3
5. GEOTECHNICAL DISCUSSION .....	4
5.1. Site Classification to AS2870-2011 .....	4
5.2. Foundation Design.....	4
5.3. Soil Aggressiveness .....	5
6. FINAL COMMENTS .....	6

DRAWING NO. 24/1224 – BOREHOLE AND PENETROMETER LOCATIONS

NOTES RELATING TO GEOTECHNICAL REPORTS

APPENDIX A – BOREHOLE LOGS AND EXPLANATION SHEETS

APPENDIX B – LABORATORY TEST RESULTS

## 1. INTRODUCTION

This report presents the results of a Geotechnical Investigation carried out by STS Geotechnics Pty Limited (STS) for a proposed new residential development to be constructed at 37 – 39 Munro Road, Crestwood, NSW. At the time of writing this report STS were not provided with architectural drawings for the project, however, we understand the development will typically comprise the demolition of existing structures prior to construction of single or double storey residential buildings. The development will not include basement levels.

The purpose of the investigation was to determine:

- Site conditions and regional geology,
- Subsurface conditions,
- Site Classification to AS2870-2011 (soil reactivity),
- Foundation design parameters including foundation options, and
- Soil aggressiveness to buried steel and concrete in accordance with AS2870-2011 and AS2159-2009.

The investigation was undertaken at the request of Homes NSW as outlined in STS's proposal referenced P24-129 dated March 15, 2024.

Our scope of work did not include a contamination assessment.

## 2. NATURE OF THE INVESTIGATION

### 2.1. Fieldwork

The fieldwork consisted of drilling four (4) boreholes numbered BH1 to BH4, inclusive, at the locations shown on Drawing No. 24/1224. BH1, BH3, and BH4 were drilled using a utility mounted Christie drilling rig, owned, and operated by STS. ***Because there was no access for the drilling rig, BH2 was drilled using a hand auger.*** Soil strengths were determined by undertaking a Dynamic Cone Penetrometer (DCP) test adjacent to each borehole location.

Drilling operations were undertaken by one of STS's senior technical officers who also logged the subsurface conditions encountered.

Representative soil samples were collected from the boreholes for subsequent laboratory testing.

The subsurface conditions observed are recorded on the borehole logs given in Appendix A. An explanation of the terms used on the logs is also given in Appendix A. Notes relating to geotechnical reports are also attached.

## 2.2. Laboratory Testing

To assess the soils for their aggressiveness, two (2) selected representative soil samples were tested to determine the following:

- pH,
- Sulphate content ( $\text{SO}_4$ ),
- Chloride content (CL), and
- Electrical Conductivity (EC)

To assist with determining the Site Classification, two (2) representative samples were collected to determine the Shrink/Swell Index.

Detailed test reports are given in Appendix B.

## 3. GEOLOGY AND SITE CONDITIONS

The Canberra geological series sheet at a scale of 1:100,000 shows that the site is underlain by Middle Late Ordovician Age Pittman Formation. Rocks within this formation comprise interbedded sandstone, siltstone, and shale (distal quartz turbidites).

The site is rectangular in shape with an area of approximately 1565 m<sup>2</sup>. At the time of the fieldwork, the site was occupied by single storey dwellings. Site vegetation comprises trees and grass. The ground surface falls about 2.0 metres to the north across the site.

The site is bound by Spendelove Street to the west, Munro Road to the south, and residential dwellings in the adjoining properties.

## 4. SUBSURFACE CONDITIONS

When assessing the subsurface conditions across a site from a limited number of boreholes, there is the possibility that variations may occur between test locations. The data derived from the site investigation programme are extrapolated across the site to form a geological model and an engineering opinion is rendered about overall subsurface conditions and their likely behaviour regarding the proposed development. The actual condition at the site may differ from those inferred, since no subsurface exploration programme, no matter how comprehensive, can reveal all subsurface details and anomalies, particularly on a site such as this that has been previously developed.

The subsurface conditions consist of fill, natural sandy clay and gravelly sandy clays, and weathered siltstone/sandstone. Fill is present from the surface to a depth of 0.2 metres. Very stiff natural sandy clay and gravelly sandy clays underlie the fill to depths of 0.4 to 1.3 metres and could not be

penetrated by hand auger below 0.8 metres in BH2. In the remaining boreholes, weathered siltstone/sandstone underlies the soils to the depths of auger refusal, 0.5 to 1.5 metres.

No groundwater was observed during the fieldwork.

## 5. GEOTECHNICAL DISCUSSION

### 5.1. Site Classification to AS2870-2011

The classification has been prepared in accordance with the guidelines set out in the “Residential Slabs and Footings” Code, AS2870 – 2011.

The samples collected for shrink swell testing were unsuitable. Experience has shown that at times, the shrink swell index can be estimated by dividing the soil Plasticity Index (PI) by a factor of 10. The soils tested at this site have PIs of 17% and 21% which imply the shrink swell indexes are 1.7% and 2.1%, respectively, per  $\Delta pF$ .

Because there are trees and existing dwellings present, abnormal moisture conditions (AMC) prevail at the site. (Refer to Section 1.3.3 of AS2870-2011).

Because of the AMC, the site is classified as a *Problem Site (P)*. However, the site may be reclassified as *Moderately Reactive (M)*, provided the recommendations given below are adopted.

Foundation design and construction consistent with this classification shall be adopted as specified in the above referenced standard and in accordance with the design parameters provided below.

### 5.2. Foundation Design

Pad and/or strip footings founded in the very stiff natural soils below the topsoil, may be proportioned using an allowable bearing pressure of 200 kPa. The minimum depth of founding must comply with the requirements of AS2870-2011. To overcome the presence of trees, the foundations should be designed in accordance with the procedures given in Appendices H and CH of AS2870-2011.

Piers founded in very stiff natural soils may be proportioned using an allowable bearing pressure of 300 kPa, provided the depth to diameter ratio exceeds a value of 4. An adhesion value of 20 kPa may be adopted below a depth of 0.5 metres.

Piers founded in weathered siltstone/sandstone may be proportioned using an allowable end bearing pressure of 700 kPa. An allowable adhesion value of 70 kPa may be adopted for the portion of the shaft in weathered siltstone/sandstone. When piers are founded in weathered siltstone/sandstone, the adhesion within the overlying soils must be ignored.

To ensure the bearing values given can be achieved, care should be taken to ensure that the base of excavations is free of all loose material prior to concreting. It is recommended that all shallow footing excavations be protected with a layer of blinding concrete as soon as possible, preferably immediately after excavating, cleaning, inspection, and approval. Pier excavations should not be left open overnight.

The site is considered suitable for slab on ground construction provided due regard is given to the ground surface slope.

During foundation construction, should the subsurface conditions vary to those inferred in this report, a suitably experienced geotechnical engineer should review the design and recommendations given above to determine if any alterations are required.

### 5.3. Soil Aggressiveness

The aggressiveness or erosion potential of an environment in building materials, particularly concrete and steel is dependent on the levels of soil pH and the types of salts present, generally sulphates and chlorides. To determine the degree of aggressiveness, the test values obtained are compared to Tables 6.4.2 (C) and 6.5.2 (C) in AS2159 – 2009 Piling – Design and Installation. The test results are summarised in Table 5.1.

Table 5.1– Soil Aggressiveness Summary

Sample No.	Location	Depth (m)	pH	Sulfate (mg/kg)	Chloride (mg/kg)	Electrical Conductivity (dS/m)	
						EC <sub>1:5</sub>	EC <sub>e</sub>
S1	BH1	0.3	8.0	30	10	0.104	0.9
S2	BH4	0.3	6.9	<10	10	0.027	0.3

The soils on the site are low permeability and above groundwater. Therefore, soil conditions B are considered appropriate (AS2159-2009).

A review of the durability aspects indicates that:

- pH : minimum value of 6.9
- SO<sub>4</sub> : maximum value of 30 mg/kg (ppm) < 5000 ppm
- Cl : maximum value of 10 mg/kg (ppm) < 5000 ppm
- EC<sub>e</sub> : maximum value of 0.9 dS/m

In accordance with AS2159-2009, the exposure classification for the onsite soils is non-aggressive for both concrete and steel. In accordance with AS2870-2011 the soils are classified as A1.

Reference to DLWC (2002) "Site Investigations for Urban Salinity" indicates that  $EC_e$  values of 0.3 to 0.9 are consistent with the presence of non-saline soils.

## 6. FINAL COMMENTS

During construction, should the subsurface conditions vary from those inferred above, we would be contacted to determine if any changes should be made to our recommendations. The exposed bearing surfaces for footings should be inspected by a geotechnical engineer to ensure the allowable pressure given has been achieved.

The above classification has been made assuming that all footings will bear in either natural ground or in controlled filling. Prior to the placement of any filling the existing surface should be stripped of all vegetation and topsoil.

If excavations for rainwater or detention tanks are to be made within 6 metres of the building foundations, advice should be sought regarding their effect on the foundations.


Placing absorption trenches on the high side of the property may create abnormal moisture conditions for the foundations (Refer to Section 1.3.3 of AS2870-2011). This could have a negative effect on the foundation performance and more than likely alter the site classification provided above.

This report has been prepared assuming no trees other than those noted will be present. If future tree planting is planned, eg. there is a landscaping plan, their effect on the foundation performance must be considered.

This report has been prepared assuming the site development will be limited to one or two storey residential buildings. The information and interpretation may not be relevant if the design proposal changes (e.g. to a five-storey building involving major cuts during the site preparation). If changes occur, we would be pleased to review the report and advise on the adequacy of the investigation.



*Lucky Ly*  
*Geotechnical Engineer*  
*STS Geotechnics Pty Limited*

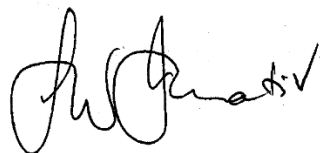

*Laurie Ihnativ*  
*Principal Geotechnical Engineer*  
*STS Geotechnics Pty Limited*





14/1 Cowpasture Place, Wetherill Park, NSW 2164, Australia  
(PO Box 6989, Wetherill Park, NSW 2164, Australia)  
T +61 2 9756 2166 | F +61 2 9756 1137  
[www.stsgeo.com.au](http://www.stsgeo.com.au) | [enquiries@stsgeo.com.au](mailto:enquiries@stsgeo.com.au)  
ABN 45 636 179 729 | ACN 636 179 729

## Borehole and Penetrometer Locations

Client:	HOMES NSW	Project No.	32670/8654D-G	Date:	May 2024
Site Address:	37-39 Munro Rad, Crestwood	Drawing No.	24/1224	Scale:	Unknown
Work:	Geotechnical Investigation	Revision No.	0		



## INTRODUCTION

These notes have been provided to outline the methodology and limitations inherent in geotechnical reporting. The issues discussed are not relevant to all reports and further advice should be sought if there are any queries regarding any advice or report. When copies of reports are made, they should be reproduced in full.

## GEOTECHNICAL REPORTS

Geotechnical reports are prepared by qualified personnel on the information supplied or obtained and are based on current engineering standards of interpretation and analysis.

Information may be gained from limited subsurface testing, surface observations, previous work and is supplemented by knowledge of the local geology and experience of the range of properties that may be exhibited by the materials present. For this reason, geotechnical reports should be regarded as interpretative rather than factual documents, limited to some extent by the scope of information on which they rely.

Where the report has been prepared for a specific purpose (eg. design of a three-storey building), the information and interpretation may not be appropriate if the design is changed (eg. a twenty storey building). In such cases, the report and the sufficiency of the existing work should be reviewed by STS Geotechnics Pty Limited in the light of the new proposal.

Every care is taken with the report content, however, it is not always possible to anticipate or assume responsibility for the following conditions:

- Unexpected variations in ground conditions. The potential for this depends on the amount of investigative work undertaken.
- Changes in policy or interpretation by statutory authorities.
- The actions of contractors responding to commercial pressures.

If these occur, STS Geotechnics Pty Limited would be pleased to resolve the matter through further investigation, analysis or advice.

## UNFORSEEN CONDITIONS

Should conditions encountered on site differ markedly from those anticipated from the information contained in the report, STS Geotechnics Pty Limited should be notified immediately. Early identification of site anomalies generally results in any problems being more readily resolved and allows re-interpretation and assessment of the implications for future work.

## SUBSURFACE CONDITIONS

Logs of a borehole, recovered core, test pit, excavated face or cone penetration test are an engineering and/or geological interpretation of the subsurface conditions. The reliability of the logged information depends on the drilling/testing method, sampling and/or observation spacings and the ground conditions. It is not always possible or economic to obtain continuous high quality data. It should also be recognised that the volume or material observed or tested is only a fraction of the total subsurface profile.

Interpretation of subsurface information and application to design and construction must take into consideration the spacing of the test locations, the frequency of observations and testing, and the possibility that geological boundaries may vary between observation points.

Groundwater observations and measurements outside of specially designed and constructed piezometers should be treated with care for the following reasons:

- In low permeability soils groundwater may not seep into an excavation or bore in the short time it is left open.
- A localised perched water table may not represent the true water table.
- Groundwater levels vary according to rainfall events or season.
- Some drilling and testing procedures mask or prevent groundwater inflow.


The installation of piezometers and long term monitoring of groundwater levels may be required to adequately identify groundwater conditions.

## SUPPLY OF GEOTECHNICAL INFORMATION OR TENDERING PURPOSES

It is recommended tenderers are provided with as much geological and geotechnical information that is available and that where there are uncertainties regarding the ground conditions, prospective tenders should be provided with comments discussing the range of likely conditions in addition to the investigation data.

## APPENDIX A – BOREHOLE LOGS AND EXPLANATION SHEETS


GEOTECHNICAL LOG - NON CORE BOREHOLE

		Client: Homes NSW Project: 37-39 Munro Road, Crestwood Location: Refer to Drawing No. 24/1224		Project: 32670/8654D-G Date : April 30, 2024 Logged: MB      Checked By:		BOREHOLE NO.: BH 1	
						Sheet 1 of 1	
W A T E R L E V E	S A M P L E S	DEPTH (m)	DESCRIPTION OF DRILLED PRODUCT  Soil Name, grain size /plasticity, colour; secondary constituents (Inc. Description) , minor constituents including other remarks		S Y M B O L	CONSISTENCY (cohesive soils) or RELATIVE DENSITY (sands and gravels)	M O I S T U R E
	S1 @ 0.3 m	0.5	FILL: SANDY GRAVEL: low plasticity, grey		GW	—	D
			SANDY CLAY: low plasticity, red grey, with gravel		CL	VERY STIFF	<PL
	U50	1.0					
		1.5	WEATHERED SILTSTONE/SANDSTONE: grey brown			EXTREMELY LOW STRENGTH	D
		2.0	AUGER REFUSAL AT 1.5 M ON WEATHERED SILTSTONE/SANDSTONE				
		2.5					
D - disturbed sample      U - undisturbed tube sample      B - bulk sample WT - level of water table or free water      N - Standard Penetration Test (SPT) S - jar sample					Contractor: STS Equipment: Christie Hole Diameter (mm): 100		
NOTES: See explanation sheets for meaning of all descriptive terms and symbols					Angle from Vertical (°): 0 Drill Bit: Spiral		


# GEOTECHNICAL LOG - NON CORE BOREHOLE

<div><div><div>STS</div><div>GEOTECHNICS PTY LTD CONSULTING GEOTECHNICAL ENGINEERS</div></div><div><div>Client:</div>Homes NSW<div>Project:</div>37-39 Munro Road, Crestwood<div>Location:</div>Refer to Drawing No. 24/1224</div><div><div>Project:</div>32670/8654D-G<div>Date :</div>April 30, 2024<div>Logged:</div>MB<div>Checked By:</div></div></div>							BOREHOLE NO.: BH 2		
							Sheet 1 of 1		
W A T E R  L E  V E L O C I T Y	S A M P L E  S	DEPTH (m)	DESCRIPTION OF DRILLED PRODUCT  Soil Name, grain size /plasticity, colour; secondary constituents (Inc. Description) , minor constituents including other remarks				SYMBOL	CONSISTENCY (cohesive soils) or RELATIVE DENSITY (sands and gravels)	MOISTURE
		<div><div>0.5</div><div>1.0</div><div>1.5</div><div>2.0</div><div>2.5</div></div>	TOPSOIL: SILTY CLAY, low plasticity, brown, trace of gravel				CL	—	<PL
			SANDY CLAY: low plasticity, orange brown, trace of gravel				CL	VERY STIFF	<PL
			HAND AUGER REFUSAL AT 0.8 M						
<div>D - disturbed sample      U - undisturbed tube sample      B - bulk sample WT - level of water table or free water      N - Standard Penetration Test (SPT) S - jar sample</div>							<div>Contractor: STS Equipment: Hand Auger Hole Diameter (mm): 100 Angle from Vertical (°): 0 Drill Bit: Spiral</div>		
NOTES: <div>See explanation sheets for meaning of all descriptive terms and symbols</div>									

# GEOTECHNICAL LOG - NON CORE BOREHOLE

 GEOTECHNICS PTY LTD CONSULTING GEOTECHNICAL ENGINEERS		Client: Homes NSW Project: 37-39 Munro Road, Crestwood Location: Refer to Drawing No. 24/1224		Project: 32670/8654D-G Date : April 30, 2024 Logged: MB      Checked By:		BOREHOLE NO.:      BH 3		
						Sheet 1 of 1		
W A T E R L E V E L	S A M P L E S	DEPTH (m)	DESCRIPTION OF DRILLED PRODUCT  Soil Name, grain size /plasticity, colour; secondary constituents (Inc. Description) , minor constituents including other remarks			S Y M B O L	CONSISTENCY (cohesive soils) or RELATIVE DENSITY (sands and gravels)	M O I S T U R E
		0.5	TOPSOIL: SILTY CLAY, low plasticity, brown, trace of gravel			CL	—	<PL
			SANDY CLAY: low plasticity, orange brown, trace of gravel			CL	VERY STIFF	<PL
			WEATHERED SILTSTONE/SANDSTONE: grey				EXTREMELY LOW STRENGTH	D
			AUGER REFUSAL AT 0.6 M ON WEATHERED SILTSTONE/SANDSTONE					
		1.0						
		1.5						
		2.0						
		2.5						
D - disturbed sample      U - undisturbed tube sample      B - bulk sample WT - level of water table or free water      N - Standard Penetration Test (SPT) S - jar sample						Contractor: STS Equipment: Christie Hole Diameter (mm): 100		
NOTES:      See explanation sheets for meaning of all descriptive terms and symbols						Angle from Vertical (°): 0  Drill Bit: Spiral		

GEOTECHNICAL LOG - NON CORE BOREHOLE

		Client: Homes NSW Project: 37-39 Munro Road, Crestwood Location: Refer to Drawing No. 24/1224		Project: 32670/8654D-G Date : April 30, 2024 Logged: MB      Checked By:		BOREHOLE NO.: BH 4	
						Sheet 1 of 1	
W A T E R L E V E	S A M P L E S	DEPTH (m)	DESCRIPTION OF DRILLED PRODUCT  Soil Name, grain size /plasticity, colour; secondary constituents (Inc. Description) , minor constituents including other remarks		S Y M B O L	CONSISTENCY (cohesive soils) or RELATIVE DENSITY (sands and gravels)	M O I S T U R E
	S2 @ 0.3 m	0.5	TOPSOIL: SILTY CLAY, low plasticity, brown, trace of gravel		CL	—	<PL
			GRAVELLY SANDY CLAY: medium plasticity, red brown		CI	VERY STIFF	<PL
	U50	1.0	WEATHERED SILTSTONE/SANDSTONE: brown			EXTREMELY LOW STRENGTH	D
			AUGER REFUSAL AT 1.0 M ON WEATHERED SILTSTONE/SANDSTONE				
		1.5					
		2.0					
		2.5					
D - disturbed sample      U - undisturbed tube sample      B - bulk sample WT - level of water table or free water      N - Standard Penetration Test (SPT) S - jar sample					Contractor: STS Equipment: Christie Hole Diameter (mm): 100		
NOTES: See explanation sheets for meaning of all descriptive terms and symbols					Angle from Vertical (°): 0 Drill Bit: Spiral		

## Dynamic Cone Penetrometer Test Report

Project: 37-39 MUNRO ROAD, CRESTWOOD

Project No.: 32670/8654D

Client: HOMES NSW

Report No.: 24/1223

Address: 4 Parramatta Square, 12 Darcy Street, Parramatta

Report Date: May 10, 2024

Test Method: AS 1289.6.3.2

Page: 1 of 1

Site No.	P1	P2	P3	P4		
Location	Refer to Drawing No. 24/1224	Refer to Drawing No. 24/1224	Refer to Drawing No. 24/1224	Refer to Drawing No. 24/1224		
Date Tested	30/4/2024	30/4/2024	30/4/2024	30/4/2024		
Starting Level	Surface Level	Surface Level	Surface Level	Surface Level		
Depth (m)	Penetration Resistance (blows / 150mm)					
0.00 - 0.15	*	10	10	8		
0.15 - 0.30	16	17	16	13		
0.30 - 0.45	20	17	23+	17		
0.45 - 0.60	23+	19	Discontinued	17		
0.60 - 0.75	*	23+		23+		
0.75 - 0.90	*	Discontinued		Discontinued		
0.90 - 1.05	23+					
1.05 - 1.20	Discontinued					
1.20 - 1.35						
1.35 - 1.50						
1.50 - 1.65						
1.65 - 1.80						
1.80 - 1.95						
1.95 - 2.10						
2.10 - 2.25						
2.25 - 2.40						
2.40 - 2.55						
2.55 - 2.70						
2.70 - 2.85						
2.85 - 3.00						
3.00 - 3.15						
3.15 - 3.30						
3.30 - 3.45						
3.45 - 3.60						
3.60 - 3.75						

Remarks: \* Pre drilled prior to testing

Technician: MB

Approved Signatory.....

Mrigesh Tamang



## EXPLANATION OF NOTES, ABBREVIATIONS & TERMS USED ON BOREHOLE AND TEST PIT LOGS

### DRILLING/EXCAVATION METHOD





<b>HA</b>	Hand Auger	<b>ADH</b>	Hollow Auger	<b>NQ</b>	Diamond Core - 47 mm
<b>DT</b>	Diatube Coring	<b>RT</b>	Rotary Tricone bit	<b>NMLC</b>	Diamond Core - 52 mm
<b>NDD</b>	Non-destructive digging	<b>RAB</b>	Rotary Air Blast	<b>HQ</b>	Diamond Core - 63 mm
<b>AD*</b>	Auger Drilling	<b>RC</b>	Reverse Circulation	<b>HMLC</b>	Diamond Core - 63 mm
<b>*V</b>	V-Bit	<b>PT</b>	Push Tube	<b>EX</b>	Tracked Hydraulic Excavator
<b>*T</b>	TC-Bit, e.g. AD/T	<b>WB</b>	Washbore	<b>HAND</b>	Excavated by Hand Methods

### PENETRATION RESISTANCE

<b>L</b>	<b>Low Resistance</b>	Rapid penetration/ excavation possible with little effort from equipment used.
<b>M</b>	<b>Medium Resistance</b>	Penetration/ excavation possible at an acceptable rate with moderate effort from equipment used.
<b>H</b>	<b>High Resistance</b>	Penetration/ excavation is possible but at a slow rate and requires significant effort from equipment used.
<b>R</b>	<b>Refusal/Practical Refusal</b>	No further progress possible without risk of damage or unacceptable wear to equipment used.

These assessments are subjective and are dependent on many factors, including equipment power and weight, condition of excavation or drilling tools and experience of the operator.

### WATER

	 <b>Standing Water Level</b>	 <b>Partial water loss</b>
	 <b>Water Seepage</b>	 <b>Complete Water Loss</b>
<b>GWNO</b>	GROUNDWATER NOT OBSERVED - Observation of groundwater, whether present or not, was not possible due to drilling water, surface seepage or cave-in of the borehole/ test pit.	
<b>GWNE</b>	GROUNDWATER NOT ENCOUNTERED - Borehole/ test pit was dry soon after excavation. However, groundwater could be present in less permeable strata. Inflow may have been observed had the borehole/ test pit been left open for a longer period.	

### SAMPLING AND TESTING

<b>SPT</b>	Standard Penetration Testing to AS1289.6.3.3 2004
4,7,11 N=18	4,7,11 = Blows per 150mm. N = Blows per 300mm penetration following a 150mm seating drive
30/80mm	Where practical refusal occurs, the blows and penetration for that interval are reported, N is not reported
RW	Penetration occurred under the rod weight only, N<1
HW	Penetration occurred under the hammer and rod weight only, N<1
HB	Hammer double bouncing on anvil, N is not reported
<b>Sampling</b>	
S1	Jar sample – number indicates sample number
D	Disturbed Sample
B	Bulk disturbed Sample
U50	Thin walled tube sample - number indicates nominal sample diameter in millimetres
<b>Testing</b>	
PP	Pocket Penetrometer test expressed as instrument reading in kPa
DCP	Dynamic Cone Penetrometer (AS1289.6.3.1 1997)
PSP	Perth Sand Penetrometer (AS1289.6.3.2 1997)

### GEOLOGICAL BOUNDARIES

————— = Observed Boundary (Position known)	- - - - - = Observed Boundary (Position approximate)	- -? - -? - -? - = Boundary (Interpreted or inferred)
---	---	--

### ROCK CORE RECOVERY

TCR = Total Core Recovery (%)

$$= \frac{\text{Length of core recovered}}{\text{Length of core run}} \times 100$$

RQD = Rock Quality Designation (%)

$$= \frac{\sum \text{Axial lengths of core} > 100\text{mm}}{\text{Length of core run}} \times 100$$

## METHOD OF SOIL DESCRIPTION USED ON BOREHOLE AND TEST PIT LOGS




FILL



COUBLES or  
BOULDERS



GRAVEL (GP or GW)



ORGANIC SOILS  
(OL, OH or Pt)



SILT (ML or MH)

Combinations of these basic symbols may be used to indicate mixed materials such as sandy clay



CLAY (CL, CI or CH)




SAND (SP or SW)

### CLASSIFICATION AND INFERRED STRATIGRAPHY

Soil is broadly classified and described in Borehole and Test Pit Logs using the preferred method given in AS 1726:2017, Section 6.1 – Soil description and classification.

PARTICLE SIZE CHARACTERISTICS				GROUP SYMBOLS		
Fraction	Components	Sub Division	Size mm	Major Divisions		Description
Oversize	BOULDERS		>200	COARSE GRAINED SOILS More than 65% of soil excluding oversize fraction is greater than 0.075mm	GRAVEL More than 50% of coarse fraction is >2.36mm	GW Well graded gravel and gravel-sand mixtures, little or no fines, no dry strength.
	COBBLES		63 to 200			GP Poorly graded gravel and gravel-sand mixtures, little or no fines, no dry strength.
Coarse grained soil	GRAVEL	Coarse	19 to 63			GM Silty gravel, gravel-sand-silt mixtures, zero to medium dry strength.
		Medium	6.7 to 19			GC Clayey gravel, gravel-sand-clay mixtures, medium to high dry strength.
		Fine	2.36 to 6.7			SW Well graded sand and gravelly sand, little or no fines, no dry strength.
	SAND	Coarse	0.6 to 2.36		SAND More than 50% of coarse fraction is <2.36 mm	SP Poorly graded sand and gravelly sand, little or no fines, no dry strength.
		Medium	0.21 to 0.6			SM Silty sand, sand-silt mixtures, zero to medium dry strength.
		Fine	0.075 to 0.21			SC Clayey sand, sandy-clay mixtures, medium to high dry strength.
Fine grained soil	SILT		0.002 to 0.075			ML Inorganic silts of low plasticity, very fine sands, rock flour, silty or clayey fine sands, zero to medium dry strength.
	CLAY		<0.002			CL, CI Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, medium to high dry strength.
PLASTICITY PROPERTIES				FINE GRAINED SOILS More than 35% of soil excluding oversized fraction is less than 0.075mm	Liquid Limit less < 50%	OL Organic silts and organic silty clays of low plasticity, low to medium dry strength.
					Liquid Limit > 50%	MH Inorganic silts of high plasticity, high to very high dry strength.
						CH Inorganic clays of high plasticity, high to very high dry strength.
						OH Organic clays of medium to high plasticity, medium to high dry strength.
					Highly Organic soil	PT Peat muck and other highly organic soils.

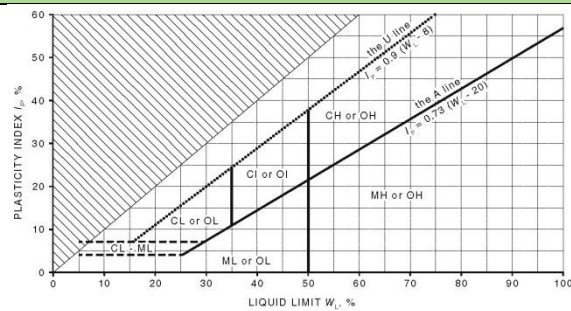

### MOISTURE CONDITION

Symbol	Term	Description
D	Dry	Non- cohesive and free running.
M	Moist	Soils feel cool, darkened in colour. Soil tends to stick together.
W	Wet	Soils feel cool, darkened in colour. Soil tends to stick together, free water forms when handling.

Moisture content of cohesive soils shall be described in relation to plastic limit (PL) or liquid limit (LL) for soils with higher moisture content as follows: Moist, dry of plastic limit ( $w < PL$ ); Moist, near plastic limit ( $w \approx PL$ ); Moist, wet of plastic limit ( $w < PL$ ); Wet, near liquid limit ( $w \approx LL$ ); Wet, wet of liquid limit ( $w > LL$ ).

CONSISTENCY				DENSITY			
Symbol	Term	Undrained Shear Strength (kPa)	SPT "N" #	Symbol	Term	Density Index %	SPT "N" #
VS	Very Soft	$\leq 12$	$\leq 2$	VL	Very Loose	$\leq 15$	0 to 4
S	Soft	$>12$ to $\leq 25$	$>2$ to $\leq 4$	L	Loose	$>15$ to $\leq 35$	4 to 10
F	Firm	$>25$ to $\leq 50$	$>4$ to 8	MD	Medium Dense	$>35$ to $\leq 65$	10 to 30
St	Stiff	$>50$ to $\leq 100$	$>8$ to 15	D	Dense	$>65$ to $\leq 85$	30 to 50
VSt	Very Stiff	$>100$ to $\leq 200$	$>15$ to 30	VD	Very Dense	$>85$	Above 50
H	Hard	$>200$	$>30$				
Fr	Friable	-					

In the absence of test results, consistency and density may be assessed from correlations with the observed behaviour of the material.

# SPT correlations are not stated in AS1726:2017, and may be subject to corrections for overburden pressure, moisture content of the soil, and equipment type.

### MINOR COMPONENTS

Term	Assessment Guide	Proportion by Mass
Add 'Trace'	Presence just detectable by feel or eye but soil properties little or no different to general properties of primary component	Coarse grained soils: $\leq 5\%$ Fine grained soil: $\leq 15\%$
Add 'With'	Presence easily detectable by feel or eye but soil properties little or no different to general properties of primary component	Coarse grained soils: 5 - 12% Fine grained soil: 15 - 30%
Prefix soil name	Presence easily detectable by feel or eye in conjunction with the general properties of primary component	Coarse grained soils: $>12\%$ Fine grained soil: $>30\%$

## CLASSIFICATION AND INFERRED STRATIGRAPHY

Rock is broadly classified and described in Borehole and Test Pit Logs using the preferred method given in AS1726 – 2017, Section 6.2 – Rock identification, description and classification.

## ROCK MATERIAL STRENGTH CLASSIFICATION

Symbol	Term	Point Load Index, $Is_{(50)}$ (MPa) #	Field Guide
VL	Very Low	0.03 to 0.1	Material crumbles under firm blows with sharp end of pick; can be peeled with knife; too hard to cut a triaxial sample by hand. Pieces up to 30 mm can be broken by finger pressure.
L	Low	0.1 to 0.3	Easily scored with a knife; indentations 1 mm to 3 mm show in the specimen with firm blows of pick point; has dull sound under hammer. A piece of core 150 mm long by 50 mm diameter may be broken by hand. Sharp edges of core may be friable and break during handling.
M	Medium	0.3 to 1	Readily scored with a knife; a piece of core 150 mm long by 50 mm diameter can be broken by hand with difficulty.
H	High	1 to 3	A piece of core 150 mm long by 50 mm diameter cannot be broken by hand but can be broken with pick with a single firm blow; rock rings under hammer.
VH	Very High	3 to 10	Hand specimen breaks with pick after more than one blow; rock rings under hammer.
EH	Extremely High	>10	Specimen requires many blows with geological pick to break through intact material; rock rings under hammer.

### # Rock Strength Test Results



Point Load Strength Index,  $Is_{(50)}$ , Axial test (MPa)



Point Load Strength Index,  $Is_{(50)}$ , Diametral test (MPa)

Relationship between rock strength test result ( $Is_{(50)}$ ) and unconfined compressive strength (UCS) will vary with rock type and strength, and should be determined on a site-specific basis. However UCS is typically  $20 \times Is_{(50)}$ .

## ROCK MATERIAL WEATHERING CLASSIFICATION

Symbol	Term	Field Guide
RS	Residual Soil	Soil developed on extremely weathered rock; the mass structure and substance fabric are no longer evident; there is a large change in volume but the soil has not been significantly transported.
XW	Extremely Weathered	Rock is weathered to such an extent that it has soil properties - i.e. it either disintegrates or can be remoulded, in water.
DW	HW	Rock strength usually changed by weathering. The rock may be highly discoloured, usually by iron staining. Porosity may be increased by leaching, or may be decreased due to deposition of weathering products in pores. In some environments it is convenient to subdivide into Highly Weathered and Moderately Weathered, with the degree of alteration typically less for MW.
	MW	
SW	Slightly Weathered	Rock slightly discoloured but shows little or no change of strength relative to fresh rock.
FR	Fresh	Rock shows no sign of decomposition or staining.

## ABBREVIATIONS AND DESCRIPTIONS FOR ROCK MATERIAL AND DEFECTS

### CLASSIFICATION AND INFERRED STRATIGRAPHY

Rock is broadly classified and described in Borehole and Test Pit Logs using the preferred method given in AS1726 – 2017, Section 6.2 – Rock identification, description and classification.

### DETAILED ROCK DEFECT SPACING

Defect Spacing			Bedding Thickness (Stratification)	
Spacing/width (mm)	Descriptor	Symbol	Term	Spacing (mm)
<20	Extremely Close	EC	Thinly laminated	<6
20-60	Very Close	VC	Laminated	6 – 20
60-200	Close	C	Very thinly bedded	20 – 60
200-600	Medium	M	Thinly bedded	60 – 200
600-2000	Wide	W	Medium bedded	200 – 600
2000-6000	Very Wide	VW	Thickly bedded	600 – 2,000
			Very thickly bedded	> 2,000

### ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT TYPES

Defect Type	Abbr.	Description
Joint	JT	Surface of a fracture or parting, formed without displacement, across which the rock has little or no tensile strength. May be closed or filled by air, water or soil or rock substance, which acts as cement.
Bedding Parting	BP	Surface of fracture or parting, across which the rock has little or no tensile strength, parallel or sub-parallel to layering/ bedding. Bedding refers to the layering or stratification of a rock, indicating orientation during deposition, resulting in planar anisotropy in the rock material.
Contact	CO	The surface between two types or ages of rock.
Sheared Surface	SSU	A near planar, curved or undulating surface which is usually smooth, polished or slickensided.
Sheared Seam/ Zone (Fault)	SS/SZ	Seam or zone with roughly parallel almost planar boundaries of rock substance cut by closely spaced (often <50 mm) parallel and usually smooth or slickensided joints or cleavage planes.
Crushed Seam/ Zone (Fault)	CS/CZ	Seam or zone composed of disoriented usually angular fragments of the host rock substance, with roughly parallel near-planar boundaries. The brecciated fragments may be of clay, silt, sand or gravel sizes or mixtures of these.
Extremely Weathered Seam/ Zone	XWS/XWZ	Seam of soil substance, often with gradational boundaries, formed by weathering of the rock material in places.
Infilled Seam	IS	Seam of soil substance, usually clay or clayey, with very distinct roughly parallel boundaries, formed by soil migrating into joint or open cavity.
Vein	VN	Distinct sheet-like body of minerals crystallised within rock through typically open-space filling or crack-seal growth.

NOTE: Defects size of <100mm SS, CS and XWS. Defects size of >100mm SZ, CZ and XWZ.

### ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT SHAPE AND ROUGHNESS

Shape	Abbr.	Description	Roughness	Abbr.	Description
Planar	PR	Consistent orientation	Polished	POL	Shiny smooth surface
Curved	CU	Gradual change in orientation	Slickensided	SL	Grooved or striated surface, usually polished
Undulating	UN	Wavy surface	Smooth	SM	Smooth to touch. Few or no surface irregularities
Stepped	ST	One or more well defined steps	Rough	RO	Many small surface irregularities (amplitude generally <1mm). Feels like fine to coarse sandpaper
Irregular	IR	Many sharp changes in orientation	Very Rough	VR	Many large surface irregularities, amplitude generally >1mm. Feels like very coarse sandpaper

#### Orientation:

**Vertical Boreholes** – The dip (inclination from horizontal) of the defect.

**Inclined Boreholes** – The inclination is measured as the acute angle to the core axis.

### ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT COATING

Coating	Abbr.	Description	Aperture	Abbr.	Description
Clean	CN	No visible coating or infilling	Closed	CL	Closed.
Stain	SN	No visible coating but surfaces are discoloured by staining, often limonite (orange-brown)	Open	OP	Without any infill material.
Veneer	VNR	A visible coating of soil or mineral substance, usually too thin to measure (< 1 mm); may be patchy	Infilled	-	Soil or rock i.e. clay, silt, talc, pyrite, quartz, etc.

## APPENDIX B – LABORATORY TEST RESULTS

## Atterberg Limits and Linear Shrinkage Report

Project: 37-39 MUNRO ROAD, CRESTWOOD

Project No.: 32670/8654D-L

Client: HOMES NSW

Report No.: 24/1217

Address: 4 Parramatta Square, Darcy Street, Parramatta

Report Date: May 9, 2024

Test Method: AS3.1.2, 3.2.1, 3.4.1, 2.1.1

Page: 1 of 1

Sampling Procedure: AS 1289.1.2.1 Clause 6.5.3 - Power Auger Drilling (Not covered under NATA Scope of Accreditation)

STS / Sample No.	8654/1	8654/2				
Sample Location	Borehole 1 Refer to Drawing	Borehole 4 Refer to Drawing				
Material Description	Sandy Clay; red grey with gravel (CL)	Gravelly Sandy Clay; red brown (CI)				
Depth (m)	0.5-0.7	0.7-0.9				
Sample Date	30/04/2024	30/4/2024				
Sample History	Oven Dried	Oven Dried				
Method of Preparation	Dry Sieve	Dry Sieve				
Liquid Limit (%)	28	37				
Plastic Limit (%)	11	16				
Plasticity Index	17	21				
Linear Shrinkage (%)	7.0	9.5				
Mould Size (mm)	250	250				
Crumbing	N	N				
Curling	N	N				

Remarks:

Approved Signatory.....



Technician: DH

Mrigesh Tamang - General Manager



## CERTIFICATE OF ANALYSIS

Work Order	: ES2414092	Page	: 1 of 2
Client	: STS Geotechnics	Laboratory	: Environmental Division Sydney
Contact	: ENQUIRES STS	Contact	: Customer Services ES
Address	: Unit 14/1 Cowpasture Place Wetherill Park 2164	Address	: 277-289 Woodpark Road Smithfield NSW Australia 2164
Telephone	: ----	Telephone	: +61-2-8784 8555
Project	: 30055/32670	Date Samples Received	: 01-May-2024 10:30
Order number	: 2024-163	Date Analysis Commenced	: 03-May-2024
C-O-C number	: ----	Issue Date	: 07-May-2024 11:46
Sampler	: MB		
Site	: ----		
Quote number	: EN/222		
No. of samples received	: 3		
No. of samples analysed	: 3		



Accreditation No. 825  
Accredited for compliance with  
ISO/IEC 17025 - Testing

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QA/QC Compliance Assessment to assist with Quality Review and Sample Receipt Notification.

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is carried out in compliance with procedures specified in 21 CFR Part 11.

Signatories	Position	Accreditation Category
Ankit Joshi	Senior Chemist - Inorganics	Sydney Inorganics, Smithfield, NSW





## General Comments

The analytical procedures used by ALS have been developed from established internationally recognised procedures such as those published by the USEPA, APHA, AS and NEPM. In house developed procedures are fully validated and are often at the client request.

Where moisture determination has been performed, results are reported on a dry weight basis.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

When sampling time information is not provided by the client, sampling dates are shown without a time component. In these instances, the time component has been assumed by the laboratory for processing purposes.

Where a result is required to meet compliance limits the associated uncertainty must be considered. Refer to the ALS Contract for details.

Key : CAS Number = CAS registry number from database maintained by Chemical Abstracts Services. The Chemical Abstracts Service is a division of the American Chemical Society.  
 LOR = Limit of reporting  
 ^ = This result is computed from individual analyte detections at or above the level of reporting  
 ø = ALS is not NATA accredited for these tests.  
 ~ = Indicates an estimated value.

- ED045G: The presence of Thiocyanate, Thiosulfate and Sulfite can positively contribute to the chloride result, thereby may bias results higher than expected. Results should be scrutinised accordingly.

## Analytical Results

Sub-Matrix: SOIL  
 (Matrix: SOIL)

Sample ID

				30055/9502	32670/S1	32670/S2	----	----
Sampling date / time				30-Apr-2024 00:00	30-Apr-2024 00:00	30-Apr-2024 00:00	----	----
Compound	CAS Number	LOR	Unit	ES2414092-001	ES2414092-002	ES2414092-003	-----	-----
Result				Result	Result	Result	----	----
<b>EA002: pH 1:5 (Soils)</b>								
pH Value	----	0.1	pH Unit	6.8	8.0	6.9	----	----
<b>EA010: Conductivity (1:5)</b>								
Electrical Conductivity @ 25°C	----	1	µS/cm	25	104	27	----	----
<b>EA055: Moisture Content (Dried @ 105-110°C)</b>								
Moisture Content	----	0.1	%	9.4	6.2	5.1	----	----
<b>ED040S : Soluble Sulfate by ICPAES</b>								
Sulfate as SO4 2-	14808-79-8	10	mg/kg	<10	30	<10	----	----
<b>ED045G: Chloride by Discrete Analyser</b>								
Chloride	16887-00-6	10	mg/kg	----	10	10	----	----