
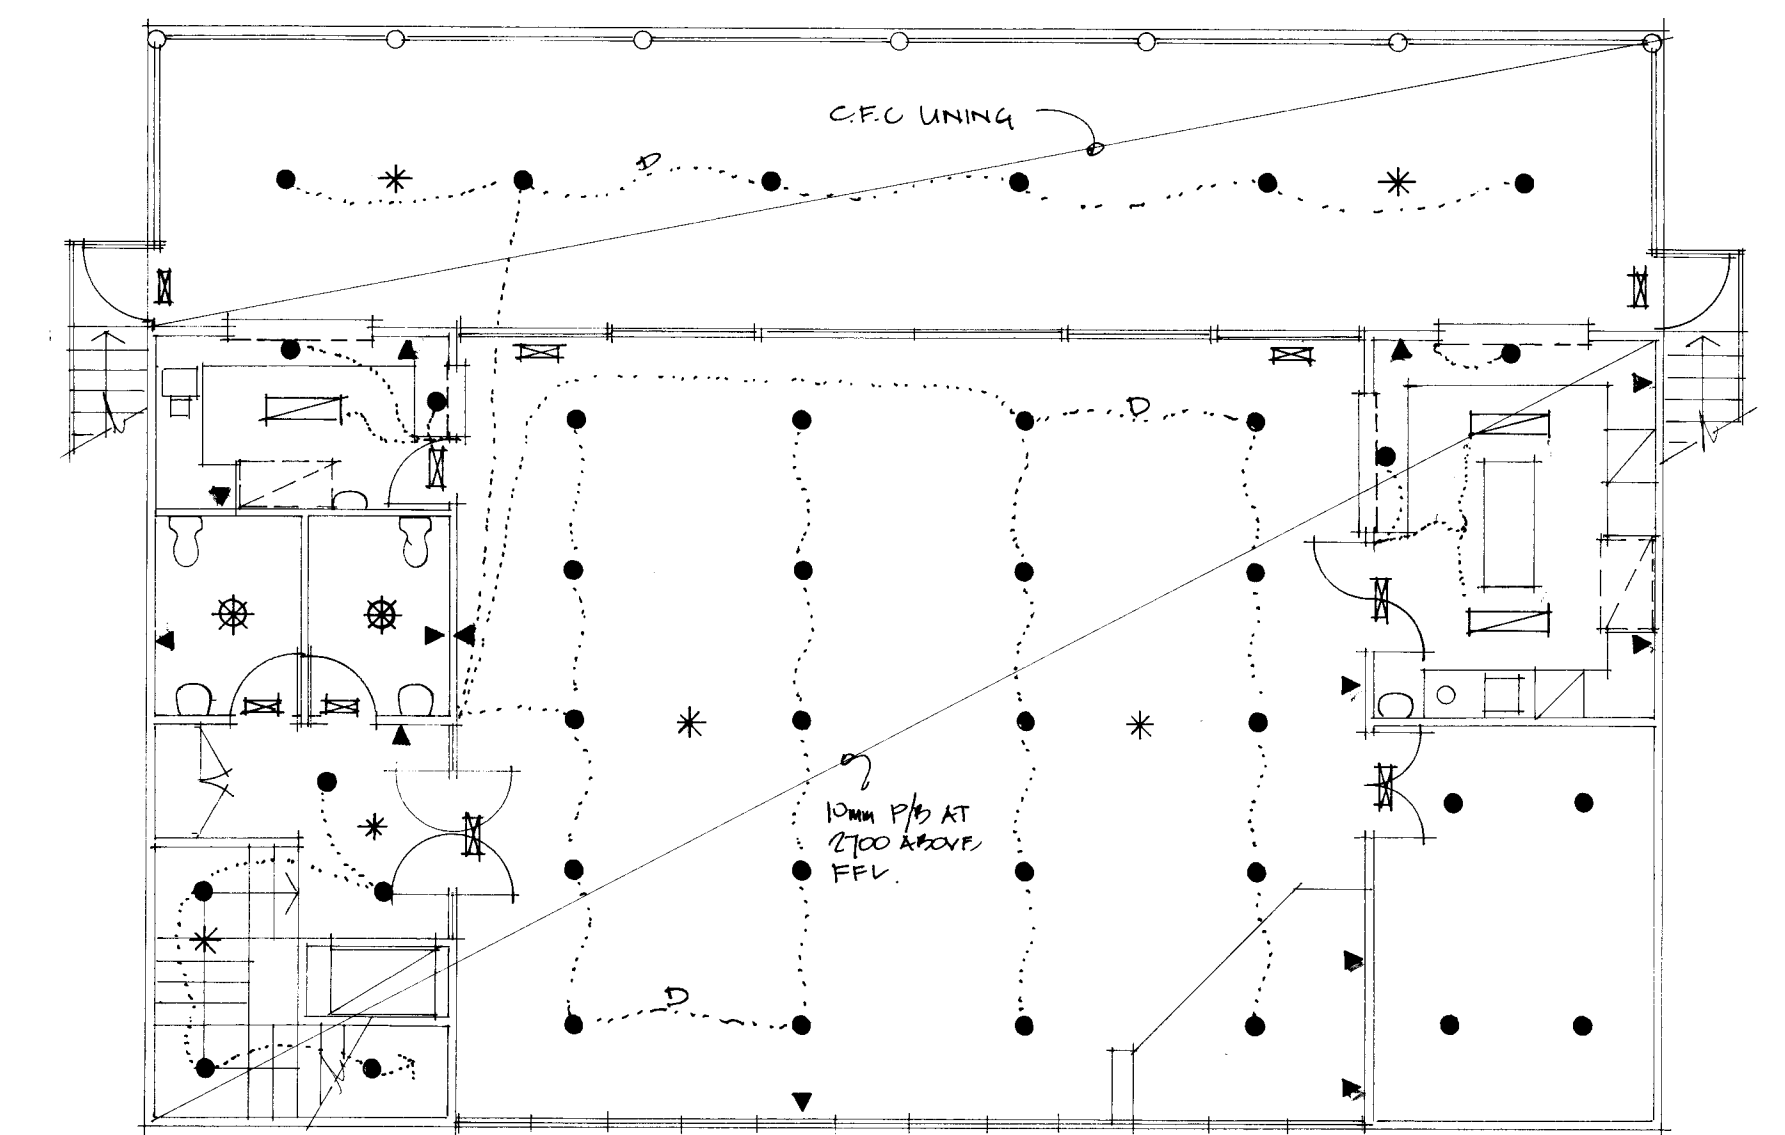
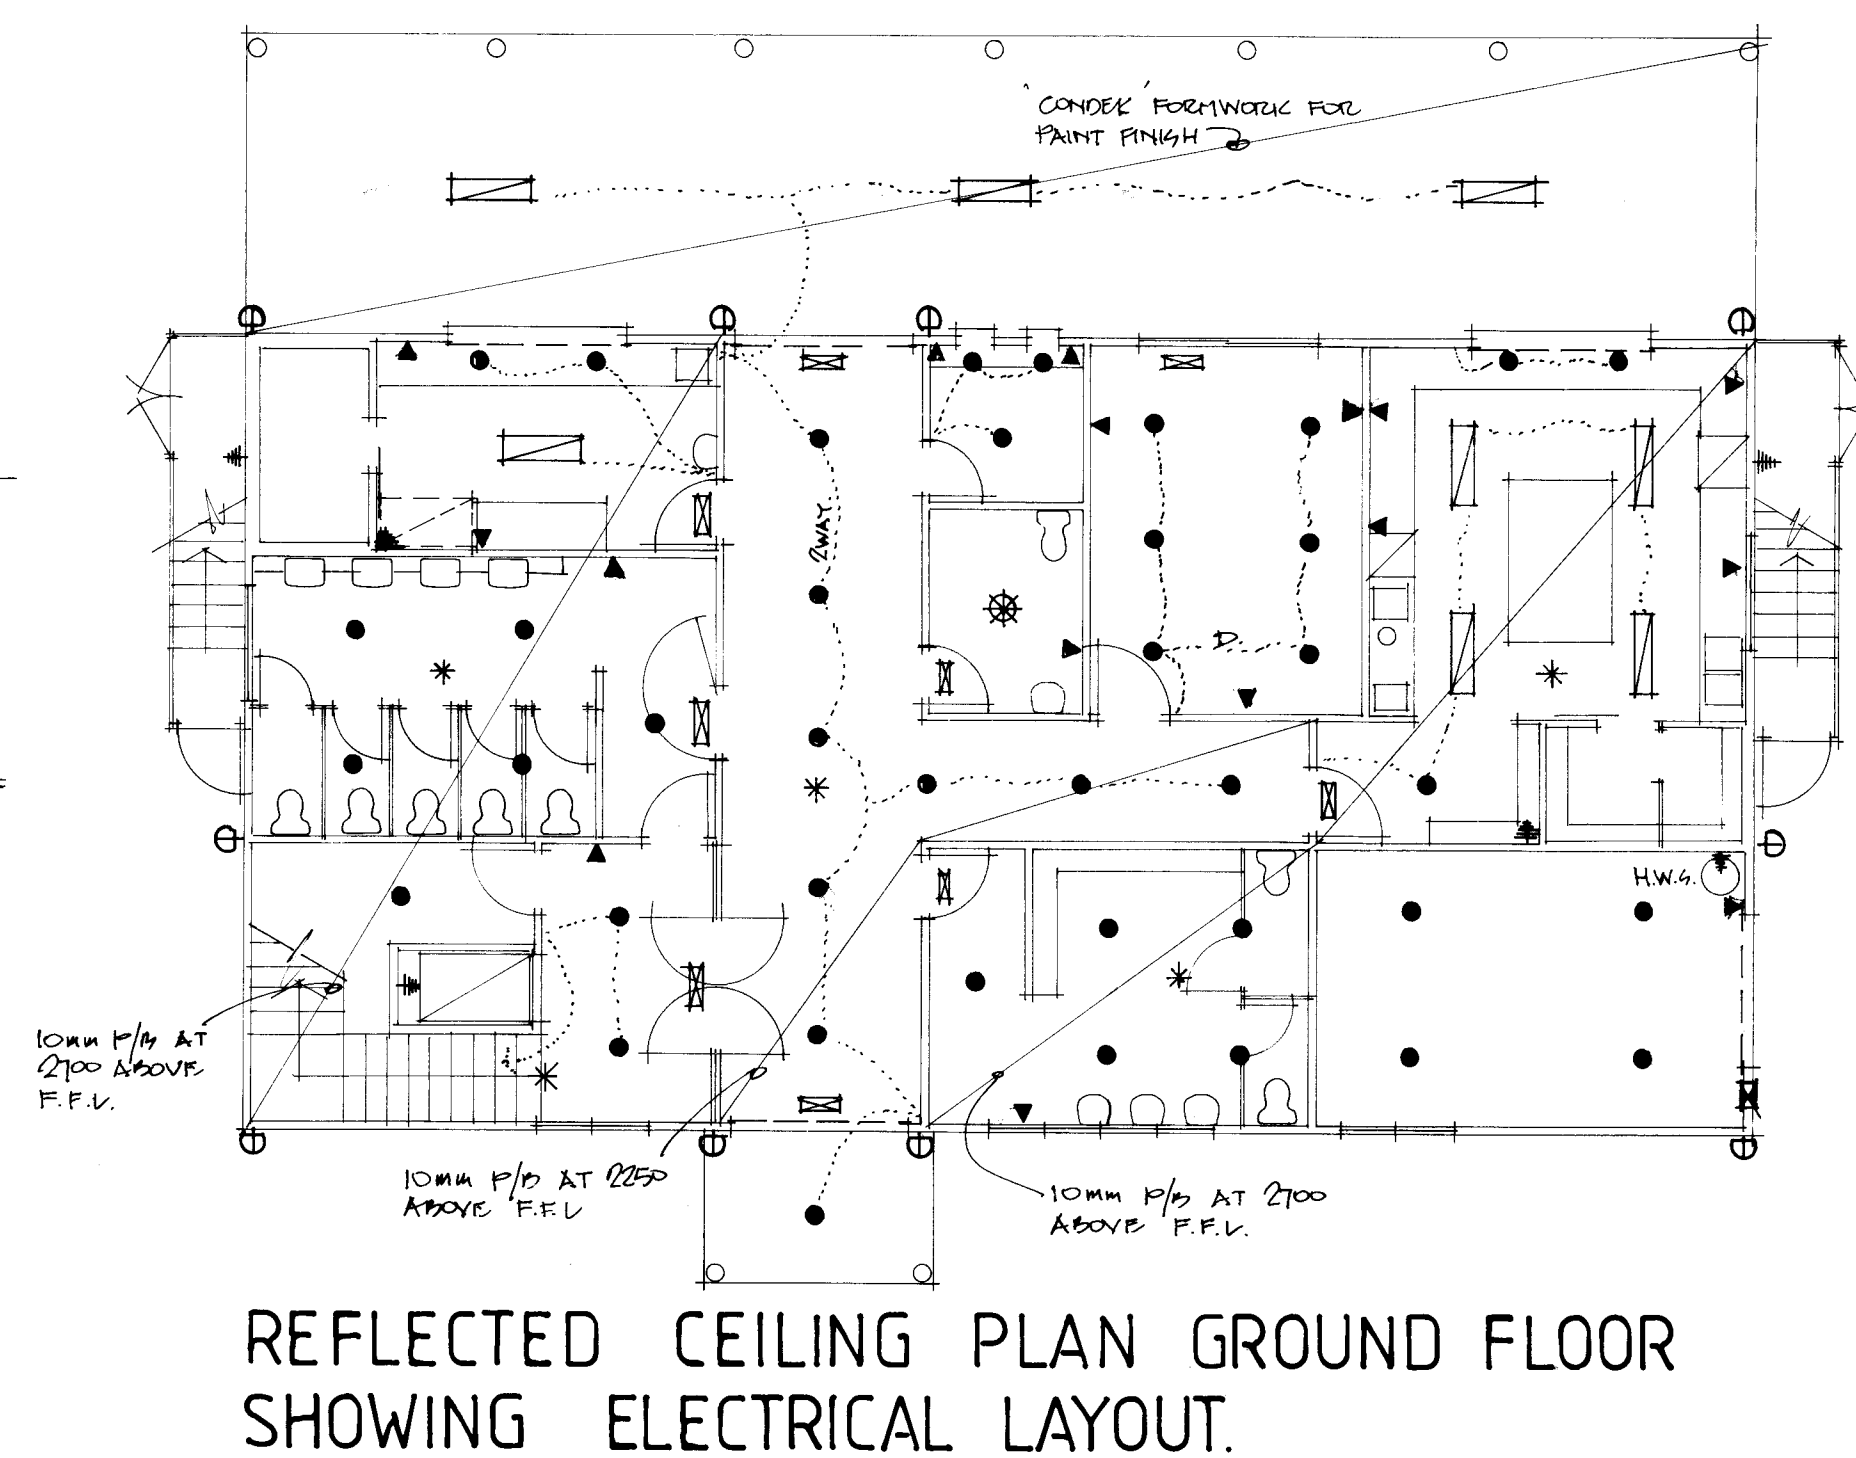


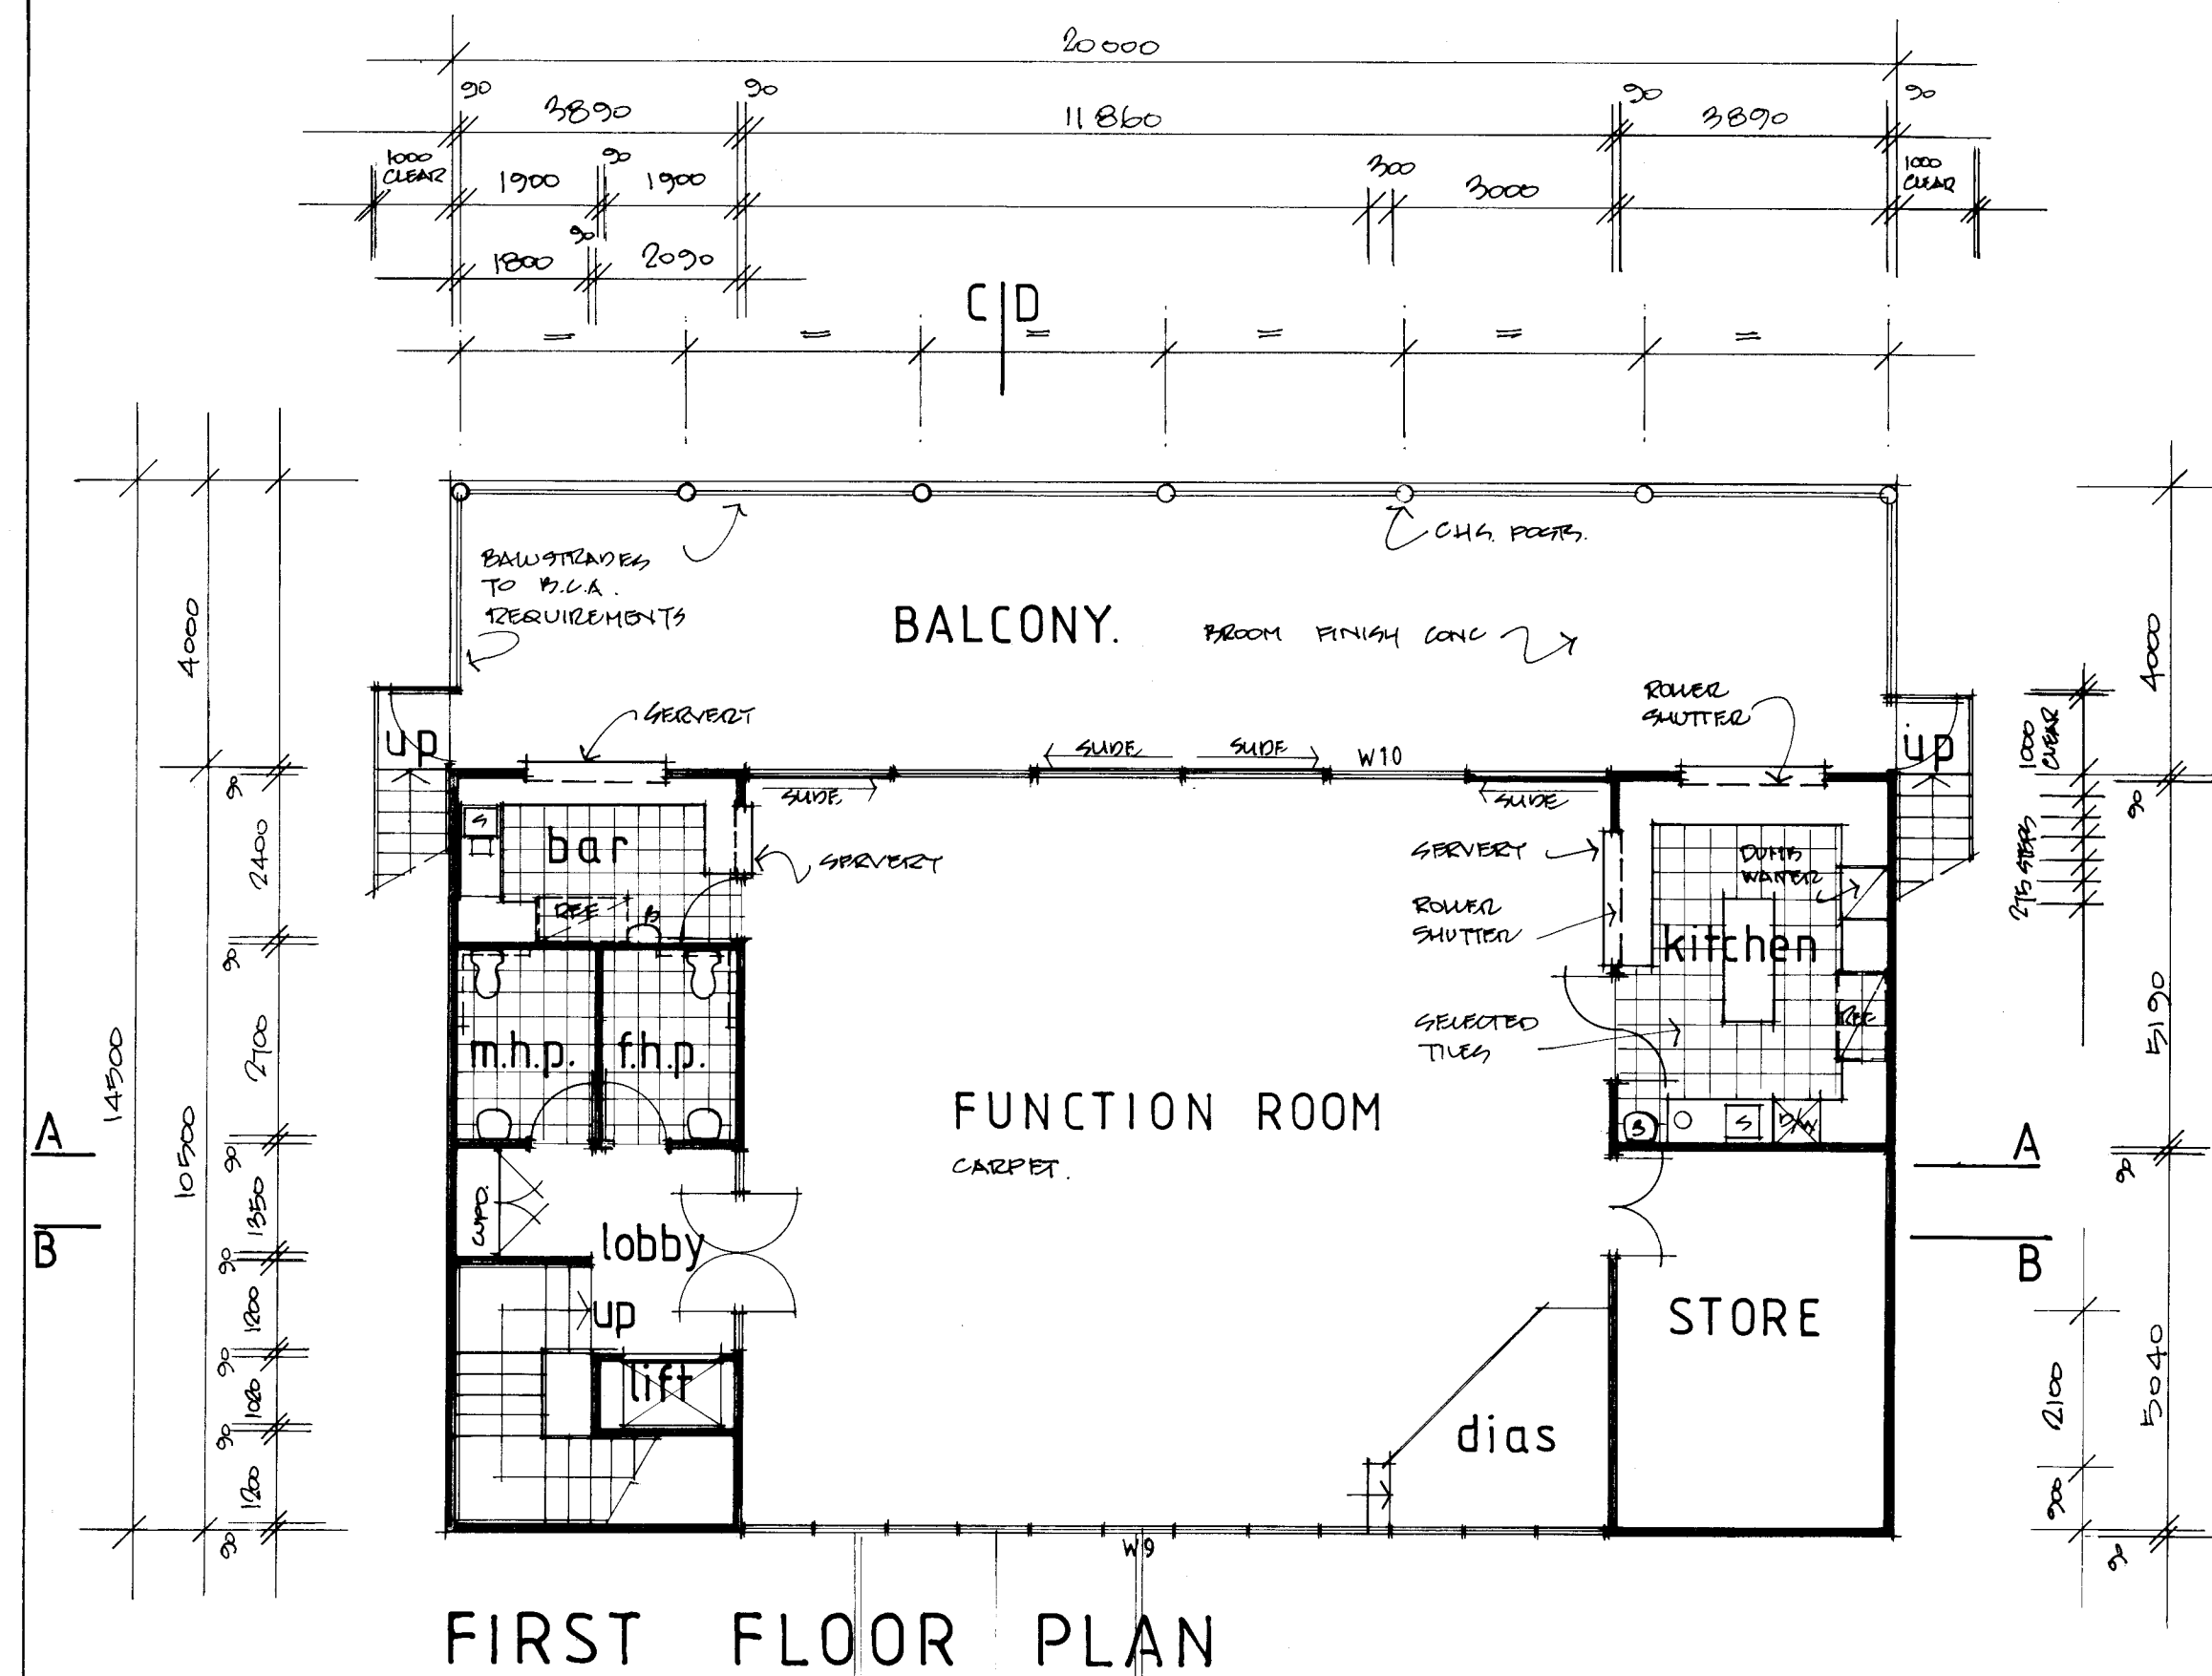

REFLECTED CEILING PLAN FIRST FLOOR
SHOWING ELECTRICAL LAYOUT.

LEGEND :

- NON DIMMABLE 40W L.E.D. 1200 X 900 LIGHT PANEL FLUSH MOUNTED ON CEILING.
COMBINATION LIGHT / EXHAUST FAN. MOTION SENSOR (SENSEWAVE) WITH TIMER.
LED DOWNLIGHT, WHERE NO SWITCHING SHOWN - SWITCH BY MOTION SENSOR.
LOW BULKHEAD FITTING - SENSEWAVE WITH PHOTO ELECTRIC CELL & MOTION SENSOR.

- | | |
|---|---|
|  | SELF ILLUMINATED EXIT SIGN |
|  | EMERGENCY LIGHT FITTING CEILING MOUNTED. |
|  | DOUBLE GENERAL PURPOSE OUTLET. |
|  | PERMANENT CONNECTION FOR LIFT, COOL ROOMS, & C/P PLANT & H.W.G. |
|  | INDICATES SWITCHING POINT. |
|  | INDICATES 2 WAY SWITCHING. |
|  | INDICATES LIGHTS TO BE DIMMABLE. |
|  | SW. BOARD. |

NOTES :

- ELECTRICAL LAYOUT IS INTENDED AS GUIDE ONLY CONTRACTOR MUST VISIT SITE TO DETERMINE FULL EXTENT OF WORK REQUIRED.
- ALL FITTINGS, SWITCHES, MOUNTING HEIGHTS ETC. ARE TO BE APPROVED BY JOB SUPERINTENDANT.
- ALL WORK IS TO COMPLY WITH LOCAL SUPPLY AUTHORITY REQUIREMENTS & CURRENT BEST PRACTICES.

SCHEDULE OF ESSENTIAL SERVICES.

- * BUILDING IS LESS THAN 500 SQ.M. ∴ NO HYDRANT SERVICE IS REQUIRED
- * 1 x 30 M FIRE HOSE REEL WILL BE INSTALLED WHERE SHOWN TO COMPLY WITH A.S. 2441
- * EXT. SIGNS OF EMERGENCY LIGHTS ARE TO BE INSTALLED WHERE SHOWN OR REQUIRED TO COMPLY WITH A.S. 2293
- * FIRE EXTINGUISHERS WILL BE INSTALLED & MAINTAINED BY AN APPROVED CONTRACTOR/ WORKSMAN OR EQUIV. DETAILS TO BE FORWARDED TO LOCAL SANITATION COUNCIL.

SEDIMENT & EROSION CONTROL
observations :

- * SITE IS FULLY ESTABLISHED @ LEVEL
 - * NO CUT & FILL WILL BE REQUIRED FOR THIS PROJECT
 - * THE ONLY EXCAVATION REQUIRED WILL BE FOR FOOTINGS
 - * THIS SOIL WILL BE RE-USED ON SITE.
- measures reqd:
- * NO SEDIMENT & EROSION CONTROL MEASURES SHOULD BE NECESSARY FOR THIS PROJECT.

measures reqd:

- * NO SEDIMENT & EROSION CONTROL MEASURES SHOULD BE NECESSARY FOR THIS PROJECT.

LANDSCAPING :


- * NOT APPLICABLE FOR THIS PROJECT.

SECTION J COMMITMENTS:

- * REFER ATTACHED REPORT BY "ENERGY TITANS" P/U

AREAS:

SITE	700,000 S/M M APP
GROUND FLOOR	210 S/M
FIRST FLOOR	210 S/M
FIRST FLOOR BALCONY	80 S/M
TOTAL	800 S/M



THIS PLAN IS SUBJECT
TO COPYRIGHT LAW &
MUST NOT BE REPRODUCE
WITHOUT WRITTEN
AUTHORITY

Job: PROPOSED STAGED UPGRADE
AT COOLAMON SHOWGROUND
WILDMAN STREET COOLAMON¹
FOR COOLAMON SHIRE COUNCIL

Dwg: _____
WORKING DRAWING

ALLEN C. THOMPSON

 BUILDING DESIGNER

RDANSW

2 BEAUTY POINT AVENUE
WAGGA WAGGA 2650
PHONE (02) 6925 2028
EMAIL: acimthompson@gmail.com

Specialising in:
RESIDENTIAL
COMMERCIAL
INDUSTRIAL
NEW & EXTENSIONS

SCALE: check all dimensions
1:100 figured dimensions to be
taken in preference to scale

Date: Nov 2021

2138-7A