


PK-008A AND PK-008B
NaOCl DOSING PACKAGE
Concentration: 10-15 % w/w
Dosing pump No.:2
Flow rate: 7.5 l/h
Tank Capacity: 150 lit
Tank material: LLDPE
Max. Op. Press.: 16 bar

PK-009A AND PK-009B
NaOH DOSING PACKAGE
Concentration: 50 % w/w
Dosing pump No.:2
Flow rate: 7.5 l/h
Tank Capacity: 150 lit
Tank material: LLDPE
Max. Op. Press.: 16 bar

PK-010
PACI DOSING PACKAGE
Concentration: 40 % w/w
Dosing pump No.:1
Flow rate: 7.5 l/h
Tank Capacity: 150 lit
Tank material: LLDPE
Max. Op. Press.: 16 bar

PK-011
CARBON DOSING PACKAGE
Source:D-Nitro UV
BOD:0.61 kg/L
Dosing pump No.:1
Flow rate: 7.5 l/h
Tank Capacity: 150 lit
Tank material: LLDPE
Max. Op. Press.: 16 bar

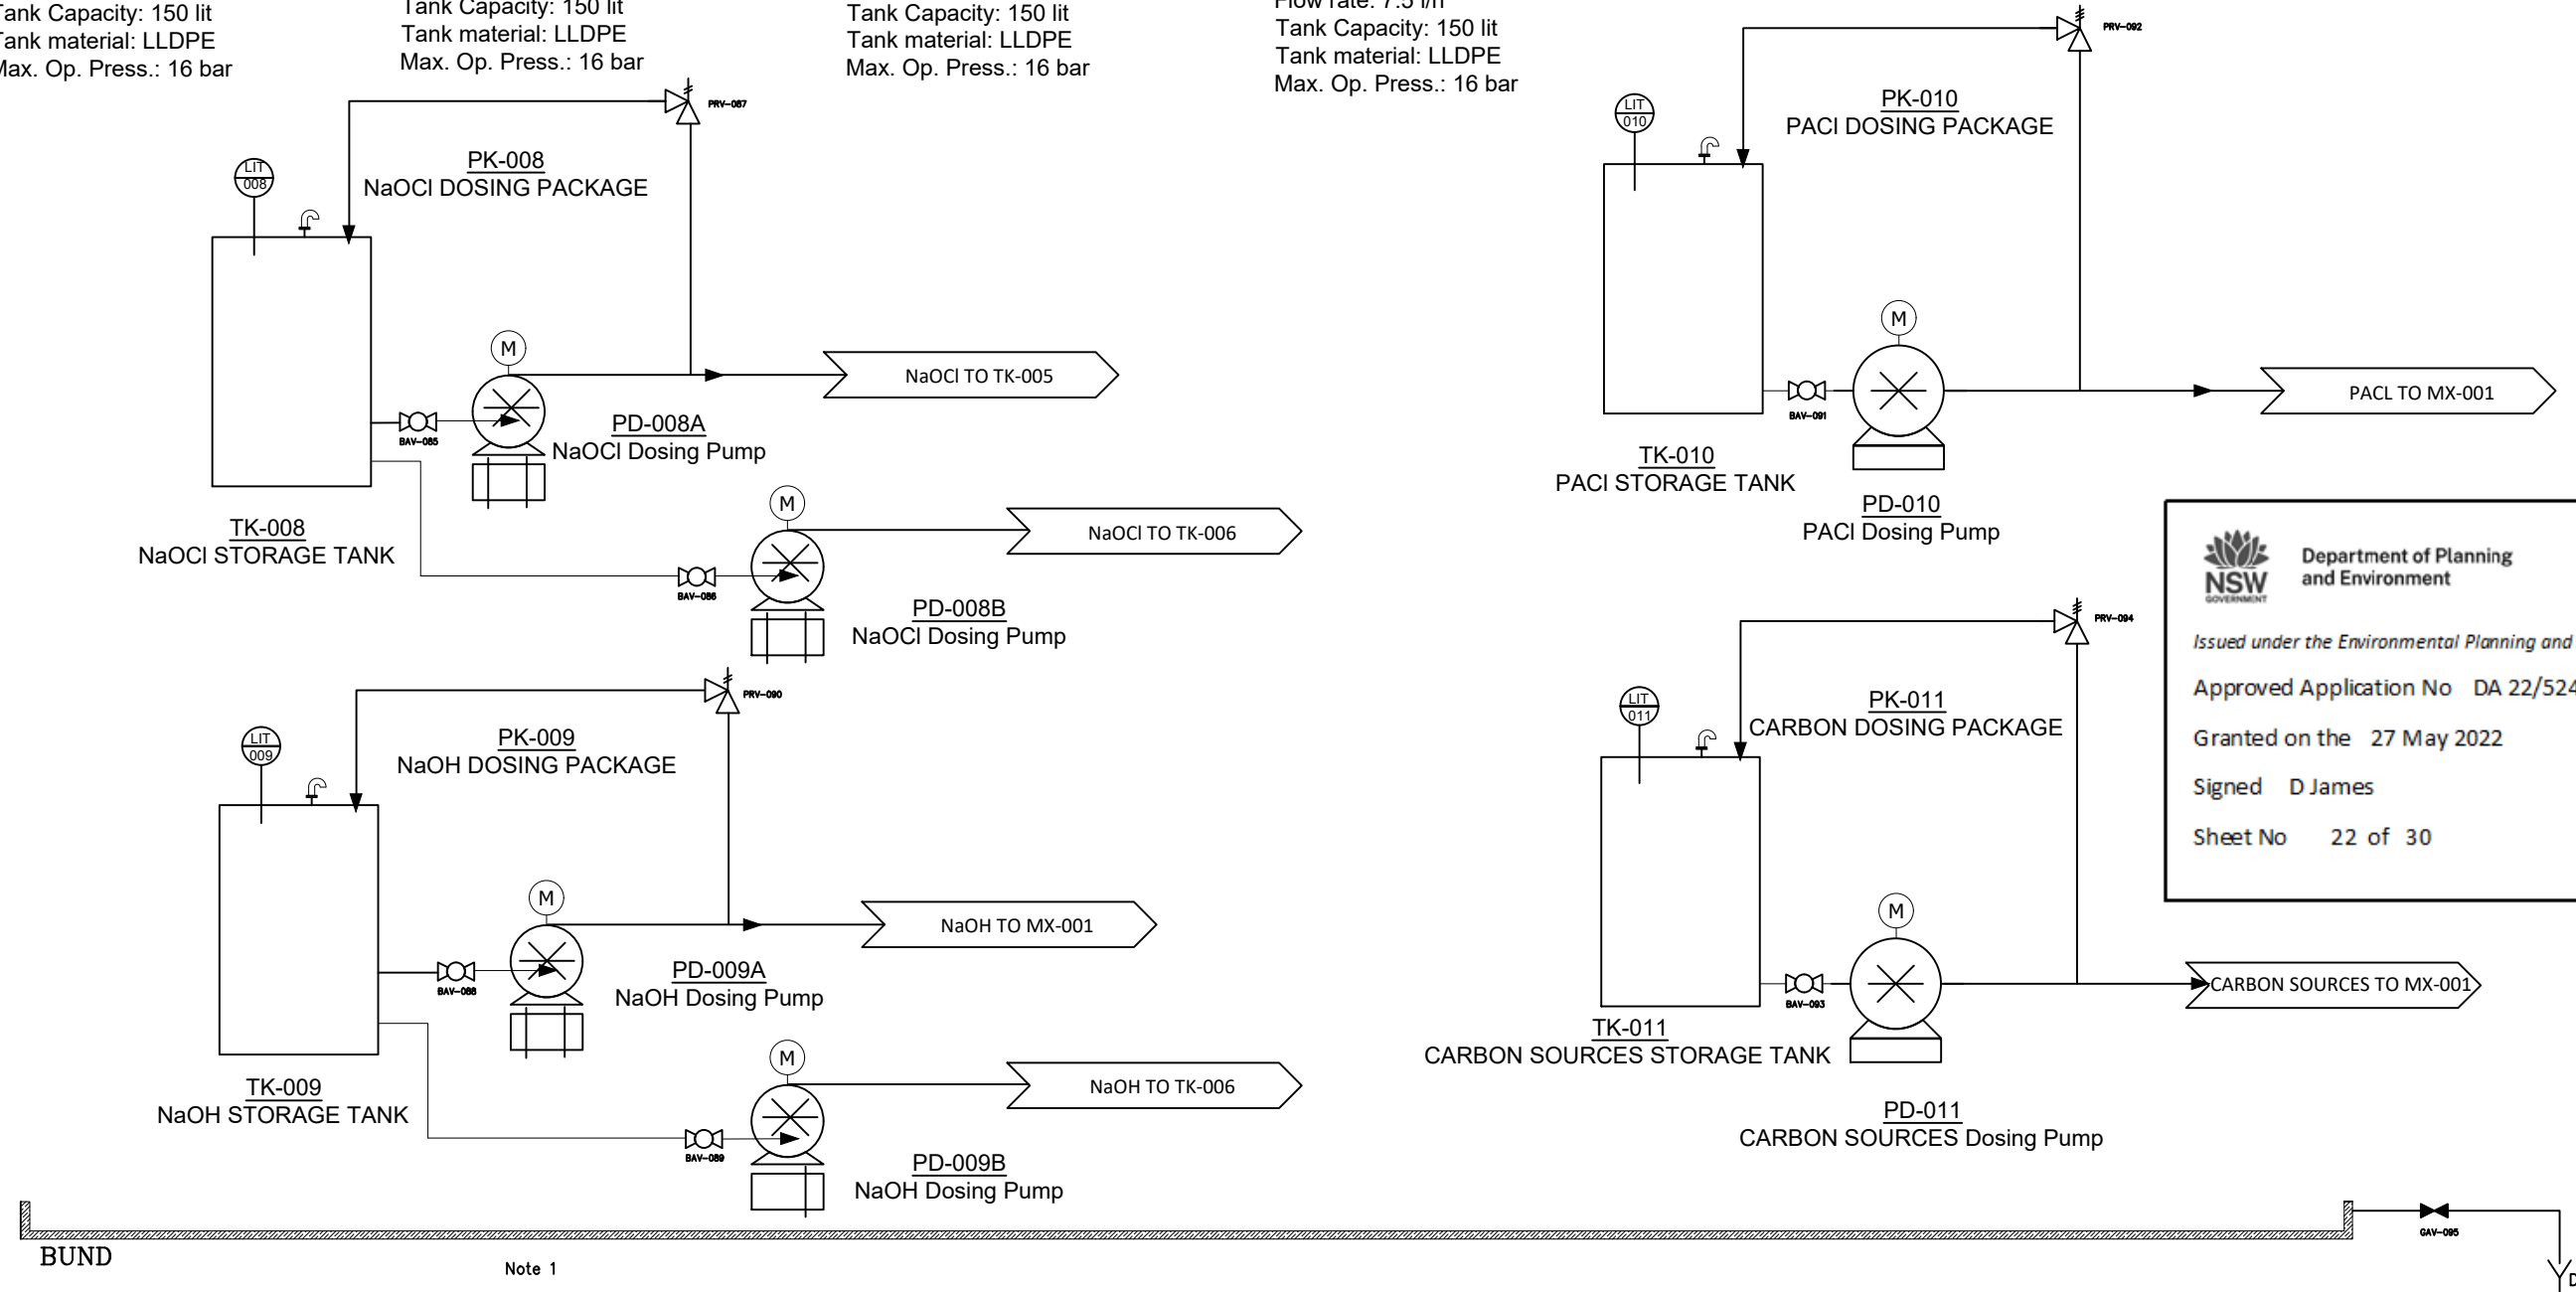

NSW
GOVERNMENT

Department of Planning
and Environment

Issued under the Environmental Planning and Assessment Act 1979

Approved Application No DA 22/5248

Granted on the 27 May 2022

Signed D James

Sheet No 22 of 30

GENERAL NOTES:

Note 1-Bund for the CEB is considered as individual.

FOR APPROVAL



SCALES							CHECKED BY		CLIENT:	CONSULTANT:	PROJECT & DRAWING TITLE	
							NAME:				Selwyn Snow Resort STP P&ID	
		07	ISSUED FOR CONSTRUCTION	21.03.22	J.T.		DATE:					
		06	UPDATED FOR 90% DESIGN –FOR APPROVAL	14.12.21	J.T.		SIGNATURE:					
		05	ISSUED FOR 30% DESIGN –FOR APPROVAL	07.06.21	T.G.		-					
		04	ISSUED FOR 30% DESIGN –FOR APPROVAL	07.06.21	T.G.		FOR CONSTRUCTION					
		03	ISSUED FOR 30% DESIGN –FOR APPROVAL	07.06.21	T.G.		NAME:					
		02	ISSUED FOR 30% DESIGN –FOR APPROVAL	28.05.21	T.G.		DATE:					
		01	ISSUED FOR 30% DESIGN –FOR APPROVAL	04.2021	T.G.		SIGNATURE:					
		00	ISSUED FOR 30% DESIGN –FOR APPROVAL	04.2021	T.G.		RPEQ No.					
ORIG. SIZE A3	REV	DESCRIPTION		DATE	DWN	APP	THIS DRAWING REMAINS THE PROPERTY OF DEMEM-AKWA REPRODUCTION OR DISSEMINATION OF ANY KIND IN ANY FORMAT IS STRICTLY FORBIDDEN WITHOUT AUTHORISED APPROVAL					
	REVISIONS											
									DRAWING NUMBER		REVISION	
											07	

07