

DESIGN CHECKED AND CERTIFIED BY
ANSARY CONSULTING ENGINEERS
Tarek El-Ansary
BE(Civil) MEngSc(Civil) MIEAust CPEng.
Signed: _____ Date:28/03/2022

Tarek El-Ansary



FRAME LOCATION

MIN EMBEDDMENT
100mm TO
COREFILLED
MASONRY

4/M10 ANKA SCREWS THROUGH
50x6 EA TOP MOUNT, MIN
EMBEDDMENT 75mm

MIN 75mm
EMBEDDMENT

4/M12 CHEMICAL
ANCHORS THROUGH
STONECLADDING TO
COREFILLED MASONRY

50x6 EA UPRIGHTS 4/M12
CHEMICAL ANCHORS AT
EQUALLY SPACED

A30-323 PLACED ON
TOP OF BASE FRAME
MESH SEE SECTION
FOR SPAN DIRECTION

100x50x3 RHS BASE
FRAME WITH 75x50x2
JOISTS AT 600 CRS

50x3 SHS
BRACING


25NB PIPE SLEEVE OR
SPACER WHERE
REQUIRED FOR UNEVEN
MOUNTING SURFACE

50x3 SHS FRONT
UPRIGHTS

2132 OVERALL FRAME

32
100

SIDE ELEVATION

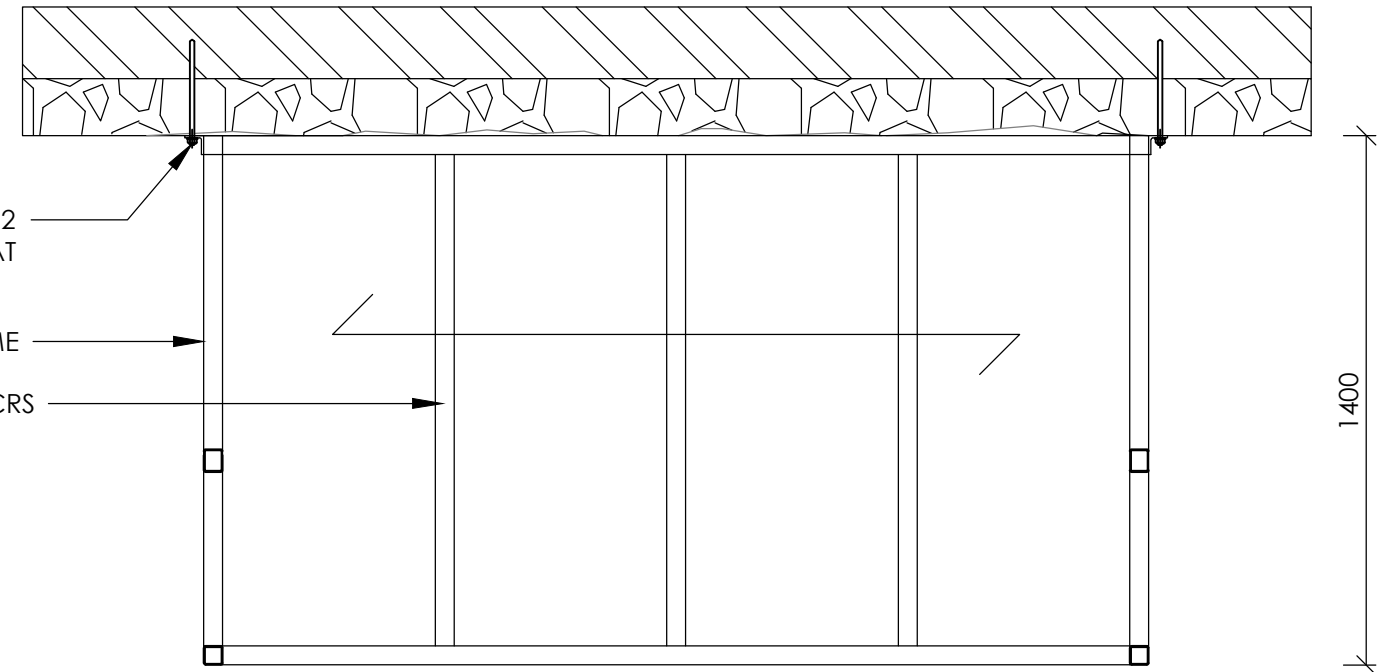


SECTION
Scale 1:20

1
-

2500

2600

2500

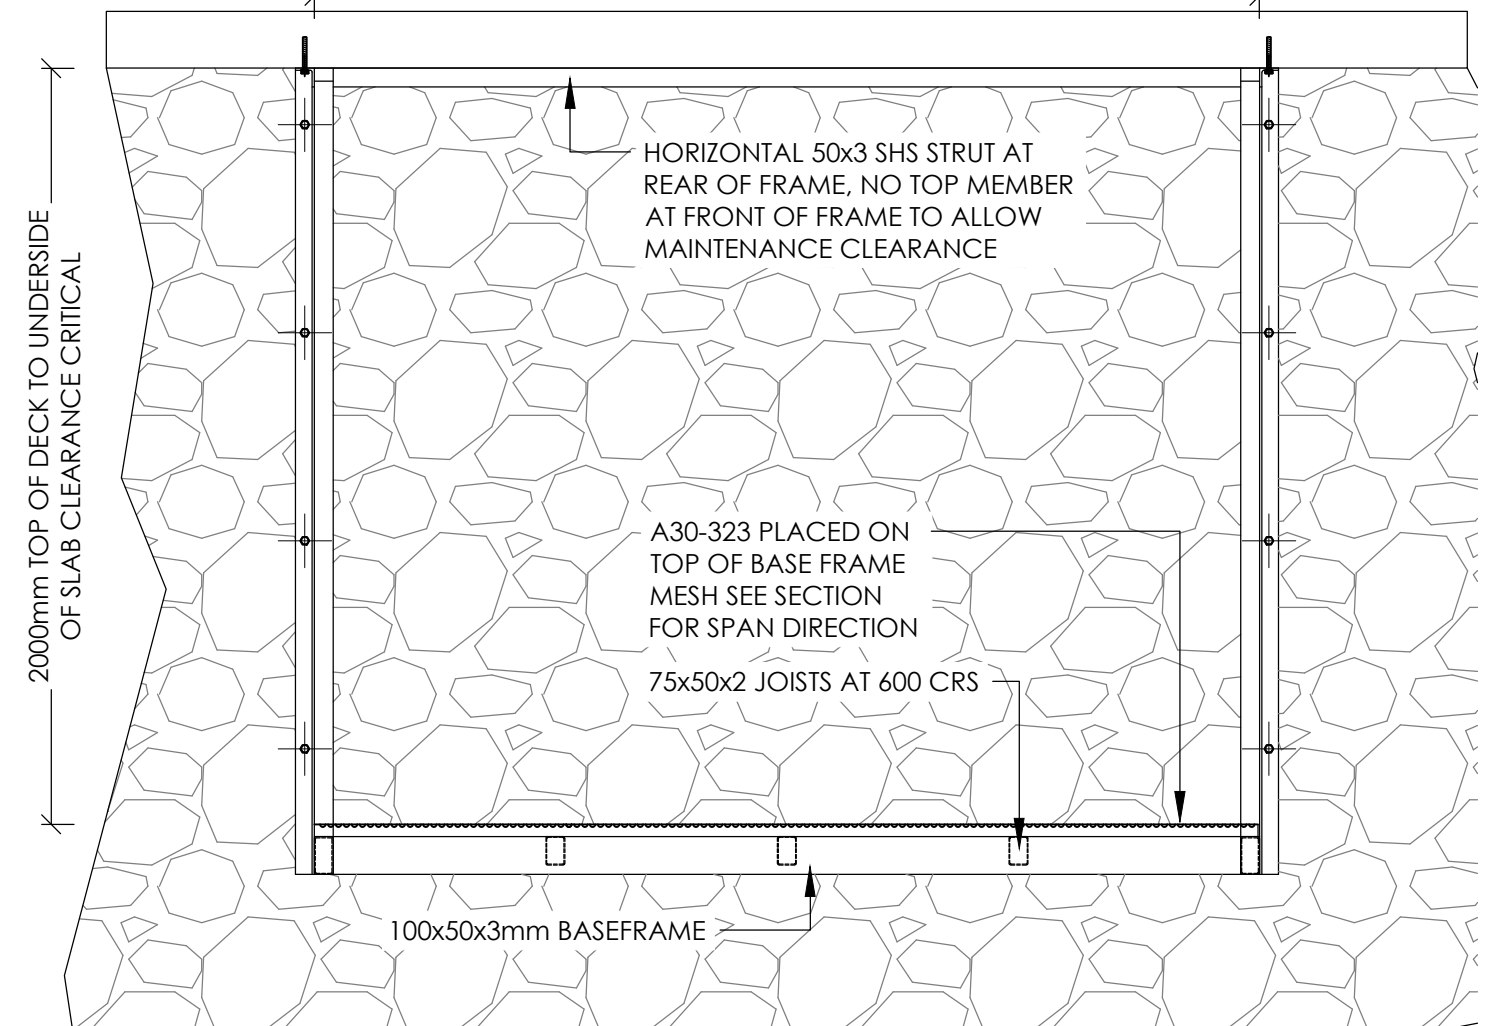

FRONT ELEVATION



Director: PAUL LARKIN
Email: paul@groundedeng.com
Mobile: 0429 071 387
PO Box 220 Jindabyne NSW 2627

Project: GUTHEGA INN HEAT PUMP INSTALL
GUTHEGA INN, GUTHEGA
NSW 2624

Client: GUTHEGA INN

Draftsman: S.WAKEFORD
Contact: 0429 071 387

Checked: PL


DATE: 23-3-22

Drawing Title:
HEAT PUMP MOUNTING FRAME

Drawing Number: S01

Revision: A

Sheet 2 of 2



SCALE: VARIES

SIZE:
A3