


A suitably experienced and qualified engineer is required to inspect the foundation material during construction and verify that an allowable bearing pressure of not less than 200kN/m^2 is achieved.

 Department of Planning
Housing and Infrastructure

Issued under the Environmental Planning and Assessment Act 1979


Approved Application No DA 22/12013

Granted on the 29 February 2024

Signed D James

Sheet No 37 of 60

Shape	Item	Pieces	W/mm	length	weight
	1	7	12	2.65 m	15 kg
	2	6	12	2.65 m	13 kg
	3	4	12	2.65 m	9 kg
	4	6	12	2.65 m	13 kg
	5	4	12	2.65 m	9 kg
	6	7	12	2.65 m	15 kg
	7	4	12	2.65 m	9 kg
	14	15	16	5.25m	199 kg
	15	13	16	3.90 m	166 kg
	16	19	12	5.25 m	80 kg
	17	23	12	3.90 m	84 kg
	18	12	12	5.50 m	56 kg
	20	12	12	3.50 m	39 kg
	22	8	12	1.70 m	11 kg
	23	4	10	5.65 m	28 kg
	24	2	35	ITEM NO. DELIVERY BY DIFFERENT PR.	
	25	8	12	1.90 m	13 kg
	26	16	16	1.50 m	18 kg
TOTAL WEIGHT::				743 kg	

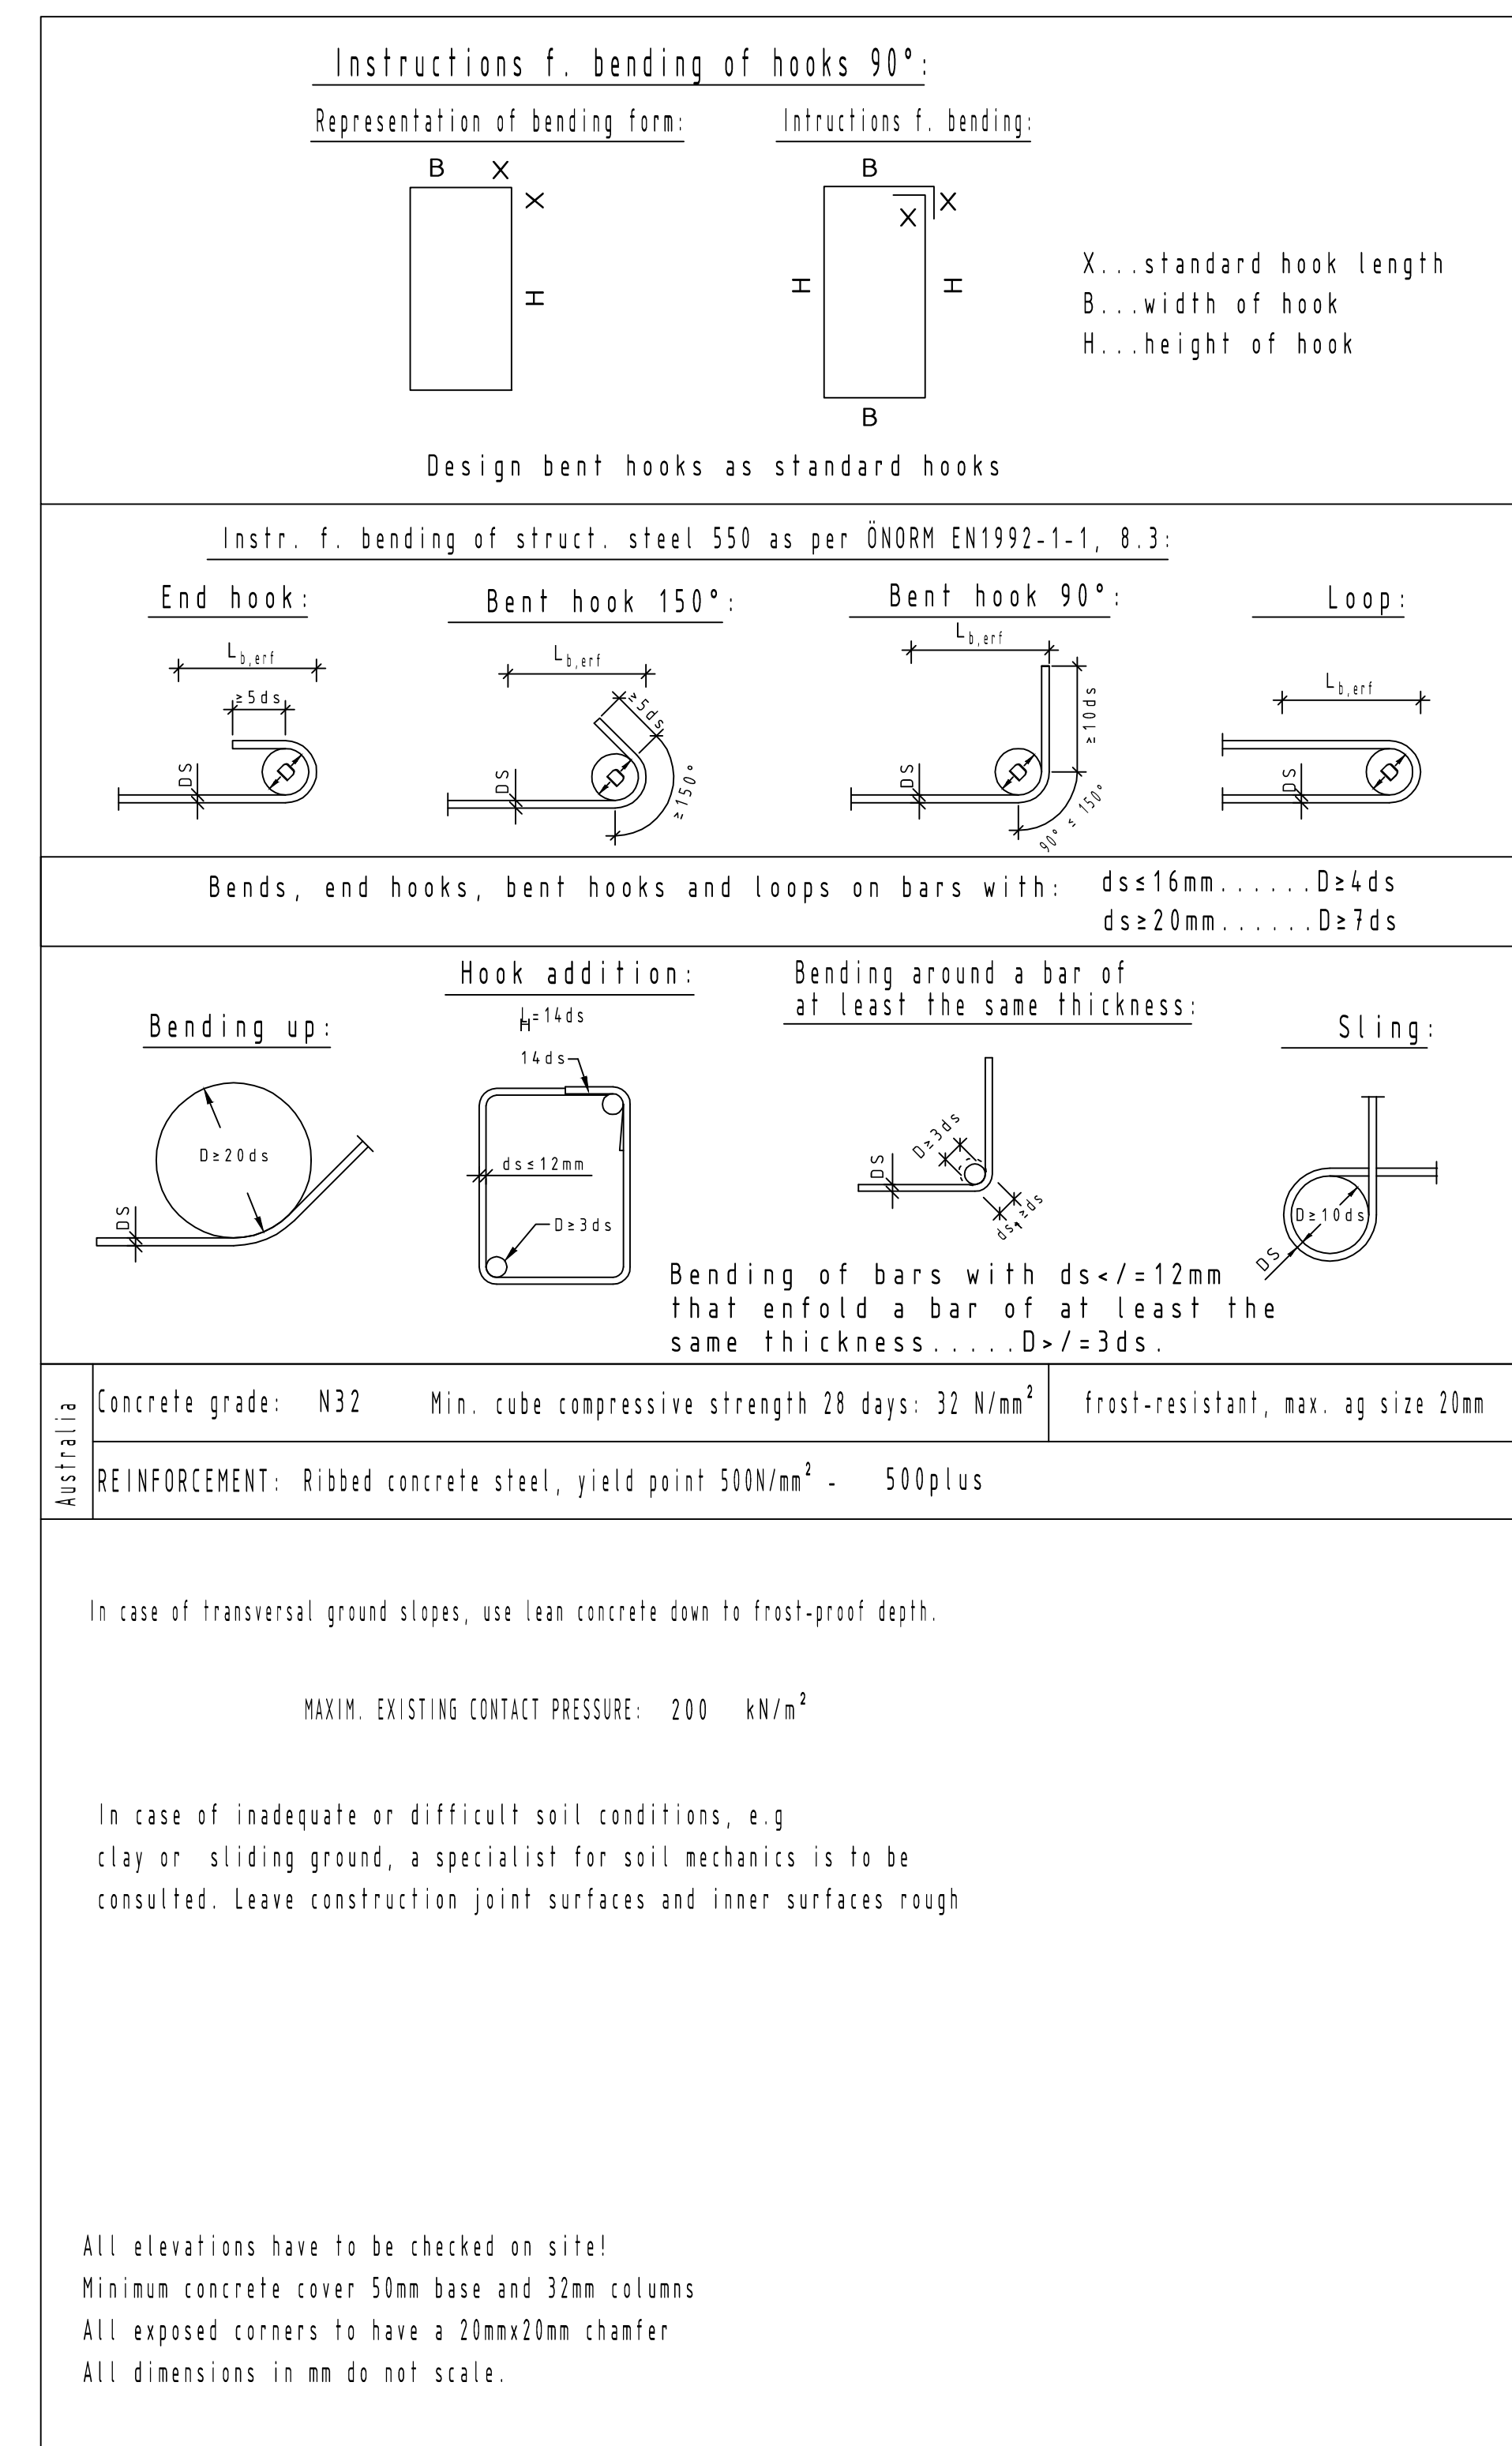


Remarks :

The company executing the works is obliged to point out any inconsistencies between this drawing, the architect's drawings or drawings of other expert engineers resp. the local conditions on the constructions site.

IMPORTANT:

The drawing is only schematic!
Only the dimensions are applicable!

$$\begin{aligned} V_{\text{column}} &= 3.4 \text{ m}^3 \\ V_{\text{base}} &= 8.1 \text{ m}^3 \\ V_{\text{hold}} &= 0.4 \text{ m}^3 \\ V_{\text{total}} &= 11.9 \text{ m}^3 \end{aligned}$$

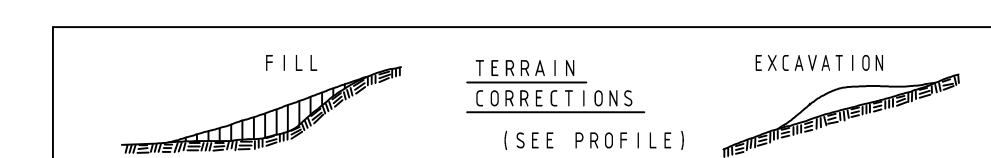

IMPORTANT: Take into account the geotechnical engineering assessment

when executing the construction works of the foundation!



ENSURE FOUNDATION HAS EARTH BONDING

The foundation must be completely back-filled in equal layers on the entire surface below the CTF height.

The backfill load was considered in the calculation. - specific weight 16 kN/m³

DISTANCE CTF TO GROUND: 610 mm

If the weight of backfill cannot be carried out in the hereby specified size, the load must be applied in a different way (e.g. concrete load)

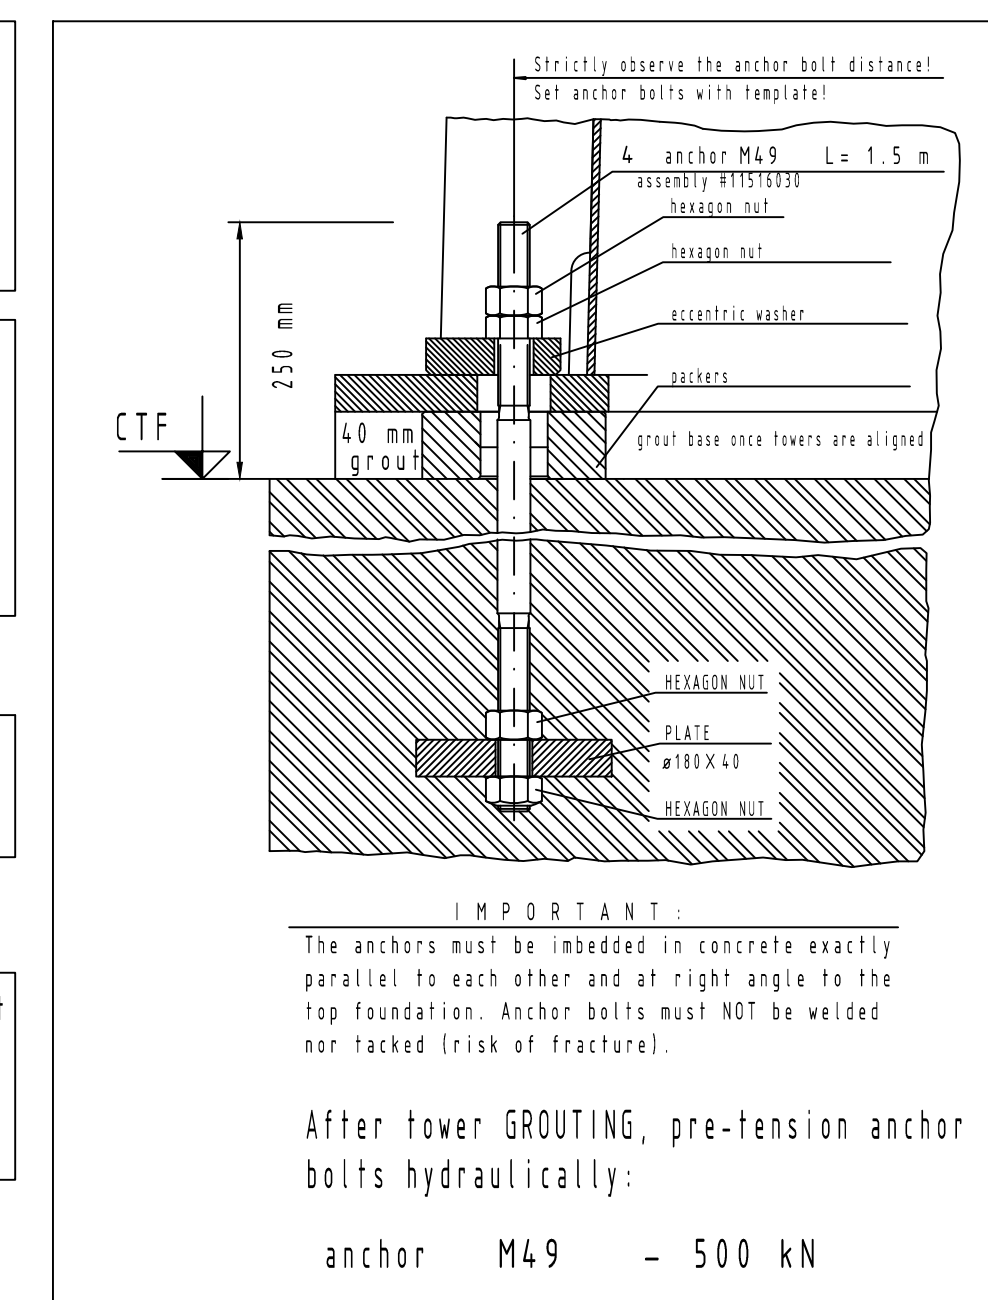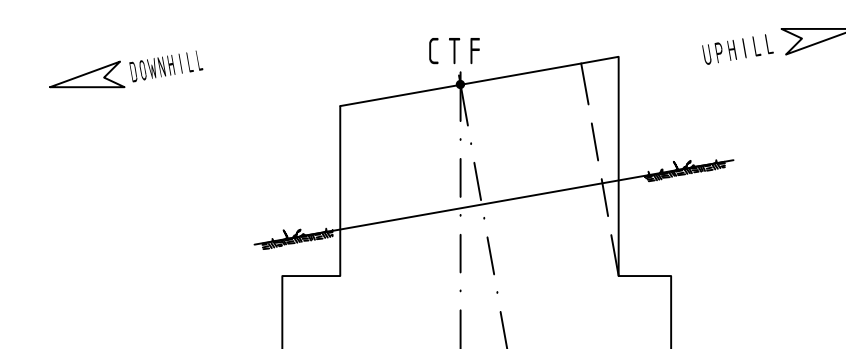

4 anchor M49 delivery
+ template for concrete work Doppelmayr

left Installation 0deg INCLINATION

The foundations must be surveyed in terrain exactly according to the specified CTF heights and lengths
 CTF length: = 50 mm, CTF HEIGHT: = 30 mm, Grass width: = 20 mm, angle: = 0.5° ;
 N.B.: The foundation dimensions are absolute minimum requirements!

[illegible]

This drawing is intellectual property of DIFFELMAYR Australia Pty Ltd and must not be copied nor utilized in whole or in part without permission.

AC