
Selwyn Snow Resort - Route of Water Pipe from Wastewater Treatment Plant to Water Storage Quarry

2m wide trenching corridor for installation of 75mm PE Pressure Pipe in a trench width of 300mm & depth of 500mm

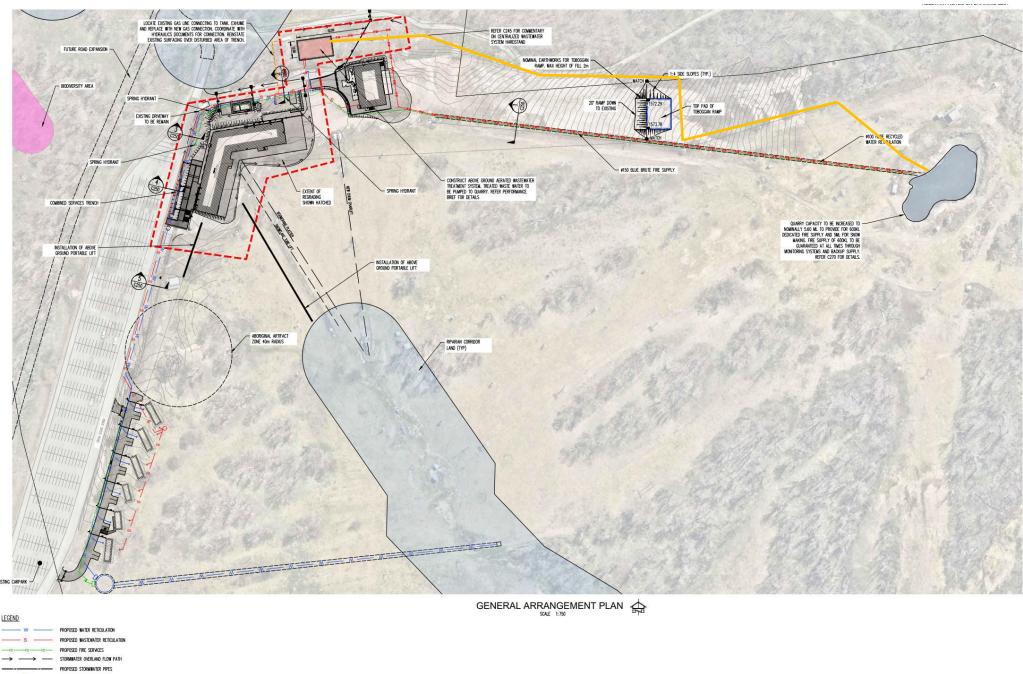

H PROPOSED FIRE HYDRANT