



# ONSITE WASTEWATER REPORT

---

## PROPOSED RURAL RESIDENTIAL SUBDIVISION DEVELOPMENT AT 83 FOTHERINGAY ROAD, CLARENCE TOWN

---

GSL Environmental

Authored by: Simon Doberer B.Sc. (ENV) Job

Reference #: 27821 - A1


Date: 22nd September 2021

## Limitations

This report has been developed based on agreed requirements between the client and GSL Environmental as understood by GSL Environmental at the time of investigation. This report only applies to the subject scope of works undertaken at the subject site. Other interpretations should not be made, including changes of scope or application to other projects. The contents of this report are based on a professional appraisal of the conditions that existed onsite at the time of this investigation. Where a subsurface soil investigation has been undertaken the results are only applicable to the specific sampling locations and the depths undertaken. Because of natural geological variability and possible anthropogenic influences, the subsurface conditions reported can change abruptly. Such changes can also occur after the site investigation has been undertaken. The accuracy of the results provided in this assessment is limited by these possible variations along with limitations by budget constraints imposed by others and by inadequate site accessibility.

## Copyright

The contents, structure, data, findings and conclusions of this report remain the intellectual property of GSL Environmental and must not be reproduced in part or full without the formal permission of the Author. Permission to use the report for the specific purpose intended in is granted to the Client identified above on condition of full payment being received for the services involved in the preparation of the report.

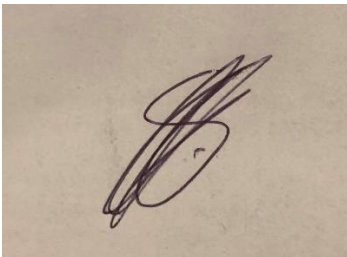A handwritten signature in dark ink on a light-colored, textured background. The signature is stylized, featuring a large, looped 'S' and 'D'.

Simon Doberer  
Principle Environmental Scientist  
B.Sc. (ENV)

## **Contents**

<b>1. Introduction .....</b>	<b>4</b>
<b>2. Site Description .....</b>	<b>4</b>
<b>3. Site Information .....</b>	<b>6</b>
<b>4. Physical Site Assessment .....</b>	<b>7</b>
<b>5. Onsite Soil Assessment .....</b>	<b>17</b>
<b>6. System Design/Selection .....</b>	<b>26</b>
<b>7. Cumulative Impact.....</b>	<b>30</b>
<b>8. Recommendations.....</b>	<b>31</b>

## 1. Introduction

GSL Environmental has been commissioned by Perception Planning on behalf of Digby Rayward to assess the suitability of an on-site sewage management system for the proposed six lot rural residential subdivision at 83 Fotheringay Road, CLARENCE TOWN NSW. This report will be submitted to Dungog Council in accordance with the relevant details in the 'Dungog Council Onsite Sewage DAF 2015'. Other guiding documents include

- Australian Standard AS1547: 2012 "On-site Domestic Wastewater Management"
- Dept. Local Government 1998, On-site Sewage Management for Single Households
- Water NSW, "Designing and Installing Onsite Wastewater Systems", 2012

This assessment is required to show that treated wastewater generated by the proposed allotments from the subdivision can be sustainably managed on the site.

## 2. Site Description

The subject allotment is irregular in shape and approximately 15.5 hectares in size. The majority of the site is gently inclined and in amid slope landform. The far east of the site drops significantly down towards the Williams River. The proposed EDAs have been located within gently inclined mid slope landscapes. The closest significant water body, the Williams River flows to the immediate east of the site. There is a number of overland flow paths traversing the site.

According to the Port Stephens 1:100 000 Soil Map the proposed dispersal areas onsite are underlain by "Clarencetown" residual soils. The Clarencetown Soil Landscape areas generally consist of undulating low hills on Carboniferous sediments in the Clarencetown Hills region. Slope gradients are generally between 5 - 15%. Underlying soils mostly consist of brown earthy sandy loams traversing to yellowish brown clays.

The proposal is for a six lot rural residential subdivision, proposed plans in Appendix B. As at subdivision stage the new allotments have been designed for 5 bedroom residences.

### Existing Wastewater Treatment Onsite

On proposed lot 6 is an existing residence and existing 1 bedroom granny flat type structure. Both wastewater sources are being serviced by septic tanks followed by absorption areas. The granny flat septic tank and absorption has been recently installed and as such the absorption area for this wastewater source is sized within this report to make that system compliant.





**Figure 1:** Subject Site, care of six maps showing property boundaries and associated landmarks.

### 3. Site Information

Site Address: 83 Fotheringay Road, CLARENCE TOWN

Water Supply: Town

Proposed Development: Six lot rural residential subdivision

Equivalent Population: Up to 10 persons/day – 5 habitable room residence – Proposed Allotments  
Up to 2 persons/day – 1 habitable room residence – Existing granny flat

Wastewater Flow Allowance: 150L per person per day

Design Flowrate: 1500L per day – Proposed Allotments  
300L per day – Existing Granny flat Structure

Proposed Effluent Dispersal Type: Sub-Surface Drip – Proposed Allotments  
Sub-Surface Absorption– Existing Granny flat Structure

System Design: Aerated wastewater treatment system – Proposed Allotments  
Septic Tank – Existing Granny flat Structure

Most restrictive Soil Texture: Clays, at depth

Minimum Dispersal Area: 654m<sup>2</sup> - Proposed Allotments  
37.5m<sup>2</sup> - Existing Granny flat Structure

Buffer Distances: All required buffer distances can be achieved without any variation required.

## 4. Physical Site Assessment

A site inspection was undertaken on the 2<sup>nd</sup> September 2021. The fieldwork included an assessment of the site's physical parameters as well as hand excavation of boreholes to determine the underlying soil structures. This was undertaken to delineate the most suitable location for the proposed dispersal area. Potential onsite limitations have been investigated and are discussed below.

### 4.1 Landform

Varying landforms pose differing potential limitations to an effluent dispersal area. Risk of run-on and runoff may be enhanced dependent on the site's landform.

The proposed EDAs have been located within gently inclined mid slope landscapes.

Limitation: **LOW**

### 4.2 Slope Gradient

Excessive slope within an EDA can potentially lead to effluent leaching away from the EDA.

The proposed EDAs have been located within gently inclined mid slope landscapes. The EDAs have slope gradients between 4 – 8%.

Limitation: **LOW**

### 4.3 Exposure

Providing the EDA with maximum wind and sun exposure is preferable. This will enhance the evapotranspiration properties of the EDA and should add to the life of the EDA.

The proposed EDAs are within areas of very high exposure.

Limitation: **LOW**

### 4.4 Flood Potential

The proposed AWTS and dispersal area will be located above the council given flood planning levels. Some areas onsite are considered flood prone lands. As such the proposed EDAs are not to be in these locations. Subsurface irrigation is recommended to minimise any spray drift from leaching from the EDA into levels below the flood planning levels.

The proposed EDAs are outside of any flood planning levels and above the 1:20 Flood level.

Limitation: **MODERATE**

#### **4.5 Vegetation**

All effluent dispersal areas should be covered with vegetation or mulch-based covers. A vegetated EDA provides the possibility of that area in enhancing nutrient uptake and evapotranspiration. Low vegetation cover can cause effluent runoff and low nutrient and evapotranspiration uptake rates.

The proposed EDAS are located within areas of good grassland vegetation coverage.

Limitation: **LOW**

#### **4.6 Stormwater Run-on**

Stormwater runoff through the EDA has the potential to transport effluent away from the EDA to more sensitive receivers.

There were no visible signs of stormwater entering the proposed EDAs. The proposed EDAs have been located within gently inclined mid slope landscapes. The EDAs have slope gradients between 4 – 8%.

Limitation: **LOW**

#### **4.7 Site Drainage**

Damp and wet areas should be avoided for EDAs. These areas indicate seepage of waters and could become a transport option for effluent if placed in these areas.

Site appears to be well drained with semi-permeable soils. No visible signs of wet/damp areas in the proposed EDA. The soil profile did not show evidence of water logging

Limitation: **LOW**

#### **4.8 Erosion Potential**

Areas of visible soil movement and erosion should be avoided.

No visible signs of erosion within the EDA. Proposed EDA areas are vegetated and gently inclined.

Limitation: **LOW**

#### 4.9 Evidence of Fill

No evidence of fill was seen onsite or in the excavated boreholes. Soil logs are consistent of the description for underlying soils within the Clarencetown Soil Areas.

Limitation: **LOW**

#### 4.10 Groundwater Depth

Groundwater not observed in bore holes.

Limitation: **LOW**

#### 4.11 Surface Rock

No surface rock was observed within the proposed EDAs. Boreholes were excavated to 1m. There was some residual river pebbles within some of the boreholes onsite. It is recommended these rocks be scarified out of the EDA area before the irrigation is installed.

Limitation: **MODERATE**

#### 4.12 Groundwater Bores

A search of Water's all groundwater mapping was undertaken to determine the proximity of any bores to the EDAs. There are no domestic bores within 250m of the proposed EDAs.

Limitation: **LOW**

#### 4.13 Watercourse Proximity

The closest significant water body, the Williams River flows to the immediate east of the site. There is a number of overland flow paths traversing the site. There is also a number of farm dams onsite. Recommended setbacks to these water bodies from the EDA will be met.

Spray irrigation is not to be used. This report proposes that subsurface irrigation be installed as the EDA on the subject site. Treatment is to be provided via a NSW Health accredited AWTS. The secondary effluent is further treated during the subsurface absorption/transpiration processes. These measures will help the effluent to not leach from the proposed EDA.

Limitation: **MODERATE**



#### 4.14 Stock Present

Stock can cause damage to irrigation systems and must be kept out of the EDA by fencing or other physical barrier.

#### 4.15 Buffer Distances

All buffer distances in accordance with the required buffer distances within AS 1547 will be achieved.

Limitation: **LOW**

Buffer distances from the EDA are required to minimise risk to public health, maintain public amenity and protect sensitive environments. Table below from 'Dungog Council Onsite Sewage DAF'.

**Table 6-8 Minimum Buffer Distances for On-site System Land Application Systems**

System / Land Application Type	Limiting Factor	Minimum Buffer Distance (m)
<b>All Land Application Systems</b>	Permanent surface waters such as: Lakes, rivers, creeks and streams	➤ 100m
	Domestic groundwater wells and bores	➤ 250m
	Other waters such as: Farm dams, intermittent waterways and drainage channels	➤ 40m
	Retaining wall, embankments, escarpments and cuttings.	➤ 15
<b>Surface Spray Irrigation (Standard Spray Heads)</b>	Driveways and property boundaries	➤ 6m if area up gradient ➤ 3m if area down gradient
	Dwellings and buildings	➤ 15m
	Paths and walkways	➤ 3m
	Swimming pools	➤ 6m
	Retaining wall, embankments, escarpments and cuttings.	➤ 12m if area up gradient ➤ 3m if down gradient
<b>Surface Drip and Trickle Irrigation</b>	Dwellings and buildings, swimming pools, property boundaries and driveways. Retaining wall, embankments, escarpments and cuttings.	➤ 6m if area up gradient ➤ 3m if area down gradient
<b>Subsurface Irrigation</b>	Dwellings and buildings, swimming pools, property boundaries and driveways Retaining wall, embankments, escarpments and cuttings.	➤ 6m if area up gradient <sup>1</sup> ➤ 3m if area down gradient <sup>1</sup>
	Depth to Hardpan or Bedrock	➤ 0.6m below level of pipework <sup>2</sup>
<b>Absorption System</b>	Property boundary Retaining wall, embankments, escarpments and cuttings.	➤ 12m if area up gradient ➤ 6m if area down gradient
	Dwellings and buildings, swimming pools and driveways	➤ 6m if area up gradient ➤ 3m if area down gradient
	Depth to Hardpan or Bedrock	➤ 0.6m below base of trench/bed

**Permanent Watercourse:** Any river, creek, stream or chain of ponds, whether artificially modified or not, in which water usually flows, either continuously or intermittently, in a defined bed or channel

**Intermittent Watercourse:** A low point with no or little defined bed or channel that carries water during rainfall events, but dries out quickly when rainfall stops. A gully or incised drainage depression is considered to be an intermittent watercourse.



**Figure 2:** Existing EDA area onsite for granny flat structure on proposed Lot 6.





**Figure 3:** Proposed EDA area onsite for proposed Lot 2.





**Figure 4:** Proposed EDA area onsite for Lot 3.





**Figure 5:** Proposed EDA area onsite in the foreground for Lot 4.





**Figure 6:** Proposed EDA area onsite for Lot 4.





**Figure 7:** Proposed EDA area onsite for Lot 1.

## 5. Onsite Soil Assessment

During the site inspection 14 boreholes were hand excavated with a 100mm auger within the proposed EDAs. 2 boreholes within each proposed EDA. The following are the results from the excavation. The auger holes were used to determine the underlying soil properties. No groundwater was observed in the excavated boreholes.

According to the Port Stephens 1:100 000 Soil Map the proposed dispersal areas onsite are underlain by “Clarencetown” residual soils. The Clarencetown Soil Landscape areas generally consist of undulating low hills on Carboniferous sediments in the Clarencetown Hills region. Slope gradients are generally between 5 - 15%. Underlying soils mostly consist of brown earthy sandy loams traversing to yellowish brown clays.

### Borehole 1

0 – 250mm - brown sandy loams

250 – 800mm – brown sandy clay loams

800 – 1000mm – brown clays



**Figure 8:** Borehole 1, excavated onsite.

### Borehole 2

0 – 300mm - brown sandy loams

300 – 800mm – brown sandy clay loams

800 – 1000mm – brown clays



### Borehole 3

0 – 250mm - brown sandy loams

250 – 850mm – brown sandy clay loams

850 – 1000mm – brown clays



**Figure 9:** Borehole 3, excavated onsite.

### Borehole 4

0 – 350mm - brown sandy loams

350 – 750mm – brown sandy clay loams

750 – 1000mm – brown clays

### Borehole 5

0 – 250mm - brown sandy loams

250 – 750mm – brown sandy clay loams

750 – 1000mm – brown clays



**Figure 10:** Borehole 5, excavated onsite.

Borehole 6

0 – 250mm - brown sandy loams

250 – 800mm – brown sandy clay loams

800 – 1000mm – brown clays

Borehole 7

0 – 400mm - brown sandy loams

400 – 800mm – brown sandy clay loams

800 – 1000mm – brown clays



**Figure 11:** Borehole 7, excavated onsite.



### Borehole 8

0 – 250mm - brown sandy loams

250 – 800mm – brown sandy clay loams

800 – 1000mm – brown clays

### Borehole 9

0 – 350mm - brown sandy loams

350 – 800mm – brown sandy clay loams

800 – 1000mm – brown clays



**Figure 12:** Borehole 9, excavated onsite.

### Borehole 10

0 – 400mm - brown sandy loams

400 – 850mm – brown sandy clay loams

850 – 1000mm – brown clays

### Borehole 11

0 – 350mm - brown sandy loams

350 – 850mm – brown sandy clay loams

850 – 1000mm – brown clays



**Figure 13:** Borehole 11, excavated onsite.

#### Borehole 12

0 – 400mm - brown sandy loams

400 – 900mm – brown sandy clay loams

900 – 1000mm – brown clays

An insitu probe, tested the soil layers for pH and EC, results as below.

#### Ph and EC

##### Borehole 1

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 250mm	5.6	860
250 – 800mm	5.5	713
800 – 1000mm	5.2	941

Borehole 2

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 300mm	5.7	619
300 – 800mm	5.6	781
800 – 1000mm	5.6	1001

Borehole 3

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 250mm	5.8	730
250 – 850mm	5.7	555
850 – 1000mm	5.2	899

Borehole 4

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 350mm	5.7	662
350 – 750mm	5.2	513
750 – 1000mm	5.3	718

Borehole 5

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 250mm	5.9	640
250 – 750mm	6.0	540
750 – 1000mm	5.5	786

Borehole 6

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 250mm	5.7	714
250 – 800mm	5.5	888
800 – 1000mm	5.3	1329

Borehole 7

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 400mm	5.8	750
400 – 800mm	5.7	613
800 – 1000mm	5.3	999

Borehole 8

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 250mm	5.9	487
250 – 800mm	5.7	619
800 – 1000mm	5.8	874

Borehole 9

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 350mm	6.0	380
350 – 800mm	5.8	418
800 – 1000mm	5.6	618

Borehole 10

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 400mm	5.9	664
400 – 850mm	5.7	333
850 – 1000mm	6.6	898

Borehole 11

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 350mm	6.0	697
350 – 850mm	5.7	581
850 – 1000mm	5.3	999

Borehole 12

Depth	pH	EC <sub>e</sub> (μS/cm)
0 – 700mm	5.8	879
400 – 900mm	5.5	613
700 – 1000mm	5.4	814

The pH of a soil influences its ability to supply nutrients to vegetation. If the soil is too acidic vegetative growth is inhibited. The electrical conductivity of the soil relates to the amount of salts present. A high salt concentration inhibits vegetative growth.

The electrical conductivity of the soils is less than 4 dS/m. This will not inhibit vegetative growth. The pH of the soil is between 5.2 and 6.0. A regular application of lime and gypsum is recommended to maintain healthy vegetation growth.

Four samples were sent to ALS Australia, a NATA accredited laboratory to determine the insitu reliability as well as the testing of further parameters. Results below and in appendix.

The samples tested at the laboratory were from

- borehole 1, 0-200mm – TP1
- borehole 3, 0-400mm – TP3
- borehole 5, 0-300mm – TP5
- borehole 7, 0-250mm – TP7
- borehole 9, 0-500mm – TP9
- borehole 11, 0-800mm – TP11

#### Coarse fragments

Coarse fragments are those over 2 mm in diameter. They can pose limitations to vegetative growth by lowering the soil's ability to supply water and nutrients.

<10% of coarse fragments within the boreholes. There were some peds which could be crushed easily using fingers.

Limitation: **LOW**

#### Exchangeable Sodium Percentage

The exchangeable sodium percentage (ESP) measures the proportion of cation exchange sites occupied by sodium. Soils are considered sodic when the ESP is greater than 6, and highly sodic when the ESP is greater than 15.

TP1 - ESP 2.2 %, suggesting non sodic soils within this area

TP3 - ESP 2.1 %, suggesting non sodic soils within this area

TP5 - ESP 1.0 %, suggesting non sodic soils within this area

TP7 - ESP 1.0 %, suggesting non sodic soils within this area

TP9 - ESP 3.8 %, suggesting non sodic soils within this area

TP11 - ESP 5.0 %, suggesting non sodic soils within this area



### Cation Exchange Capacity

Cation exchange capacity (CEC) is a measure of the soil's ability to hold positively charged ions. It is a very important soil property influencing soil structure stability, nutrient availability, soil pH and the soil's reaction to fertilisers and other ameliorants. A figure above 10 meq/100g is preferred for plant production. You can improve CEC in weathered soils by adding lime and raising the pH.

TP1 - CEC = 6.9 meq/100g

TP3 - CEC = 10.6 meq/100g

TP5 - CEC = 8.2 meq/100g

TP7- CEC = 7.6 meq/100g

TP9- CEC = 4.4 meq/100g

TP11- CEC = 5.2 meq/100g

### Phosphorus Sorption Index

The capacity of a soil to adsorb phosphorus is expressed as its phosphorus sorption capacity.

TP1 - P sorb = 1420 mg P sorbed/kg

TP3 - P sorb = 1790 mg P sorbed/kg

TP5 - P sorb = 840 mg P sorbed/kg

TP7 - P sorb = 751 mg P sorbed/kg

TP9 - P sorb = 559 mg P sorbed/kg

TP11 - P sorb = 827 mg P sorbed/kg

### Emerson Aggregate Test

The combination of slaking and dispersion caused a reduction in macroporosity and, therefore, lower infiltration rates and hydraulic conductivities as well as an increase in soil strength and other undesirable soil physical properties. This test classifies the behavior of soil aggregates, when immersed, on their coherence in water. This test was completed inhouse. Soils are divided into seven classes on the basis of their coherence in water, with one further class being distinguished by the presence of calcium-rich minerals.

EAT Class = 2(2). Some slight dispersion potential within underlying soils onsite.

## 6. System Design/Selection

For the subject site there are a number of methods to treat the wastewater generated onsite. A general septic followed by an absorption pit/trench could be recommended for the subject site. However, with the site being of high-risk, effluent should be treated to a secondary level followed by subsurface dispersal. A number of dispersal options could be considered, subsurface irrigation, pressure dosed absorption bed and mounds. Subsurface irrigation was the dispersal method recommended and designed. Subsurface irrigation reduces the chance of human contact with the effluent and significantly reduces any potential public health risk.

### Proposed Treatment Node

The proposal is to install a NSW Health Accredited AWTs system onsite for each new proposed allotment. An Aerated Wastewater Treatment System (AWTS) uses aerobic treatment to promote oxidation and microbiological consumption of organic matter by bacteria through facilitated biological processes.

The existing septic's servicing the existing residence and granny flat can continue to be utilized to such time that an upgrade is needed.



**Figure 14:** existing septic servicing existing residence onsite.





**Figure 15:** existing septic servicing existing granny flat onsite.

### **Proposed Effluent Dispersal**

The proposal is to install subsurface irrigation onsite. Subsurface irrigation reduces the chance of human contact with the effluent and significantly reduces any potential public health risk. By placing the effluent in the root zone of plants or grasses, beneficial reuse of both the hydraulic and nutrient components of the effluent is maximised, offering enhanced environmental benefits. There are also potential amenity benefits offered by subsurface irrigation, such as less chance of surface saturation and effluent runoff.

### **Hydraulic Sizing**

As per section 6.4.3 of “Dungog Council Onsite Sewage DAF 2015’ the hydraulic sizing was calculated using the following formula.

$$LAA = q / (DLR - CAF)$$

$$LAA = EDA$$

Q = Design Daily Loading Rate (L/day)  
 DLR = Design Loading Rate (mm/day)  
 CAF = Climate Adjustment Factor (mm/day)

### Proposed Allotments

$$\text{LAA} = 1500 / (3.5 - 0)$$

$$\text{LAA} = 429\text{m}^2$$

### **Annual Nutrient Balance**

As per section 9.3 of Dungog Council Onsite Sewage Management Technical Manual the following methodology was utilized for completing the annual nutrient balance.

### Proposed Allotments

Daily Flowrate 1500L/day

### Total Nitrogen effluent concentration

$$\text{Daily N load} = 30 \times 1500 = 45,000 \text{ mg/day}$$

$$45,000 \times 365 = 16,425,000 \text{ mg/year}$$

Allowing a 20% loss through denitrification, volatisation, microbial digestion and other processes.

$$\text{Annual N load} = 13.14\text{kg/year}$$

Allow N uptake of 220kg/ha/year

$$13.14 / 220 = 0.0598 \text{ ha}$$

$$0.0598 \times 10000 = 598\text{m}^2$$

Minimum area required for N uptake is 598m<sup>2</sup>.

**Total Phosphorus effluent concentration**

Daily P load =  $10 \times 1500 = 15,000 \text{ mg/day}$

$15,000 \times 365 = 5,475,000 \text{ mg/year}$

Annual P load =  $5.475 \text{ kg/year}$

Allow for an uptake by plants (application rate) of  $50 \text{ kg P/ha/yr}$

Determine P sorption each year for 50 years

$3375 / 50 \times 0.5$  (actual field sorption multiplier) =  $33.75 \text{ kg/ha/yr}$

Determine total annual application rate

Plant uptake + P sorption =  $33.75 + 50$  Total P application rate =  $83.75 \text{ kg/ha/yr}$

$5.475 / 83.75 = 0.0654$

$0.0654 \times 10000 = 654 \text{ m}^2$

Minimum area required for P uptake is  $654 \text{ m}^2$ .

As the P uptake requires the greater area for calculated dispersal from N balance and hydraulic calculations the minimum EDA size is to be  $654 \text{ m}^2$  for each allotment.

**Existing Granny flat**

Continued use of existing septic tank. Confirmation or expansion of existing EDA to  $37.5 \text{ m}^2$  as per below calculations.

Strongly Structured clays: Maximum Loading rate of  $8 \text{ mm/day}$ . (AS1547:2012 – Table L1)


Total flowrate dispersing into adsorption bed  $600 \text{ L/day}$ .

Area of bed(s):  $300 / 8 = \underline{37.5 \text{ m}^2}$



## 7. Cumulative Impact


Each of the proposed allotments have a minimum 4000m<sup>2</sup> of usable land for effluent dispersal. The usable land areas meet the setbacks identified within Table 6 – 8 of the 'Dungog Council Onsite Sewage DAF 2015'. As such a cumulative impact assessment is not required for the subject proposal. Image below and in Appendix A show the minimum 4000m<sup>2</sup> areas.

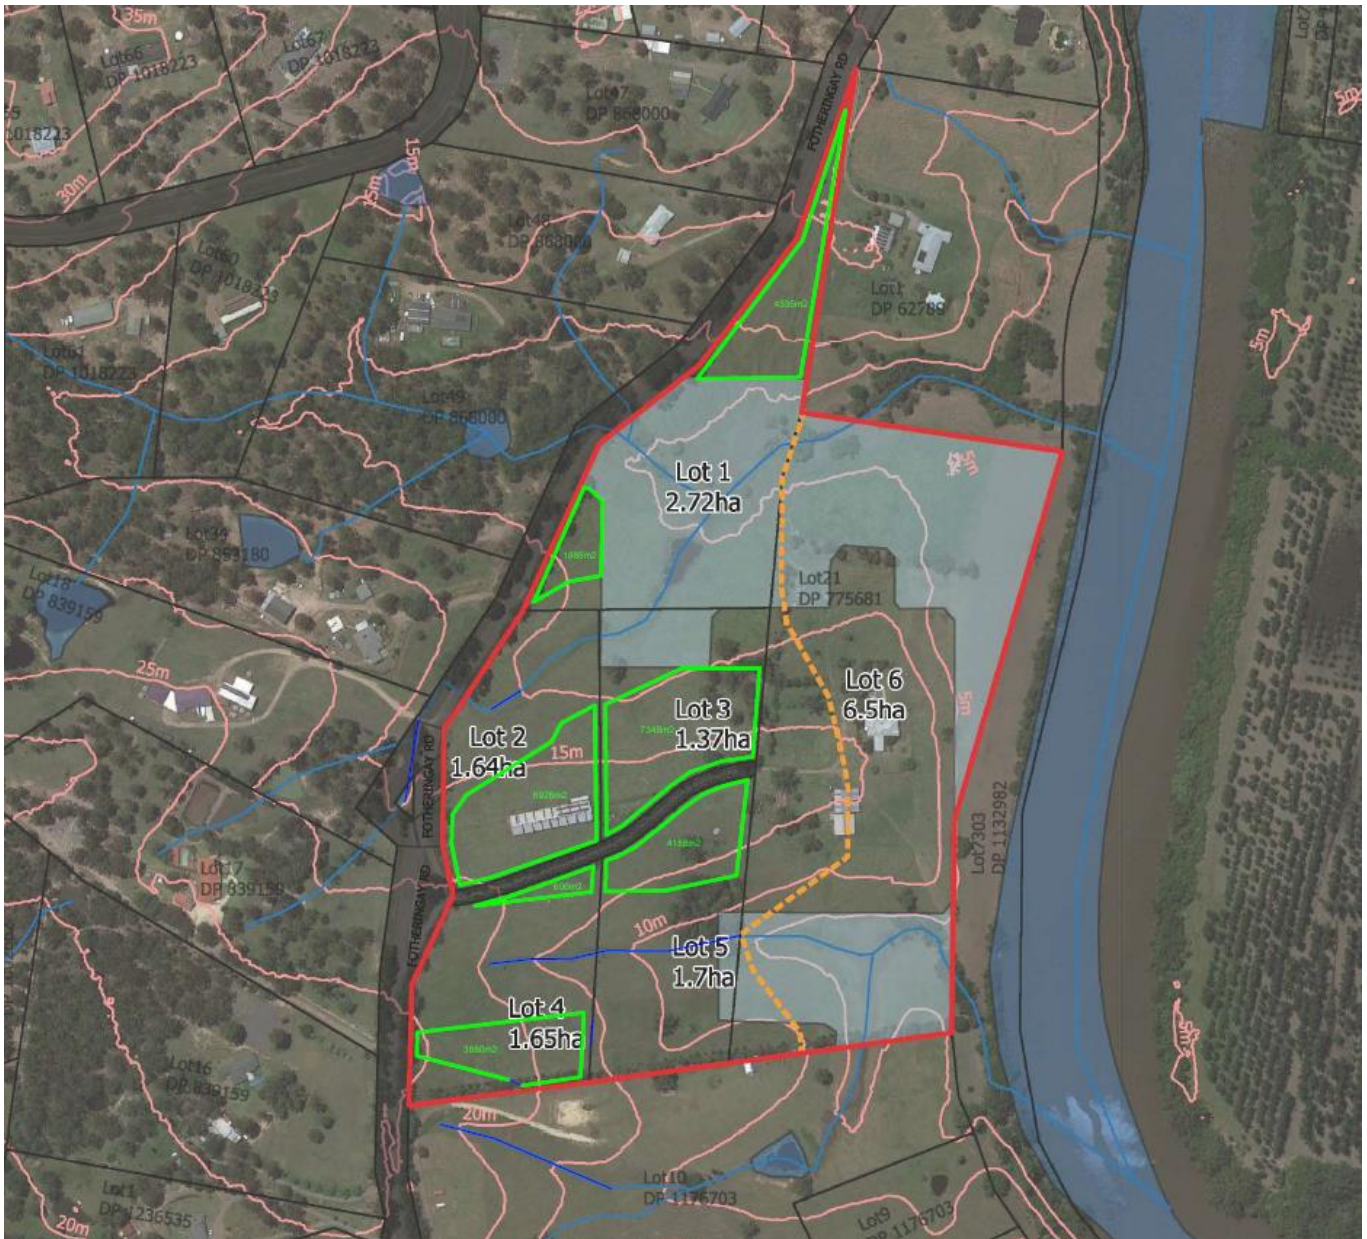

**Figure 8:** minimum 4000m<sup>2</sup> of usable land for effluent dispersal for each of the proposed allotments.

## 8. Recommendations


- Installation of NSW Health Accredited AWTs systems onsite to treat the calculated flowrate of 1500L/day on the proposed allotments.
- Installation of subsurface effluent dispersal fields of a minimum 654m<sup>2</sup> for the proposed allotments are to be installed within the available area envelopes as per appendix A.
- Continued use of septic systems onsite to treat the existing residence and granny flat.
- Confirmation via installer that the absorption area for the granny flat is a minimum 37.5m<sup>2</sup>. If not, this area is to be expanded to become compliant.
- Stock must be kept out of the EDAs by fencing or other physical barrier.
- This design assumes at least three-star rated plumbing fixtures are used in any new development.

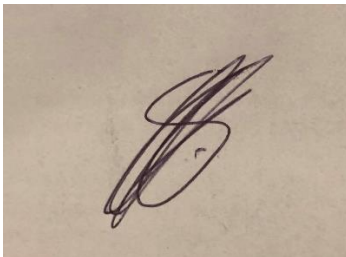A handwritten signature in dark ink on a light-colored, textured background. The signature is stylized, featuring a large, looped 'S' and 'D'.


Simon Doberer  
Principle Environmental Scientist  
B.Sc. (ENV)

## Appendix A – Site Plans



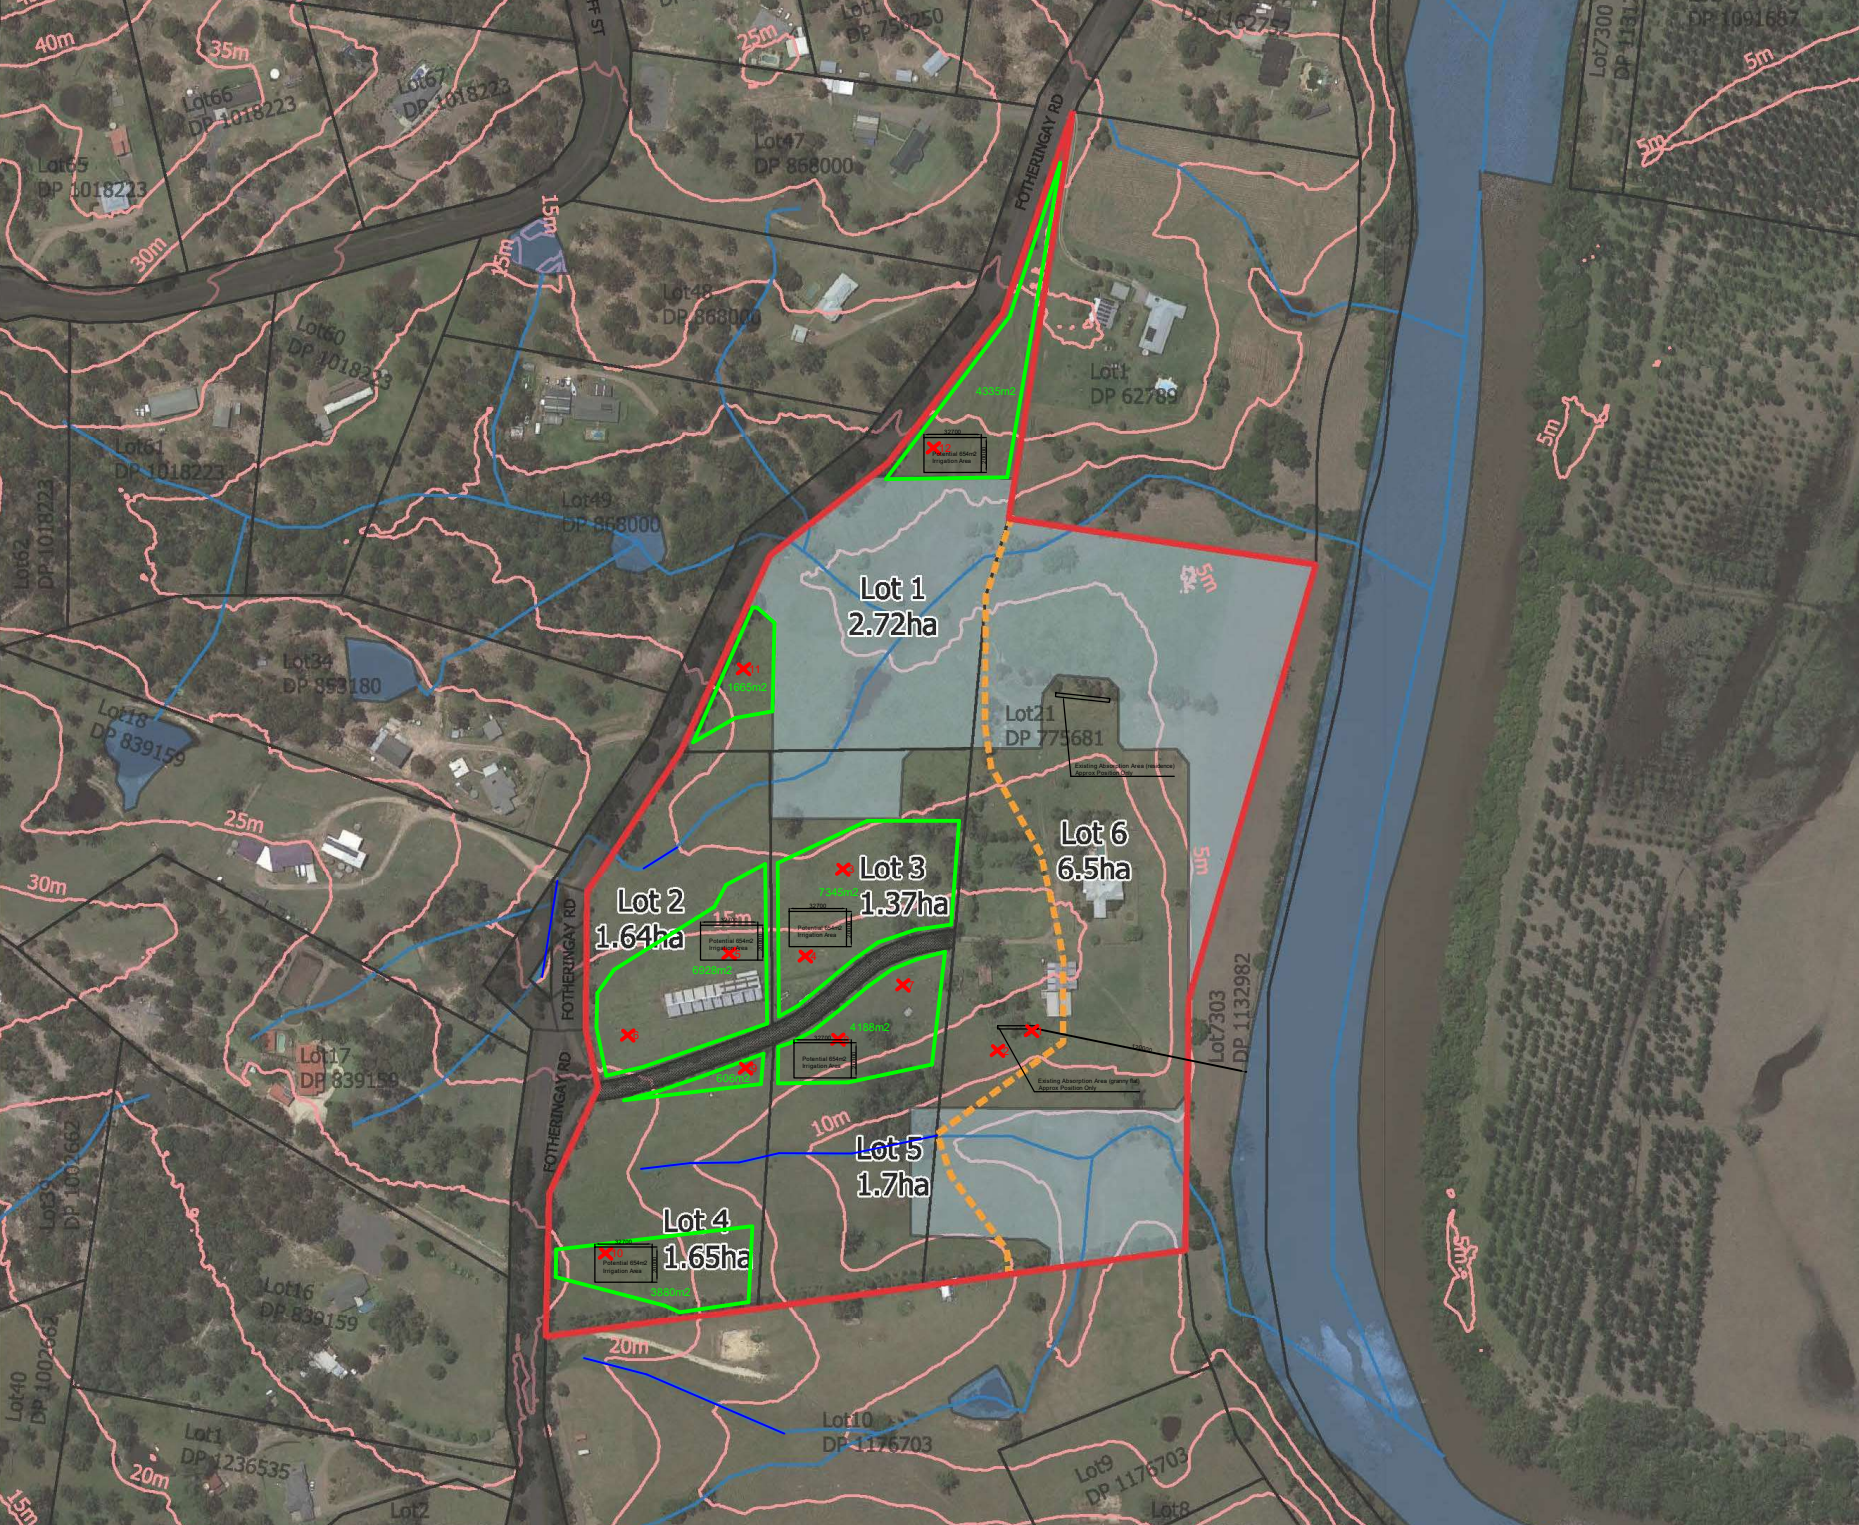



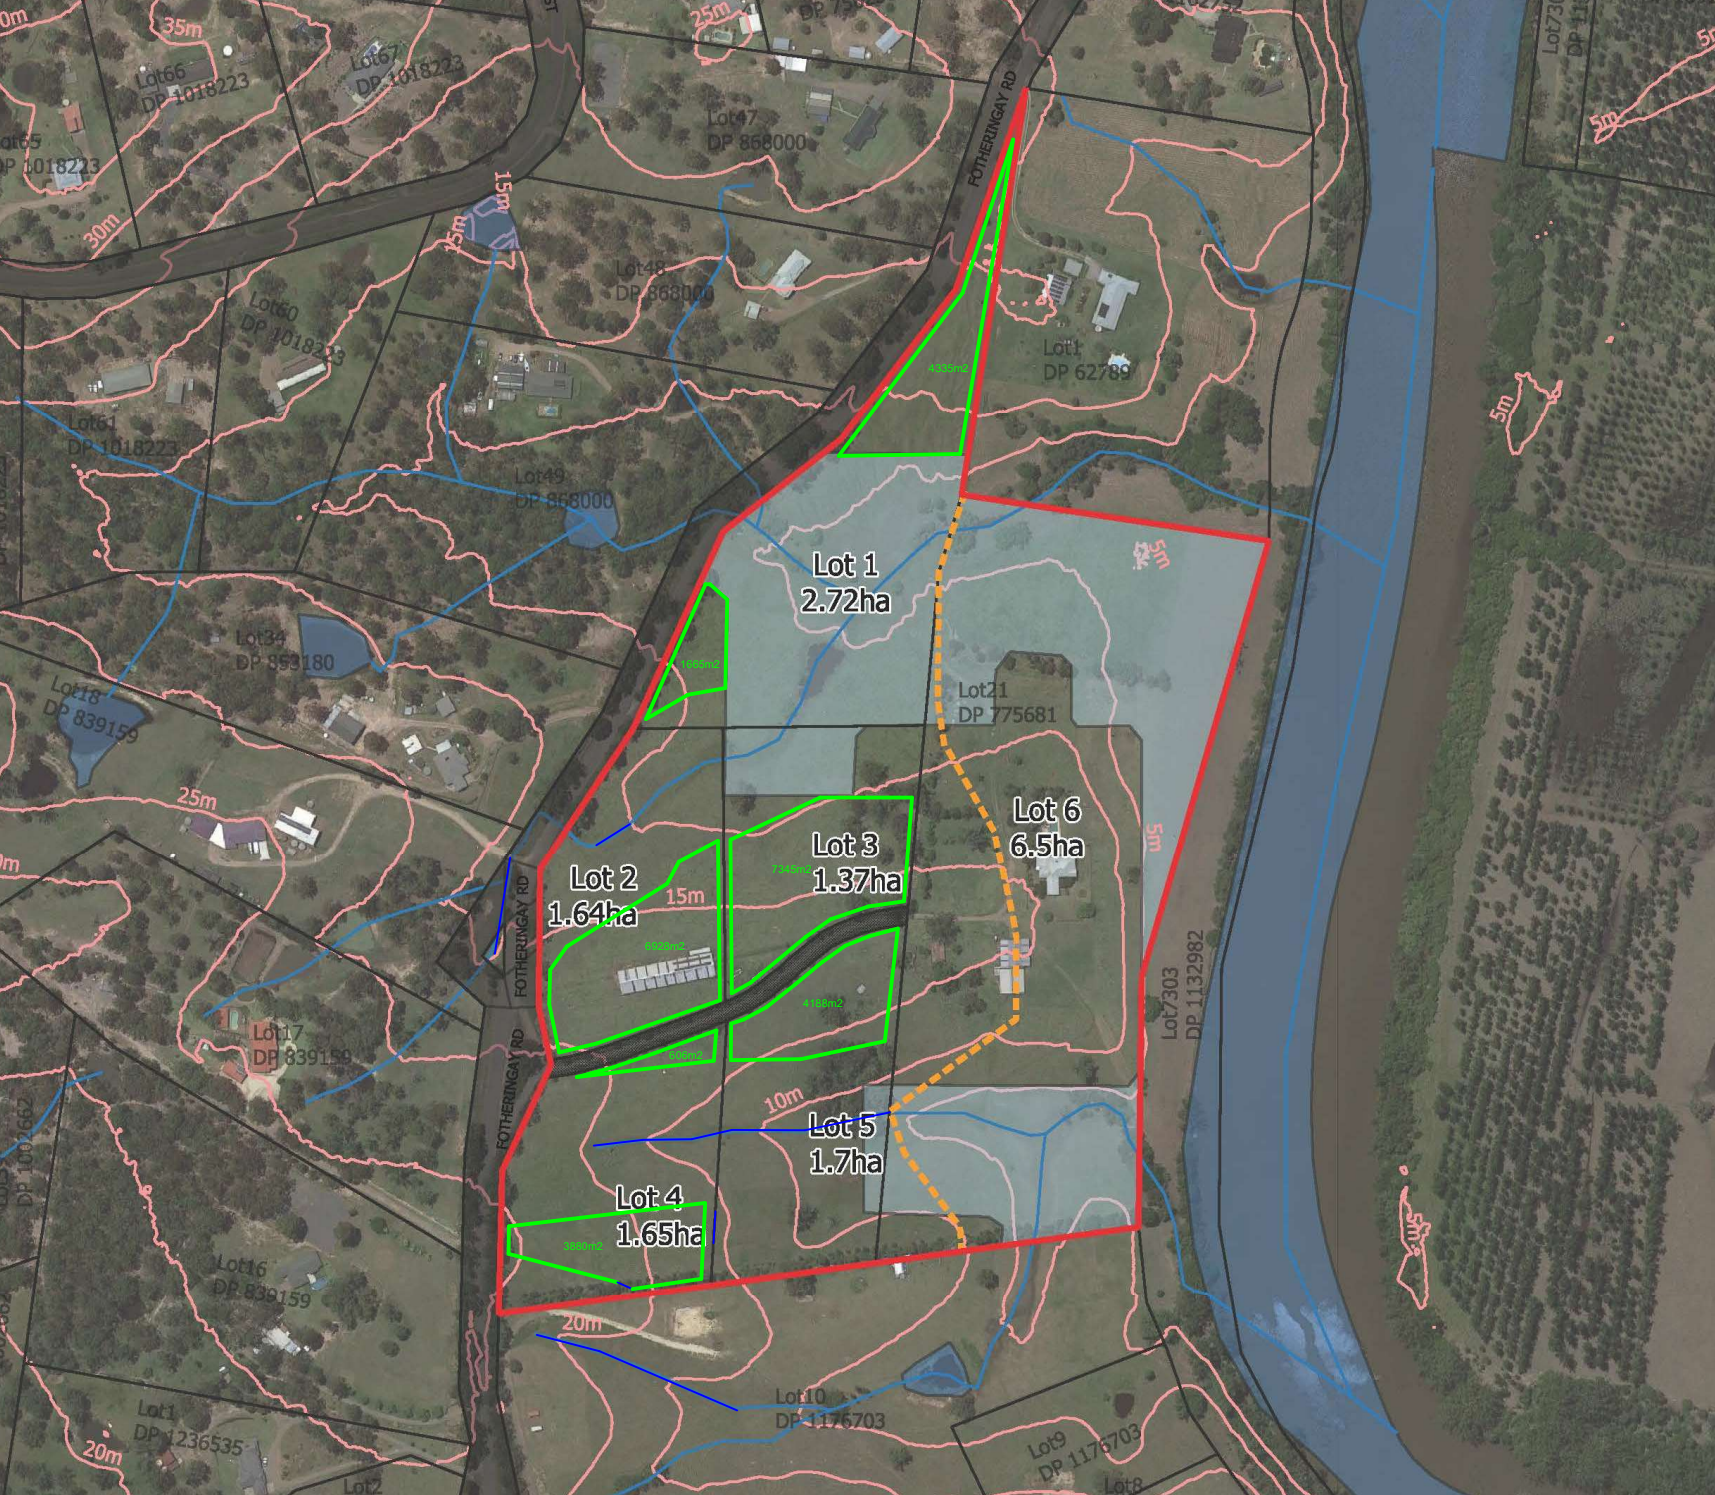

## Appendix B – Proposed Plans



83 Fotheringay Rd

## Figure 1 - Revised Subdivision Plan



- Site Boundary
- Watercourses
- Waterbodies
- Zone E3 - Boundary
- Contours - 5m
- Flood Prone Land
- Roads




0 100 200 m

A horizontal scale bar with black and white segments, representing distances of 0, 100, and 200 meters.

Disclaimer: While every effort is made to ensure this map is free of errors, there is no warrant the map or its features are either spatially or temporally accurate or fit for a particular use. This map is provided without any warranty of any kind whatsoever, either express or implied.

Job No: J001630

Date: 02/08/2021

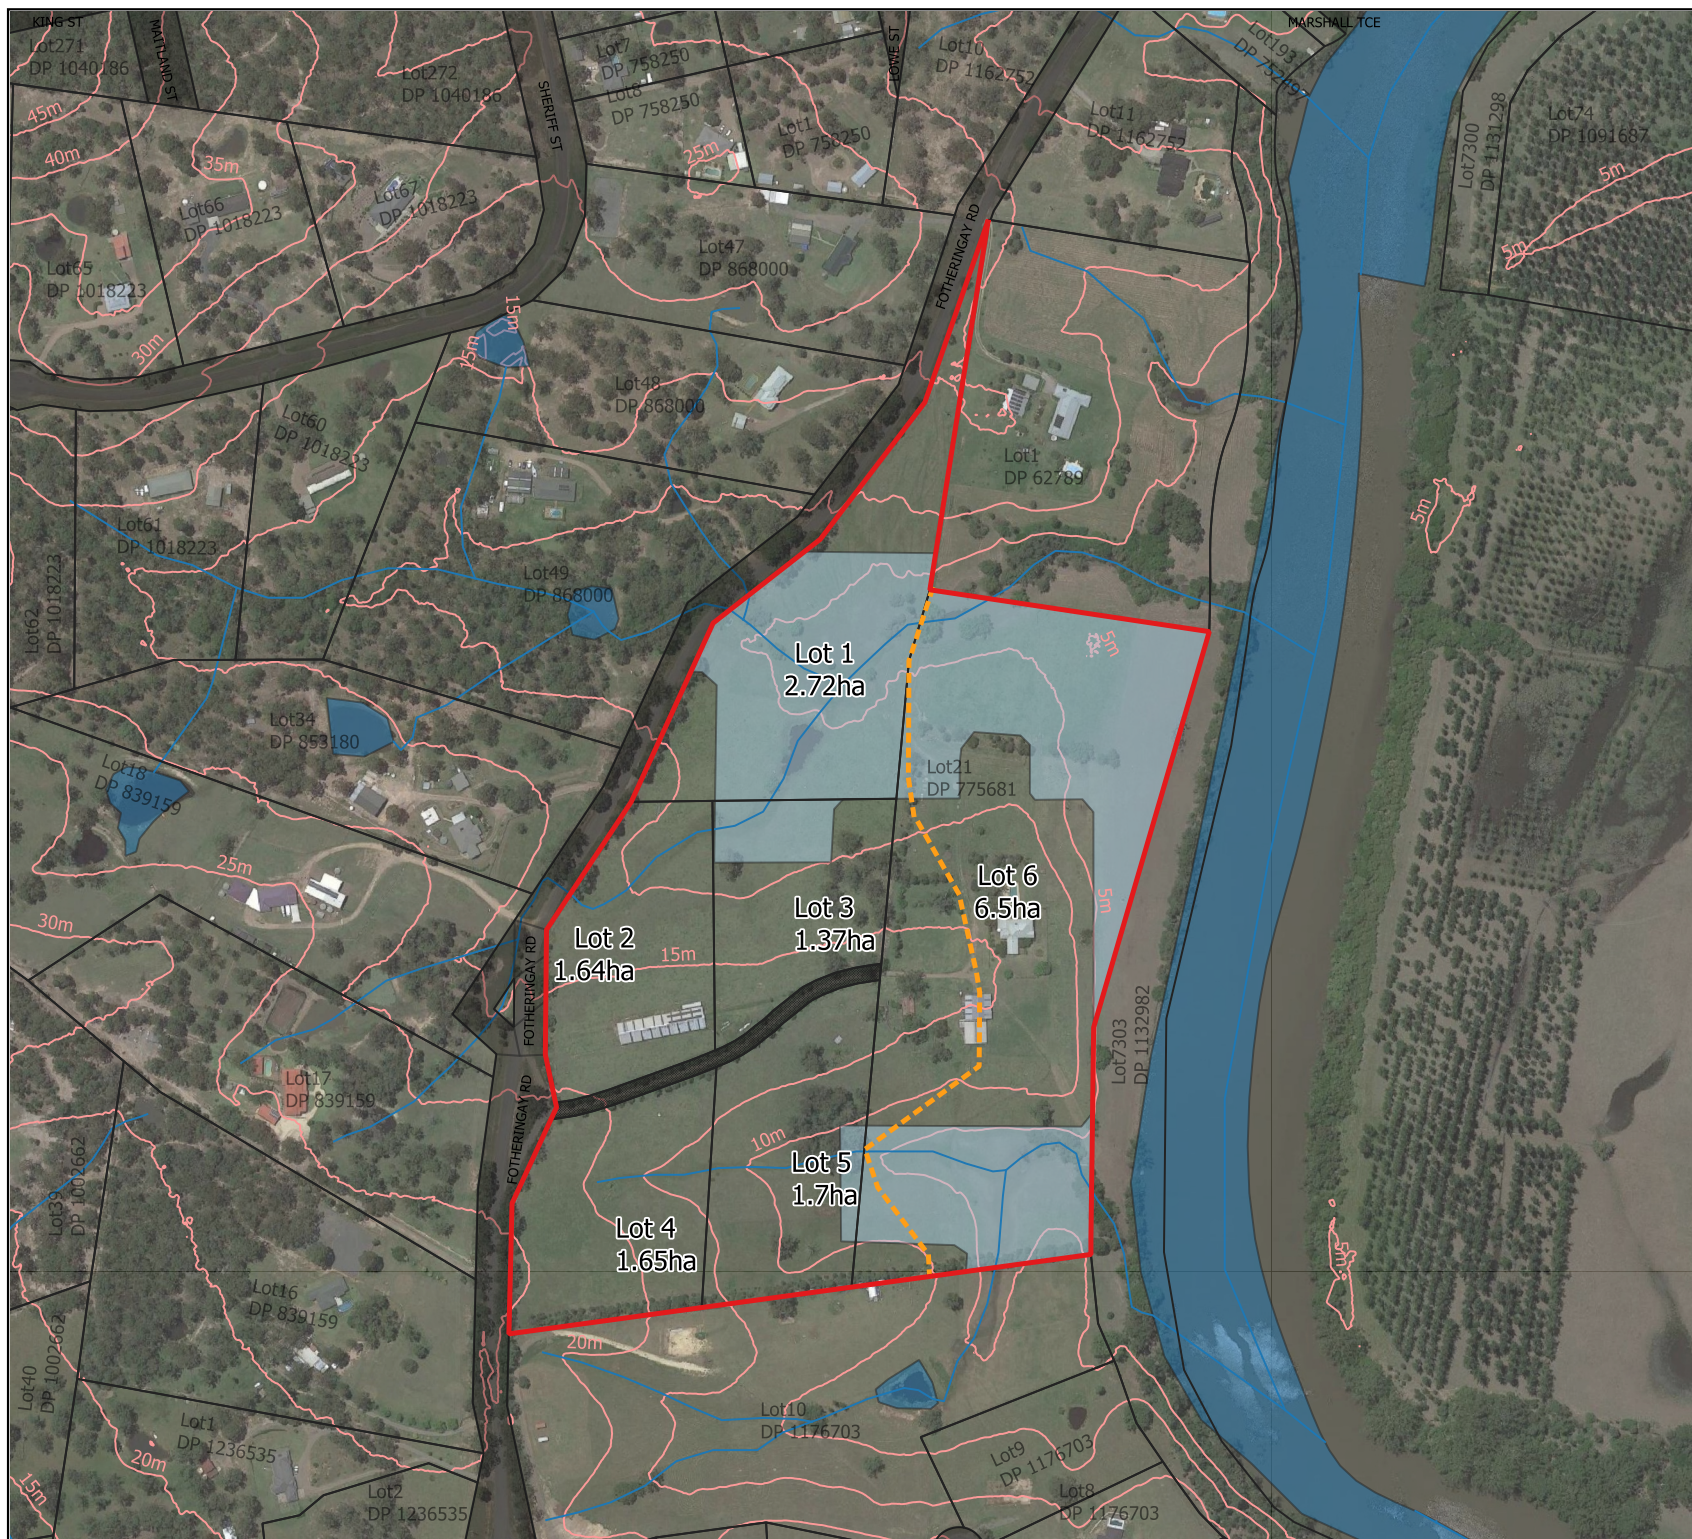



## Appendix C – Operation and Maintenance Guideline

### ON-SITE SEWAGE MANAGEMENT SYSTEMS

If you live in or rent a house that is not connected to the main sewer then chances are that your yard contains an on-site sewage management system. If this is the case then you have a special responsibility to ensure that it is working as well as it can.

The aim of this pamphlet is to introduce you to some of the most popular types of on-site sewage management systems and provide some general information to help you maintain your system effectively. You should find out what type of system you have and how it works.

More information can be obtained from the pamphlets:

Your Septic System  
Your Aerated Wastewater Treatment System  
Your Composting Toilet  
Your Land Application Area

You can get a copy of these pamphlets from your local council or the address marked on the back of this pamphlet.

It is important to keep in mind that maintenance needs to be performed properly and regularly. Poorly maintained on-site sewage management systems can significantly affect you and your family's health as well as the local environment.

#### What is an on-site sewage management system?

A domestic on-site sewage management system is made up of various components which - if properly designed, installed and maintained - allow the treatment and utilisation of wastewater from a house, completely within the boundary of the property.

Wastewater may be blackwater (toilet waste), or greywater (water from showers, sinks, and washing machines), or a combination of both.

Partial on-site systems - eg. pump out and common effluent systems (CES) - also exist. These usually involve the preliminary on-site treatment of wastewater in a septic tank, followed by collection and transport of the treated wastewater to an off-site management facility. Pump out systems use road tankers to transport the effluent, and CES use a network of small diameter pipes.

#### How does an on-site sewage management system work?

For complete on-site systems there are two main processes:

1. treatment of wastewater to a certain standard
2. its application to a dedicated area of land.

The type of application permitted depends on the quality of treatment, although you should try to avoid contact with all treated and untreated wastewater, and thoroughly wash affected areas if contact does occur.

Treatment and application can be carried out using various methods:

#### Septic Tank

Septic tanks treat both greywater and blackwater, but they provide only limited treatment through the settling of solids and the flotation of fats and greases. Bacteria in the tank break down the solids over a period of time. Wastewater that has been treated in a septic tank can only be applied to land through a covered soil absorption system, as the effluent is still too contaminated for above ground or near surface irrigation.

#### AWTS

Aerated wastewater treatment systems (AWTS) treat all household wastewater and have several treatment compartments. The first is like a septic tank, but in the second compartment air is mixed with the wastewater to assist bacteria to break down solids. A third compartment allows settling of more solids and a final chlorination contact chamber allows disinfection. Some AWTS are constructed with all the compartments inside a single tank. The effluent produced may be surface or sub-surface irrigated in a dedicated area.

#### Composting Toilets

Composting toilets collect and treat toilet waste only. Water from the shower, sinks and the washing machine needs to be treated separately (for example in a septic tank or AWTS as above). The compost produced by a composting toilet has special requirements but is usually buried on-site.

These are just some of the treatment and application methods available, and there are many other types such as sand filter beds, wetlands, and amended earth mounds. Your local council or the NSW Department of Health have more information on these systems if you need it.

#### Regulations and recommendations

The NSW Department of Health determines the design and structural requirements for treatment systems for single households. Local councils are primarily responsible for approving the installation of smaller domestic septic tank systems, composting toilets and AWTSs in their area, and are also responsible for approving land application areas. The NSW Environment Protection Authority approves larger systems.

The design and installation of on-site sewage management systems, including plumbing and drainage, should only be carried out by suitably qualified or experienced people. Care is needed to ensure correct sizing of the treatment system and application area.

Heavy fines may be imposed under the Clean Waters Act if wastewater is not managed properly.

#### Keeping your on-site sewage management system operating well

What you put down your drains and toilets has a lot to do with how well your system performs. Maintenance of your sewage management system also needs to be done well and on-time. The following is a guide to the types of things you should and should not do with your system.

## DO

- ✓ Learn how your sewage management system works and its operational and maintenance requirements.
- ✓ Learn the location and layout of your sewage management system.
- ✓ Have your AWTS (if installed) inspected and serviced four times per year by an approved contractor. Other systems should be inspected at least once every year. Assessment should be applicable to the system design.
- ✓ Keep a record of desludgings, inspections, and other maintenance.
- ✓ Have your septic tank or AWTS desludged every three years to prevent sludge build up, which may 'clog' the pipes.
- ✓ Conserve water. Conservative water use around the house will reduce the amount of wastewater which is produced and needs to be treated.
- ✓ Discuss with your local council the adequacy of your existing sewage management system if you are considering house extensions for increased occupancy.

## DON'T

- ✗ Don't let children or pets play on land application areas.
- ✗ Don't water fruit and vegetables with effluent.
- ✗ Don't extract untreated groundwater for cooking and drinking.
- ✗ Don't put large quantities of bleaches, disinfectants, whiteners, nappy soakers and spot removers into your system via the sink, washing machine or toilet.
- ✗ Don't allow any foreign materials such as nappies, sanitary napkins, condoms and other hygiene products to enter the system.
- ✗ Don't put fats and oils down the drain and keep food waste out of your system.
- ✗ Don't install or use a garbage grinder or spa bath if your system is not designed for it.

## Reducing water usage

Reducing water usage will lessen the likelihood of problems such as overloading with your septic system. Overloading may result in wastewater backing up into your house, contamination of your yard with improperly treated effluent, and effluent from your system contaminating groundwater or a nearby waterway.

Your sewage management system is also unable to cope with large volumes of water such as several showers or loads of washing over a short period of time. You should try to avoid these 'shock loads' by ensuring water use is spread more evenly throughout the day and week.


## HELP PROTECT YOUR HEALTH AND THE ENVIRONMENT

Poorly maintained sewage management systems are a serious source of water pollution and may present health risks, cause odours and attract vermin and insects.

By looking after your management system you can do your part in helping to protect the environment and the health of you and your community.

For more information please contact:

# Managing Wastewater In Your Backyard

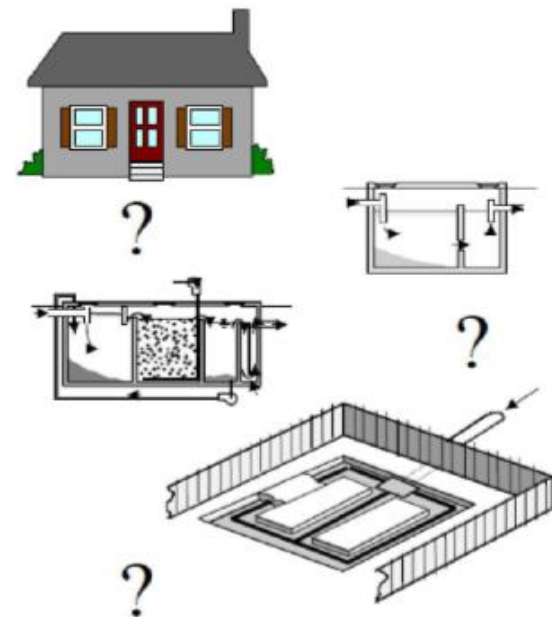



## Aerated Wastewater Treatment Systems (AWTS)

In unsewered areas, the proper treatment and utilisation of household wastewater on-site is critical in preserving the health of the public and the environment. AWTS have been developed as a way of achieving this.

### What is an AWTS?

An AWTS is a purpose built system used for the treatment of sewage and liquid wastes from a single household or multiple dwellings.

It consists of a series of treatment chambers combined with an irrigation system. An AWTS enables people living in unsewered areas to treat and utilise their wastewater.

### How does an AWTS work?

Wastewater from a household is treated in stages in several separate chambers. The first chamber is similar to a conventional septic tank. The wastewater enters the chamber where the solids settle to the bottom and are retained in the tank forming a sludge layer. Scum collects at the top, and the partially clarified wastewater flows into a second chamber. Here the wastewater is mixed with air

to assist bacteria to further treat it. A third chamber allows additional clarification through the settling of solids, which are returned for further treatment to either the septic chamber (as shown) or to the aeration chamber. The clarified effluent is disinfected in another chamber (usually by chlorination) before irrigation can take place.

Bacteria in the first chamber break down the solid matter in the sludge and scum layers. Material that cannot be fully broken down gradually builds up in the chamber and must be pumped out periodically.

### Regulations and recommendations

Local councils are primarily responsible for approving the smaller, domestic AWTSs in their area. The Environment Protection Authority (EPA) approves larger units, whilst the NSW Department of Health determines the design and structural requirements for all AWTSs.

At present AWTSs need to be serviced quarterly by an approved contractor at a cost to the owner. Local councils should also maintain a register of the servicing of each system within their area.

AWTSs should be fitted with an alarm having visual and audible components to indicate mechanical and electrical equipment malfunctions. The alarm should provide a signal adjacent to the alarm and at a relevant position inside the house. The alarm should incorporate a warning lamp which may only be reset by the service agent.

### Maintaining your AWTS


The effectiveness of the system will, in part, depend on how it is used and maintained. The following is a guide on good maintenance procedures that you should follow:

### DO

- ✓ Have your AWTS inspected and serviced four times per year by an approved contractor. Assessment should be applicable to the system design.
- ✓ Have your system service include assessment of sludge and scum levels in all tanks, and performance of irrigation areas.
- ✓ Have all your tanks deslugged at least every three years.
- ✓ Have your disinfection chamber inspected and tested quarterly to ensure correct disinfectant levels.
- ✓ Have your grease trap (if installed) cleaned out at least every two months.
- ✓ Keep a record of pumping, inspections, and other maintenance.
- ✓ Learn the location and layout of your AWTS and land application area.
- ✓ Use biodegradable liquid detergents such as concentrates with low sodium and phosphorous levels.
- ✓ Conserve water.

### DON'T

- ✗ Don't put bleaches, disinfectants, whiteners, nappy soakers and spot removers in large quantities into your AWTS via the sink, washing machine or toilet.
- ✗ Don't allow any foreign materials such as nappies, sanitary napkins, condoms and other hygiene products to enter the system.
- ✗ Don't use more than the recommended amounts of detergents.
- ✗ Don't put fats and oils down the drain and keep food waste out of your system.
- ✗ Don't switch off power to the AWTS, even if you are going on holidays

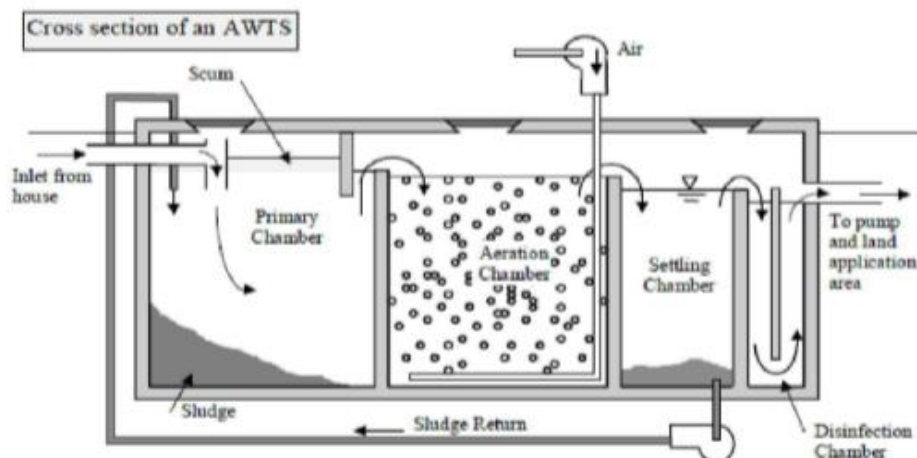

### Reducing water usage

Reducing water usage will lessen the likelihood of problems such as overloading with your AWTs. Overloading may result in wastewater backing up into your house, contamination of your yard with improperly treated effluent, and effluent from your system entering a nearby river, creek or dam.

Conservative water use around the house will reduce the amount of wastewater which is produced and needs to be treated.

Your AWTs is also unable to cope with large volumes of water such as several showers or loads of washing over a short period of time. You should try to avoid these 'shock loads' by ensuring water use is spread more evenly throughout the day and week.

### Warning signs

You can look out for a few warning signs that signal to you that there are troubles with your AWTs. Ensure that these problems are attended to immediately to protect your health and the environment.

Look out for the following warning signs:

- ⚠ Water that drains too slowly.
- ⚠ Drain pipes that gurgle or make noises when air bubbles are forced back through the system.
- ⚠ Sewage smells, this indicates a serious problem.
- ⚠ Water backing up into your sink which may indicate that your system is already failing.
- ⚠ Wastewater pooling over the land application area.
- ⚠ Black coloured effluent in the aerated tank.
- ⚠ Excess noise from the blower or pumping equipment.
- ⚠ Poor vegetation growth in irrigated area.

- ⚠ Black coloured effluent in the aerated tank.
- ⚠ Excess noise from the blower or pumping equipment.
- ⚠ Poor vegetation growth in irrigated area.

Odour problems from a vent on the AWTs can be a result of slow or inadequate breakdown of solids. Call a technician to service the system.


### HELP PROTECT YOUR HEALTH AND THE ENVIRONMENT

Poorly maintained AWTs are a serious source of water pollution and may present health risks, cause odours and attract vermin and insects.


By looking after your treatment system you can do your part in helping to protect the environment and the health of you and your family.

If you would like more information please contact:

## Your Aerated Wastewater Treatment System

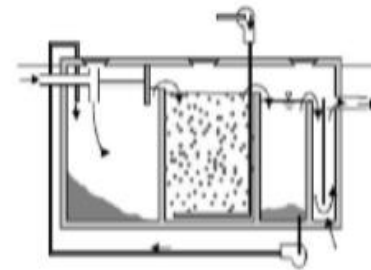

## Your Aerated Wastewater Treatment System

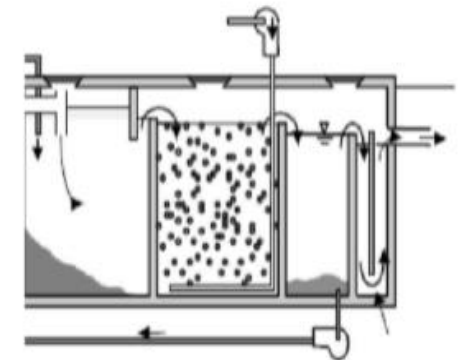



## LAND APPLICATION AREAS

The reuse of domestic wastewater on-site can be an economical and environmentally sound use of resources.

### What are land application areas?

These are areas that allow treated domestic wastewater to be managed entirely on-site.

The area must be able to utilise the wastewater and treat any organic matter and wastes it may contain. The wastewater is rich in nutrients, and can provide excellent nourishment for flower gardens, lawns, certain shrubs and trees. The vegetation should be suitably tolerant of high water and nutrient loads.

### How does a land application area work?


Treated wastewater applied to a land application area may be utilised or simply disposed, depending on the type of application system that is used. The application of the wastewater can be through a soil absorption system (based on disposal) or through an irrigation system (based on utilisation).

**Soil absorption systems** do not require highly treated effluent, and wastewater treated by a septic tank is reasonable as the solids content in the effluent has been reduced. Absorption systems release the effluent into the soil at a depth that cannot be reached by the roots of most small shrubs and grasses. They rely mainly on the processes of soil treatment and then transmission to the water table, with minimal evaporation and up-take by plants. **These systems are not recommended in sensitive areas as they may lead to contamination of surface water and groundwater.**

**Irrigation systems** may be classed as either subsurface or surface irrigation. If an irrigation system is to be used, wastewater needs to be pre-treated to at least the quality produced by an aerated wastewater treatment system (AWTS).

**Subsurface irrigation** requires highly treated effluent that is introduced into the soil close to the surface. The effluent is utilised mainly by plants and evaporation.

**Surface irrigation** requires highly treated effluent that has undergone aeration and disinfection treatments, so as to reduce the possibility of bacteria and virus contamination.

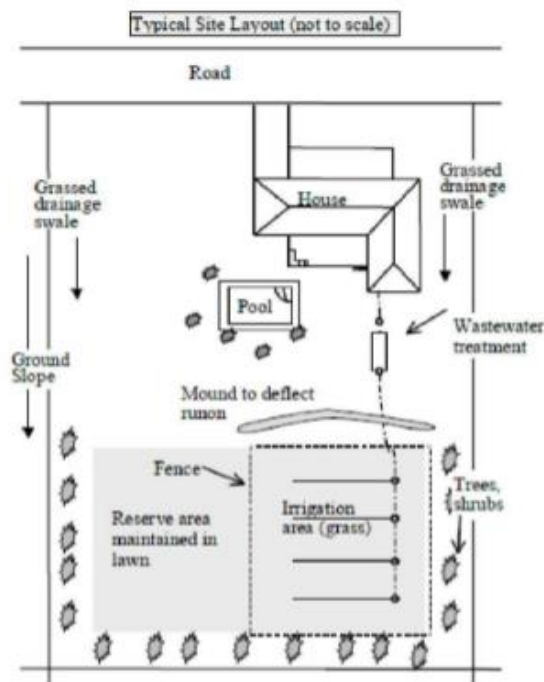

The effluent is then applied to the land area through a series of drip, trickle, or spray points which are designed to eliminate airborne drift and run-off into neighbouring properties.

There are some public health and environmental concerns about surface irrigation. There is the risk of contact with treated effluent and the potential for surface run-off. Given these problems, subsurface irrigation is arguably the safest, most efficient and effective method of effluent utilisation.

### Regulations and recommendations

The design and installation of land application areas should only be carried out by suitably qualified or experienced people, and only after a site and soil evaluation is done by a soil scientist. Care should be

taken to ensure correct buffer distances are left between the application area and bores, waterways, buildings, and neighbouring properties.

Heavy fines may be imposed under the Clean Waters Act if effluent is managed improperly.

At least two warning signs should be installed along the boundary of a land application area. The signs should comprise of 20mm high Series C lettering in black or white on a green background with the words:

**RECLAIMED EFFLUENT  
NOT FOR DRINKING  
AVOID CONTACT**

Depending on the requirements of your local council, wet weather storage and soil moisture sensors may need to be installed to ensure that effluent is only irrigated when the soil is not saturated.

Regular checks should be undertaken of any mechanical equipment to ensure that it is operating correctly. Local councils may require periodic analysis of soil or groundwater characteristics.

Humans and animals should be excluded from land application areas during and immediately after the application of treated wastewater. The longer the period of exclusion from an area, the lower the risk to public health.

The householder is required to enter into a service contract with the installation company, its agent or the manufacturer of their sewage management system, this will ensure that the system operates efficiently.

### Location of the application area

Treated wastewater has the potential to have negative impacts on public health and the environment. For this reason the application area must be located in accordance with the results of a site evaluation, and approved landscaping must be completed prior to occupation of the building. Sandy soil and clayey soils may present special problems.

The system must allow even distribution of treated wastewater over the land application area.



## Maintaining your land application area

The effectiveness of the application area is governed by the activities of the owner.

### DO

- ✓ Construct and maintain diversion drains around the top side of the application area to divert surface water.
- ✓ Ensure that your application area is kept level by filling any depressions with good quality top soil (not clay).
- ✓ Keep the grass regularly mowed and plant small trees around the perimeter to aid absorption and transpiration of the effluent.
- ✓ Ensure that any run off from the roof, driveway and other impermeable surfaces is directed away from the application area.
- ✓ Fence irrigation areas.
- ✓ Ensure appropriate warning signs are visible at all times in the vicinity of a spray irrigation area.
- ✓ Have your irrigation system checked by the service agent when they are carrying out service on the treatment system.

### DON'T

- ✗ Don't erect any structures, construct paths, graze animals or drive over the land application area.
- ✗ Don't plant large trees that shade the land application area, as the area needs sunlight to aid in the evaporation and transpiration of the effluent.
- ✗ Don't plant trees or shrubs near or on house drains.
- ✗ Don't alter stormwater lines to discharge into or near the land application area.
- ✗ Don't flood the land application area through the use of hoses or sprinklers.
- ✗ Don't let children or pets play on land application areas.
- ✗ Don't water fruit and vegetables with the effluent.
- ✗ Don't extract untreated groundwater for potable use.

## Warning signs

Regular visual checking of the system will ensure that problems are located and fixed early.

The visual signs of system failure include:

- ⚠ surface ponding and run-off of treated wastewater
- ⚠ soil quality deterioration
- ⚠ poor vegetation growth
- ⚠ unusual odours

## Volume of water

Land application areas and systems for on-site application are designed and constructed in anticipation of the volume of waste to be discharged. Uncontrolled use of water may lead to poorly treated effluent being released from the system.

If the land application area is waterlogged and soggy the following are possible reasons:

- A Overloading the treatment system with wastewater.
- A The clogging of the trench with solids not trapped by the septic tank. The tank may require desludging.
- A The application area has been poorly designed.
- A Stormwater is running onto the area.


## HELP PROTECT YOUR HEALTH AND THE ENVIRONMENT

Poorly maintained land application areas are a serious source of water pollution and may present health risks, cause odours and attract vermin and insects.

By looking after your sewage management system you can do your part in helping to protect the environment and the health of you and your family.

For more information please contact:

# Your Land Application Area

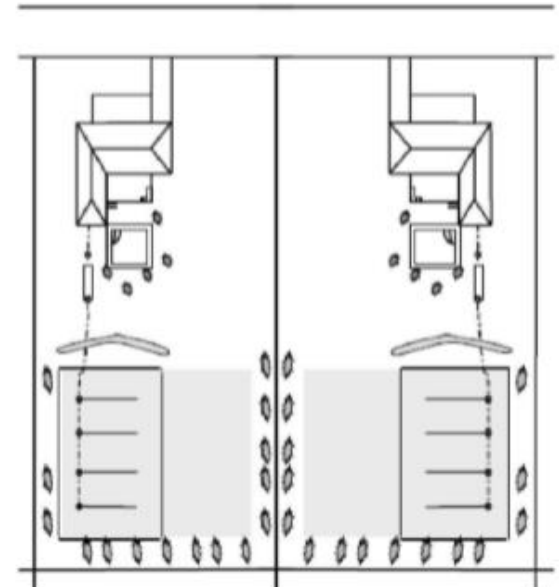

## Appendix D – Laboratory Results

## CERTIFICATE OF ANALYSIS

<b>Work Order</b>	<b>: EW2103772</b>	<b>Page</b>	<b>: 1 of 4</b>
<b>Client</b>	<b>: GSL Environmental</b>	<b>Laboratory</b>	<b>: Environmental Division NSW South Coast</b>
<b>Contact</b>	<b>: Simon Doberer</b>	<b>Contact</b>	<b>: Aneta Prosaroski</b>
<b>Address</b>	<b>: 71 Moona Creek Road Vincentia</b>	<b>Address</b>	<b>: 1/19 Ralph Black Dr, North Wollongong 2500 NSW Australia</b>
<b>Telephone</b>	<b>: ----</b>	<b>Telephone</b>	<b>: 02 42253125</b>
<b>Project</b>	<b>: Fotheringay Road, CLARENCE TOWN</b>	<b>Date Samples Received</b>	<b>: 06-Sep-2021 12:37</b>
<b>Order number</b>	<b>: 27821</b>	<b>Date Analysis Commenced</b>	<b>: 08-Sep-2021</b>
<b>C-O-C number</b>	<b>: ----</b>	<b>Issue Date</b>	<b>: 16-Sep-2021 09:30</b>
<b>Sampler</b>	<b>: Client, Simon Doberer</b>		
<b>Site</b>	<b>: ----</b>		
<b>Quote number</b>	<b>: EN/333</b>		
<b>No. of samples received</b>	<b>: 6</b>		
<b>No. of samples analysed</b>	<b>: 6</b>		



Accreditation No. 825  
Accredited for compliance with  
ISO/IEC 17025 - Testing

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

**Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QA/QC Compliance Assessment to assist with Quality Review and Sample Receipt Notification.**

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is carried out in compliance with procedures specified in 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Accreditation Category</i>
Ankit Joshi	Inorganic Chemist	Sydney Inorganics, Smithfield, NSW
Dian Dao	Senior Chemist - Inorganics	Sydney Inorganics, Smithfield, NSW





## General Comments

The analytical procedures used by ALS have been developed from established internationally recognised procedures such as those published by the USEPA, APHA, AS and NEPM. In house developed procedures are fully validated and are often at the client request.

Where moisture determination has been performed, results are reported on a dry weight basis.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

When sampling time information is not provided by the client, sampling dates are shown without a time component. In these instances, the time component has been assumed by the laboratory for processing purposes.

Where a result is required to meet compliance limits the associated uncertainty must be considered. Refer to the ALS Contact for details.

Key : CAS Number = CAS registry number from database maintained by Chemical Abstracts Services. The Chemical Abstracts Service is a division of the American Chemical Society.  
LOR = Limit of reporting  
^ = This result is computed from individual analyte detections at or above the level of reporting  
ø = ALS is not NATA accredited for these tests.  
~ = Indicates an estimated value.

- **Analytical work for this work order will be conducted at ALS Sydney.**
- ED007 and ED008: When Exchangeable Al is reported from these methods, it should be noted that Rayment & Lyons (2011) suggests Exchange Acidity by 1M KCl - Method 15G1 (ED005) is a more suitable method for the determination of exchange acidity ( $H^+$  +  $Al^{3+}$ ).



## Analytical Results

Sub-Matrix: SOIL (Matrix: SOIL)				Sample ID	TP1	TP3	TP5	TP7	TP9
Sampling date / time					02-Sep-2021 00:00	02-Sep-2021 00:00	02-Sep-2021 00:00	02-Sep-2021 00:00	02-Sep-2021 00:00
Compound	CAS Number	LOR	Unit		EW2103772-001	EW2103772-002	EW2103772-003	EW2103772-004	EW2103772-005
					Result	Result	Result	Result	Result
<b>EA002: pH 1:5 (Soils)</b>									
pH Value	----	0.1	pH Unit		5.6	5.7	5.9	5.9	6.0
<b>EA010: Conductivity (1:5)</b>									
Electrical Conductivity @ 25°C	----	1	µS/cm		51	43	38	44	22
<b>ED007: Exchangeable Cations</b>									
Exchangeable Calcium	----	0.1	meq/100g		4.4	7.2	6.0	5.6	3.5
Exchangeable Magnesium	----	0.1	meq/100g		1.5	2.4	1.5	1.4	0.7
Exchangeable Potassium	----	0.1	meq/100g		0.8	0.8	0.6	0.5	<0.1
Exchangeable Sodium	----	0.1	meq/100g		0.2	0.2	<0.1	<0.1	0.2
Cation Exchange Capacity	----	0.1	meq/100g		6.9	10.6	8.2	7.6	4.4
Exchangeable Sodium Percent	----	0.1	%		2.2	2.1	1.0	1.0	3.8
<b>EK072: Phosphate Sorption Capacity</b>									
Phosphate Sorption Capacity	----	250	mg P sorbed/kg		1420	1790	840	751	559
Phosphate Sorption Index	----	1	mgkg-1/log10 ugL-1		50	59	12	13	24



## Analytical Results

Sub-Matrix: <b>SOIL</b> (Matrix: <b>SOIL</b> )			Sample ID	<b>TP11</b>	----	----	----	----
			Sampling date / time	02-Sep-2021 00:00	----	----	----	----
Compound	CAS Number	LOR	Unit	<b>EW2103772-006</b>	-----	-----	-----	-----
Result				----	----	----	----	----
<b>EA002: pH 1:5 (Soils)</b>								
pH Value	----	0.1	pH Unit	<b>6.0</b>	----	----	----	----
<b>EA010: Conductivity (1:5)</b>								
Electrical Conductivity @ 25°C	----	1	µS/cm	<b>21</b>	----	----	----	----
<b>ED007: Exchangeable Cations</b>								
Exchangeable Calcium	----	0.1	meq/100g	<b>3.6</b>	----	----	----	----
Exchangeable Magnesium	----	0.1	meq/100g	<b>1.2</b>	----	----	----	----
Exchangeable Potassium	----	0.1	meq/100g	<0.1	----	----	----	----
Exchangeable Sodium	----	0.1	meq/100g	<b>0.3</b>	----	----	----	----
Cation Exchange Capacity	----	0.1	meq/100g	<b>5.2</b>	----	----	----	----
Exchangeable Sodium Percent	----	0.1	%	<b>5.0</b>	----	----	----	----
<b>EK072: Phosphate Sorption Capacity</b>								
Phosphate Sorption Capacity	----	250	mg P sorbed/kg	<b>827</b>	----	----	----	----
Phosphate Sorption Index	----	1	mgkg-1/log10 ugL-1	<b>32</b>	----	----	----	----

## Inter-Laboratory Testing

Analysis conducted by ALS Sydney, NATA accreditation no. 825, site no. 10911 (Chemistry) 14913 (Biology).

(SOIL) EK072: Phosphate Sorption Capacity

(SOIL) EA010: Conductivity (1:5)

(SOIL) EA002: pH 1:5 (Soils)

(SOIL) ED007: Exchangeable Cations



## CHAIN OF CUSTODY

ALS Laboratory:  
please click →

DADELAIDE 21, Bona Road, Port Adelaide SA 5009  
Ph: 08 8356 4950 Fax: 08 8356 4917 E: [info@macskay.com.au](mailto:info@macskay.com.au)

**BRISBANE** 32 Shand Street Stafford QLD 4051 **MELBOURNE** 2-4 Westall Road Springvale VIC 3171  
 Ph: 07 3243 7222 E: [samples.brisbane@alsglobal.com.au](mailto:samples.brisbane@alsglobal.com.au) 8549 5600 E: [samples.melbourne@alsglobal.com](mailto:samples.melbourne@alsglobal.com)

Ph: 07 7476 0303 E: [60251inord@redmail.com](mailto:60251inord@redmail.com)

NEWCASTLE 5/535 Maitland Rd May 26/2015 NSW 2304 Woodpark Road Smithfield

Ph: 02 4014 2500 E: samples.newcastle@alsglobal.com.au Ph: 02 4014 2500 E: samples.sydney@alsglobal.com.au  
 ry Place North Nowra NSW 2541 QTOWNSVILLE 14-15 Desma Court Bohle QLD 4818  
 newcastle@alsglobal.com Ph: 07 4000 0000 E: samples.townsville@alsglobal.com.au

Ph: 07 4798 0600 E: [townsville.environmental@alsglobal.com](mailto:townsville.environmental@alsglobal.com)  
 WOLLONGONG 99 Kenny Street Wollongong NSW 2500

**CLIENT: GSL Environmental**

**OFFICE: 71 Moona Creek Road, VINCENTIA**

**PROJECT: Fotheringhay Road, CLARENCE TOWN**

ORDER NUMBER:27821

**PROJECT MANAGER:** Simon Doberer

CONTACT PH: 0418935888

**SAMPLER:** Simon Dobrerer

**SAMPLER MOBILE: 0416936868**

COC emailed to ALS? ( YES / NO)

**EDD FORMAT (or default):**

Email Reports to (will default to PM if no other addresses are listed): [galeenvironmental@outlook.com](mailto:galeenvironmental@outlook.com)

Email Invoice to (will default to PM if no other addresses are listed): [galenvrnmnts@outlook.com](mailto:galenvrnmnts@outlook.com)

**TURNAROUND REQUIREMENTS :**

(Standard TAT may be longer for some tests e.g., Ultra Trace Organics)

☐ Standard TAT (List due date):

☐ Non Standard or urgent TAT (List due date):

ALS QUOTE NO.:

**SY/175/20**

COC SEQUENCE NUMBER (Circle)

COC: 1 2 3 4 5 6 7

OF: 1 ~~2~~ 3 4 5 6 7

FOR LABORATORY USE ONLY (Circle)

Custody Seal Intact?	Yes	No	N/A
----------------------	-----	----	-----

Free ice / frozen ice bricks present upon	Yes	No	Not Applicable
---	-----	----	----------------

receipt?	Yes	No	N/A
----------	-----	----	-----

Random Sample Temperature on Receipt: °C

Other comment: 16.7

INDEXED BY: \_\_\_\_\_ RECEIVED BY: \_\_\_\_\_

ACQUISISHED BY: \_\_\_\_\_ RECEIVED BY: \_\_\_\_\_


TEST TIME: DATE/TIME:

[illegible]

COMMENTS/SPECIAL HANDLING/STORAGE OR DISPOSAL:

ALS USE	SAMPLE DETAILS MATRIX: SOLID (S) WATER (W)			CONTAINER INFORMATION		ANALYSIS REQUIRED including SUITES (NB, Suite Codes must be listed to attract suite price) Where Metals are required, specify Total (unfiltered bottle required) or Dissolved (field filtered bottle required).								Additional Information
LAB ID	SAMPLE ID	DATE / TIME	MATRIX	TYPE & PRESERVATIVE (to codes below) (refer	TOTAL CONTAINERS	IN-4S	ED006	EK072						Comments on likely contaminant levels, dilutions, or samples requiring specific QC analysis etc.
	TP1	2/09/2021	S		1	1	1	1						
	TP3	2/09/2021	S		1	1	1	1						
	TP5	2/09/2021	S		1	1	1	1						
	TP7	2/09/2021	S		1	1	1	1						
	TP9	2/09/2021	S		1	1	1	1						
	TP11	2/09/2021	S		1	1	1	1						
TOTAL					6	6	6	6						

Environmental Division  
Wollongong  
Work Order Reference  
**EW2103772**



Telephone : 02 42263121

Water Container Codes: P = Unpreserved Plastic; N = Nitric Preserved Plastic; ORC = Nitric Preserved ORC; SH = Sodium Hydroxide/Cd Preserved; S = Sodium Hydroxide Preserved Plastic; AG = Amber Glass Unpreserved; AP = Airtight Unpreserved Plastic; V = VOA Vial HCl Preserved; VB = VOA Vial Sodium Bisulfate Preserved; VS = VOA Vial Sulfuric Preserved; AV = Airtight Unpreserved Vial SG = Sulfuric Preserved Amber Glass; H = HCl preserved Plastic; HS = HCl preserved Speciation bottle; SP = Sulfuric Preserved Plastic; F = Formaldehyde Preserved Glass; Z = Zinc Acetate Preserved Bottle; E = EDTA Preserved Bottles; ST = Sterile Bottle; ASS = Plastic Bag for Acid Sulphate Solids; B = Unpreserved Bag.

Environmental Division  
Wollongong  
Work Order Reference  
**EW2103772**



Telephone : 02 42267228