


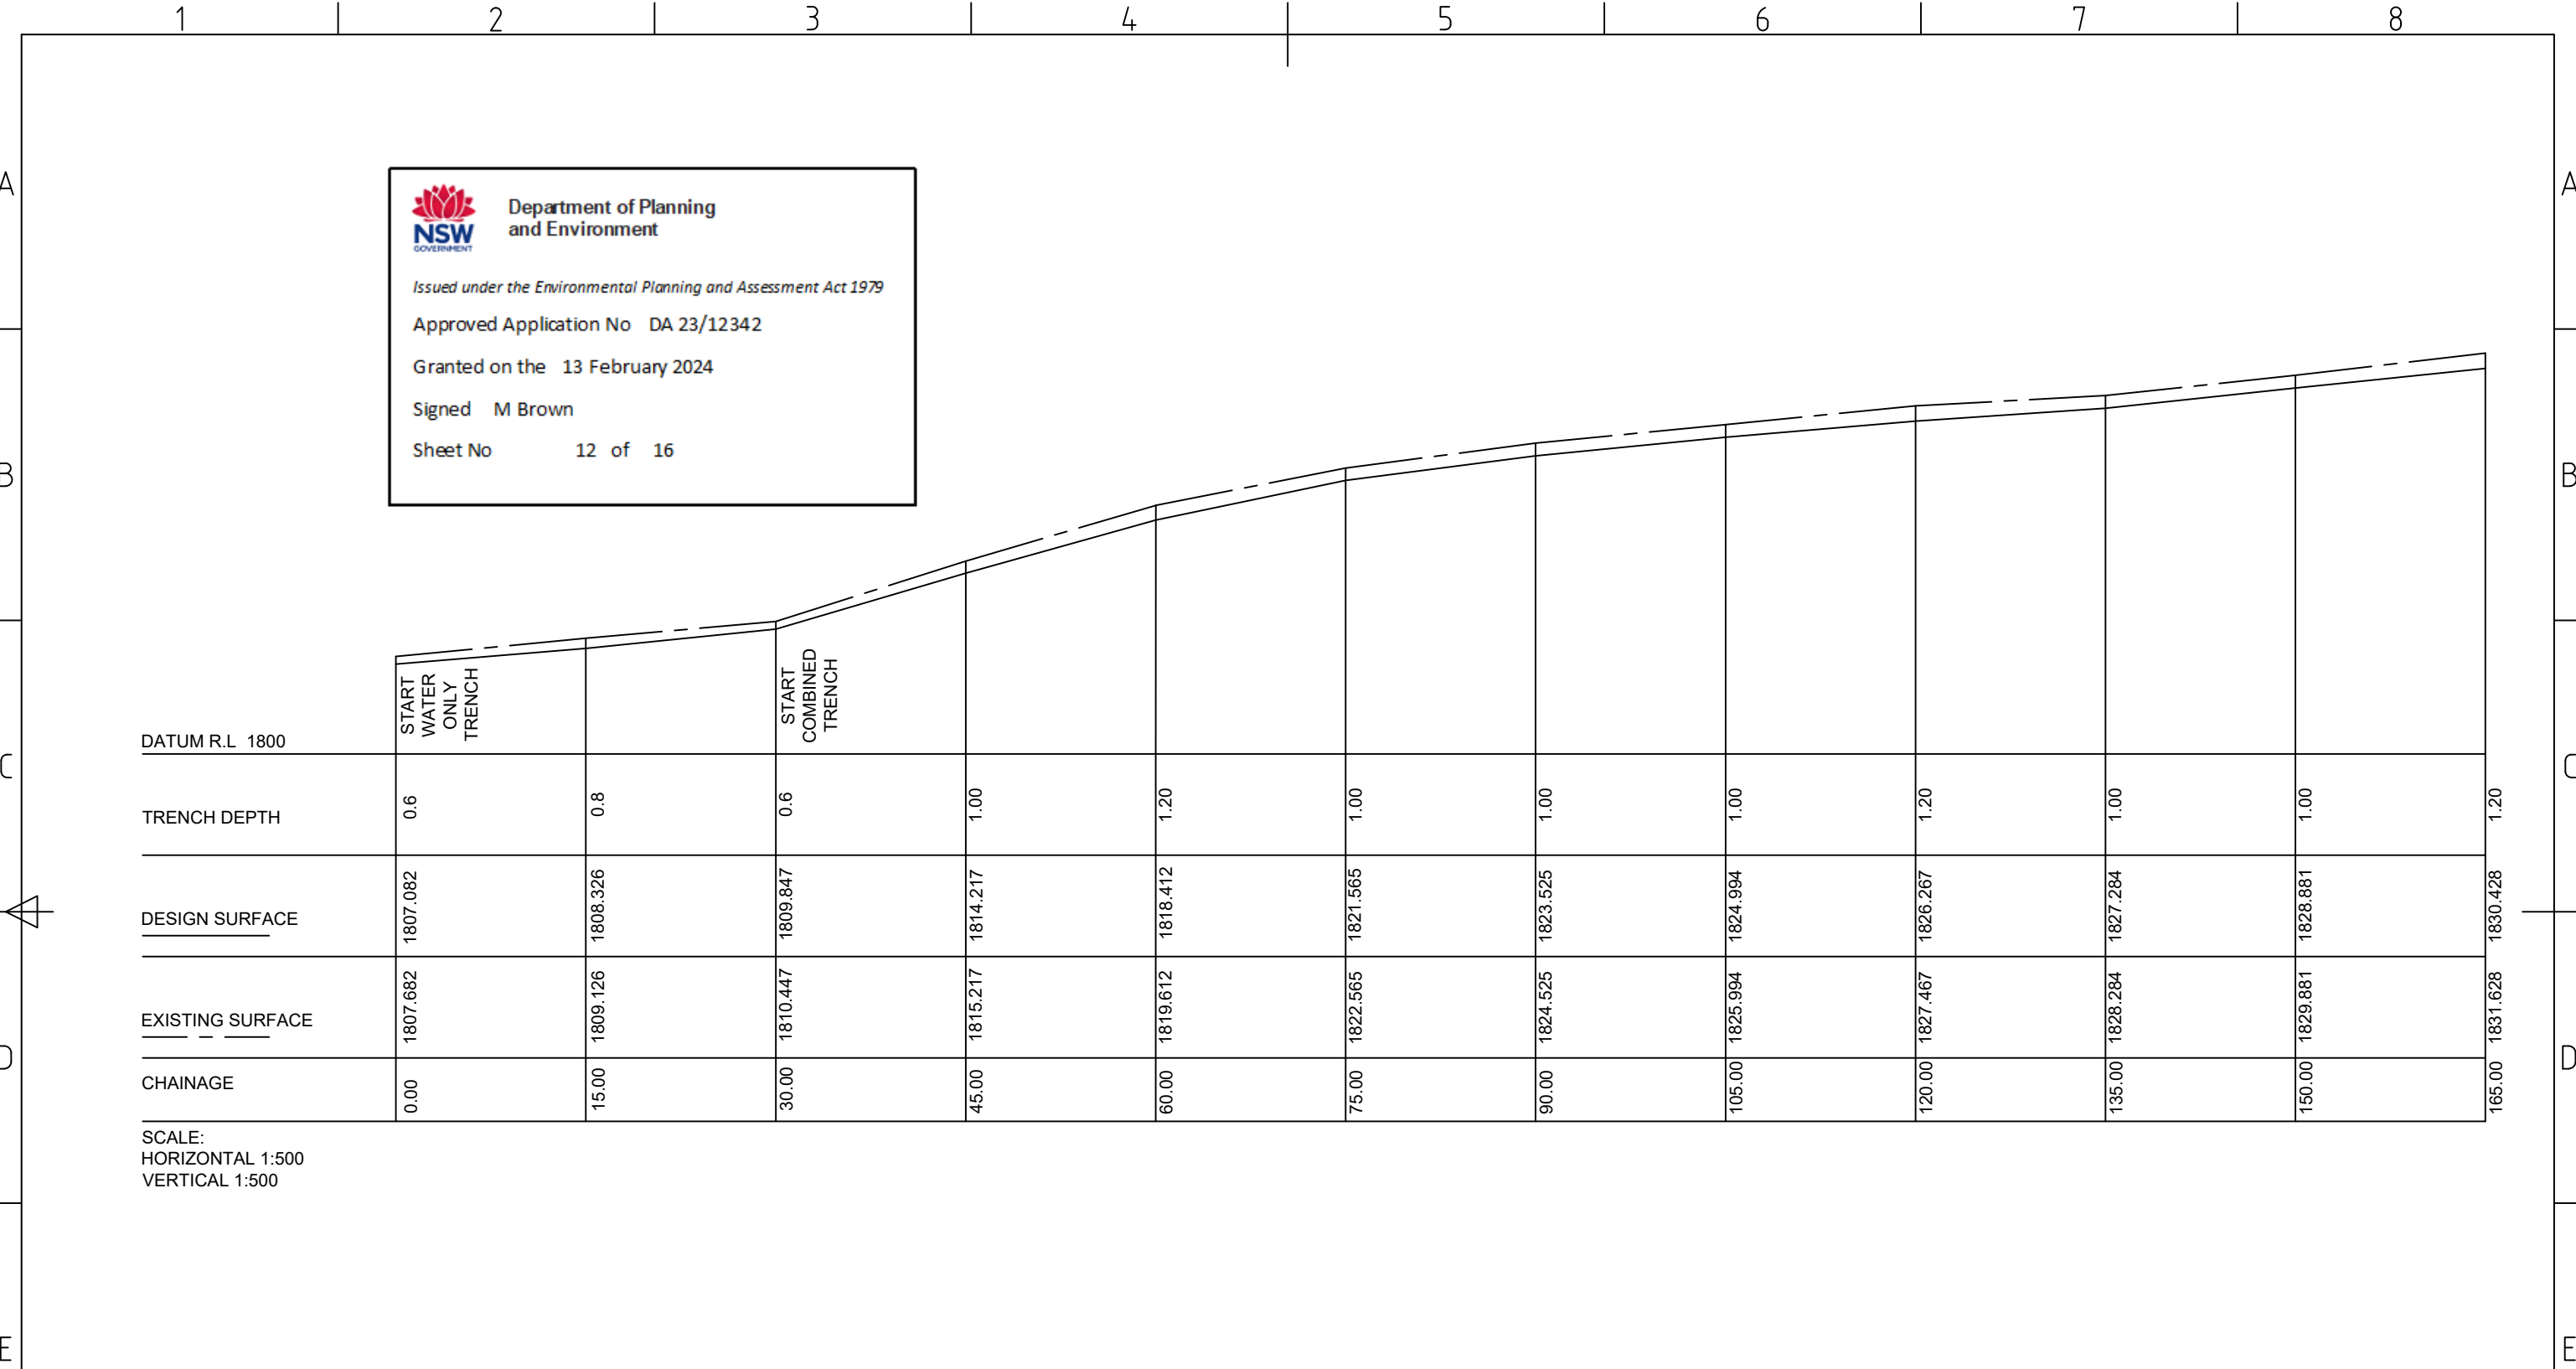

NOTES:

1. TRENCHING IN THE NOMINATED DEPTH OF 1.0M FOR COMBINED SNOWMAKING AND SERVICES TRENCH AND 0.6M FOR SERVICES TRENCH, VERTICAL CUTS MAY BE CARRIED OUT IF SIDEWALLS REMAIN STABLE DURING PIPE CONSTRUCTION

2. FOR SECTIONS DEEPER THAN 1.5M, BENCHING MUST BE CARRIED OUT TO ACHIEVE AN OVERALL TEMPORARY BATTER SLOPE NO STEEPER TAN 1H:1V AND WITH MAXIMUM INDIVIDUAL BENCH HEIGHTS OF 1.5M

© COPYRIGHT – KOSCIUSZKO THREDBO PTY. LTD.
NOT TO BE UTILISED OR COPIED IN PART, OR
IN WHOLE, WITHOUT PERMISSION.