


SECTION B-B THROUGH SWALE Scale 1 : 25


GENERAL NOTE
ALL PLUMBING & DRAINAGE SHALL BE
UNDERTAKEN IN STRICT ACCORDANCE WITH
a) AS 3500 NATIONAL PLUMBING & DRAINAGE

- CODE

 b) NATIONAL CONSTRUCTION CODE
- c) LOCAL GOVERNMENT AUTHORITY
- d) RELEVANT AUSTRALIAN STANDARDS
- e) NATURAL GAS INSTALLATION SHALL BE IN ACCORDANCE WITH AS 5601-2013
- f) IN ACCORDANCE WITH THE REQUIREMENTS
- ÓF WATER NSW

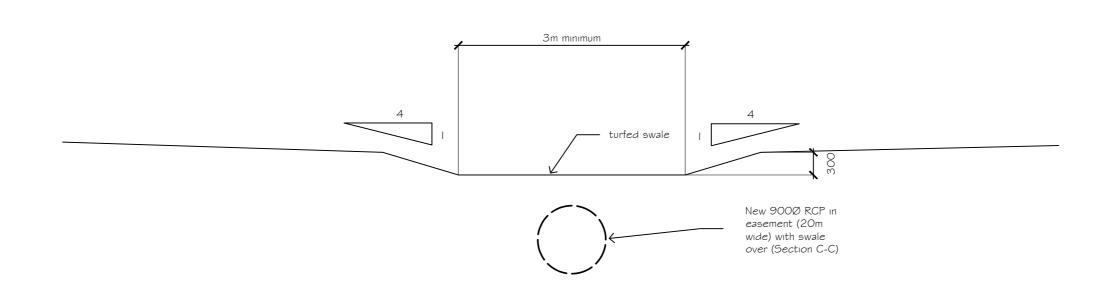

SECTION C-C THROUGH SWALE Not to Scale

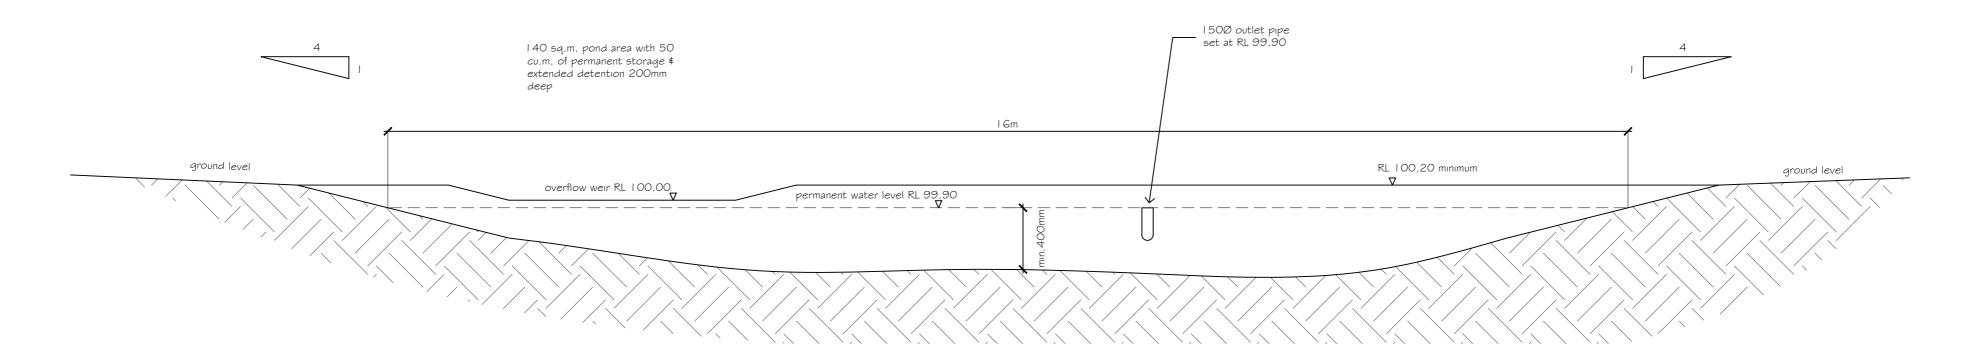

SECTION A-A THROUGH POND

Not to Scale

										20.9.23	as per detail	R.B	J.N. Tiernan BE MIE Aust	No. in set: 2	36152	02	Rev:
						awts aerated waste treatment system	tm tempering valve thermostatic mixing valve	vp ivmf co io io inspection opening gully bs boundary shaft floor waste tundish briw driw hwu p (a)	THIS DRAWING IS FOR GUIDANCE ONLY. ALL FINAL DETAILS MUST MEET SITE CONDITIONS RELEVANT AUTHORITIES & APPLICABLE AUSTRALIAN & LOCAL CODES. CONTRACTORS MUST VERIFY ALL LEVELS & DIMENSIONS ON THE JOB BEFORE COMMENCING ANY WORK OR MAKING SHOP DRAWINGS. FIGURED DIMENSIONS ARE TO BE USED. SCALED DIMENSIONS ARE TO BE VERIFIED.			Drawn: Checked:		SECTION & DETAILS			
				gas meter - water meter -		hd australian height datu polypropylene inspection pic pit wts gerated waste	n wc toilet ur urinal							Residential Subdivision			
				HR 25ø hose reel		fbp floor mounted bayons base wbp wall mounted bayone base	t nrv non return valve u union bsn handbasin shr shower			Phone: (02) 4872 2800 Email: engineer@a			Mobile: 0413 059 550 net.com.au	Taralga			
				< hot water NG natural gas		ed dropper dp downpipe ng natural gas	wm water meter cold water dq drinking quality water hw water ww warm water hc hose cock sv stop valve gv gate valve bv ball valve – fullway						DP 5411 Lot A 34 Hillas St				
<u> </u>				DQ 20ø — drinking quality water - WW 15ø — warm water -		h fire hydrant b fire hydrant booster d fire damper				CIVIL & STRUCTURAL							
REV.	DATE	APP'D.	AMENDMENT		fhr fire hose reel	wm water meter	Vp vent pipe					NASA RAAD					