

BUSHFIRE CERTIFICATE

PROPOSED NEW DWELLING

**LOT 56 DP 1299650
3 Lady Parry Drive, Stroud**

Date: **2/06/2024**

Prepared for: **McDonald Jones Homes**

NEWCASTLE BUSHFIRE CONSULTING

5 Chartley Street, Warners Bay NSW 2282
(ph) 02 40230149 (mob) 0423 923284
email: mail@newcastlebushfire.com.au

I hereby declare that I am a BPAD accredited bushfire practitioner.		
Accreditation No.	BPAD16132	
Signature		
Date	2/06/2024	

Couch Family Trust T/A
Newcastle Bushfire Consulting Pty Ltd A.B.N. 96 831 374 298
Bushfire and Building Sustainability Consultants

Document Status

Revision No.	Issue	Description	Reviewed	Approved by Director
1	2/06/2024	Final	C. Couch	P. Couch

Prepared By:



Phillip Couch GFireE
Bach Info Science
Grad Dip Design for Bushfire Prone Areas
FPAA BPAD – Level 3 Accreditation Number BPD-PA-16132
Director Newcastle Bushfire Consulting



TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY AND COMPLIANCE TABLES	4
2.0 INTRODUCTION	6
2.1 PURPOSE OF REPORT	6
2.2 PROPOSED DEVELOPMENT	6
3.0 BUSHFIRE ATTACK ASSESSMENT	6
3.1 VEGETATION CLASSIFICATION	6
3.2 EFFECTIVE SLOPE.....	10
3.3 BUSHFIRE ATTACK LEVELS.....	10
4.0 UTILITY SERVICES AND INFRASTRUCTURE	12
4.1 WATER SERVICES.....	12
4.2 ELECTRICITY SERVICES.....	12
4.3 GAS SERVICES.....	12
5.0 PROPERTY ACCESS	12
6.0 LANDSCAPING MAINTENANCE	13
7.0 RECOMMENDATIONS.....	13
8.0 CONCLUSION	14
9.0 APPENDIX 1.0 – ASSET PROTECTION ZONES SUMMARY	15
10.0 REFERENCES AND DISCLAIMER	16

LIST OF TABLES

TABLE 1 – PROPERTY DETAILS AND TYPE OF PROPOSAL	4
TABLE 2 – BUSHFIRE THREAT ASSESSMENT.....	4
TABLE 3 – PLANNING FOR BUSH FIRE PROTECTION (2019) COMPLIANCE.....	5

LIST OF FIGURES

FIGURE 1 – SITE CONSTRAINTS MAP	8
FIGURE 2 – LOCALITY MAP.....	9
FIGURE 3 – COUNCIL’S BUSHFIRE PRONE LAND MAP	9
FIGURE 4 – SITE PLAN	11

LIST OF PHOTOGRAPHS

PHOTO 1 - SITE PHOTO LOOKING EAST	7
PHOTO 2 - SOUTHERN GRAZING PASTURE.....	7
PHOTO 3 - EASTERN CLEARED RESIDENTIAL LAND AND NORTHERN GRASSLAND	10

1.0 EXECUTIVE SUMMARY AND COMPLIANCE TABLES

This report has assessed the proposed new dwelling against the requirements of Section 4.14 of the Environmental Planning and Assessment Act 1979, AS3959 (2018) Construction of buildings in bushfire-prone areas and Planning for Bush Fire Protection (2019).

This report establishes that the new dwelling is capable of complying with the acceptable solutions of Planning for Bush Fire Protection (2019).

TABLE 1 – PROPERTY DETAILS AND TYPE OF PROPOSAL

Applicant Name	McDonald Jones Homes		
Site Address	3 Lady Parry Drive, Stroud	Lot/Sec/DP	Lot 56 DP 1299650
Local Government Area	Mid-Coast	FDI	80
Bushfire Prone Land	Yes, mapped bushfire prone land		
Type of development	New Dwelling	Type of Area	Rural Residential
Special Fire Protection Purpose	No	Flame Temperature	1090K
Application Complies with Acceptable Solutions	Yes. Relevant specifications and requirements are satisfied	Referral to NSW Rural Fire Service (NSW RFS) required	No

TABLE 2 – BUSHFIRE THREAT ASSESSMENT

	North	East	South	West
Vegetation Structure	Grassland	Maintained Land/Low-threat	Grassland	Maintained Land
Distance to Vegetation	49 metres	140 metres	14 metres	140 metres
Accurate Slope Measure	8 degrees downslope	N/A	Level/Cross-slope	N/A
Slope Range	>5 to 10 degrees downslope	N/A	Level/Upslope	N/A
AS3959 (2018) Bushfire Attack Level (BAL)	BAL-12.5	BAL-LOW	BAL-19	BAL-LOW

The highest BAL, being **BAL-19** applies to the entire building except the northern elevation, which may be built to BAL-12.5 due to shielding of the building bulk.

TABLE 3 – PLANNING FOR BUSH FIRE PROTECTION (2019) COMPLIANCE

Performance Criteria	Proposed Development Determinations	Method of Assessment
Asset Protection Zone	Asset protection zones have been determined in accordance with Planning for Bush Fire Protection (2019). The asset protection zone will be maintained for the life of development and defendable space is provided onsite.	Acceptable Solution
Siting and Design	Buildings have been designed to minimise the risk of bushfire attack.	Acceptable Solution
Construction Standards AS3959 (2018)	Bushfire Attack Levels have been determined in accordance with Planning for Bush Fire Protection (2019). The highest BAL to the proposed building was determined to be BAL-19. The northern elevation may be built to BAL-12.5 due to shielding of the building bulk	Acceptable Solution
Private and or Public Road Infrastructure	The public road system is not affected or changed as part of this application.	Acceptable Solution
Property Access	Property access offers compliance with Planning for Bush Fire Protection (2019) Section 7.	Acceptable Solution
Water and Utility Services	Water, electricity and gas services offer compliance with Planning for Bush Fire Protection (2019) Section 7.	Acceptable Solution
Landscaping	Landscaping to comply with Planning for Bush Fire Protection (2019) Appendix 4.	Acceptable Solution

Bushfire Certification

This report has been prepared by Phillip Couch, a Fire Protection Association, Bushfire Planning and Design - Alternate Solutions Accredited Practitioner (FPAA BPAD-Level 3) and a Graduate Fire Engineer with the Institution of Fire Engineers. Phillip Couch certifies that the proposed development design conforms to the relevant specifications and requirements of AS3959 (2018) Construction of buildings in bushfire-prone areas and Planning for Bush Fire Protection (2019) detailed in Section 4.14 of the Environmental Planning and Assessment Act 1979.



2/06/2024

Phillip Couch GFireE

Bach Info Science

Grad Dip Design for Bushfire Prone Areas

FPAA BPAD – Level 3 Accreditation Number BPD-PA-16132

2.0 INTRODUCTION

2.1 PURPOSE OF REPORT

The purpose of this report is to establish suitable bushfire mitigation measures for the proposed new dwelling to be constructed at Lot 56 DP 1299650, 3 Lady Parry Drive, Stroud in order for the Council to make determination of the proposed development pursuant to the requirements of Section 4.14 of the Environmental Planning and Assessment Act 1979.

Features on or adjoining the site that may mitigate the impact of a bushfire on the proposed development

The vegetation surrounding the site is a combination of cleared residential land and short cropped grazing pasture. Rotational grazing could lead to limited ember attack with future subdivision stages resulting in even lower grassfire risk.

Likely environmental impact of any proposed bush fire protection measures

No native vegetation removal is required for the development.

The recommendations within this report address the aims and objectives of Planning for Bush Fire Protection (2019) to reduce the risk of ignition of the new dwelling in a bushfire event.

2.2 PROPOSED DEVELOPMENT

The proposed development includes the construction of a new freestanding dwelling.

3.0 BUSHFIRE ATTACK ASSESSMENT

3.1 VEGETATION CLASSIFICATION

Potential bushfire hazards were identified from Mid-Coast Council's Bushfire Prone Mapping as occurring within the investigation area. Aerial mapping and inspection of the site reveals that the bushfire prone land map is somewhat inaccurate in respect to the current bushfire hazard.

The major vegetative threats have been determined using Keith (2004) to derive vegetation structures listed in Planning for Bush Fire Protection (2019).

Primary vegetation structures have been identified in Figure 1 – Site Constraints Map and separation distances shown in Table 2 – Bushfire Attack Assessment.



PHOTO 1 - SITE PHOTO LOOKING EAST

View of the subject site looking east. Cleared residential land extends east, southeast and west of the site.



PHOTO 2 - SOUTHERN GRAZING PASTURE

View of grazing pasture located south of the site. The land has been conservatively assessed as grassland due to no guaranteed management plan.



FIGURE 1 – SITE CONSTRAINTS MAP

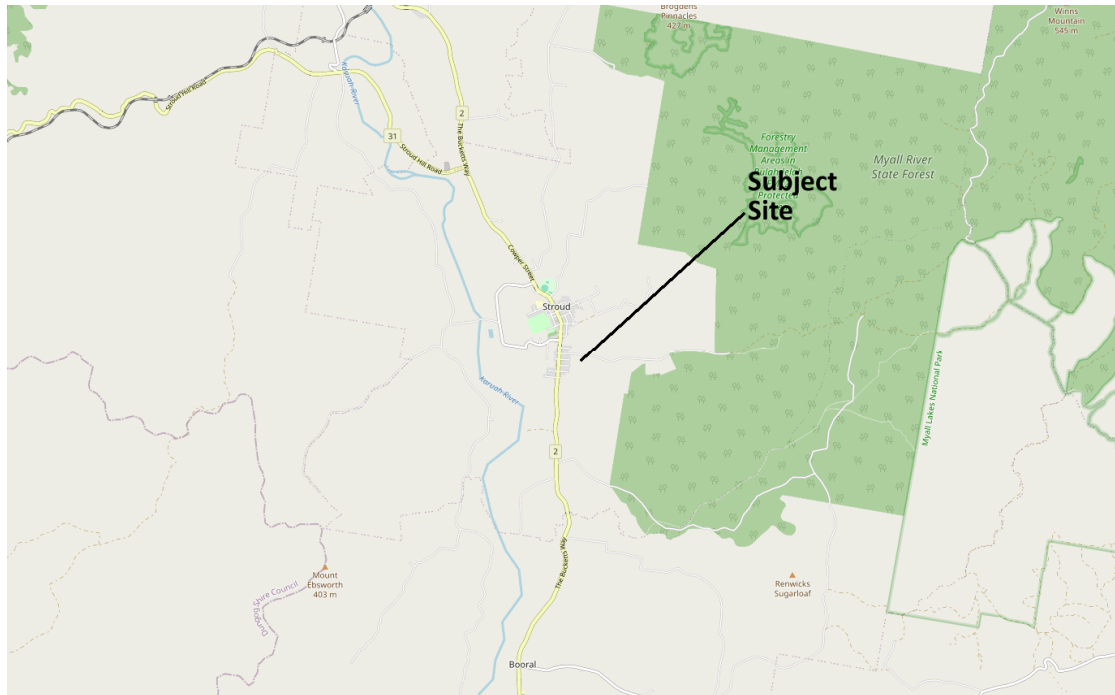


FIGURE 2 – LOCALITY MAP
Courtesy of OpenStreetMap

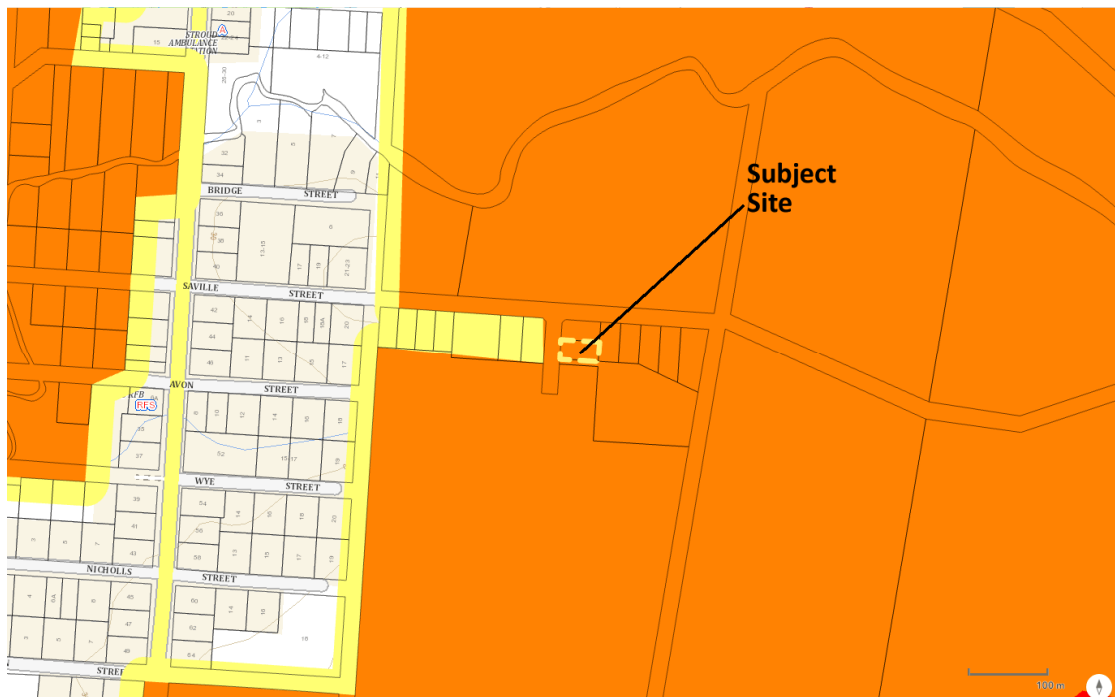


FIGURE 3 – COUNCIL'S BUSHFIRE PRONE LAND MAP

3.2 EFFECTIVE SLOPE

Effective Slope was measured using 2-metre contour data obtained from the Department of Lands and verified by a laser hypsometer on site. The laser hypsometer verified slope within the vegetation, calculating effective fire run slope from 5 separate measurements in each dominant direction.

Effective Slopes have been identified in Figure 1 – Site Constraints Map and slope ranges are shown in Table 2 – Bushfire Threat Assessment.

3.3 BUSHFIRE ATTACK LEVELS

BALs and relevant construction levels in accordance with Planning for Bush Fire Protection (2019) have been demonstrated in Section 1 Executive Summary and Compliance Tables.


Reduction in Construction Requirements due to Shielding (Northern Elevation)

In accordance with AS3959 (2018) Section 3.5, the construction requirements for the next lower BAL than that determined for the site may be applied to an elevation of the building where the elevation is not exposed to the source of bushfire attack. An elevation is deemed to be not exposed to the source of bushfire attack if all of the straight lines between that elevation and the source of bushfire attack are obstructed by another part of the building.



PHOTO 3 - EASTERN CLEARED RESIDENTIAL LAND AND NORTHERN GRASSLAND

View of cleared residential land located east of the site with grazing pasture visible to the north. The short grazing pasture represents limited grassfire fuels.



4.0 UTILITY SERVICES AND INFRASTRUCTURE

4.1 WATER SERVICES

A reticulated water supply and street hydrant access is available providing coverage of the development in accordance with AS 2419.1.

4.2 ELECTRICITY SERVICES

The existing electrical transmission lines are located underground and require no additional protection measures.

4.3 GAS SERVICES

- Reticulated or bottled gas to be installed and maintained in accordance with AS1596 (2002) and the requirements of the relevant authorities. Metal piping is to be used.
- Fixed gas cylinders to be kept clear of flammable material by a distance of 10 metres and shielded on the hazard side of the installation.
- Gas cylinders close to the dwelling are to have the release valves directed away from the building and be at least 2 metres from flammable material with connections to and from the gas cylinder being of metal.
- Polymer-sheathed, flexible gas supply lines to gas meters adjacent to the buildings are not to be used.

5.0 PROPERTY ACCESS

Property access is by way of Lady Parry Drive providing access from the public road system directly to the private land, giving firefighters access to the building.

Property access roads shall comply with Section 7 of Planning for Bush Fire Protection (2019).

Planning for Bush Fire Protection (2019) requires no specific access requirements where a 70-metre, unobstructed path can be demonstrated between the most distant external part of the proposed building and the nearest part of the public access road (where the road speed limit is not greater than 70kph) that supports the operational use of emergency firefighting vehicles (i.e. a hydrant or water supply). There are no formal requirements for property access.

6.0 LANDSCAPING MAINTENANCE

It is recommended that landscaping is undertaken in accordance with Planning for Bush Fire Protection (2019) Appendix 4 and be maintained for the life of the development.

Trees should be located greater than 2 metres from any part of the roofline of a building. Garden beds of flammable shrubs are not to be located under trees and should be no closer than 10 metres from an exposed window or door. Trees should have lower limbs removed up to a height of 2 metres above the ground.

The landscaped area should be maintained free of leaf litter and debris. The gutter and roof should be maintained free of leaf litter and debris.

Landscaping should be managed so that flammable vegetation is not located directly under windows.

Ground fuels such as fallen leaves, twigs (less than 6 millimetres in diameter) and branches should be removed on a regular basis, and grass needs to be kept closely mown and, where possible, green.

7.0 RECOMMENDATIONS

Based upon an assessment of the plans and information received for the proposal, it is recommended that development consent be granted subject to the following conditions:

1. The proposed building works excepting the northern elevation, shall comply with BAL-19 in accordance with AS3959 (2018) Construction of buildings in bushfire-prone areas or NASH Standard (1.7.14 updated) National Standard Steel Framed Construction in Bushfire Areas – 2014 as appropriate and the additional construction requirements of Planning for Bush Fire Protection (2019) Section 7.5.2.
2. The northern elevation of the proposed building works shall comply with BAL-12.5 in accordance with AS3959 (2018) Construction of buildings in bushfire-prone areas or NASH Standard (1.7.14 updated) National Standard Steel Framed Construction in Bushfire Areas – 2014 as appropriate and the additional construction requirements of Planning for Bush Fire Protection (2019) Section 7.5.2.
3. At the commencement of building works and in perpetuity, the entire property shall be managed as an inner protection area (IPA) as outlined within Appendix 4 of Planning for Bush Fire Protection 2019 and the NSW Rural Fire Service's document Standards for Asset Protection Zones.
4. Water, electricity and gas are to comply with Section 7 of Planning for Bush Fire Protection (2019).

5. Landscaping is to be undertaken in accordance with Planning for Bush Fire Protection (2019) Appendix 4 and managed and maintained in perpetuity.
6. It is recommended that the property owner and occupants familiarise themselves with the relevant bushfire preparation and survival information provided by the NSW RFS.

8.0 CONCLUSION

The final recommendation is that the proposed development offers compliance with Planning for Bush Fire Protection (2019). There is potential for bushfire attack at this site and a list of recommendations has been included in the above assessment to reduce that risk.

9.0 APPENDIX 1.0 – ASSET PROTECTION ZONES SUMMARY

Below is a summary of Asset Protection Zones outlined in appendix 4 of Planning for Bush Fire Protection (2019) and the NSW Rural Fire Services “Standards for Asset Protection Zones”. The property owner(s) should obtain these two documents and familiarise themselves with their content.

Generally

Asset Protection Zones (APZ) refer to the area between the bushfire threat and the asset (i.e. building). The APZ may contain two areas; the Inner Protection Area (IPA) and the Outer Protection Area (OPA). Some areas should be managed entirely as an Inner Protection Area (IPA). Refer to the plans for locations of APZ and distances from Assets.

Inner Protection Area (IPA)

The inner protection area is located adjacent to the asset and is identified as a fuel-free zone.

A. Shrubs (consisting of plants that are not considered to be trees)

1. Create large discontinuities or gaps in the vegetation to slow down or break the progress of fire towards buildings should be provided;
2. Shrubs should not be located under trees;
3. Shrubs should not form more than 10% ground cover; and
4. Clumps of shrubs should be separated from exposed windows and doors by a distance of at least twice the height of the vegetation.

B. Trees: Maintain a minimum 2-5 metre canopy separation.

1. Tree canopy cover should be less than 15% at maturity;
2. Trees at maturity should not touch or overhang the building;
3. Lower limbs should be removed up to a height of 2m above the ground;
4. Tree canopies should be separated by 2 to 5m; and
5. Preference should be given to smooth barked and evergreen trees.

Outer Protection Area (OPA)

The Outer Protection Area (OPA) is located adjoining the vegetation. The OPA should be maintained as a fuel-reduced area. This assumes trees may remain but with a significantly reduced shrub, grass, and leaf litter layer. In many situations leaf litter and the shrub layer may not require maintenance at all.

A. Shrubs:

1. Shrubs should not form a continuous canopy;
2. Shrubs should form no more than 20% of ground cover.

B. Trees:

1. Existing trees can be retained.
2. Tree canopy cover should be less than 30%; and
3. Canopies should be separated by 2 to 5m.

Grass (throughout the entire asset protection zone)

Grass should be kept mown (as a guide grass should be kept to no more than 100mm in height); and leaves and vegetation debris should be removed.

10.0 REFERENCES AND DISCLAIMER

References

Standards Australia AS3959 (2018) Construction of buildings in bushfire-prone areas.

Keith D. "Ocean Shores to Desert Dunes", Department of Environment and Conservation, Sydney, (2004).

Environmental Planning and Assessment Act 1979.

New South Wales Rural Fire Service Planning for Bush Fire Protection (2019).

Disclaimer

Despite the recommendations in this report, it is impossible to remove the risk of fire damage to the building entirely. This report assesses and provides recommendations to reduce that risk to a manageable level. It is of paramount importance that the recommendations are adhered to for the life of the structure and that all maintenance is performed to ensure a level of protection is provided to the building, occupants and firefighters.

Planning for Bush Fire Protection (2019) states that notwithstanding the precautions adopted, it should always be remembered that bushfires burn under a wide range of conditions and an element of risk, no matter how small, always remains.

AS3959 (2018) Construction of buildings in bushfire-prone areas states that the standard is designed to lessen the risk of damage to buildings occurring in the event of the onslaught of bushfire. There can be no guarantee, because of the variable nature of bushfires, that any one building will withstand bushfire attack on every occasion. External combustible cladding is not recommended.