



STORMWATER

CIVIL

FLOODING

STRUCTURAL

REMEDIAL

20240376




PROPOSED STORMWATER DRAINAGE PLANS

Proposed Alterations And Additions Development
42 Homer Street Earlwood 2206

Reference
20240376-DA-SW-DWG-01

Client
Van Hai Nguyen

Architect
Design Formation

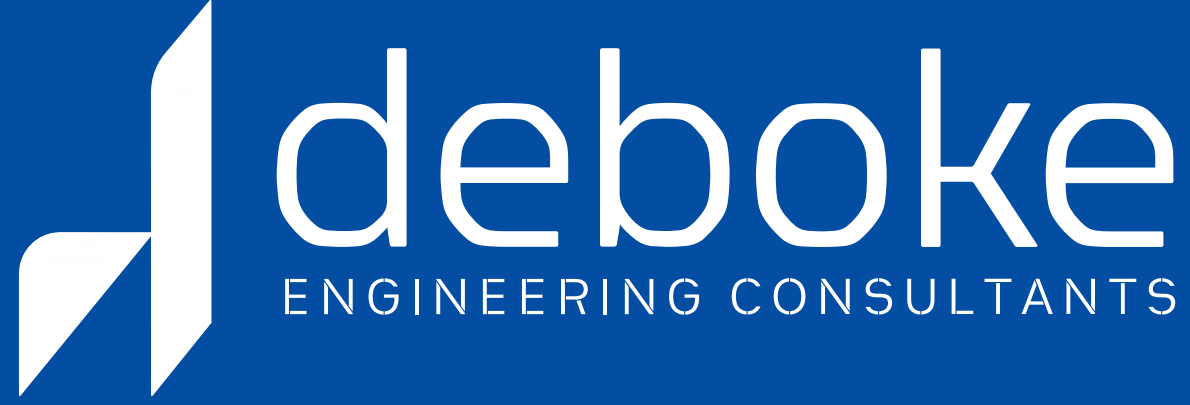

Drawing Register		
Number	Name	Revision
S100	Cover Sheet	01
S101	Specifications Sheet	01
S200	Garage Plan	01
S201	Ground Floor Plan	01
S202	First Floor Plan	01
S203	Roof Plan	01
S300	Details Sheet	01
S400	Erosion and Sediment Control Plan	01

General Notes

- All work shall be carried out in accordance with council's requirements, building code of Australia, NSW code of practice and the to the relevant service codes.
- These drawings shall be read in conjunction with all architectural and other consultants' drawings and specifications and with such other written instructions as may be issued during the course of the contract. All discrepancies shall be referred to the superintendent for decision before proceeding with the work.
- All dimensions shown on the drawings are in millimeters (u.n.o.). Dimensions shall not be obtained by scaling of these drawings. Use figured dimensions only.
- Benchmarks have been established where indicated on the drawings. All Levels are to Australian height datum A.H.D.). The contractor shall undertake all necessary survey work to ensure that the works are constructed to design line and level.
- Setting out dimensions and levels shown on the drawings shall be verified by the contractor.
- All materials shall be in accordance with the requirements of the relevant codes and the by-laws and ordinances of the relevant building authorities.
- It is the contractor's responsibility to provide all safety fences, warning signs, traffic diversions and the like during construction. All works to comply with work health and safety requirements and other relevant authority safety requirements.
- No trees shall be removed, cutback or relocated without the written instruction from the superintendent.
- Where new works abut existing the contractor shall ensure that a smooth even profile, free from abrupt changes is obtained.
- All works shall be carried out in accordance with the details shown on the drawings and these specifications.
- Design Levels given are to finished surface level and inclusive of topsoil. (topsoil depth varies)
- The contractor shall arrange all survey set out to be carried out by a registered surveyor.
- Care is to be taken when excavating near existing services. No mechanical excavations are to be undertaken over telecommunications or electrical services. Hand excavate in these areas.
- The locations of underground services shown on the drawing have been plotted from diagrams provided by service authorities. This information has been prepared solely for the authorities own use and may not necessarily be updated or accurate.
- The position of services as recorded by the authority at the time of installation may not reflect changes in the physical environment after installation.
- Deboke Engineering Consultants do not guarantee that the services information shown on the drawing shows more than the presence or absence of services, and will accept no liability for inaccuracies in the services information shown from any cause whatsoever.
- It is the contractor's responsibility to obtain from the utility services authorities a current copy of underground services search for the location of all existing services prior to commencement of any work and notify any conflict with the drawings immediately. Clearance shall be obtained from the relevant regulatory authority. Contractor to keep copy of underground services search on site at all times. Any damages to services or services adjustments shall be carried out by the contractor or relevant authority at the contractor's expense.
- Visit the site before submitting the final tender price to assess 'on site' conditions. Failure to do so will forfeit any claim for not being aware of conditions affecting the tender.
- The contractor shall prepare accurate work-as-executed drawings following the completion of all works.
- It is the contractor's responsibility to have in place & maintain traffic facilities at all times during construction.
- Contractor to provide workshop coordinated drawings prior to commencing works on site. Workshop drawings to be reviewed and approved by design engineer.

Stormwater Notes

- Contractor must verify all dimensions & existing levels, services & structures on site prior to commencement of work.
- Plans to be read in conjunction with approved Architectural, Landscape, Structural, Hydraulic, & other services drawings & specifications. If any discrepancies exist between the drawings, the builder shall report the discrepancies to the engineer prior to commencement of any works.
- Where subsoil drainage lines pass under floor slabs & vehicular pavements, slotted uPVC sewer grade pipe shall be used.
- Charged lines to be sewer grade & sealed.
- All pipes to have min 150mm cover if located within property.
- All pits in driveways to be concrete & all pits in landscaped areas may be plastic.
- Pits less than 600mm deep may be brick, precast or concrete.
- All balconies & roofs to be drained & to have safety overflows in accordance with relevant Australian standards.
- All grates to have child proof locks.
- All drainage works to avoid tree roots.
- Council's issued footway design levels to be incorporated into the finished levels once issued by council.
- All works shall be in accordance with NCC BCA 2019 & A.S.3500.3.
- Care to be taken around existing sewer. Structural advice required for sewer protection against additional loading from new pits, pipes, retaining walls & OSD basin water levels.
- All Ø300 drainage pipes & larger shall be class 2 approved spigot & socket RCP pipes with rubber ring joints (U.N.O.). All drainage pipes up to & including Ø225 shall be sewer grade uPVC with solvent weld joints (U.N.O.).
- All pipe junctions, bends & tapers up to & including Ø450 shall be via purpose made fittings.
- Contractor to supply & install all fittings including various pipe adaptors to ensure proper connection between dissimilar pipe work.
- All connections to existing drainage pits shall be made in accordance with the NCC BCA 2019 and relevant Australian Standards. The internal wall of the pit at the point of entry shall be cement rendered to ensure a smooth finish.
- Bedding shall be type H1 (U.N.O.), in accordance with current relevant Australian standards.
- Where stormwater lines pass under floor slabs, sewer grade rubber ring joints are to be used.
- All pipes in covered balconies to be Ø65 uPVC cast in concrete slab.
- Ø65 PVC @ min 1.0% Ø90 PVC @ min 1.0%
Ø100 PVC @ min 1.0% Ø150 PVC @ min 1.0%
Ø225 PVC @ min 0.5% Ø300 PVC @ min 0.4%
Unless Noted Otherwise
- Contractor to provide a break / open void in rail / balustrade for stormwater emergency overflow.
- All enclosed areas/planter boxes be fitted with floor wastes.
- Downpipes to be checked by architect & plumber prior to construction.
- Provide 3.0m length of Ø100 subsoil drainage pipe wrapped in fabric sock, at upstream end of each pit.
- All the cleaning eyes (or inspection eyes) for the underground pipes must be taken up to the finished ground level for easy identification & maintenance purposes.
- All sub-soil drainage shall be provided with a filter sock. The subsoil drainage shall be installed in accordance with details to be provided by the landscape architect.
- Prior to commencing any works, the builder shall ensure that the invert levels of where the site stormwater system connects into the council's kerb/drainage system matched the design levels. Any discrepancies shall be reported to the design engineer immediately.
- For stormwater drainage pipes that exceed 1:5 grade, reinforced concrete anchor blocks shall be installed. Anchor blocks to be constructed to specifications set out in AS3500.3-2003 section 8.10
- Existing services shown in approximate locations only. Confirm exact locations and depths on site prior to commencing work.
- Coordinate the installation of new services with all new & existing services & structural provisions as determined on site.
- All pipework is to be tested in accordance with the requirements as set out in AS3500.3-2003. All in-ground pipework to be inspected by the superintendent under test conditions prior to backfilling. Backfilling and bedding to AS3500.3-2003.
- Pipes shall be true to grades shown and aligned so that the centre of the inlet pipe intersects with the centre of the outlet pipe at the downstream face of the pit.
- Lay and joint all pipes in accordance with the manufacturer's recommendations and AS3725-2007 'design for installation of buried concrete pipes'.
- Allow to test all pipes and pits to local authority's requirements.
- Excavate trenches and stockpile all material for inspection with regard to reuse for trench backfill. Remaining material to be removed from site.
- Backfill pipes with imported fill. Provide 200mm side support and 150mm overlay above pipe crown. Trench fill above the embedment zone to the underside of the road pavement or the footway shall be as follow:-

- Under roadway
Trench fill material shall consist of imported fill as specified herein of either high grade compaction sand or approved crushed road gravel conforming to TfNSW QA specification 3051 or similar.
- Other than roadway
Trench material excavated shall consist of select fill as specified herein and shall not contain more than 20% of stones of size between 25mm and 75mm and none larger than 75mm. Prior to use of the excavated material it shall be inspected and approved by the engineer.
38. Compact bedding, Embedment and trench fill materials as follow:-
Embedment:-
For granular fill material (non-cohesive soil) e.g. Coarse aggregate fill, the density index (id) shall be not less than 70%.
Trench fill:-
For granular material (non cohesive soils). The density index (id) shall be not less than 70%. For non-granular fill material (cohesive soils), the dry density ratio (rd) shall be not less than 95%.
39. Existing services
Utility information shown on the plans is not intended to depict more than the presence of any services. Actual locations should be verified by hand excavation prior to construction.
40. The contractor shall allow for the capping off, excavation and removal (if required) of all existing services in areas affected by the works.
41. The contractor shall ensure that services to all buildings not affected by the works are not disrupted at all times. The contractor shall construct temporary services to maintain existing supply to buildings remaining where required. Once the works are complete and commissioned the contractor shall remove all such temporary services and make good all disturbed areas.
42. Existing pipes which form no part of the drainage system shall be removed or sealed as indicated on the plans.
43. Where downpipes pass under floor slabs, sewer grade uPVC with rubber ring joints are to be used.
44. Minimum grade to drainage pipes to be 1% (U.N.O.), min. Size 100mm diameter (U.N.O.).
45. Pipe installation under trafficable areas shall be in accordance with concrete pipe association of Australia publication "concrete pipe selection & installation" type HS3 support.
46. Equivalent strength FRC pipes may be used subject to authority approval.
47. Minimum pipe cover to be 600mm under trafficable areas and 300mm elsewhere (U.N.O.).
48. Contractor to supply and install all fittings and specials including various pipe adaptors to ensure proper connection between dissimilar pipework.
49. Provide cleaning eyes to all downpipes not directly connected to pits.
50. Stormwater drainage connections to council's system shall be to the requirements and the satisfaction of the local council.
51. Drainage pits
Pits deeper than 1200mm to be fitted with step irons at 300 centres to AS1657-2013 'fixed platforms, walkways, stairways and ladders - design, construction and installation'.
52. All exposed edges to be rounded with 20mm radius, or chamfered 20mm x 20mm.
53. Pit reinforcement - mesh SL82 Lap to be 400mm min. Clear cover 40 mm. Cast against blinding or formwork. Corner returns may be fabric or equivalent bars.
54. Benching to be half outgoing pipe depth. Concrete for benching to be 20mpa mass concrete.
55. Approved precast pits may be used.
56. 100mm diameter hole for subsoil drainage outlet to be located 100mm above invert of all inlet pipes. Subsoil drainage to extend for a distance of 3m upstream of pit (at each inlet trench) with the upstream end sealed.
57. Pit grate, frames and solid covers shall be Class B in non traffic areas and Class D in trafficable areas in accordance with AS3946.
58. Maximum front entry pipe:-
a. Straight entry - Ø750
b. Skew entry 45° - Ø525
59. Subsoil drainage
Subsoil pipes shall be laid at a min grade of 0.5% (U.N.O.).
60. Additional subsoil drainage shall be laid to suit site conditions and groundwater presence as directed.
61. Subsoil pipes shall be laid behind kerbs in cut areas of the site.
62. Grates to pits in footpath areas shall be heel safe complying with the disabled access code.
63. Contractor to provide workshop coordinated drawings prior to commencing works on site. Workshop drawings to be reviewed and approved by design engineer.
64. All external area to have a minimum 1% fall to outlets provided.
65. Provide overflows to all areas to architect's specifications.
66. All rainwater outlets to open areas shall be SPS TRUFLO type TIA100F unless noted otherwise. Do not install balcony outlets or similar in areas subject to direct rainfall.

Legend

- RAINWATER TANK LINES
- STORMWATER LINE
- SUBSOIL LINE
- STORMWATER RISING MAIN
- HIGH LEVEL STORMWATER LINE
- OVERFLOW LINE
- EXISTING STORMWATER LINE
- AUTHORITY STORMWATER LINE
- AUTHORITY SEWER LINE
- AUTHORITY WATER LINE
- AUTHORITY GAS LINE
- AUTHORITY ELECTRICITY LINE
- AUTHORITY UNDERGROUND ELECTRICITY LINE
- AUTHORITY FIBRE OPTIC LINE
- AUTHORITY COMMS LINE
- FENCE LINE
- GRATED SURFACE INLET PIT
- JUNCTION PIT
- KERB INLET PIT
- EXISTING KERB INLET PIT
- EXISTING TELSTRA PIT
- EXISTING HYDRANT
- EXISTING STOP VALVE
- EXISTING POWER POLE
- EXISTING SEWER MANHOLE
- OVERLAND FLOW PATH
- RAINWATER OUTLET
- CLEAR OUT POINT
- CAPPING
- DOWNPIPE DROP
- DOWNPIPE
- SPOT LEVELS
- BENCHMARK

DBYD DECLARATION



BEFORE YOU DIG SHOULD BE CONTACTED PRIOR TO ANY EXCAVATION ON SITE

TM: TRADE MARK OF THE ASSOCIATION OF DIAL BEFORE YOU DIG SERVICES LTD. USED UNDER LICENSE.

SERVICES NOTE





SERVICES SHOWN ON PLAN ARE INDICATIVE, EXACT DEPTH AND LOCATION TO BE CONFIRMED ONSITE. CONTRACTOR TO CARRY OUT DIAL BEFORE YOU DIG APPLICATION AND ENGAGE A REGISTERED SURVEYOR TO PEG OUT ALL EXISTING SERVICES PRIOR TO ANY WORK COMMENCING ONSITE.

ABBREVIATIONS

Ø or DIA	DIAMETER
CO	CLEAR OUT
DDO	DISH DRAIN OUTLET
DP	DOWNPIPE
e	EXISTING
FFL	FINISHED FLOOR LEVEL
GTd	GRATED TRENCH DRAIN
GSIP	GRATED SURFACE INLET PIT
IL	INVERT LEVEL
KIP	KERB INLET PIT
NGL	NATURAL GROUND LEVEL
OFF	OVERLAND FLOWPATH
OSD	ON-SITE DETENTION
RCP	REINFORCED CONCRETE PIPE
RL	REDUCED LEVEL
RWT	RAINWATER TANK
SW	STORMWATER
SWP	STORMWATER PIT
SWRM	STORMWATER RISING MAIN
SWS	STORMWATER SUMP
TOK	TOP OF KERB
TOW	TOP OF WALL
uPVC	UNPLASTICISED POLYVINYL CHLORIDE


Erosion and Sediment Control Notes

- Before earthworks can commence the erosion & sediment control measures must be in place.
- During the construction period, these control measures will need to be inspected & maintained regularly, especially after storm events, by the contractor.
- All work is to be carried out to prevent erosion, contamination & sedimentation of the storage site, surrounding areas & drainage systems.
- Minimize disturbed area covered with natural vegetation. Only those areas directly required for construction are to be disturbed.
- Install erosion/sediment control measures prior to commencement of construction or excavation operations.
- Provide silt fence/straw bale barriers to the low side of all exposed earth excavations. Tie sediment fencing material to cyclone wire security fence. Sediment control fabric shall be an approved material (eg. Humes propex silt stop) standing 300mm above ground & extending 150mm below ground.
- Isolate existing stormwater pits with straw bales or silt traps to filter all incoming flows.
- Do not stockpile excavated material on the roadway.
- Divert clean water from undisturbed areas around the working areas.
- Construction entry/exit shall be via the location noted on the drawing. Contractor shall ensure all droppable soil & sediment is removed prior to construction traffic exiting site. Contractor shall ensure all construction traffic entering and leaving the site do so in a forward direction.
- Treat the stormwater runoff with suspended solids so the discharge water quality to council stormwater drainage system has a maximum concentration of suspended solids that does not exceed 50 milligrams per litre in accordance with the protection of the environment operation act (poee 1997) and shall be approved by local council.
- Adopt temporary measures as may be necessary for erosion & sediment control, including but not limited to the following:-
-Drains: temporary drains and catch drains.
-Spreader banks or other structures: to disperse concentrated runoff.
-Silt traps: construction and maintenance of silt traps to prevent discharge of scoured material to downstream areas.
- After rain, inspect, clean, and repair if required, temporary erosion & sediment control measures.
- Remove temporary erosion & sediment control measures when they are no longer required.
- Comply with the requirements of Landcom's Managing Urban Stormwater - Soil and Construction 'The Blue Book' latest edition
- The erosion & sediment control plan provided is only indicative. The contractor should prepare a detailed ESCP suitable for the specific site conditions

	Project No. 20240376-DA-SW-DWG-01	Drawing No. S101	<table><tr><th>Rev.</th><th>Description</th><th>Design</th><th>Date</th></tr><tr><td>01</td><td>Issued For DA</td><td>CS</td><td>07-10-2024</td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr></table>	Rev.	Description	Design	Date	01	Issued For DA	CS	07-10-2024															<p>Project Proposed Alterations And Additions Development</p> <p>Application Development Application</p> <p>Address 42 Homer Street Earlwood 2206</p> <p>LGA CANTERBURY-BANKSTOWN Council</p>	<table><tr><th>Drawn</th><th>DF</th><th>Designed</th><th>CS</th></tr><tr><td>Reviewed</td><td>AA</td><td>Date</td><td>07-10-2024</td></tr><tr><td>Approved</td><td>AA</td><td>Date</td><td>07-10-2024</td></tr></table> <div>Andrew Arida B.E Civil/Structural MIEAust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455) </div>	Drawn	DF	Designed	CS	Reviewed	AA	Date	07-10-2024	Approved	AA	Date	07-10-2024	<table><tr><th>Discipline</th><th>Consultant</th><th>Reference</th><th>Revision</th><th>Date</th></tr><tr><td>Architect</td><td>Design Formation</td><td>----</td><td>02</td><td>04.09.2024</td></tr><tr><td>Surveyor</td><td></td><td></td><td></td><td></td></tr><tr><td>Landscape</td><td></td><td></td><td></td><td></td></tr><tr><td>Geotechnical</td><td></td><td></td><td></td><td></td></tr><tr><td>Structural</td><td></td><td></td><td></td><td></td></tr><tr><td>Hydraulic/Fire</td><td></td><td></td><td></td><td></td></tr><tr><td>Mechanical</td><td></td><td></td><td></td><td></td></tr></table>	Discipline	Consultant	Reference	Revision	Date	Architect	Design Formation	----	02	04.09.2024	Surveyor					Landscape					Geotechnical					Structural					Hydraulic/Fire					Mechanical					<div><p>E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688</p><p>COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.</p></div>
	Rev.	Description	Design	Date																																																																													
	01	Issued For DA	CS	07-10-2024																																																																													
Drawn	DF	Designed	CS																																																																														
Reviewed	AA	Date	07-10-2024																																																																														
Approved	AA	Date	07-10-2024																																																																														
Discipline	Consultant	Reference	Revision	Date																																																																													
Architect	Design Formation	----	02	04.09.2024																																																																													
Surveyor																																																																																	
Landscape																																																																																	
Geotechnical																																																																																	
Structural																																																																																	
Hydraulic/Fire																																																																																	
Mechanical																																																																																	
Title Specifications Sheet																																																																																	
Scale																																																																																	

GARAGE PLAN

1:100

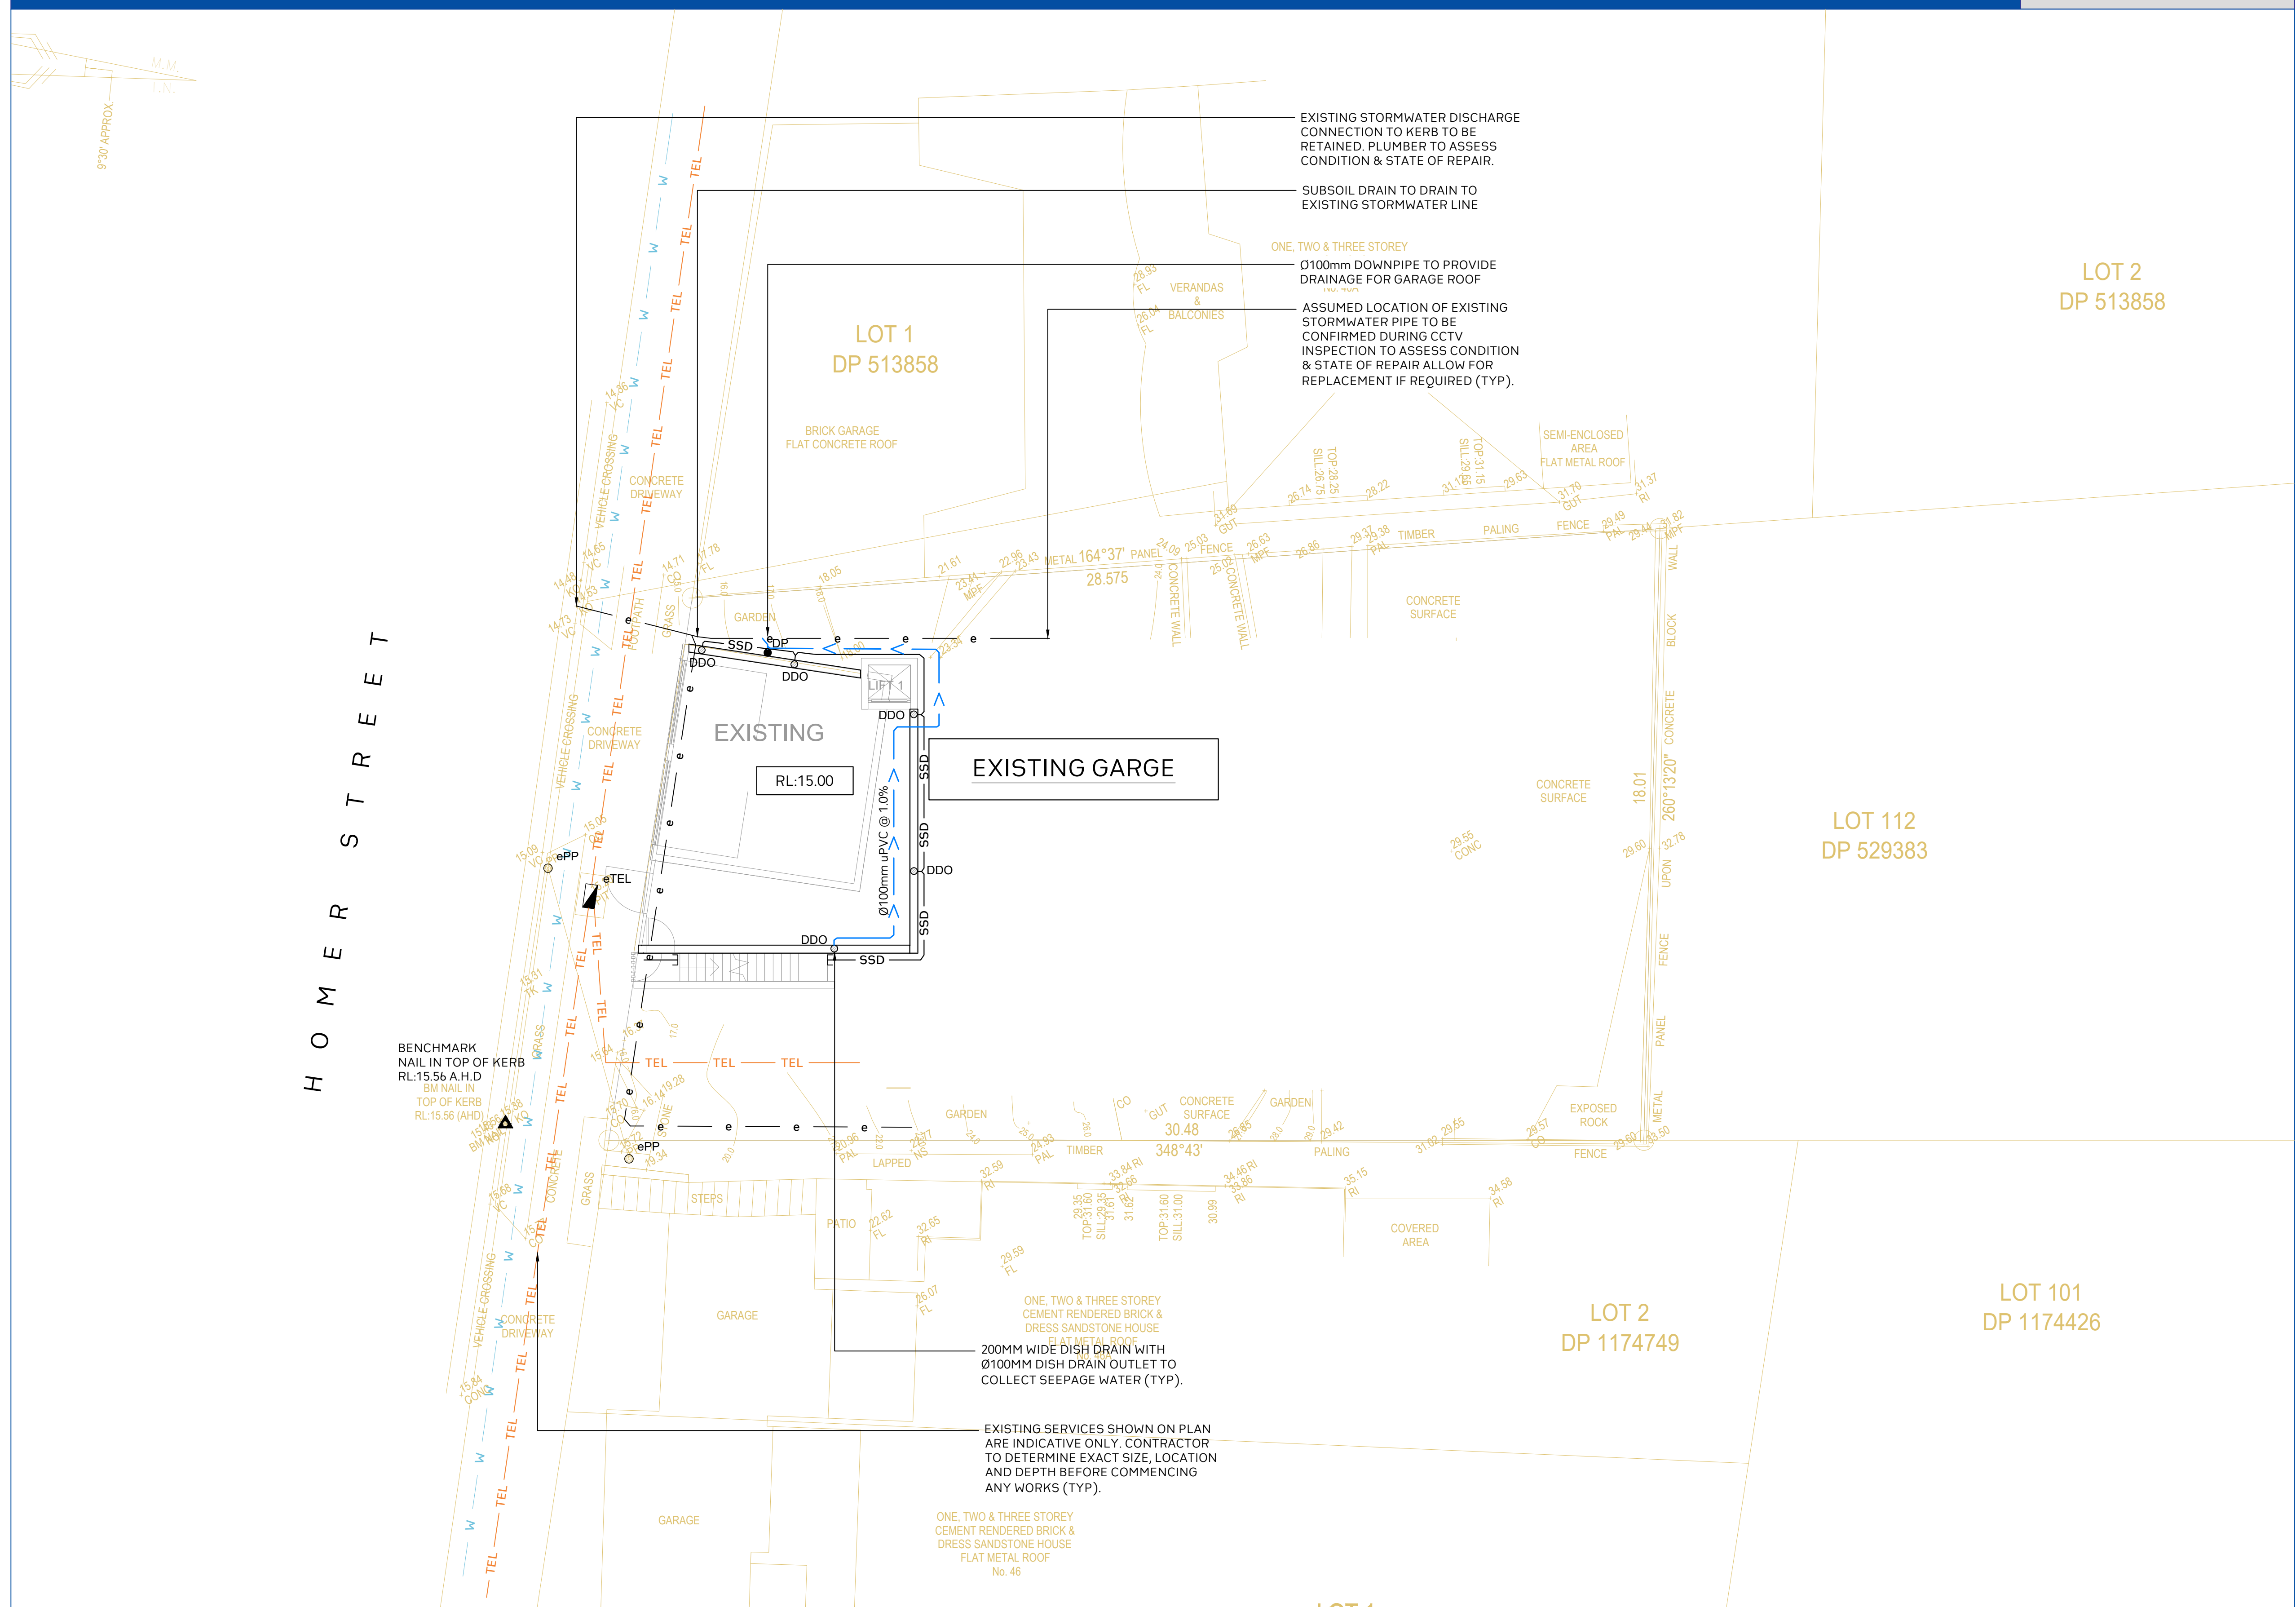

Project No. 20240376-DA-SW-DWG-01	Drawing No. S200
Title Garage Plan	

Scale

0m 1 2 3 4 5

SCALE 1:100 ON ORIGINAL SIZE

⊙

[illegible]

Architect




Client

Project
Proposed Alterations And Additions
Development

Application
Development Application

Address
42 Homer Street Earlwood 2206

LGA
CANTERBURY-BANKSTOWN
Council

Drawn	DF	Designed	CS
Reviewed	AA	Date	07-10-2024
Approved	AA	Date	07-10-2024
Andrew Arida B.E Civil/Structural MIE Aust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455)			

Discipline	Consultant	Reference	Revision	Date
Architect	Design Formation	----	02	04.09.2024
Surveyor				
Landscape				
Geotechnical				
Structural				
Hydraulic/Fire				
Mechanical				



E admin@deboke.com.au
W deboke.com.au
A 17 William Street Ryde NSW 2112
P 02 9188 0688

COPYRIGHT
This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.

General Notes

SITE IS LOCATED IN CANTERBURY-BANKSTOWN COUNCIL.

SITE AREA = 499.492m²

SITE IS GOVERNED BY CANTERBURY-BANKSTOWN DCP
2023-CHAPTER 3.1.

THE DEVELOPMENT IS AN ADDITIONS AND ALTERATIONS. THERE
IS NO CHANGE IN IMPERVIOUS AREA. THUS, OSD IS NOT
REQUIRED.

ALL DOWNPIPES SHOWN ON PLAN ARE Ø100mm uPVC U.N.O.

ALL NEW STORMWATER PIPES TO HAVE A MINIMUM OF 100mm
CONCRETE OR 300mm TOPSOIL COVER U.N.O.

SITE AREA = 499.492m²

SITE IS GOVERNED BY CANTERBURY-BANKSTOWN DCP
2023-CHAPTER 3.1.

THE DEVELOPMENT IS AN ADDITIONS AND ALTERATIONS. THERE IS NO CHANGE IN IMPERVIOUS AREA. THUS, OSD IS NOT REQUIRED.

ALL DOWNPIPES SHOWN ON PLAN ARE Ø100mm uPVC U.N.O.

ALL NEW STORMWATER PIPES TO HAVE A MINIMUM OF 100mm
CONCRETE OR 300mm TOPSOIL COVER U.N.O.

Key Notes









1. ALL EXISTING STORMWATER PIPES AND DOWNPIPES ARE TO BE RETAINED U.N.O (TYP). PLUMBER TO ASSESS CONDITION AND STATE OF REPAIR. ALLOW FOR REPLACEMENT IF REQUIRED.
2. CONTRACTOR TO ENSURE LOCATION OF NEW DWELLING DOES NOT ADVERSELY IMPACT EXISTING STORMWATER SYSTEM. IF SO, CONTRACTOR TO CONTACT STORMWATER ENGINEER PRIOR TO COMMENCING ANY WORKS.
3. CONTRACTOR PERMITTED TO CONNECT TO EXISTING STORMWATER SYSTEM IF FOUND TO BE IN GOOD CONDITION DURING CONSTRUCTION. STORMWATER ENGINEER TO BE CONTACTED PRIOR TO COMMENCING ANY WORKS WHICH VARY FROM THE APPROVED STORMWATER PLANS.
4. IF EXISTING STORMWATER SYSTEM IS CONNECTED TO SEWER, CONTRACTOR IS TO RECTIFY STORMWATER DESIGN AND CREATE A NEW CONNECTION AS PER COUNCIL SPECIFICATIONS AND AUSTRALIAN STANDARDS. CONTRACTOR TO CONTACT STORMWATER ENGINEER PRIOR TO COMMENCING ANY WORKS.









2. CONTRACTOR TO ENSURE LOCATION OF NEW DWELLING DOES NOT ADVERSELY IMPACT EXISTING STORMWATER SYSTEM. IF SO, CONTRACTOR TO CONTACT STORMWATER ENGINEER PRIOR TO COMMENCING ANY WORKS.

3. CONTRACTOR PERMITTED TO CONNECT TO EXISTING STORMWATER SYSTEM IF FOUND TO BE IN GOOD CONDITION DURING CONSTRUCTION. STORMWATER ENGINEER TO BE CONTACTED PRIOR TO COMMENCING ANY WORKS WHICH VARY FROM THE APPROVED STORMWATER PLANS.

4. IF EXISTING STORMWATER SYSTEM IS CONNECTED TO SEWER, CONTRACTOR IS TO RECTIFY STORMWATER DESIGN AND CREATE A NEW CONNECTION AS PER COUNCIL SPECIFICATIONS AND AUSTRALIAN STANDARDS. CONTRACTOR TO CONTACT STORMWATER ENGINEER PRIOR TO COMMENCING ANY WORKS.

Legend

	STORMWATER LINE
	EXISTING STORMWATER LINE
	AUTHORITY WATER LINE
	AUTHORITY COMMS LINE
	EXISTING TELSTRA PIT
	EXISTING POWER POLE
	CLEAR OUT POINT
	BENCHMARK

	STORMWATER LINE
	EXISTING STORMWATER LINE
	AUTHORITY WATER LINE
	AUTHORITY COMMS LINE
	EXISTING TELSTRA PIT
	EXISTING POWER POLE
	CLEAR OUT POINT
	BENCHMARK

[illegible]

LOT 2
DP 513858


LOT 112
DP 529383

LOT 101
DP 1174426



Title
Ground Floor Plan

Scale



0m 1 2 3 4 5

SCALE 1:100 ON ORIGINAL SIZE

[illegible]

Architect




Client

Application Development Application

LGA
CANTERBURY-BANKSTOWN
Council

Drawn	DF	Designed	CS
Reviewed	AA	Date	07-10-2024
Approved	AA	Date	07-10-2024

Andrew Arida
 B.E Civil/Structural
 MIE Aust (NO: 5579488)
 Professional Engineer (PRE0000268)
 Design Practitioner (DEP0000455)




Discipline	Consultant	Reference	Revision	Date
Architect	Design Formation	----	02	04.09.2024
Surveyor				
Landscape				
Geotechnical				
Structural				
Hydraulic/Fire				
Mechanical				



E admin@deboke.com.au
W deboke.com.au
A 17 William Street Ryde NSW 2112
P 02 9188 0688

COPYRIGHT
This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.

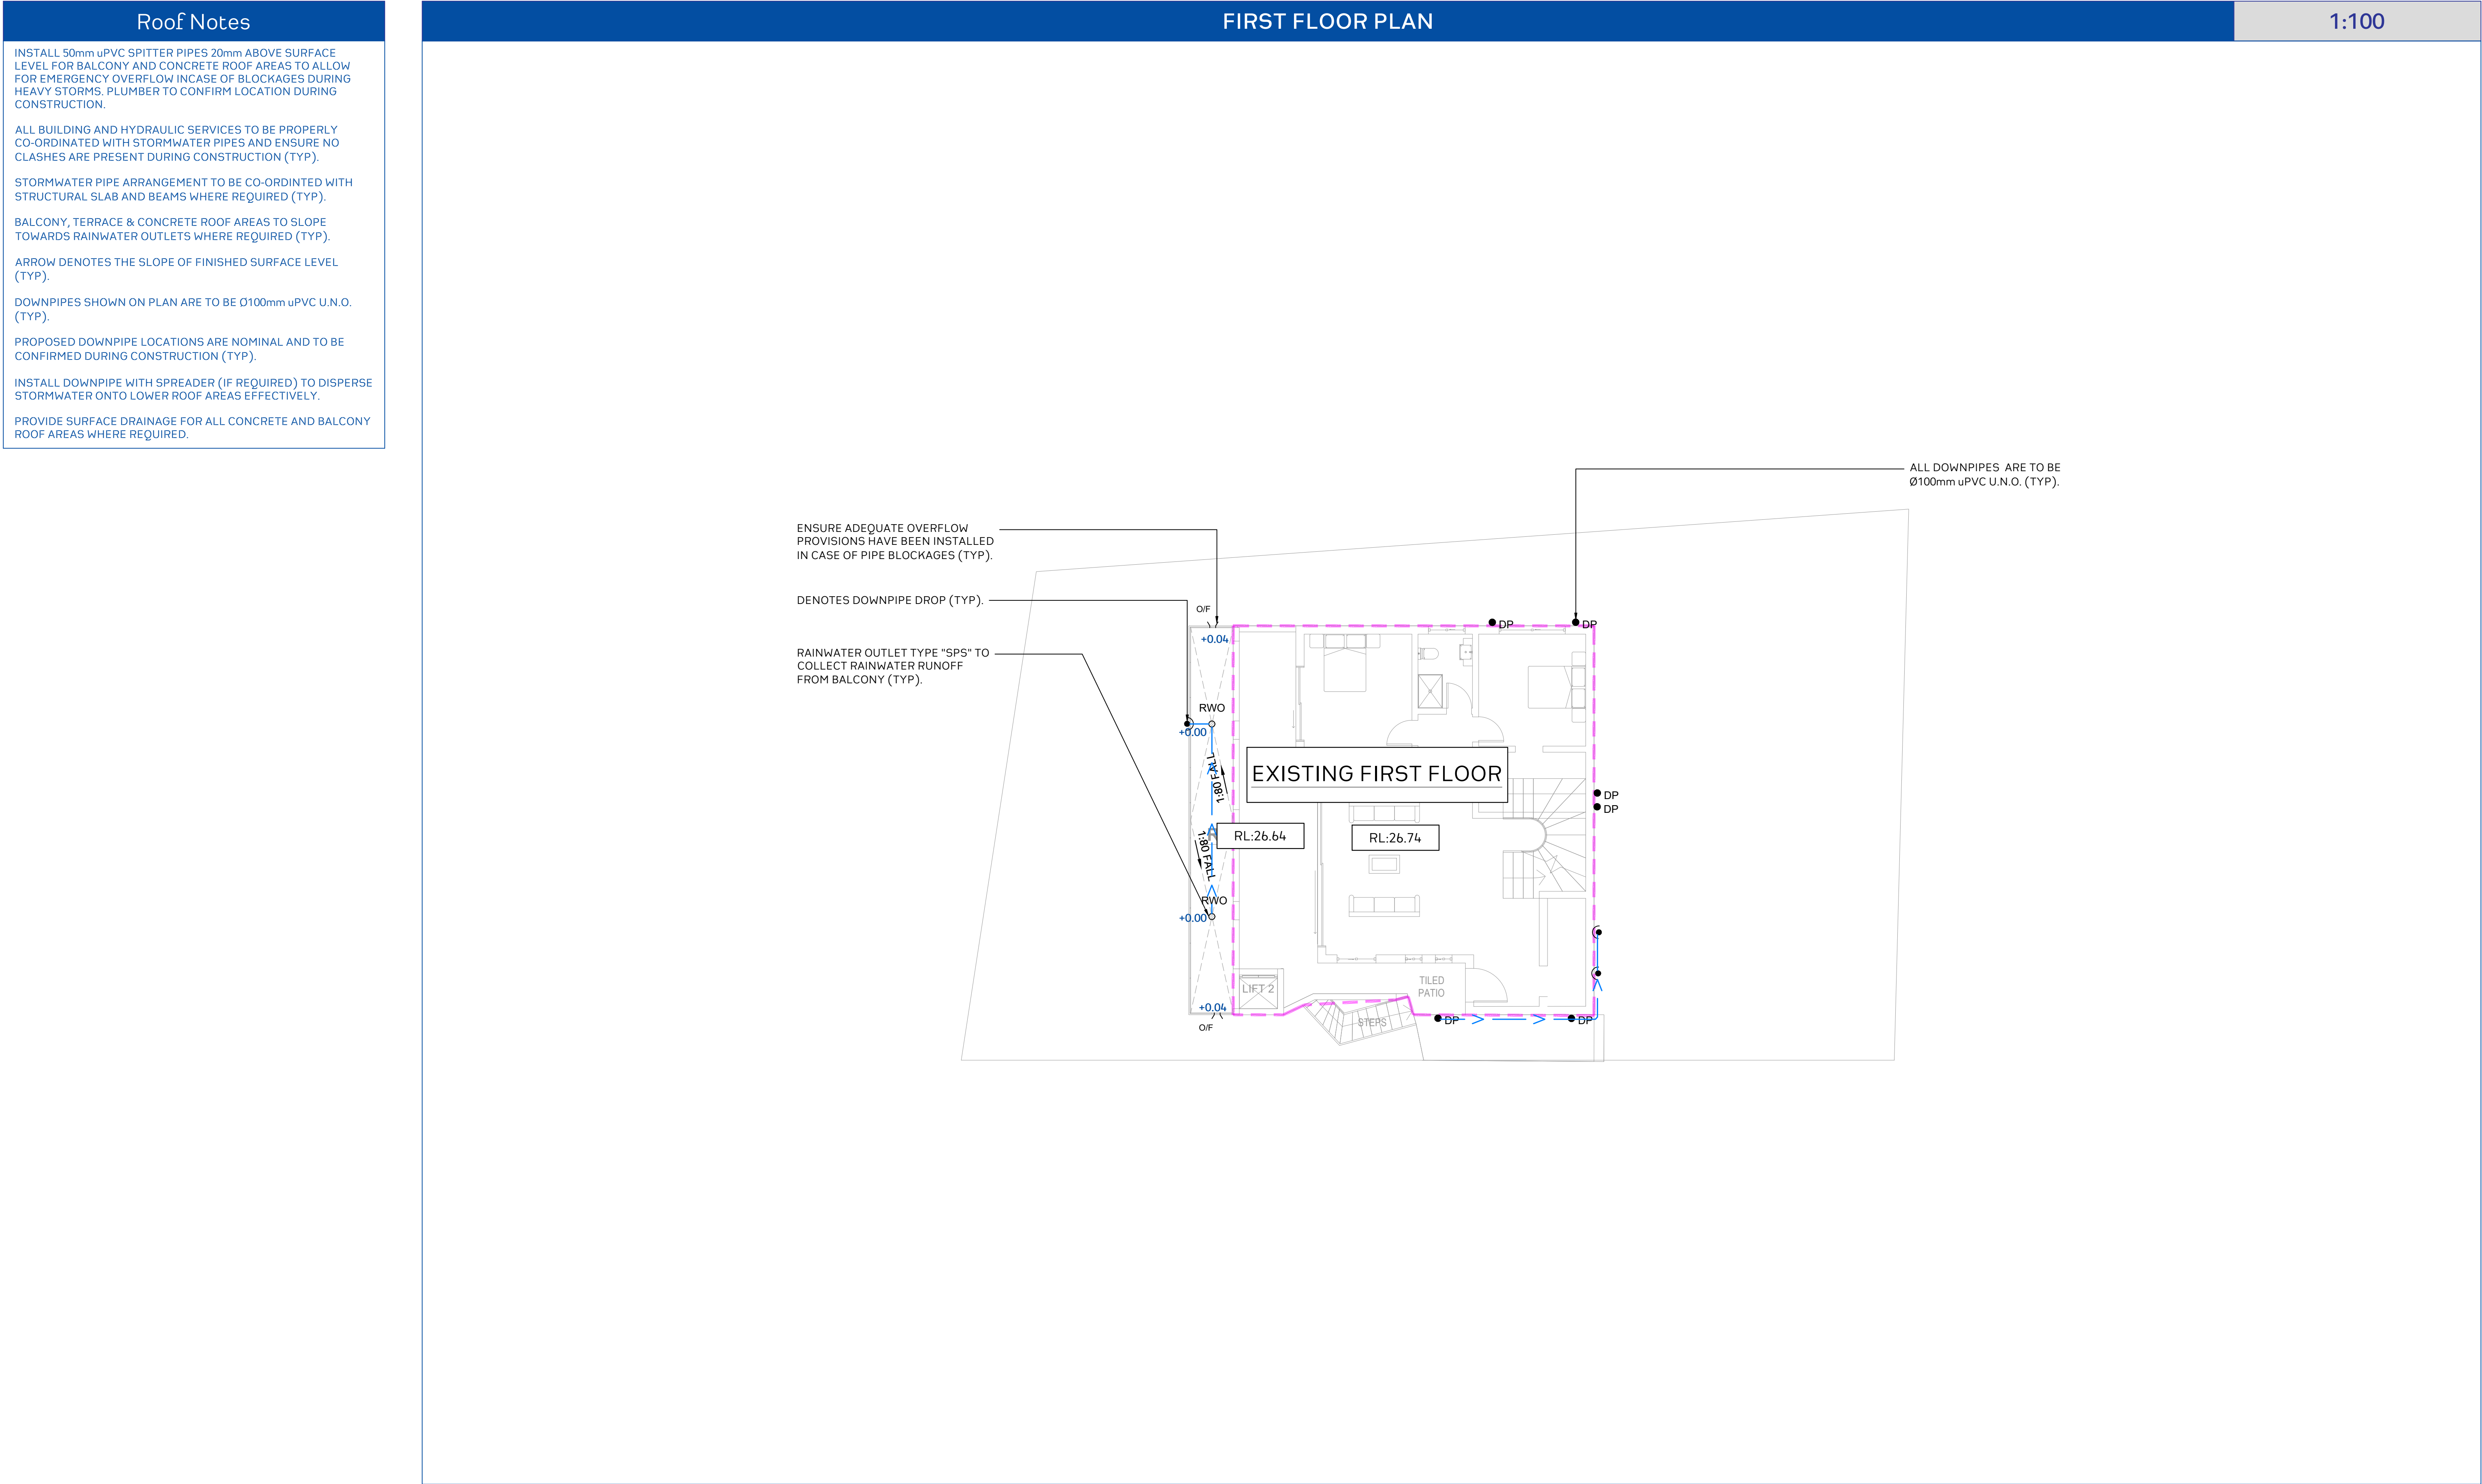

Roof Notes
DOWNPIPES SHOWN ON PLAN ARE TO BE Ø100mm uPVC U.N.O. (TYP).
PROPOSED DOWNPIPE LOCATIONS ARE NOMINAL AND TO BE CONFIRMED DURING CONSTRUCTION (TYP).

LYSAGHT® gutter areas and downpipes.				
Minimum standard downpipe sizes to suit gutters (gutter gradient ≥ 1:500)				
	Slotted	Effective # cross section	Round (diameter)	Rectangular or square
	YES/NO	mm²	mm	mm
Quad Hi-front	YES	5255	90	100x50
	NO	5809	90	100x50
Quad Lo-front	NO	6165	90	100x50
	YES	7600	100	100x75
SHEERLINE®	NO	8370	§	100x75
	YES	6244	90	100x50
TRIMLINE®	NO	7800	100	100x75
	YES	4675	90	100x50
150 HaLF Round	NO	7042	100	100x75
	YES	4602	90	100x50
150 HaLF Round Flat Back	NO	7042	100	100x75
	NO	4300	75	100x50*
HaLF Round 125	NO	6300	90	100x50'
Half Round 150	NO	9200	§	100x75*
HaLF Round 200	NO	14500	§	§
HaLF Round 250	NO	24500	§	§
HaLF Round 300	NO	35300	§	§
# Values calculated in accordance with AS/NZS 3500.3.				
§ Non standard downpipe and nozzle/pop is required.				
* Non standard nozzle/pop is required to suit rectangular downpipe.				

Box Gutter Notes
THE FOLLOWING REQUIREMENTS MUST APPLY; - THE MINIMUM WIDTH ALLOWED FOR DOMESTIC PROJECTS IS 200MM. FOR COMMERCIAL PROJECTS THE MINIMUM ALLOWABLE WIDTH IS 300MM.
- BOX GUTTERS MUST BE STRAIGHT, (NO BENDS).
- SIDES MUST BE VERTICAL.
- CONSTANT WIDTH.
- MUST HAVE A CONSTANT SLOPE BETWEEN 1:40 AND 1:200.
- DOWN PIPE MUST BE VERTICAL FROM SUMP (NOT TO THE SIDE).
- MINIMUM SUMP LENGTH IS 400MM.
- IF THE SIDE OVERFLOW (SPITTER) LENGTH IS GREATER THAN 450MM, THE MINIMUM ALLOWABLE SLOPE FOR THE SPITTER IS 1:10.

ROOF PLAN

1:100

Downpipe And Eaves Gutters									
Catchment	Area (m2)	Slope (DEG)	Type	Runoff (L/s)	Suggested DP	Number Required	Gutter Area (mm²)	Minimum Gutter Width (mm)	Minimum Gutter Depth (mm)
A	67.869	5.0	SHEERLINE®	3.52	Ø100mm	2	7580	125	71
B	79.852	5.0	SHEERLINE®	4.14	Ø100mm	2	8830	130	70
C	20.215	5.0	SHEERLINE®	1.05	Ø100mm	1	4663	125	48
D	22.752	5.0	SHEERLINE®	1.18	Ø100mm	1	5203	125	52

PROPOSED ROOF

ROOF AREA DRAINING TO BOX GUTTER. REFER TO TABLE FOR FURTHER DETAILS (TYP).

ENSURE ADEQUATE OVERFLOW PROVISIONS HAVE BEEN INSTALLED IN CASE OF PIPE BLOCKAGES (TYP).

SUMP TO BE INSTALLED IN BOX GUTTER, OVERFLOW PROVISIONS TO BE INSTALLED. REFER TO DETAIL FOR FURTHER INFORMATION (TYP).

RAINWATER OUTLET TYPE "SPS" TO COLLECT RAINWATER RUNOFF FROM BALCONY (TYP).








DENOTES DOWNPIPE DROP (TYP).



ALL DOWNPIPES ARE TO BE Ø100mm uPVC U.N.O. (TYP).







DENOTES DIRECTION OF FALL IN EAVES GUTTER (TYP).


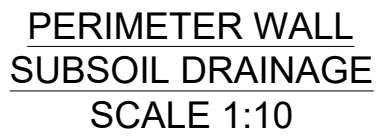
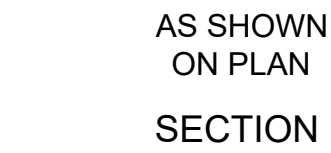
DENOTES HIGH POINT IN EAVES GUTTER (TYP).

BOX GUTTER DETAILS															
CATCHMENT	AREA (m²)	SLOPE (DEG)	TYPE	RUNOFF (L/s)	SUGGESTED DP	BOX GUTTER WIDTH Wbg (mm)	BOX GUTTER DEPTH Dbg (mm)	RWH / SUMP WIDTH Wbg (mm)	RWH / SUMP DEPTH hs (mm)	RWH / SUMP LENGTH Wos (mm)	OVERFLOW WIDTH Woc (mm)	OVERFLOW DEPTH Doc (mm)	MINIMUM CLEARANCE loc (mm)	MINIMUM CLEARANCE hc (mm)	DIMENSION ht (mm)
C	7.729	5.0	BOX GUTTER AND SUMP WITH VERTICAL OVERFLOW	0.660	Ø100mm	200	75	200	150	600	-	-	7	-	-

	Project No. 20240376-DA-SW-DWG-01	Drawing No. S203	<table><tr><th>Rev.</th><th>Description</th><th>Design</th><th>Date</th></tr><tr><td>01</td><td>Issued For DA</td><td>CS</td><td>07-10-2024</td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr></table>	Rev.	Description	Design	Date	01	Issued For DA	CS	07-10-2024													 Architect	 Client	<p>Project Proposed Alterations And Additions Development</p> <p>Application Development Application</p> <p>Address 42 Horner Street Earlwood 2206</p> <p>LGA CANTERBURY-BANKSTOWN Council</p>	<table><tr><td>Drawn</td><td>DF</td><td>Designed</td><td>CS</td></tr><tr><td>Reviewed</td><td>AA</td><td>Date</td><td>07-10-2024</td></tr><tr><td>Approved</td><td>AA</td><td>Date</td><td>07-10-2024</td></tr></table> <div><div>Andrew Arida B.E Civil/Structural MIEAust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455)</div></div>	Drawn	DF	Designed	CS	Reviewed	AA	Date	07-10-2024	Approved	AA	Date	07-10-2024	<table><tr><th>Discipline</th><th>Consultant</th><th>Reference</th><th>Revision</th><th>Date</th></tr><tr><td>Architect</td><td>Design Formation</td><td>----</td><td>02</td><td>04.09.2024</td></tr><tr><td>Surveyor</td><td></td><td></td><td></td><td></td></tr><tr><td>Landscape</td><td></td><td></td><td></td><td></td></tr><tr><td>Geotechnical</td><td></td><td></td><td></td><td></td></tr><tr><td>Structural</td><td></td><td></td><td></td><td></td></tr><tr><td>Hydraulic/Fire</td><td></td><td></td><td></td><td></td></tr><tr><td>Mechanical</td><td></td><td></td><td></td><td></td></tr></table>	Discipline	Consultant	Reference	Revision	Date	Architect	Design Formation	----	02	04.09.2024	Surveyor					Landscape					Geotechnical					Structural					Hydraulic/Fire					Mechanical					 <p>E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688</p> <p>COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.</p>
	Rev.	Description	Design	Date																																																																													
	01	Issued For DA	CS	07-10-2024																																																																													
Drawn	DF	Designed	CS																																																																														
Reviewed	AA	Date	07-10-2024																																																																														
Approved	AA	Date	07-10-2024																																																																														
Discipline	Consultant	Reference	Revision	Date																																																																													
Architect	Design Formation	----	02	04.09.2024																																																																													
Surveyor																																																																																	
Landscape																																																																																	
Geotechnical																																																																																	
Structural																																																																																	
Hydraulic/Fire																																																																																	
Mechanical																																																																																	
Title Roof Plan		<p>Scale</p>  <p>SCALE 1:100 ON ORIGINAL SIZE</p> 																																																																															



	Project No. 20240376-DA-SW-DWG-01	Drawing No. S300	Rev.	Description	Design	Date	 Architect	 Client	Project Proposed Alterations And Additions Development Application Development Application Address 42 Homer Street Earlwood 2206 LGA CANTERBURY-BANKSTOWN Council	Drawn	DF	Designed	CS	Discipline	Consultant	Reference	Revision	Date	 E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688 COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.	
	Title Details Sheet			01	Issued For DA	CS				07-10-2024	Reviewed	AA	Date	07-10-2024	Surveyor			02		04.09.2024
	Scale										Approved	AA	Date	07-10-2024	Landscape					
	 SCALE 1:20 ON ORIGINAL SIZE										Andrew Arida B.E Civil/Structural MIEAust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455) 			Geotechnical						

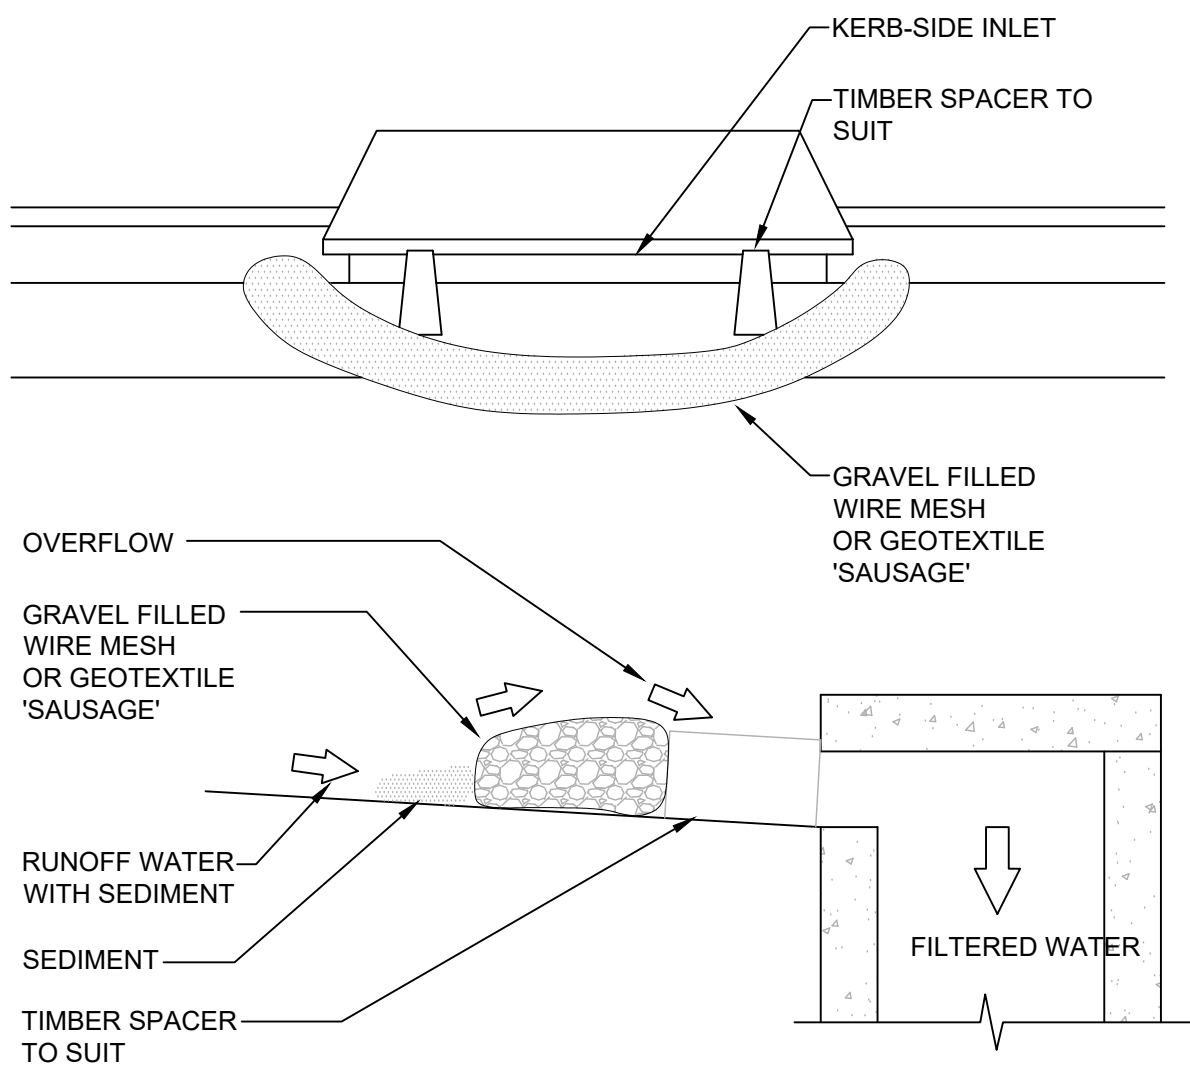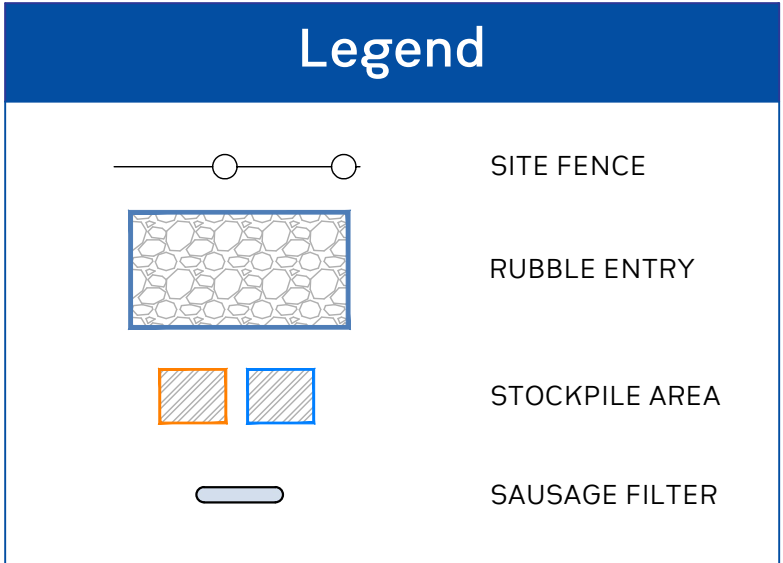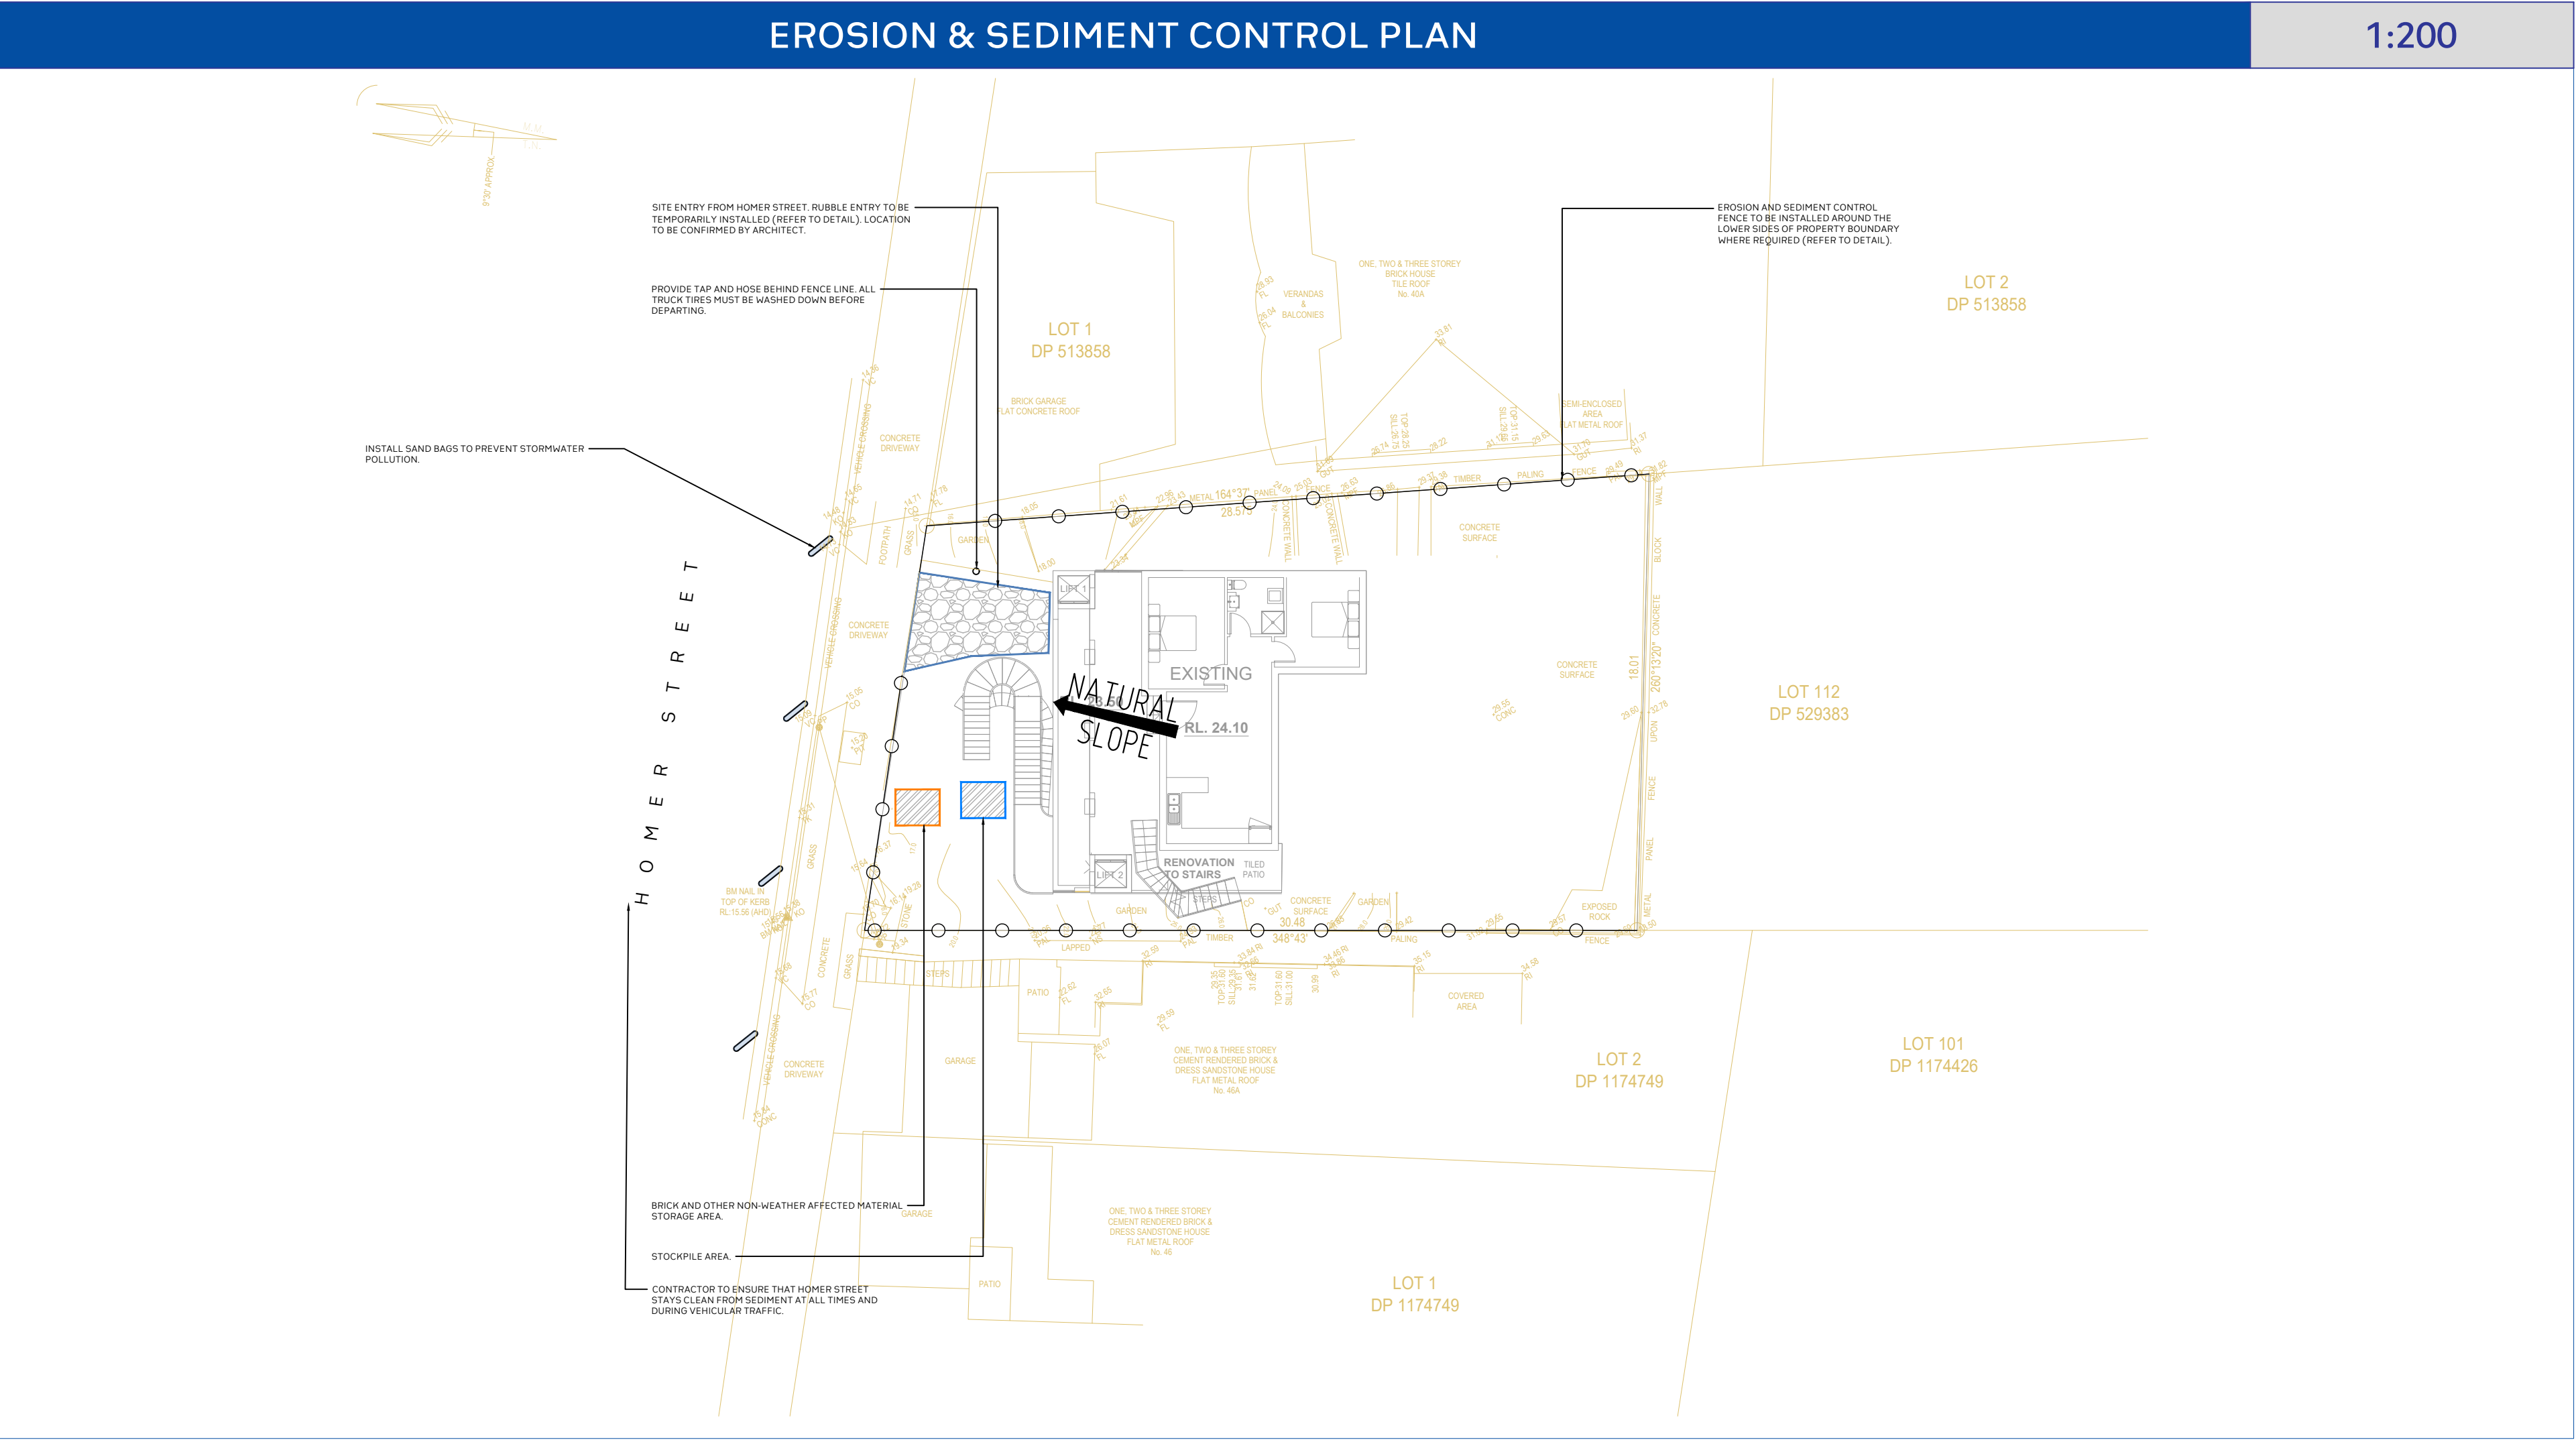


CONSTRUCTION NOTES:

1. INSTALL KERB INLET FILTERS TO KERB INLETS ONLY AT SAG POINTS OR AS SHOWN ON PLAN
2. FABRICATE A SLEEVE MADE FROM GEOTEXTILE OR WIRE MESH LONGER THAN THE LENGTH OF THE INLET PIT AND FILL IT WITH 25mm TO 50mm GRAVEL
3. FORM AN ELLIPTICAL CROSS-SECTION ABOUT 150mm HIGH x 400mm WIDE
4. PLACE THE FILTER AT THE OPENING LEAVING AT LEAST A 100mm SPACE BETWEEN IT AND THE KERB INLET. MAINTAIN THE OPENING WITH SPACER BLOCKS.
5. FORM A SEAL WITH THE KERB TO PREVENT SEDIMENT BYPASSING THE FILTER.
6. SANDBAGS FILLED WITH GRAVEL CAN SUBSTITUTE FOR THE MESH OR GEOTEXTILE PROVIDING THEY ARE PLACED SO THAT THEY FIRMLY ABUT EACH OTHER AND SEDIMENT-LADEN WATERS CANNOT PASS BETWEEN.


GRAVEL INLET FILTER (SANDBAG)

NTS

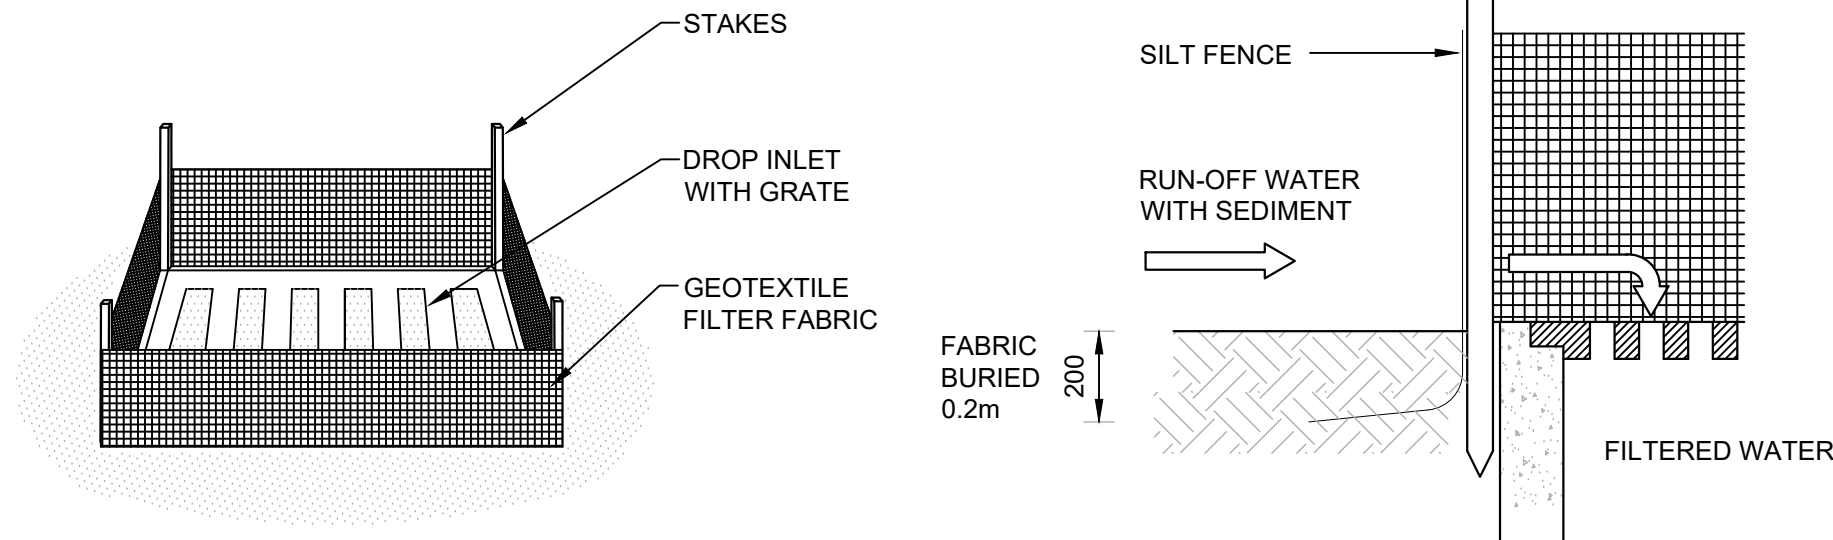

SUMP SEDIMENT TRAP

NTS

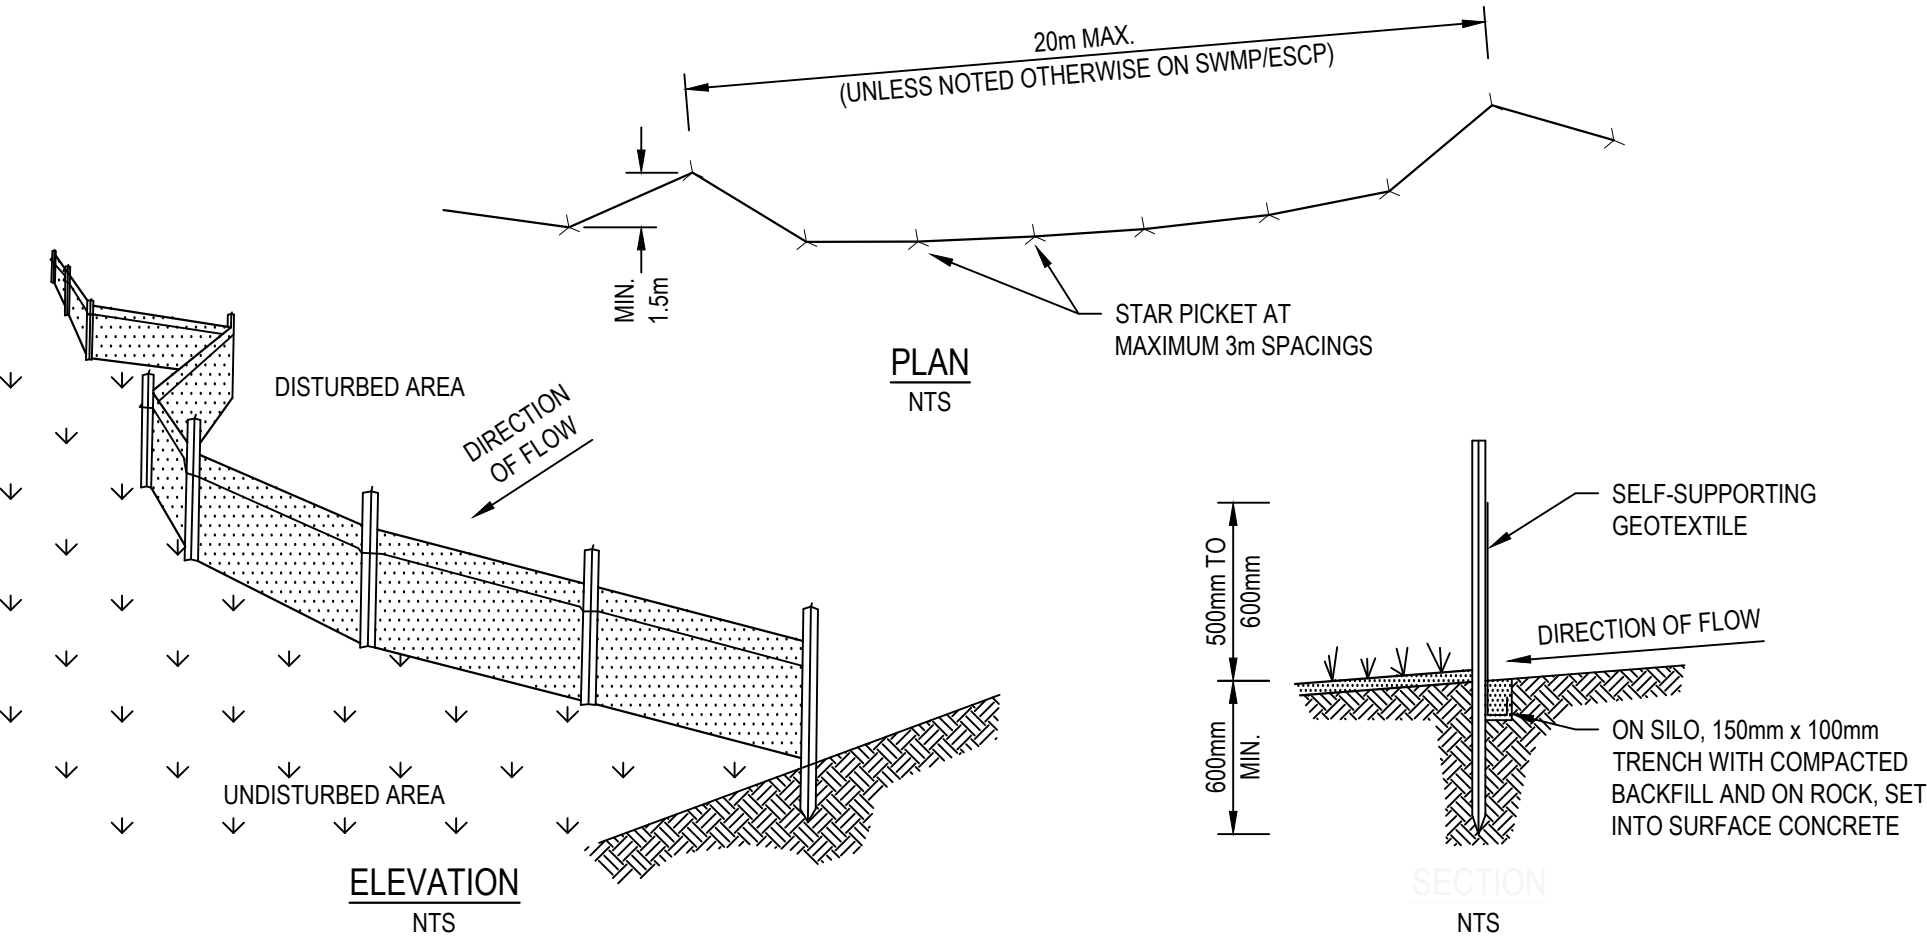


GENERAL CONSTRUCTION NOTES

1. CONSTRUCTION SEDIMENT FENCES AS CLOSE AS POSSIBLE TO PARALLEL TO THE CONTOURS OF THE SITE
2. DIVE 1.5m LONG STAR PICKETS INTO GROUND, 3m APART
3. DIG A 150mm DEEP TRENCH ALONG THE UPSLOPE LINE OF THE FENCE FOR THE BOTTOM OF THE FABRIC TO BE ENTRENCHED
4. BACKFILL TRENCH OVER BASE OF FABRIC
5. FIX SELF-SUPPORTING GEOTEXTILE TO UPSLOPE SIDE OF POSTS WITH WIRE TIES OR AS RECOMMENDED BY GEOTEXTILE MANUFACTURER
6. JOIN SECTIONS OF FABRIC AT A SUPPORT POST WITH A 150mm OVERLAP

SEDIMENT FENCE

NTS

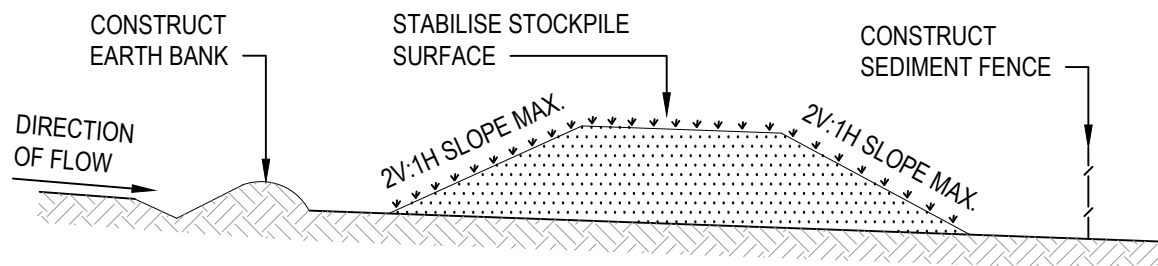


GENERAL CONSTRUCTION NOTES

1. LOCATE STOCKPILE AT LEAST 5m FROM EXISTING VEGETATION, CONCENTRATED WATER FLOWS, ROADS AND HAZARD AREAS
2. CONSTRUCT ON THE CONTOUR AS A LOW, FLAT, ELONGATED MOUND
3. WHERE THERE IS SUFFICIENT AREA TOPSOIL STOCKPILES SHALL BE LESS THAN 2m IN HEIGHT
4. REHABILITATE IN ACCORDANCE WITH THE SWMP/ESCP
5. CONSTRUCT EARTH BANK ON THE UPSLOPE SIDE TO DIVERT RUN OFF AROUND THE STOCKPILE AND A SEDIMENT FENCE 1 TO 2m DOWNSLOPE OF STOCKPILE

STOCKPILES

NTS

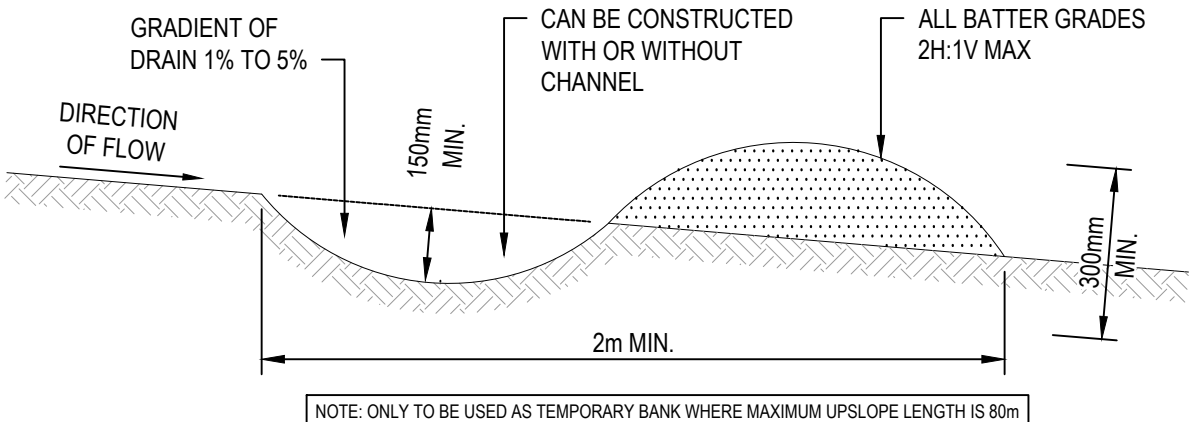


GENERAL CONSTRUCTION NOTES

1. CONSTRUCT WITH GRADIENT OF 1% TO 5%
2. AVOID REMOVING TREES AND SHRUBS IF POSSIBLE
3. DRAINS TO BE CIRCULAR, PARABOLIC OR TRAPEZOIDAL CROSS SECTION NOT V-SHAPED
4. EARTH BANKS TO BE ADEQUATELY COMPACTED IN ORDER TO PREVENT FAILURE
5. PERMANENT OR TEMPORARY STABILISATION OF THE EARTH BANK TO BE COMPLETED WITHIN 10 DAYS OF CONSTRUCTION
6. ALL OUTLETS FROM DISTURBED LANDS ARE TO FEED INTO A SEDIMENT BASIN OR SIMILAR
7. DISCHARGE RUNOFF COLLECTED FROM UNDISTURBED LANDS ONTO EITHER A STABILISED OR AN UNDISTURBED DISPOSAL SITE WITHIN THE SAME SUBCATCHMENT AREA FROM WHICH THE WATER ORIGINATED
8. COMPACT BANK WITH A SUITABLE IMPLEMENT IN SITUATIONS WHERE THEY ARE REQUIRED TO FUNCTION FOR MORE THAN FIVE DAYS
9. EARTH BANKS TO BE FREE OF PROJECTIONS OR OTHER IRREGULARITIES THAT WILL IMPEDED NORMAL FLOW

EARTH BANK (LOW FLOW)

NTS

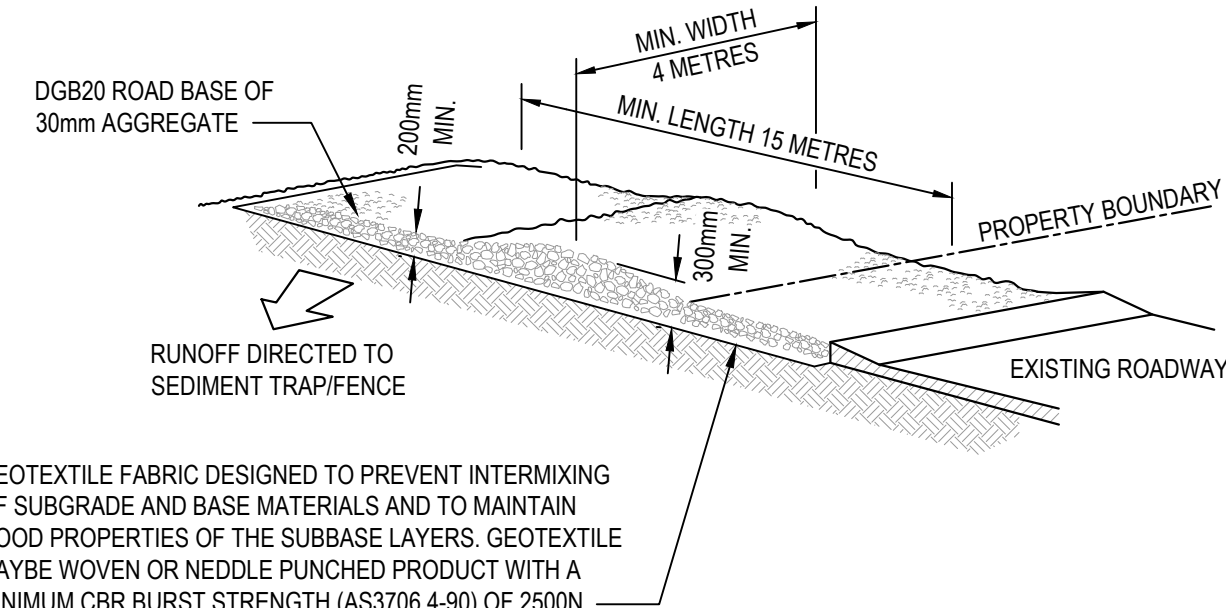

STABILISED SITE ACCESS CONSTRUCTION NOTES:

1. STRIP THE TOPSOIL, LEVEL THE SITE AND COMPACT THE SUBGRADE.
2. COVER THE AREA WITH NEEDLE - PUNCHED GEOTEXTILE.
3. CONSTRUCT A 200mm THICK PAD OVER THE GEOTEXTILE USING ROAD BASE OR 30mm AGGREGATE.
4. ENSURE THE STRUCTURE IS AT LEAST 15 METRES LONG OR TO BUILDING ALIGNMENT AND AT LEAST 3 METRES WIDE.
5. WHERE A SEDIMENT FENCE JOINS ONTO THE STABILISED ACCESS, CONSTRUCT A HUMP IN THE STABILISED ACCESS TO DIVERT WATER TO SEDIMENT FENCE.

STABILISED SITE ACCESS

NTS

	Project No. 20240376-DA-SW-DWG-01	Drawing No. S400	Rev. Description Design Date			Project Proposed Alterations And Additions Development Application Development Application Address 42 Homer Street Earlwood 2206 LGA CANTERBURY-BANKSTOWN Council	Drawn DF Designed CS	Discipline Consultant Reference Revision Date	 E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688 COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.
	Title Erosion and Sediment Control Plan	Scale 0m 2 4 6 8 10 SCALE 1:200 ON ORIGINAL SIZE	01 Issued For DA CS 07-10-2024				Reviewed AA Date 07-10-2024 Approved AA Date 07-10-2024	Architect Design Formation Surveyor Landscape Geotechnical Structural Hydraulic/Fire Mechanical	