



**BUSHFIRE**  
**CONSULTING**  
**SERVICES** PTY LTD

Designing Bushfire Protection Measures

Reference: J22/0455

PO Box 1020

Penrith NSW 2751

Tel: 02 4744 5800

Mob: 0425 833 893

[info@bfcs.com.au](mailto:info@bfcs.com.au)

[www.bfcs.com.au](http://www.bfcs.com.au)

Date of Issue: 10 June 2022

## **Bush Fire Assessment Report**

in relation to the new  
dwelling and swimming pool  
at:



**Lot 7 DP 29657**

**40 Thomas Street Picnic Point**

**(subject site)**

## Contents

1. Introduction .....	9
2. Purpose of this Report .....	9
3. Location.....	10
4. Property Description .....	11
4.1 Zoning.....	11
4.2 Biodiversity Values .....	12
4.3 The Proposal.....	12
5. Site Assessment .....	13
6. Bush Fire Attack Assessment .....	13
6.1 Determine Vegetation Formations .....	13
6.2 The effective slope .....	14
6.3 Fire Weather.....	16
6.4 Determination of APZs .....	16
6.5 Identify Construction Requirements.....	17
6.6 Reduction in BAL due to Shielding (PBP A1.8) .....	18
7. Bush Fire Protection Measures.....	19
7.1 Asset Protection Zones.....	20
7.2 Access .....	20
7.3 Water Supplies .....	21
7.4 Electricity Services.....	22
7.5 Gas Services.....	22
7.6 Construction Standards.....	22
7.7 Landscaping.....	23
8. Likely Impact of any BPMs .....	24
9. “The SEPP Code”, Part 1, Division 2 clause 1.19A .....	24

10.	Part 3 Housing Code.....	25
11.	Recommendations .....	27
12.	Summary.....	29
13.	References .....	31
14.	Legislation .....	31
	Appendix 1 - Site Plan .....	32
	Appendix 2 – Photos of Site and Surrounds .....	33
	Appendix 3 – Bushfire Risk Assessment Certificate.....	35
	Appendix 4 - Modifications of section 7.5 of PBP.....	37

## Document Tracking

Item	Detail
Project Name	Bush Fire Assessment Report, new dwelling and swimming pool
Project Address	Lot 7 DP 29657, 40 Thomas Street Picnic Point
Client Name	ET Plumbing Pty Ltd
Project Number	J22/0455
Plan Reference	Plans by Costi Architects numbered A22005 revision A11 dated 03/06/2022
Prepared by	Laura Richards
Approved by	Laura Richards
BAL under AS3959-2018	BAL 19 to the north, east and south and BAL 12.5 to the west and the relevant additional construction requirements of PBP section 7.5

### Bushfire Consulting Services Pty Ltd Contact Details

Catherine Gorrie	Managing Director
Office Number	02 4744 5800
Mobile Number	0425 833 893
Email	info@bfcs.com.au

## Document Control

Version	Primary Author	Description	Date Completed
1	Laura Richards	Final	10/06/2022

## Copyright

*The information and intellectual property contained in this document is confidential and is proprietary to the company Bushfire Consulting Services Pty Ltd. It is intended for use only by the person, company or organisation to whom it is provided and only for the stated purpose for which it is provided. It must not be used for any other purpose or by any other individual or organisation without the written approval of the author.*

## Disclaimer

*Any recommendation or advice expressed in this report is made in good faith and in accordance with the relevant legislation for bushfire prone development in New South Wales. Bushfire Consulting Services Pty Ltd has endeavoured to ensure that the information in this document is correct. However, many factors outside our current knowledge or control affect the recipient's needs and project plans. Bushfire Consulting Services Pty Ltd does not warrant or represent that the document is free from error or omissions and does not accept liability for any errors or omissions. Changes to available information, legislation and schedules are made on an ongoing basis and readers should obtain up to date information. To the fullest extent possible Bushfire Consulting Services Pty Ltd excludes any express or implied warranty as to condition, fitness, merchantability or suitability of this document and limits its liability for direct or consequential loss at Bushfire Consulting Services Pty Ltd option to re-supplying the document or the cost of correcting the document. In no event shall Bushfire Consulting Services Pty Ltd responses to questions or any other information in this document be deemed to be incorporated into any legally binding agreement without the express written consent of an officer of Bushfire Consulting Services Pty Ltd.*

*It should be borne in mind that the measures recommended in this report cannot guarantee that a building will survive a bushfire event on every occasion. This is due to the degree of vegetation management, the unpredictable behaviour of bushfires and extreme weather conditions. As such, the author is not liable to any person for any damage or loss whatsoever which has occurred or may occur in relation to the person taking action or not taking action based on the recommendations of this report.*

*NOTE: This bush fire assessment shall remain valid for 12 months from the date of issue.*

## Executive Summary


Bushfire Consulting Services was commissioned by ET Plumbing Pty Ltd to provide a bush fire assessment for a new dwelling and swimming pool at Lot 7 DP 29657, 40 Thomas Street Picnic Point. The subject site is mapped as designated bush fire prone land by Canterbury-Bankstown Council and is located within 100 metres of bush fire prone (hazardous) vegetation. The bush fire attack level (BAL) associated with the development of the subject building has been assessed as BAL 19 to the north, east and south and BAL 12.5 to the west.

The proposal is a form of infill development and, as such, this report makes recommendations in accordance with the aim, objectives, and performance criteria of Chapter 7 of the NSW RFS document '*Planning for Bush Fire Protection*' (PBP) (NSWRFS 2019). The recommendations address the required bush fire protection measures, including:

- establishment and maintenance of asset protection zones (APZs)
- siting and design of the development
- construction requirements under AS3959-2018 (Standards Australia 2018)
- adequate access for emergency personnel,
- adequate water supply, and utility requirements to reduce the risk of ignition by electrical or gas supplies
- landscaping to reduce the risk of ignition by embers, and to minimise flame contact and radiant heat on the proposed development.

Where all recommendations are implemented, the report concludes that the proposal can comply with the aim, objectives and performance criteria of PBP.

## Compliance Summary

<p>This Assessment has been Certified by:</p> <p>Laura Richards</p> <p>BPAD-Level 2 Accredited Practitioner</p> <p>FPAA Cert No: BPAD48551</p>	
<p>What is the recommended level of compliance with AS3959-2018?</p>	<p>BAL 19 to the north, east and south and BAL 12.5 to the west</p>
<p>Can this proposal comply with AS 3959-2018?</p>	<p>Yes</p>
<p>Does this development comply with the aim and objectives of PBP?</p>	<p>Yes</p>
<p>Is referral to the NSW Rural Fire Service (RFS) required?</p>	<p>No</p>

## List of Abbreviations

APZ	Asset Protection Zone
AS3959	Australian Standard 3959 – 2018, <i>Construction of Buildings in Bushfire Prone Areas</i>
BAL	Bushfire Attack Level
BPAD	Bushfire Planning and Design (Accreditation Scheme)
BPMs	Bushfire Protection Measures
BPLM	Bushfire Prone Land Map
Council	Canterbury-Bankstown Council
CDC	Complying Development Certificate
DA	Development Application
DEM	Digital Elevation Model
EP&A Act	<i>Environmental Planning and Assessment Act – 1979</i>
FDI	Fire Danger Index
FPAA	Fire Protection Association of Australia
IPA	Inner Protection Area
kW/m <sup>2</sup>	Kilowatts per metre squared
LiDAR	Light Detection and Ranging
LPMA	Land & Property Management Authority
NCC	National Construction Code
PBP	<i>Planning for Bush Fire Protection 2019</i>
RF Act	<i>Rural Fires Act – 1997</i>
RFS	NSW Rural Fire Service
SEPP	State Environmental Planning Policy
SIX	Spatial Information Exchange

## 1. Introduction

This report has been commissioned by ET Plumbing Pty Ltd to provide a bush fire assessment for a new dwelling and swimming pool at Lot 7 DP 29657, 40 Thomas Street Picnic Point.

The subject property is “bushfire prone land” as per the local Council bushfire prone land map as defined by section 10.3 (s10.3) of the *Environmental Planning & Assessment Act (EP&A) 1979* and therefore the requirements stipulated by legislation apply to any new development on the site.

*Planning for Bush Fire Protection 2019* (Chapter 7) describes this type of development as “infill development” and therefore the requirements of section 4.14 (s4.14) of the *EP&A Act* are applicable.

The bush fire assessment and recommendations are derived from the *NSW EP&A Act*, the Rural Fire Service document *Planning for Bush Fire Protection 2019* and Australian Standard 3959-2018 ‘*Construction of Buildings in Bushfire Prone Areas*’.

## 2. Purpose of this Report


The purpose of this report is to provide the owners, the Consent Authority and the Certifier with a description of the proposed development as well as the vegetation type, slope and any other factors influencing the likely bushfire behaviour, sufficient to show that the development will be protected from the likely bushfire threat as outlined in current legislation.

This assessment includes an analysis of the hazard, threat and subsequent risk to the development and provides recommendations that satisfy the aim and objectives of *Planning for Bush Fire Protection*.

### 3. Location

The site is located and known as Lot 7 DP 29657, 40 Thomas Street Picnic Point. The property is part of the Canterbury-Bankstown local government area.

**Figure 1. Location Map. Source: LPMA SIX Viewer (NSW Government 2022a)**

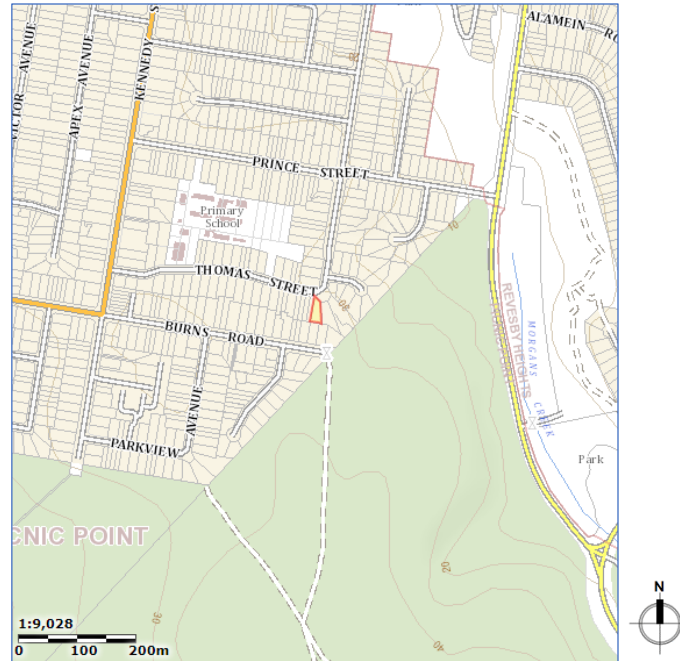


*Site location outlined in red*

**Figure 2. Aerial Map. Source: LPMA SIX Viewer (NSW Government 2022a)**



*Site location outlined in red*

**Figure 3. Bushfire Prone Land Map. Source: NSW Government Planning Portal  
(NSW Government 2022b)**

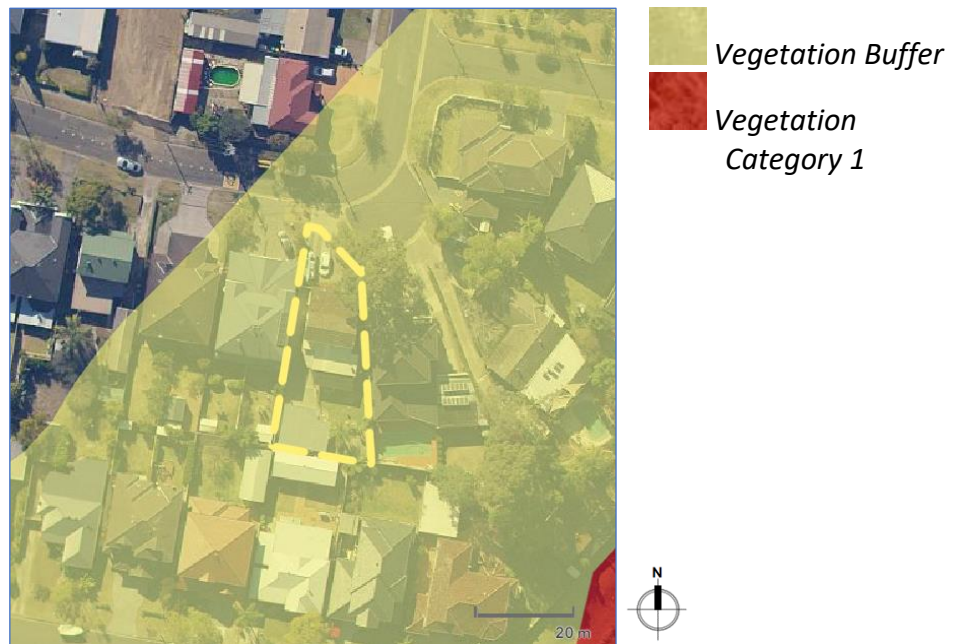

*Site location outlined in yellow*


## 4. Property Description

The property is comprised of Lot 7 DP 29657, 40 Thomas Street Picnic Point, covering approximately 626m<sup>2</sup> in area (Figure 2). It is bounded by Thomas Street to the approximate north, with private allotments to the approximate east, south and west. It currently contains a single occupancy development, comprising a two-storey dwelling, verandah, awnings, decks, and a detached garage, to be demolished.

### 4.1 Zoning

The land is zoned R2: Low Density Residential under Bankstown Local Environmental Plan 2015. Adjacent lands are similarly zoned. (Figure 4).

**Figure 4. Zoning Map. Source: NSW Government Planning Viewer  
(NSW Government 2022b)**

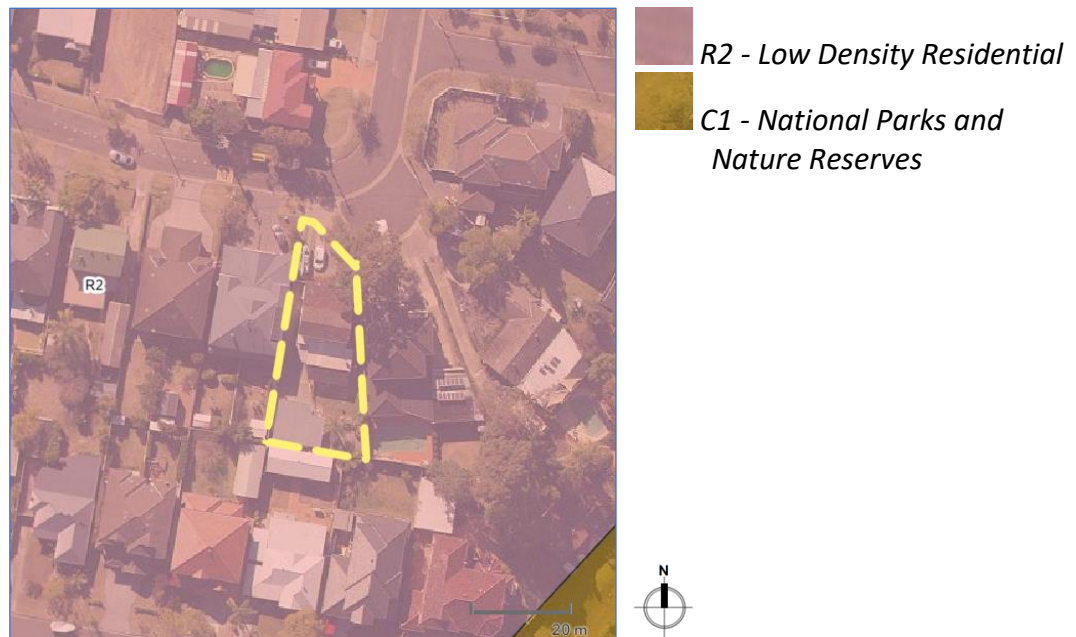

*Site location outlined in yellow*

## 4.2 Biodiversity Values

A search of the NSW Office of Heritage and Environment and Heritage's Biodiversity Values Map (NSW Government 2022c) has been carried out and has not revealed any high biodiversity values on the land.

## 4.3 The Proposal

The proposal is for a two storey dwelling, including skylights, garage, porch, alfresco, deck, balcony and a swimming pool. In terms of the NCC, the classification of the building is Class 1a, 10a and 10b.

## 5. Site Assessment

Bushfire Consulting Services Pty Ltd attended the site on 7 June 2022. The assessment relates to the new development shown in the site plans (reference Appendix 1 below). The NSW Spatial Services mapping website has also been used as a reference (NSW Government 2022a), and 'Ocean Shores to Desert Dunes' by David Keith (Keith 2004), in determining the vegetation type.

## 6. Bush Fire Attack Assessment


### 6.1 Determine Vegetation Formations

The hazardous vegetation formations for each aspect of the development within 140m of the asset have been identified according to Keith (2004). The bushfire threat emanates from bushland located to the southeast of the subject building. This vegetation is external to the subject site boundaries.

Apart from the hazard, within 140m of the site, lots contain existing residential developments with curtilages comprising lawns, shrubs and occasional trees, which do not constitute a hazard.

Based on a site visit and determination of vegetation formation using the Keith (2004) Identification Key, the primary bushland vegetation having the potential to affect the subject building is most representative of Forest.

**Figure 5. Hazardous vegetation affecting the subject building. Source: NearMap (2022)  
with overlays by BFCS P/L**

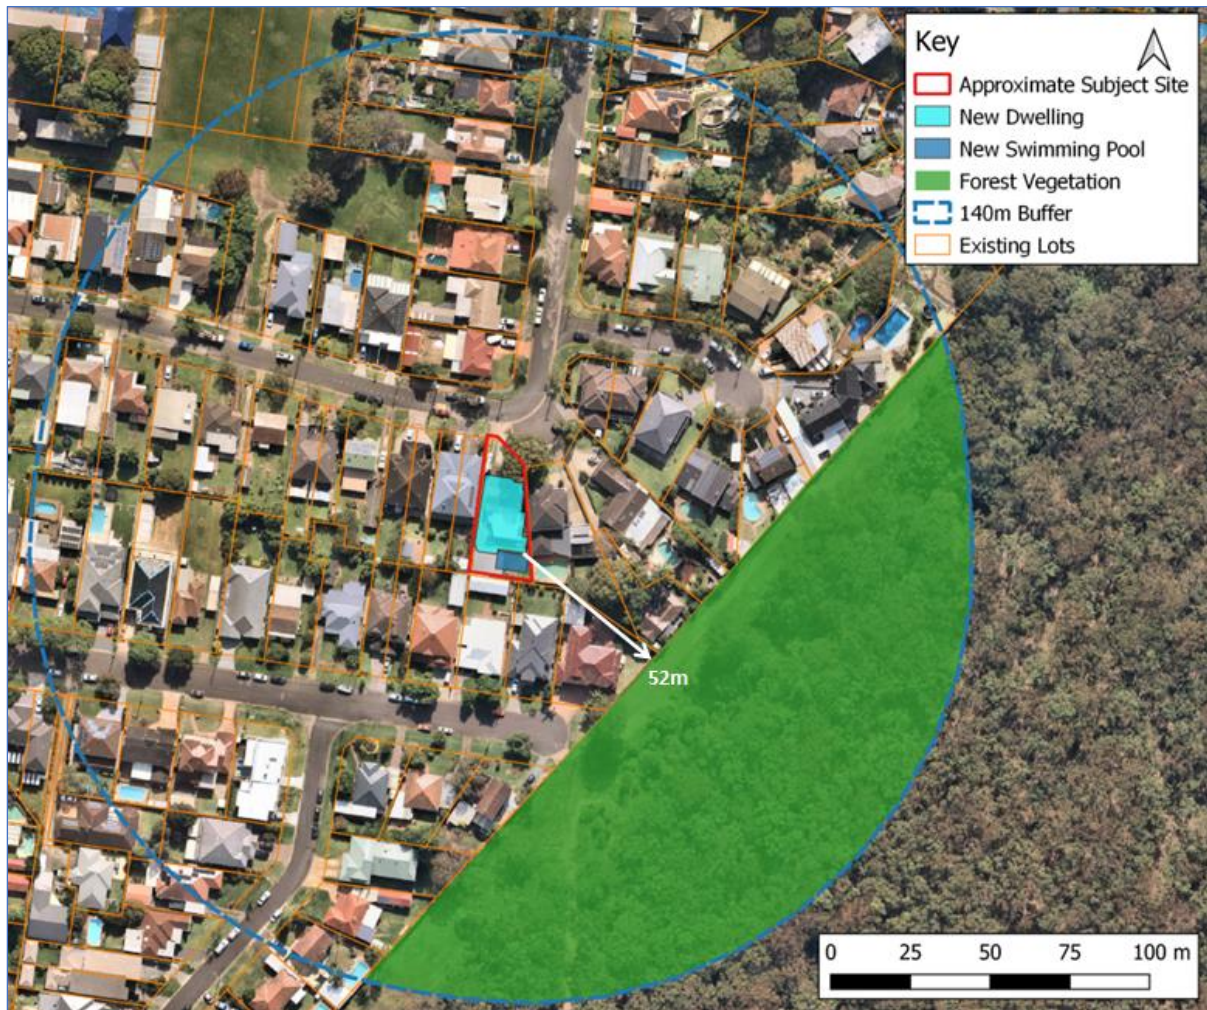

*Subject site outlined in red. Vegetation was assessed to a distance of 140m from the subject building*

## 6.2 The effective slope

The slope of the land under the classified vegetation has a direct influence on the rate of fire spread, the intensity of the fire and the level of radiant heat flux. The effective slope of the land from the new building for a distance of 100m is derived from a site assessment combined with the most detailed contour data available. The slope is then categorised into one of following classes, relative to the location of the hazard:

- all upslope vegetation (considered 0 degrees)
- >0 to 5 degrees downslope vegetation
- >5 degrees to 10 degrees downslope vegetation

>10 degrees to 15 degrees downslope vegetation, and

>15 degrees to 20 degrees downslope vegetation.

1m DEM data is sourced from NSW Spatial Services which is captured using LiDAR and has a horizontal accuracy of 0.3m and vertical accuracy of 0.8m at 95%.

The effective slope has been measured manually on site over a distance of 100m from the proposed development where accessible, under the classified vegetation community constituting the hazard. The slope was found to be consistent with the topographical information from NSW Spatial Services LiDAR data.

**Figure 6. Slope Diagram. Source: NearMap (2022) and LiDAR (NSW Government 2022a) with overlays by BFCs P/L**



Site location outlined in red, 1m contours

Slope is  $((29-26)/30) \times 1/\tan = \text{Downslope } 5.71^\circ$

Direction from Building Footprint	Slope Description
North	N/A
East	N/A
South (southeast)	Downslope > 5 - 10°
West	N/A

## 6.3 Fire Weather

The development is located in the Canterbury-Bankstown Council area, a part of the Greater Sydney Region, which has a Fire Danger Index of 100.

## 6.4 Determination of APZs

An Asset Protection Zone (APZ) is a fuel-reduced area surrounding a built asset or structure. An APZ provides a buffer zone between a bush fire hazard and an asset and an area of reduced bush fire fuel that allows suppression of fire. It also provides an area from which backburning or hazard reduction can be conducted, and allows emergency services access as well as providing a relatively safe area for firefighters and home owners to defend their property.

Potential bush fire fuels should be minimised within an APZ. This is so that the vegetation within the planned zone does not provide a path for the transfer of fire to the asset either from the ground level or through the tree canopy. PBP has minimum specifications for APZs to be established around a dwelling to be managed as an Inner Protection Area (IPA).

An IPA should provide a tree canopy cover of less than 15% and have minimal fine fuel at ground level, the grass mowed on a frequent basis, trees and shrubs retained as clumps or islands and do not take up more than 20% of the area, trees and shrubs located far enough from buildings so that they will not ignite the building, garden beds with flammable shrubs not located under trees or within 10 metres of any windows or doors, minimal plant species that keep dead material or drop large quantities of ground fuel, tree canopies not located within 2 metres of the building, trees separated by 2-5 metres and do not provide a continuous canopy from the hazard to the building, and lower limbs of trees removed up to a height of 2 metres above the ground.

To identify the appropriate APZ, the relevant FFDI, vegetation formation and effective slope are matched using Table A1.12.2 of PBP.

**Table A1.12.2 of PBP - Minimum distances for APZs – residential development, FFDI 100 areas ( $\leq 29\text{kW/m}^2$ , 1090K)**

Aspect	Vegetation Classification	Slope Under Classified Vegetation	Minimum APZ required	APZ available/achievable
North	N/A	N/A	N/A	N/A
East	N/A	N/A	N/A	N/A
South (southeast)	Forest	Downslope > 5 - 10°	36m	52m
West	N/A	N/A	N/A	N/A

The entire lot is to be managed as an IPA. The site currently contains no classified vegetation. Vegetation modification is not required. The APZ can be achieved when including adjacent managed land and roadway/s as permitted by PBP 3.2.

## 6.5 Identify Construction Requirements

The appropriate construction requirements for the development are determined by matching the relevant FFDI, vegetation type, the distance measured from the edge of the unmanaged vegetation to the closest external wall to identify the BAL using the relevant tables from PBP. These construction requirements are located in section 3 of AS3959-2018. These requirements are varied by the applicable additional construction requirements of PBP section 7.5.

**PBP Table A1.12.5 Determination of BAL, FFDI 100 – residential developments**

Aspect	Distance from hazard	Vegetation Classification	Effective Slope Under Classified Vegetation	Bushfire Attack Level (BAL) required
North	>100m	>100m	N/A	BAL 19
East	>100m	>100m	N/A	BAL 19
South (southeast)	52m	Forest	Downslope > 5 - 10°	BAL 19
West	>100m	>100m	N/A	BAL 12.5**

**\*\* Due to shielding see 6.6**

The assessment indicates that the subject building will experience radiant heat levels of <19kW/m<sup>2</sup> as a result of foreseeable local bushfires under conditions of an FDI of 100. The expected radiant heat levels translate to a Bushfire Attack Level (BAL) on the building of BAL 19. Construction of any new development to BAL 19 specifications is 'primarily concerned with protection from ember attack and radiant heat up to and including 19kW/m<sup>2</sup>'.

## 6.6 Reduction in BAL due to Shielding (PBP A1.8)

Where an elevation is shielded from direct radiant heat arising from bush fire attack, then the construction requirements for that elevation can be reduced to the next lower BAL. An elevation is considered to not be exposed to the source of bush fire attack if the line of sight between that elevation and the source of bush fire attack are obstructed by another part of the building.

The shielding of an elevation shall apply to all the elements of the wall but shall not apply to subfloors or roofs.

In this instance, the west aspect of the dwelling will be fully shielded from exposure to the source of the greatest bushfire attack by the building itself. Therefore the BAL for the west elevation can be reduced by one level to BAL 12.5.

**Figure 8. Shielding Diagram for the Subject Building. Source: NearMap with overlays by  
BFCS P/L**



## 7. Bush Fire Protection Measures

The BPMs for residential infill development include provisions relating to APZs, access, water supply, electricity and gas services, construction standards, landscaping and emergency evacuation. In order to create appropriate separation between a dwelling and the bush fire hazard, APZs commensurate with those specified for new subdivision must be provided.

## 7.1 Asset Protection Zones

**PBP Table 7.4a Performance criteria and acceptable solutions for residential infill development**

Performance Criteria	Acceptable Solutions/Comment
APZs are provided commensurate with the construction of the building	Achieved as a the minimum APZ of 36m is provided. In this case, the available separation distance between the building and the hazard is 52m, which exceeds the requirements of PBP
A defendable space is provided	Achieved as adequate defendable space is available to the front of the subject building and pedestrian firefighter access is available to the rear
APZs are managed and maintained to prevent the spread of a fire to the building	Achieved as the APZs are already managed in accordance with the requirements of Appendix 4 of PBP
The APZ is provided in perpetuity	Achieved as APZs requirements will be specified in the Development Consent conditions
APZ maintenance is practical, soil stability is not compromised and the potential for crown fires is minimised	Achieved as the APZ is located on lands with a slope less than 18 degrees. The slope under the site APZ is <5°

## 7.2 Access

Performance Criteria	Acceptable Solutions/Comment
Firefighting vehicles are provided with safe, all-weather access to structures and hazard vegetation	Achieved as property access roads are two-wheel drive, all-weather roads

Performance Criteria	Acceptable Solutions/Comment
The capacity of access roads is adequate for firefighting vehicles	Achieved as it is assumed that the capacity of road surfaces is sufficient to carry fully loaded firefighting vehicles (up to 23 tonnes)
There is appropriate access to water supply	Achieved as a hydrant is located approximately 55m from the development to the north, assumed to be in accordance with the relevant clauses of AS 2419.1:2005
Firefighting vehicles can access the dwelling and exit the property safely	Achieved as the development is located within an urban area where an unobstructed path (no greater than 70m) is provided between the most distant external part of the proposed dwelling and the nearest part of the public access road (where the road speed limit is not greater than 70kph) that supports the operational use of emergency firefighting vehicles

### 7.3 Water Supplies

Performance Criteria	Acceptable Solutions/Comment
An adequate water supply is provided for fire-fighting purposes	Achieved as reticulated water is provided to the development
Water supplies are located at regular intervals	Achieved as fire hydrant spacing, design and sizing are assumed to comply with the relevant clauses of AS 2419.1:2005
The water supply is accessible and reliable for fire fighting operations	Achieved as hydrants are not located within any road carriageway and reticulated water supply to urban subdivisions uses a ring main system for areas with perimeter roads (assumed)
Flows and pressure are appropriate	Achieved as fire hydrant flows and pressures are assumed to comply with the relevant clauses of AS 2419.1:2005
The integrity of the water supply is maintained	Achieved as any new above-ground water service pipes external to the building are to be metal, including and up to any taps

## 7.4 Electricity Services

Performance Criteria	Acceptable Solutions/Comment
Location of electricity services limits the possibility of ignition of surrounding bush land or the fabric of buildings	<p>Where practicable, electrical transmission lines are to be provided underground, and where overhead, electrical transmission lines are proposed as follows:</p> <p>Lines are installed with short pole spacing (30m), unless crossing gullies, gorges or riparian areas; and</p> <p>No part of a tree is closer to a power line than the distance set out in accordance with the specifications in ISSC3 <i>Guideline for Managing Vegetation Near Power Lines</i></p>

## 7.5 Gas Services

Performance Criteria	Acceptable Solutions/Comment
Location and design of gas services will not lead to ignition of surrounding bushland or the fabric of buildings	<p>Where applicable, reticulated or bottled gas is installed and maintained in accordance with AS/NZS 1596:2014 and the requirements of relevant authorities, and metal piping is used</p> <p>All fixed gas cylinders are kept clear of all flammable materials to a distance of 10m and shielded on the hazard side, connections to and from gas cylinders are metal</p> <p>Polymer-sheathed flexible gas supply lines are not used, and above-ground gas service pipes are metal, including and up to any outlets</p>

## 7.6 Construction Standards

Performance Criteria	Acceptable Solutions/Comment
The proposed building can withstand bush fire attack in the form of	<p>BAL 19 to the north, east and south and BAL 12.5 to the west</p> <p>has been determined in accordance with PBP Table A1.12.5</p>

Performance Criteria	Acceptable Solutions/Comment
embers, radiant heat and flame contact	The additional construction requirements of section 7.5 of PBP are to be incorporated into the development and are provided as an Appendix
Proposed fences and gates are designed to minimise the spread of bush fire	Any new fences and gates are constructed of either hardwood or non-combustible material, however, if located within 6m of a building, they are to be constructed from non-combustible material only
Proposed Class 10a buildings are designed to minimise the spread of bush fire	There are no bush fire protection requirements for Class 10a buildings located more than 6m from a dwelling in bush fire prone areas. Where a Class 10a building is located within 6m of a dwelling it must be constructed in accordance with the NCC

## 7.7 Landscaping

Performance Criteria	Acceptable Solutions/Comment
Landscaping is designed and managed to minimise flame contact and radiant heat to buildings, and the potential for wind-driven embers to cause ignitions	<p>Achieved as any landscaping within the APZ is to comply with the NSW RFS 'Asset protection zone standards' (PBP Appendix 4)</p> <p>A clear area of low-cut lawn or pavement is maintained adjacent to the house, and</p> <p>Trees and shrubs are located so that:</p> <ul style="list-style-type: none"> <li>▪ The branches will not overhang the roof;</li> <li>▪ The tree canopy is not continuous; and</li> <li>▪ Any proposed windbreak is located on the elevation from which fires are likely to approach</li> </ul>

## 8. Likely Impact of any BPMs

The proposed bushfire protection measures will not adversely impact on the environment. It should be noted that this report has not focused on environmental issues and as the land is a fully developed residential site, such features are unlikely to exist on the site.

## 9. “The SEPP Code”, Part 1, Division 2 clause 1.19A

### Land on which complying development may not be carried out— bush fire prone land

Criteria	Compliance
(1) To be complying development specified for any complying development code (except the Housing Alterations Code)—	
(a) the development must not be carried out on land in bush fire attack level-40 (BAL-40) or the flame zone (BAL-FZ), and  (b) in the case of development specified for the Rural Housing Code—any associated access way to the development must be on land that is— (i) not in bush fire attack level-40 (BAL-40) or the flame zone (BAL-FZ), or (ii) grasslands.	Yes, the BAL is 19 and 12.5
(2) This clause does not apply to the following development— (a) non-habitable detached development that is more than 6m from any dwelling house, (b) landscaped areas, (c) non-combustible fences, (d) swimming pools.	
(3) For the purposes of this clause, land is not in bush fire attack level-40 (BAL-40) or the flame zone (BAL-FZ) if—	
a) A person who is recognised by the NSW Rural Fire Service as a suitably qualified	Yes, the author of this report is recognised by the NSW Rural Fire

Criteria	Compliance
consultant in bush fire risk assessment determines, in accordance with the methodology specified in Planning for Bush Fire Protection, that the land is not in bush fire attack level-40 (BAL-40) or the flame zone (BAL-FZ), or	Service as a suitably qualified consultant in bush fire risk assessment
(b) in the case of development carried out on grasslands—the development conforms to the specifications and requirements of Table 7.9a of Planning for Bush Fire Protection that are relevant to the development	N/A

## 10. Part 3 Housing Code

### Assessment of Compliance with SEPP (Exempt and Complying Development Codes) 2008, Part 3 Housing Code, Division 2 Clause 3.4

(1) This clause does not apply to the following complying development under this code—

- (a) non-habitable detached development that is more than 6m from any dwelling house,
- (b) landscaped areas,
- (c) non-combustible fences,
- (d) swimming pools.

Note. See clause 1.19A for additional provisions relating to bush fire prone land.

(2) If complying development under this code is carried out on bush fire prone land, the following development standards also apply in addition to any other development standards:

Criteria	Compliance
a) Repealed	N/A
b) The lot on which the development is to be carried out must have direct access to a	Yes

Criteria	Compliance
public road or a road vested in or maintained by the council	
c) The dwelling house must be able to be connected to mains electricity	Yes
<p>d) If reticulated or bottled gas is installed and maintained on the lot</p> <p>i) it must be installed and maintained in accordance with AS/NZS 1596:2014, The storage and handling of LP Gas and the requirements of relevant authorities (metal piping must be used), and</p> <p>ii) the storage and handling of any LP gas on the lot must comply with the requirements of the relevant authorities (including the use of metal piping)</p>	These requirements will be provided by the owner or builder to any gas installer for compliance, if applicable
<p>e) any gas cylinders stored on the lot within 10m of any dwelling house must:</p> <p>(i) have its release valves directed away from the dwelling house, and</p> <p>ii) be enclosed on the hazard side of the installation</p> <p>(iii) have metal connections to and from the cylinder</p>	These requirements will be provided by the owner or builder to any gas installer for compliance, if applicable
f) there must not be any polymer sheathed flexible gas supply lines to gas meters adjacent to the dwelling house	These requirements will be provided by the owner or builder to any gas installer for compliance, if applicable
g) if the development is carried out on a lot in Zone RU5, there must be—	N/A as the zone is R2

Criteria	Compliance
(i) a reticulated water supply connection to the lot and a fire hydrant within 70m of any part of the development, or (ii) a 10,000 L capacity water tank on the lot,	
h) if the development is carried out on a lot in any zone other than Zone RU5, there must be— (i) a reticulated water supply connection to the lot, and (ii) a fire hydrant within 70m of any part of the development,	Yes, the zone is R2: Low Density Residential and there is a reticulated water supply connection to the lot, and a fire hydrant is located approximately 55m from the development to the north which is within 70m of any part of the development
i) The development must conform to the specifications and requirements of Planning for Bush Fire Protection that are relevant to the development	Yes, see above

## 11. Recommendations

The following recommendations are made for the bushfire measures for the proposed residential development of a new dwelling and swimming pool at Lot 7 DP 29657, 40 Thomas Street Picnic Point, and are based upon the relevant provisions of the NSW Rural Fire Service Guideline entitled *Planning for Bush Fire Protection 2019*.

### 1. Asset Protection Zones

At the commencement of the development, and in perpetuity, the entire site shall be managed as an Inner Protection Area (IPA) Asset Protection Zone, as outlined in PBP 2019 Appendix 4.

#### Trees

- canopy cover should be less than 15% (at maturity)
- trees (at maturity) should not touch or overhang the building

- lower limbs should be removed up to a height of 2m above ground
- canopies should be separated by 2 to 5m
- preference should be given to smooth barked and evergreen trees

#### Shrubs

- create large discontinuities or gaps in the vegetation to slow down or break the progress of fire towards buildings
- shrubs should not be located under trees
- shrubs should not form more than 10% ground cover
- clumps of shrubs should be separated from exposed windows and doors by a distance of at least twice the height of the vegetation

#### Grass

- should be kept mown (as a guide grass should be kept to no more than 100mm in height)
- leaves and vegetation debris should be removed.

## 2. Construction Standards

New construction shall comply with Sections 3 and 6 (BAL 19) to the north, east and south and Sections 3 and 5 (BAL 12.5) to the west of AS3959-2018 '*Construction of buildings in bush fire-prone areas*', as varied by the applicable additional construction requirements of PBP section 7.5 (shown as Appendix 4 below).

## 3. Electricity Services

Where practicable, electrical transmission lines are underground, and where overhead, electrical transmission lines are proposed as follows:

- i) lines are installed with short pole spacing (30m), unless crossing gullies, gorges or riparian areas; and
- ii) no part of a tree is closer to a power line than the distance set out in accordance with the specifications in ISSC3 *Guideline for Managing Vegetation Near Power Lines*.

#### 4. Gas Services

Where applicable, reticulated or bottled gas is installed and maintained in accordance with AS/NZS 1596:2014 *The storage and handling of LP Gas* and the requirements of relevant authorities, and metal piping is used.

All fixed gas cylinders are kept clear of all flammable materials to a distance of 10m and shielded on the hazard side, connections to and from gas cylinders are metal.

Polymer-sheathed flexible gas supply lines are not used, and above-ground gas service pipes are metal, including and up to any outlets.

#### 5. Fences and gates

All new fences and gates are constructed of either hardwood or non-combustible material, however, if located within 6m of a building, they are to be constructed from non-combustible material only.

#### 6. Landscaping

Any new landscaping within the APZ is to comply with the NSW RFS 'Asset protection zone standards' (PBP Appendix 4).

#### 7. Emergency and Evacuation Planning

The need to formulate an emergency evacuation plan is suggested. To do so, occupants can complete a Bush Fire Safety Plan on the NSW RFS Website <http://www.rfs.nsw.gov.au/> under publications / bushfire safety.

## 12. Summary


This report consists of a bush fire assessment for the proposed residential development of a dwelling and swimming pool at Lot 7 DP 29657, 40 Thomas Street Picnic Point. The report concludes that the proposed development is on designated bushfire prone land and the legislative requirements for development in bushfire prone areas are applicable.

This report has considered all the elements of bushfire attack and finds that the development has a Bushfire Attack Level of BAL 19 to the north, east and south and BAL 12.5 to the west.

The development satisfies the Objectives and Performance requirements of 'Planning for Bush Fire Protection' 2019, subject to implementation of the recommendations made by this report.

*Notwithstanding the precautions adopted, it should always be remembered that bushfires burn under a wide range of conditions and an element of risk, no matter how small, always remains and although the standard is designed to improve the performance of such buildings, there can be no guarantee because of the variable nature of bushfires that any one building will withstand bushfire attack on every occasion.*

*This report is a bush fire assessment that provides the required information to assist local Council in determining compliance in accordance with Planning for Bush Fire Protection and AS3959-2018. The local Council is the final consenting authority and the construction of the building must comply with the recommendations included in the Council's conditions of consent.*



**Laura Richards**

(a person who is recognised by the NSW Rural Fire Service as a suitably qualified consultant in bush fire risk assessment)

**Accredited Bushfire Planning and Design Practitioner**

Fire Protection Association Australia BPAD-Level 2 (BPAD 48551)

Grad. Cert. Bushfire Protection (WSU)

Bushfire Consulting Services Pty Ltd

**Tel: 02 4744 5800 | Mob: 0425 833 893**

## 13. References

Keith D 2004, *Ocean Shores to Desert Dunes, the Native Vegetation of NSW and the ACT*, Department of Environment and Conservation, Sydney

NearMap 2022, *NearMap Photomap Aerial Imagery*, NearMap Australia, Barrangaroo, NSW

NSW Government 2022a, *NSW Spatial Services*, NSW Department of Finance, Services and Innovation.

NSW Government 2022b, *NSW Planning Portal*, NSW Department of Planning and Environment.

NSW Government 2022c, *Biodiversity Values Map*, NSW Department of Environment and Heritage.

NSW RFS 2019, *Planning for Bush Fire Protection*, NSW Rural Fire Service, Sydney.

Standards Australia 2018, *Australian Standard AS 3959-2018 'Construction of Buildings in Bushfire Prone Areas'*, SAI Global, Australia.


## 14. Legislation

*Environmental Planning & Assessment Act 1979*

*Rural Fires Act 1997*

*Rural Fires Regulation 2013*

Appendix 1 - Site Plan

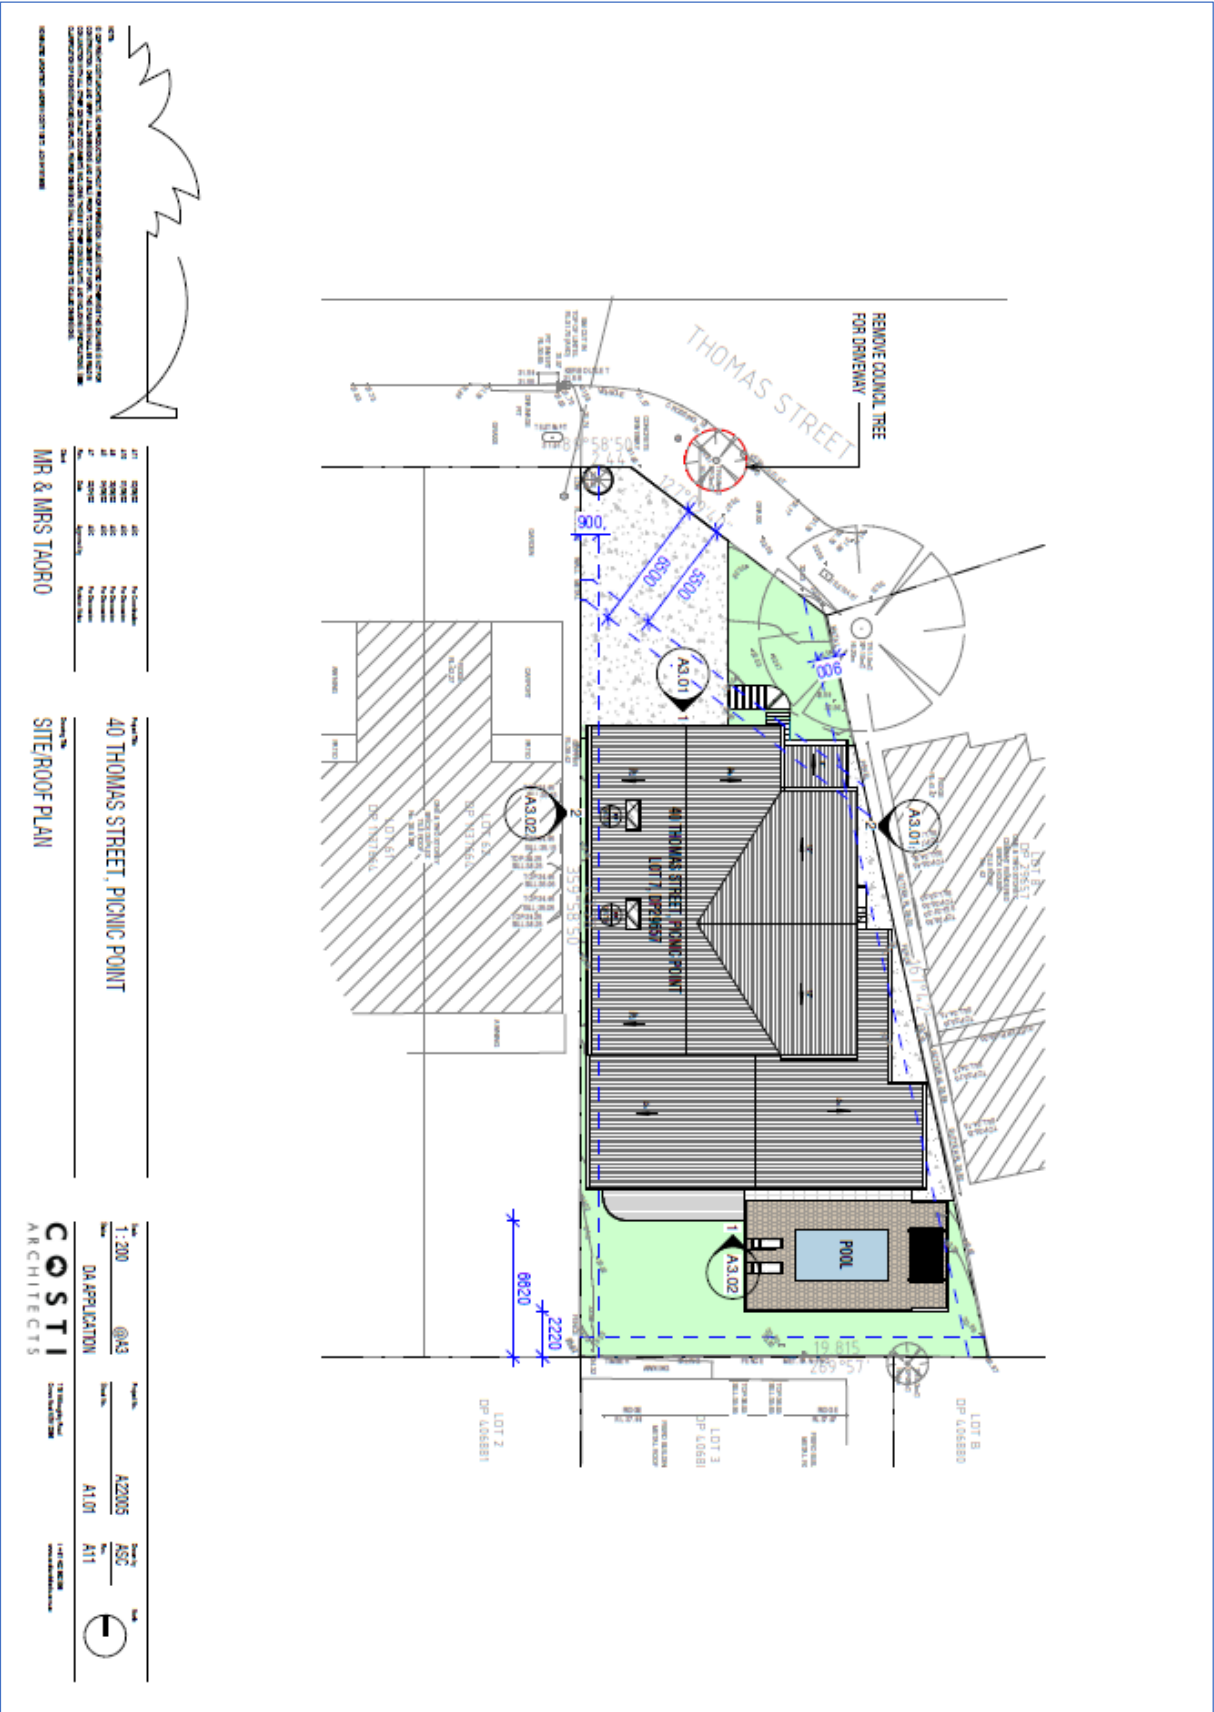

## Appendix 2 – Photos of Site and Surrounds

Source: BFCS P/L 07/06/2022



*Subject site*



*Vegetation to the southeast, approximately 52m from the proposal*



*Vegetation to the southeast, approximately 52m from the proposal*



*Vegetation to the southeast, approximately 52m from the proposal*

## Appendix 3 – Bushfire Risk Assessment Certificate

This form is completed by a recognized consultant in bushfire risk assessment in accordance with section s4.14 of the *Environmental Planning and Assessment Act 1979 No 203*

PROPERTY ADDRESS:	Lot 7 DP 29657 40 Thomas Street Picnic Point
DESCRIPTION OF PROPOSAL:	Dwelling and swimming pool
PLAN REFERENCE: (relied upon in report preparation)	Plans by Costi Architects numbered A22005 revision A11 dated 03/06/2022
BAL RATING	BAL 19 to the north, east and south and BAL 12.5 to the west (If the BAL rating is FZ the application is to be referred to NSW RFS for assessment)
DOES THE PROPOSAL RELY ON ALTERNATE SOLUTIONS:	YES <input type="radio"/> NO <input checked="" type="radio"/> (Circle the relevant response) (If YES the application is to be referred to NSW RFS for assessment)

I, Laura Richards, of Bushfire Consulting Services Pty Ltd, have carried out a bushfire risk assessment on the above mentioned proposal and property. A detailed Bushfire Assessment Report is attached which includes the submission requirements set out in Appendix 2 of *Planning for Bushfire Protection 2019* together with recommendations as to how the relevant specifications and requirements are to be achieved.

REPORT REFERENCE:	J22/0455
REPORT DATE:	10/06/2022
CERTIFICATION NO/ACCREDITED SCHEME:	BPAD-Level 2 Accredited Practitioner FPAA Cert No: BPAD48551

Note: this certificate must be completed and signed by a person recognised by the NSW Rural Fire Service as a qualified consultant in bush fire risk assessment in accordance with s4.14 of the *EP&A Act 1979 No 203*.

\*\*\*\*\*

I hereby certify, in accordance with Section 4.14 of the Environmental Planning and Assessment Act 1979 No 203:

That I am a person recognised by the NSW Rural Fire Service as a qualified consultant in bushfire risk assessment; and

That subject to the recommendations contained in the attached Bushfire Risk Assessment Report the proposed development conforms to the relevant specifications and requirements\*.

\* The relevant specifications and requirements being; specifications and requirements of the document entitled Planning for Bush Fire Protection prepared by the NSW Rural Fire Service in co-operation with the Department of Planning and any other document as prescribed by Section s4.14 of the *Environmental Planning and Assessment Act 1979 No 203*.

I am aware that the bush fire assessment report, prepared for the above mentioned site is to be submitted in support of a development application for this site and will be relied upon by Council as the basis for ensuring that the bushfire risk management aspects of the proposed development have been addressed in accordance with *Planning for Bush Fire Protection 2019*.

Attachments:



Bush Fire Risk Assessment Certificate



Recommendations



Statement of vegetation impact in relation to AP



SIGNATURE:

DATE: 10/06/2022

## Appendix 4 - Modifications of section 7.5 of PBP

### 7.5 Additional construction requirements

To ensure the performance criteria for construction standards given in section 7.4 can be met, PBP adopts additional measures over and above AS 3959 and NASH Standard as follows:

- construction measures for ember protection at BAL-12.5 and BAL-19 provided by AS 3959
- construction measures for development in BAL-FZ; and
- requirements over and above the performance criteria contained within AS 1530.8.1 and AS 1530.8.2 apply in regards to flaming.

#### 7.5.1 Ember protection

Based on the findings from the 2009 Victorian Bush Fires Royal Commission, PBP aims to maintain the safety levels previously provided by AS 3959:1999 in relation to ember protection at lower Bush Fire Attack Levels.

In particular, the areas addressed are in relation to:

- sarking;
- subfloor screening;
- floors;
- verandas, decks, steps, ramps and landings;
- timber support posts and beams; and
- fascias and bargeboards.

#### 7.5.2 NSW State Variations under G5.2(a) (i) and 3.10.5.0(c)(i) of the NCC

Certain provisions of AS 3959 are varied in NSW based on the findings of the Victorian Bush Fires Royal Commission and bush fire industry research.

The following variations to AS 3959 apply in NSW for the purposes of NSW G5.2(a)(i) of Volume One and NSW 3.10.5.0(c)(i) of Volume Two of the NCC;

- clause 3.10 of AS 3959 is deleted and any sarking used for BAL-12.5, BAL-19, BAL-29 or BAL-40 shall:
  - be non-combustible; or

- comply with AS/NZS 4200.1, be installed on the outside of the frame and have a flammability index of not more than 5 as determined by AS 1530.2; and
- clause 5.2 and 6.2 of AS 3959 is replaced by clause 7.2 of AS 3959, except that any wall enclosing the subfloor space need only comply with the wall requirements for the respective BAL; and
- clause 5.7 and 6.7 of AS 3959 is replaced by clause 7.7 of AS 3959, except that any wall enclosing the subfloor space need only comply with the wall requirements for the respective BAL; and
  - fascias and bargeboards, in BAL-40, shall comply with:
  - clause 8.4.1(b) of AS 3959; or
  - clause 8.6.6 of AS 3959.