

31 ENDEAVOUR RD, GEORGES HALL, NSW 2198

STORMWATER PLAN

GENERAL




- G1. THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH ALL ARCHITECTURAL & OTHER WORKING DRAWINGS, SPECIFICATIONS & WITH SUCH WRITTEN INSTRUCTIONS AS MAY BE ISSUED DURING THE COURSE OF THE CONTRACT.
- G2. ALL WORKMANSHIP & MATERIALS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CURRENT EDITION OF THE RELEVANT AUSTRALIAN STANDARDS, THE BUILDING CODE OF AUSTRALIA AND ANY OTHER APPLICABLE AUTHORITY REQUIREMENTS.
- G3. ANY CONFLICT BETWEEN THESE NOTES, THE SPECIFICATION, THE DRAWINGS OR ANY OTHER RELEVANT DOCUMENTS SHALL BE REFERRED TO ABCON ENGINEERS FOR DECISION PRIOR TO PROCEEDING WITH THE WORK.
- G4. DIMENSIONS SHALL NOT BE OBTAINED BY SCALING THE DRAWINGS. FOR SETTING OUT DIMENSIONS & LEVELS REFER TO ARCHITECTURAL DRAWINGS.
- G5. THE BUILDER SHALL BE RESPONSIBLE FOR THE PROVISION OF ALL SHORING TO MAINTAIN THE STABILITY & INTEGRITY OF EXCAVATIONS & ADJACENT STRUCTURES.
- G6. IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE ALL SERVICES PRIOR TO COMMENCEMENT OF ANY EARTHWORKS.
- G7. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
- STORMWATER**
- W1. ALL LEVELS ARE TO A.H.D. UNO.
- W2. THE STORMWATER SYSTEM IS DESIGNED TO COMPLY WITH COUNCIL'S DESIGN CRITERIA AND TO APPROXIMATELY MAINTAIN EXISTING FLOW PATTERNS.
- W3. OVERLAND FLOW PATHS ARE PRESERVED.
- W4. EXISTING DRAINAGE AND LEVELS ARE BASED ON SURVEY PROVIDED & SHOULD BE ASSUMED TO BE APPROXIMATE. ALLOW TO CONFIRM ALL RELEVANT DETAILS BEFORE PROCEEDING WITH AFFECTED AREAS.
- W5. ALL WORK TO COMPLY WITH AS3500.3.
- W6. ALL PITS TO BE PRECAST CONCRETE OR F.R.C. UNO.
- W7. DOWNPIPE LOCATIONS SHOULD BE CONFIRMED WITH ARCHITECT'S PLAN UNO.
- W8. GRADE LOCAL SURFACES INTO PITS TO ENSURE COLLECTION OF WATER & THAT THERE ARE NO AREAS OF PONDING, TYPICAL.
- W9. GRATED TRENCHES AND SILT ARRESTOR PITS TO BE INSPECTED AND CLEANED AFTER PERIODS OF HEAVY RAINFALL.
- W10. TREE ROOTS TO BE AVOIDED DURING PLACEMENT OF DRAINAGE SYSTEM.
- W11. ALL PIPES TO BE Ø100 UPVC UNO.
- W12. ALL PIPES TO HAVE 100 MIN. COVER IN LANDSCAPED AREAS AND 600 MIN. COVER IN TRAFFICABLE AREAS.
- W13. ALL INLET AND OUTLET PIPES FROM PITS TO BE CONNECTED AT THE HIGHEST POSSIBLE INVERT LEVEL WHILST KEEPING 1% MIN. GRADE UNLESS NOTED OTHERWISE.
- W14. FINISHED SURFACES TO BE GRADED AWAY FROM THE DWELLING AND TOWARD THE PITS.
- W15. GRATED TRENCHES TO BE 1% MIN. GRADE THROUGHOUT TO OUTLET PIPE.

STORMWATER

- W1. ALL LEVELS ARE TO A.H.D. UNO.
- W2. THE STORMWATER SYSTEM IS DESIGNED TO COMPLY WITH COUNCIL'S DESIGN CRITERIA AND TO APPROXIMATELY MAINTAIN EXISTING FLOW PATTERNS.
- W3. OVERLAND FLOW PATHS ARE PRESERVED.
- W4. EXISTING DRAINAGE AND LEVELS ARE BASED ON SURVEY PROVIDED & SHOULD BE ASSUMED TO BE APPROXIMATE. ALLOW TO CONFIRM ALL RELEVANT DETAILS BEFORE PROCEEDING WITH AFFECTED AREAS.
- W5. ALL WORK TO COMPLY WITH AS3500.3.
- W6. ALL PITS TO BE PRECAST CONCRETE OR F.R.C. UNO.
- W7. DOWNPIPE LOCATIONS SHOULD BE CONFIRMED WITH ARCHITECT'S PLAN UNO.
- W8. GRADE LOCAL SURFACES INTO PITS TO ENSURE COLLECTION OF WATER & THAT THERE ARE NO AREAS OF PONDING, TYPICAL.
- W9. GRATED TRENCHES AND SILT ARRESTOR PITS TO BE INSPECTED AND CLEANED AFTER PERIODS OF HEAVY RAINFALL.
- W10. TREE ROOTS TO BE AVOIDED DURING PLACEMENT OF DRAINAGE SYSTEM.
- W11. ALL PIPES TO BE Ø100 UPVC UNO.
- W12. ALL PIPES TO HAVE 100 MIN. COVER IN LANDSCAPED AREAS AND 600 MIN. COVER IN TRAFFICABLE AREAS.
- W13. ALL INLET AND OUTLET PIPES FROM PITS TO BE CONNECTED AT THE HIGHEST POSSIBLE INVERT LEVEL WHILST KEEPING 1% MIN. GRADE UNLESS NOTED OTHERWISE.
- W14. FINISHED SURFACES TO BE GRADED AWAY FROM THE DWELLING AND TOWARD THE PITS.
- W15. GRATED TRENCHES TO BE 1% MIN. GRADE THROUGHOUT TO OUTLET PIPE.

LEGEND

- SURFACE FLOW
- EXISTING SURFACE LEVEL
- DP DOWN PIPE
- PROPOSED ROOF PIPE
- PROPOSED NON-ROOF PIPE

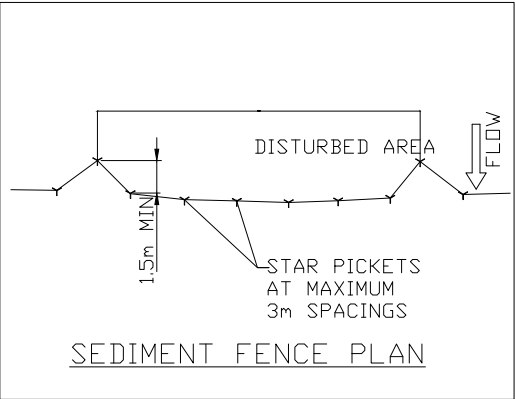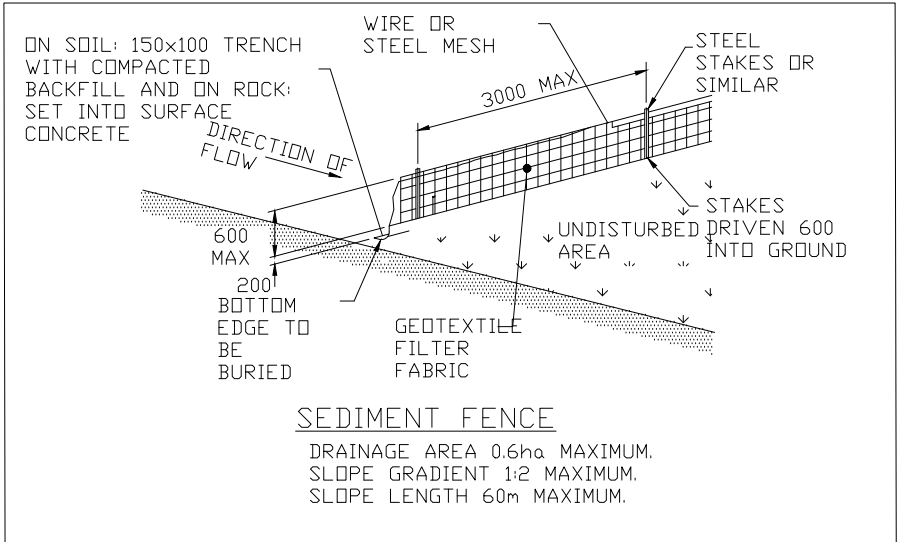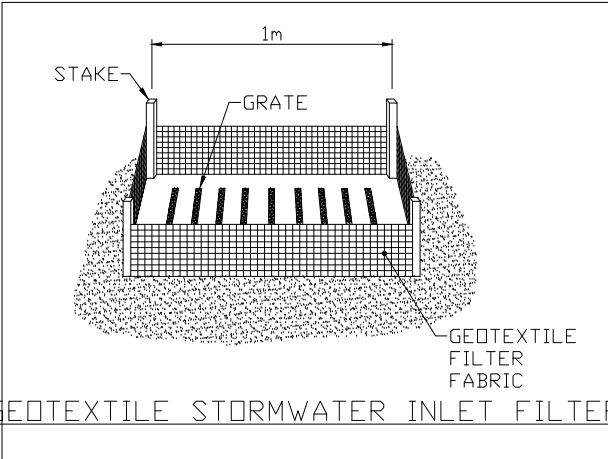

SCALE 1:100 (m) @ A3

0 1 2 3 4 5

NOTE: DO NOT SCALE OFF DRAWINGS. REFER TO ARCHITECTURAL PLANS. VERIFY DIMENSIONS ON SITE

REV	DATE	DESCRIPTION	BY
A	08.11.2024	ISSUED FOR CONSTRUCTION	AS

COPYRIGHT
All rights reserved.
These drawings, plans and specifications and the copyright are the property of ABCON Engineers and must not be used, reproduced or copied wholly or in part without the written permission of ABCON Engineers


info@abcon.com.au
02 8768 0561



PROPOSED ROOFING AT
31 Endeavour Rd, Georges Hall, NSW 2198

STORMWATER NOTES

JOB NUMBER: 24142	DWG NUMBER: C00	ORIGINAL SIZE: A3
DESIGNED BY: AS	DATE: 08.11.2024	
CHECKED BY: MA	SCALE: AS SHOWN	

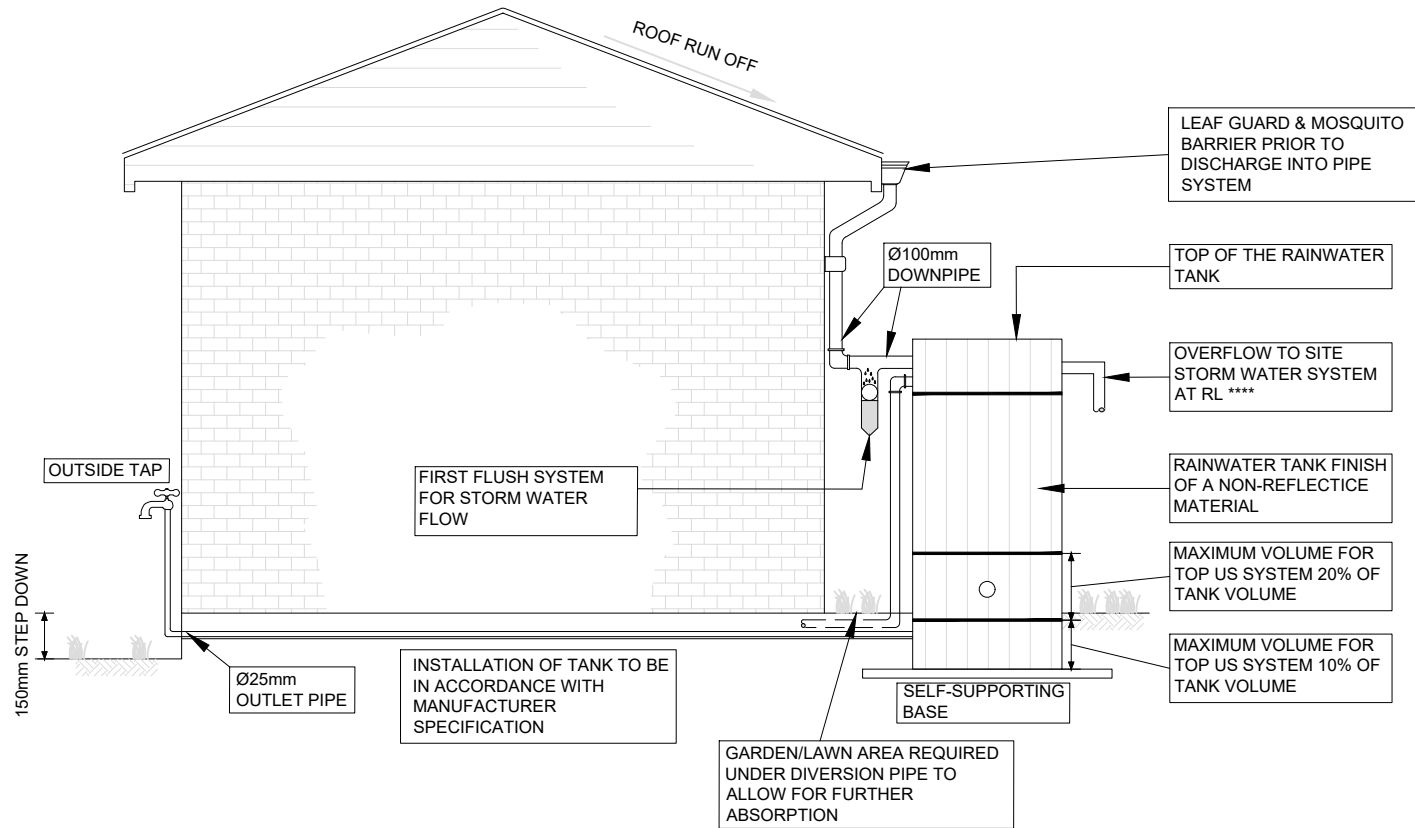


RAINWATER TANK DETAIL

N.T.S

STORAGE TANK NOTES:







1. TANK WATER TAPS SHALL BE MARKED "RAINWATER NOT TO HUMAN CONSUMPTION".
2. RAINWATER TANKS SHALL BE CONNECTED TO MAINS WATER SUPPLY AS BACK UP.
3. THE PUMP ARE TO BE INSULATED IN ACCORDANCE WITH COUNCIL POLICY.
4. PUMPS SHALL PROVIDE MINIMUM 150 kPa PRESSURE.
5. EACH TANK TOP BE CONNECTED TO AN OUTDOOR TAP FOR IRRIGATION USE.
6. RAINWATER TANK TO BE CLEANED OUT EVERY 6 MONTHS.
7. WATER TANK AND ASSOCIATED STRUCTURE TO BE THE SAME COLOR, OR A COLOR COMPLEMENTARY TO THE DWELLING.
8. TOP TANK TO BE BELOW TO OF NEAREST FENCE, OR 1.8M METERS WHICHEVER IS LESS.
9. THE WATER TANK SHOULD BE LOCATED AT LEAST 900mm FROM ANY PROPERTY BOUNDARY.
10. PLUMBING FROM THE WATER TANK IS TO BE KEPT SEPARATED FROM THE RETICULATED WATER SUPPLY SYSTEM.
11. TANK TO BE BUILT ON SELF-SUPPORTING BASE.
12. PROVIDE BACK-FLOW PREVENTING DEVICE AT MAINS WATER METER.
13. ROOF DRAINING TO TANK MUST NOT CONTAIN LEAD,TAR BASED PAINTS OR ASBESTOS.
14. WATER TO BE DRAWN FROM ANAEROBIC ZONE OF TANK.

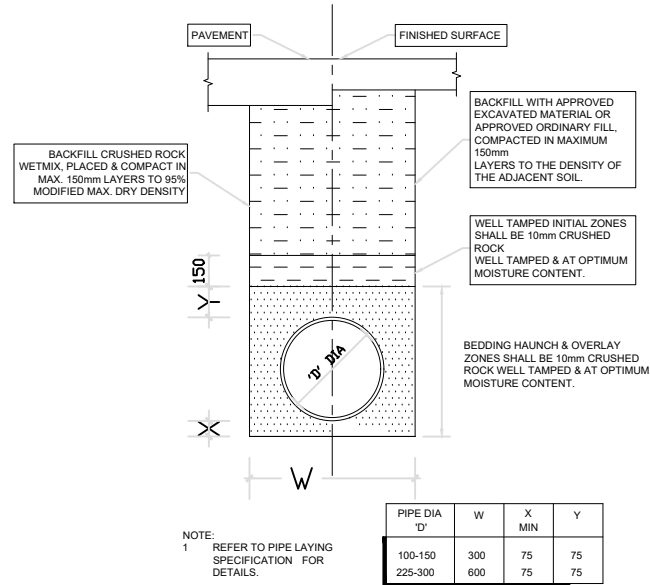

TYPICAL UPVC PIPE LAYING DETAIL

1:20

SEDIMENT & EROSION CONTROL DETAILS

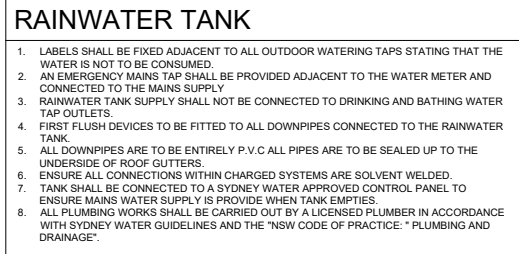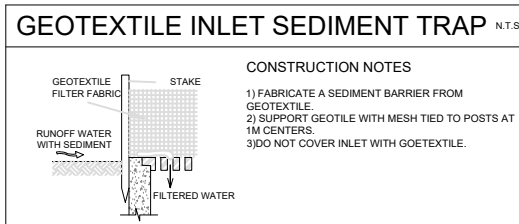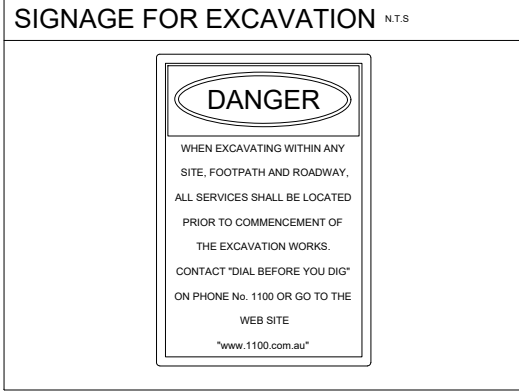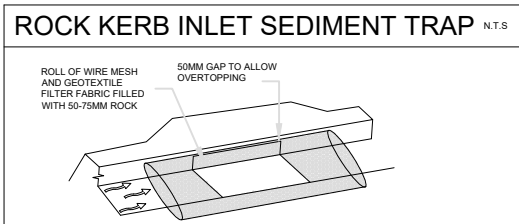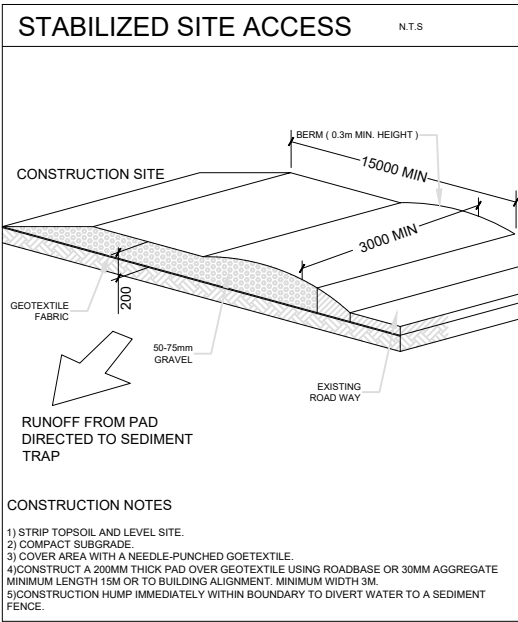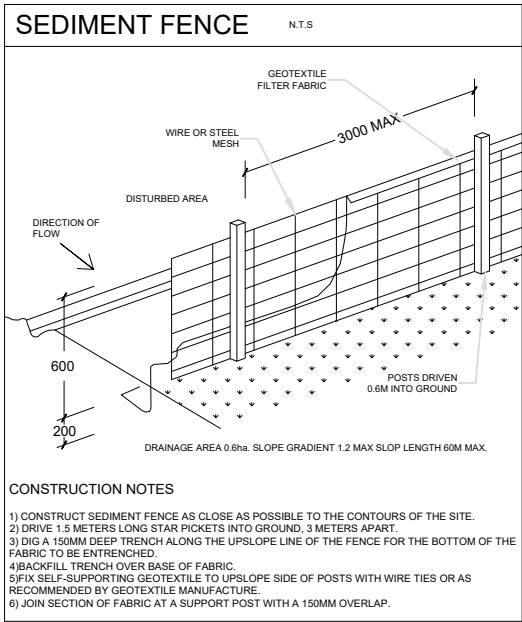

SCALE 1:100 (m) @ A3
0 1 2 3 4 5

NOTE: DO NOT SCALE OFF DRAWINGS. REFER TO ARCHITECTURAL PLANS. VERIFY DIMENSIONS ON SITE

REV	DATE	DESCRIPTION	BY
A	08.11.2024	ISSUED FOR CONSTRUCTION	AS

COPYRIGHT
All rights reserved.
These drawings, plans and specifications and the copyright are the property of ABCON Engineers and must not be used, reproduced or copied wholly or in part without the written permission of ABCON Engineers
info@abcon.com.au
02 8768 0561



PROPOSED ROOFING AT
31 Endeavour Rd, Georges Hall, NSW 2198

SEDIMENT CONTROL DETAILS

JOB NUMBER: 24142	DWG NUMBER: C02	ORIGINAL SIZE: A3
DESIGNED BY: AS	DATE: 08.11.2024	
CHECKED BY: MA	SCALE: AS SHOWN	

8/11/2024 11:47 AM