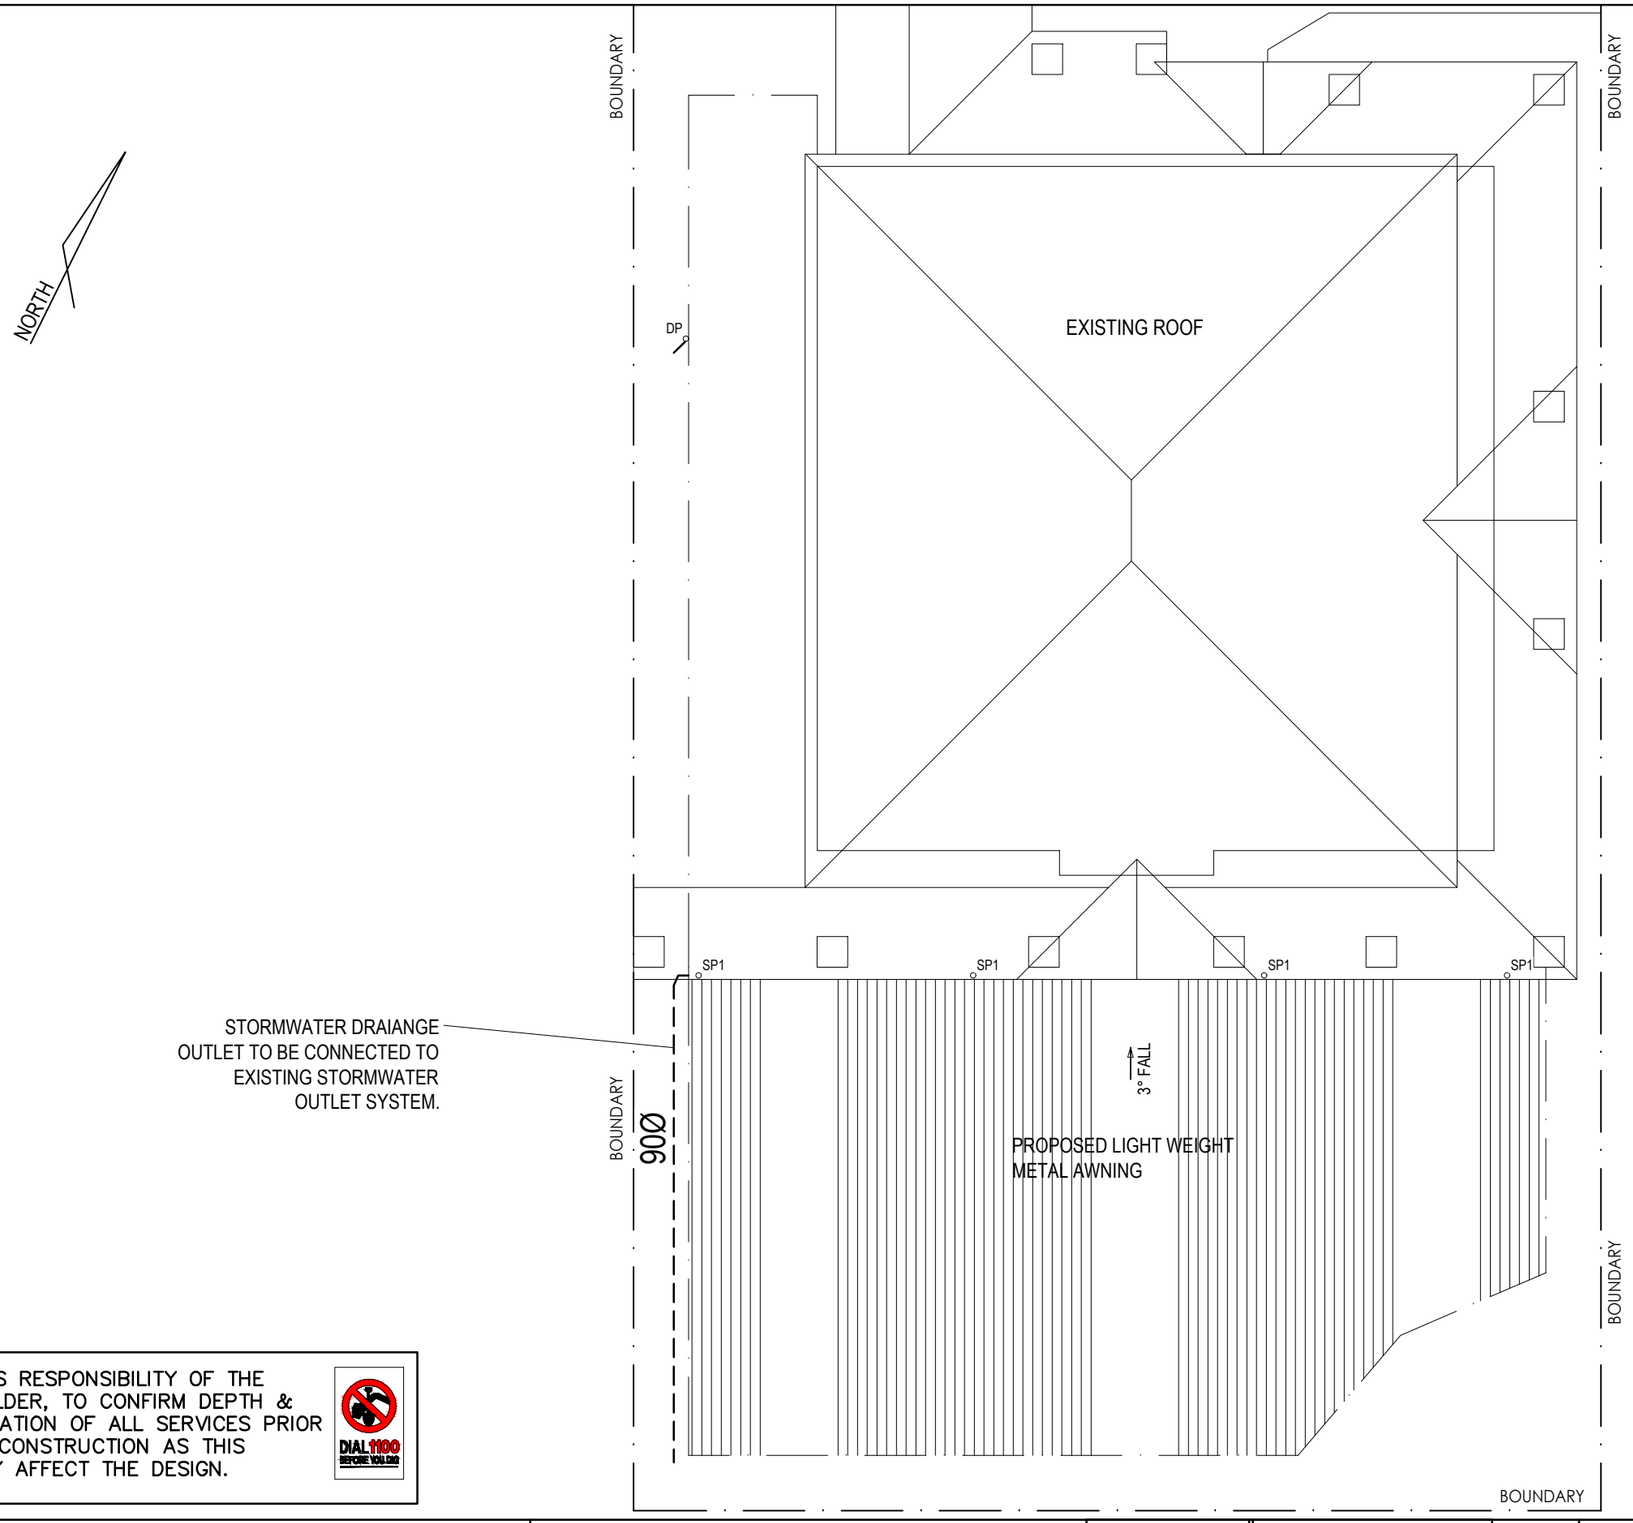

STORMWATER

1. THESE DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL DETAILS.
2. ALL WORKS IN ACCORDANCE WITH AS3500, COUNCIL DEVELOPMENT CONTROL PLANS, SYDNEY WATER REQUIREMENTS AND PROPRIETARY MANUFACTURER'S RECOMMENDATIONS.
3. ALL STORMWATER PIPES TO BE MIN. 100Ø UPVC GRADE, U.N.O., JOINTED & INSTALLED TO MANUFACTURER'S RECOMMENDATIONS.
4. ALL STORMWATER LINES TO HAVE ALL JOINTS, INC. DP CONNECTIONS, FULLY SOLVENT WELDED (AS LINES ARE 'CHARGED')

STORMWATER MANAGEMENT PLAN

1:100

IT IS RESPONSIBILITY OF THE BUILDER, TO CONFIRM DEPTH & LOCATION OF ALL SERVICES PRIOR TO CONSTRUCTION AS THIS MAY AFFECT THE DESIGN.

DIAL 1100 BEFORE YOU DIG

LEGEND

DP	90DIA DOWN PIPE UNO
SP	90DIA PCV STORMWATER SPREADER

CLIENT:
DARUL TARBIYAH ASSOCIATION

JOB:
PROPOSED ALTERATIONS AND ADDITIONS TO COMMUNITY FACILITY AT NO. 1021 CANTERBURY ROAD LAKEMBA NSW 2195

JOB NO: 2126 | DRAWING TITLE: SW1

APPROVED BY:

B.E. M.E. MIEAust

Drawn by: SMU | Checked by: SUS

Date: 25/08/2024 | SCALE 1:100

Date	Revision	REV.
09.11.24	AMENDED FOR APPROVAL	B
29.09.24	ISSUED FOR APPROVAL	A

SUS Consulting (Structural and Civil Engineers.)
7 PEREGRINE CLOSE, ABERGLASSLYN, NSW 2320
engr.siraj70@gmail.com
Contact: 04 2652 0664