



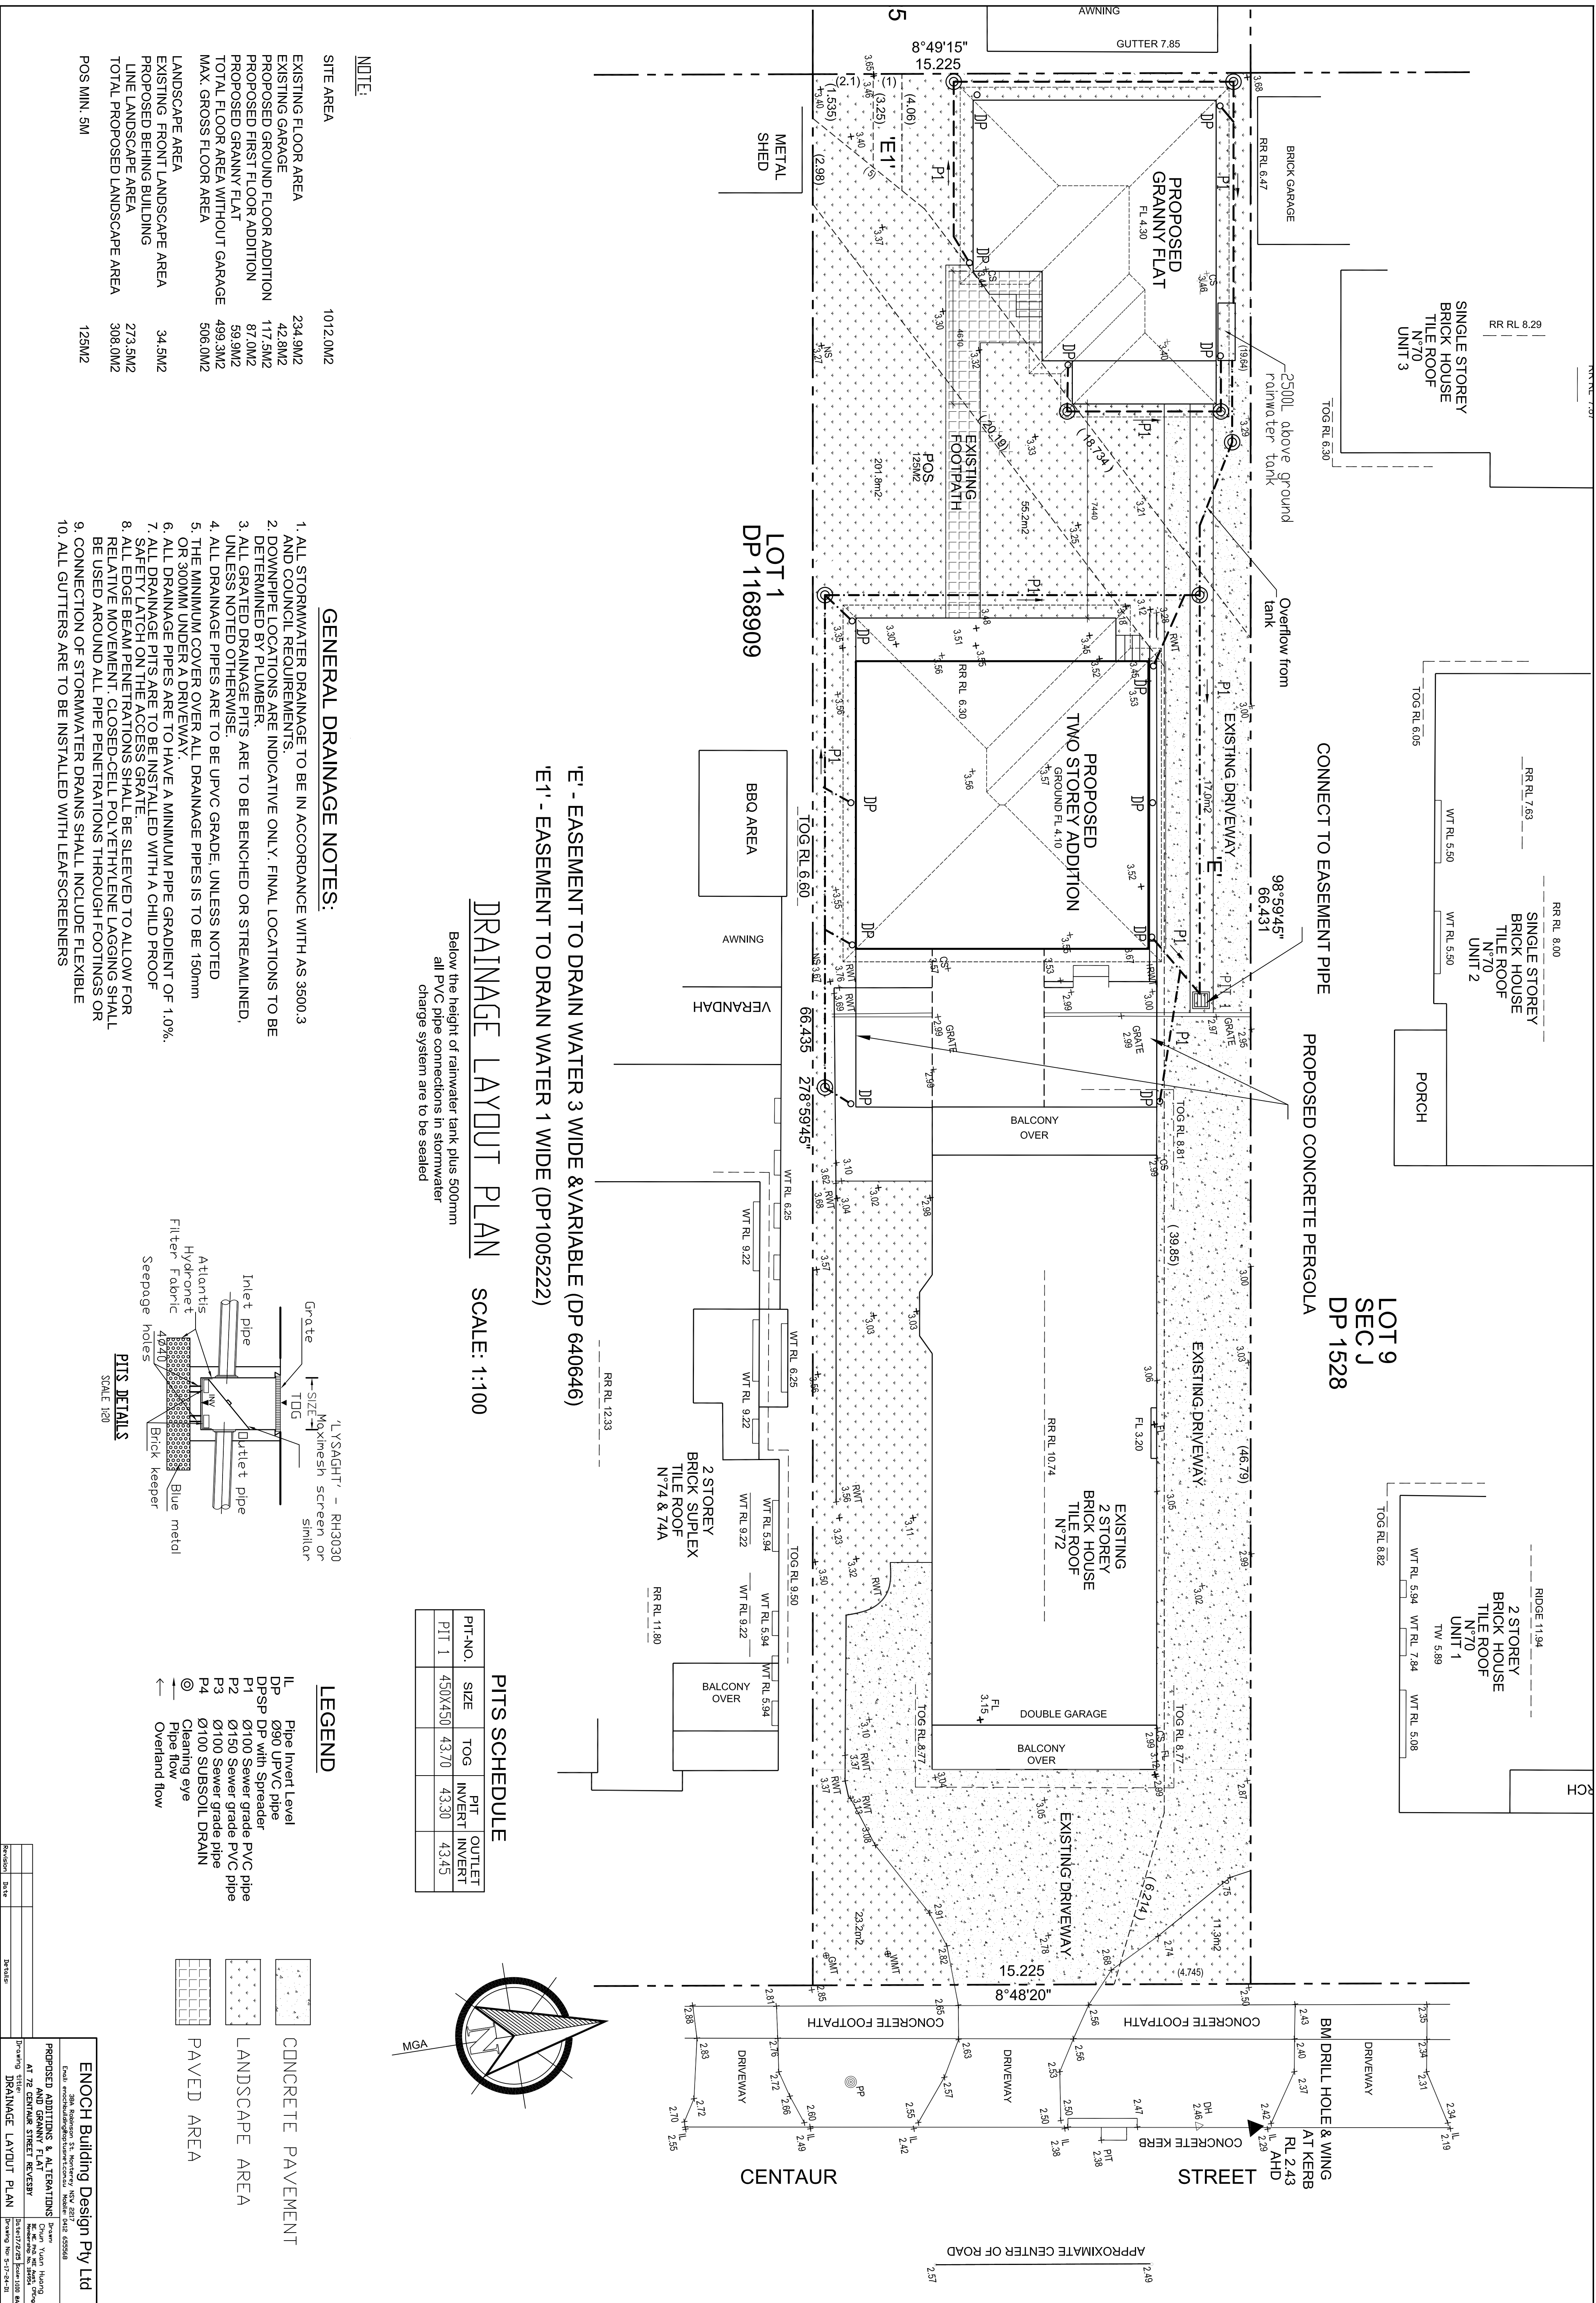

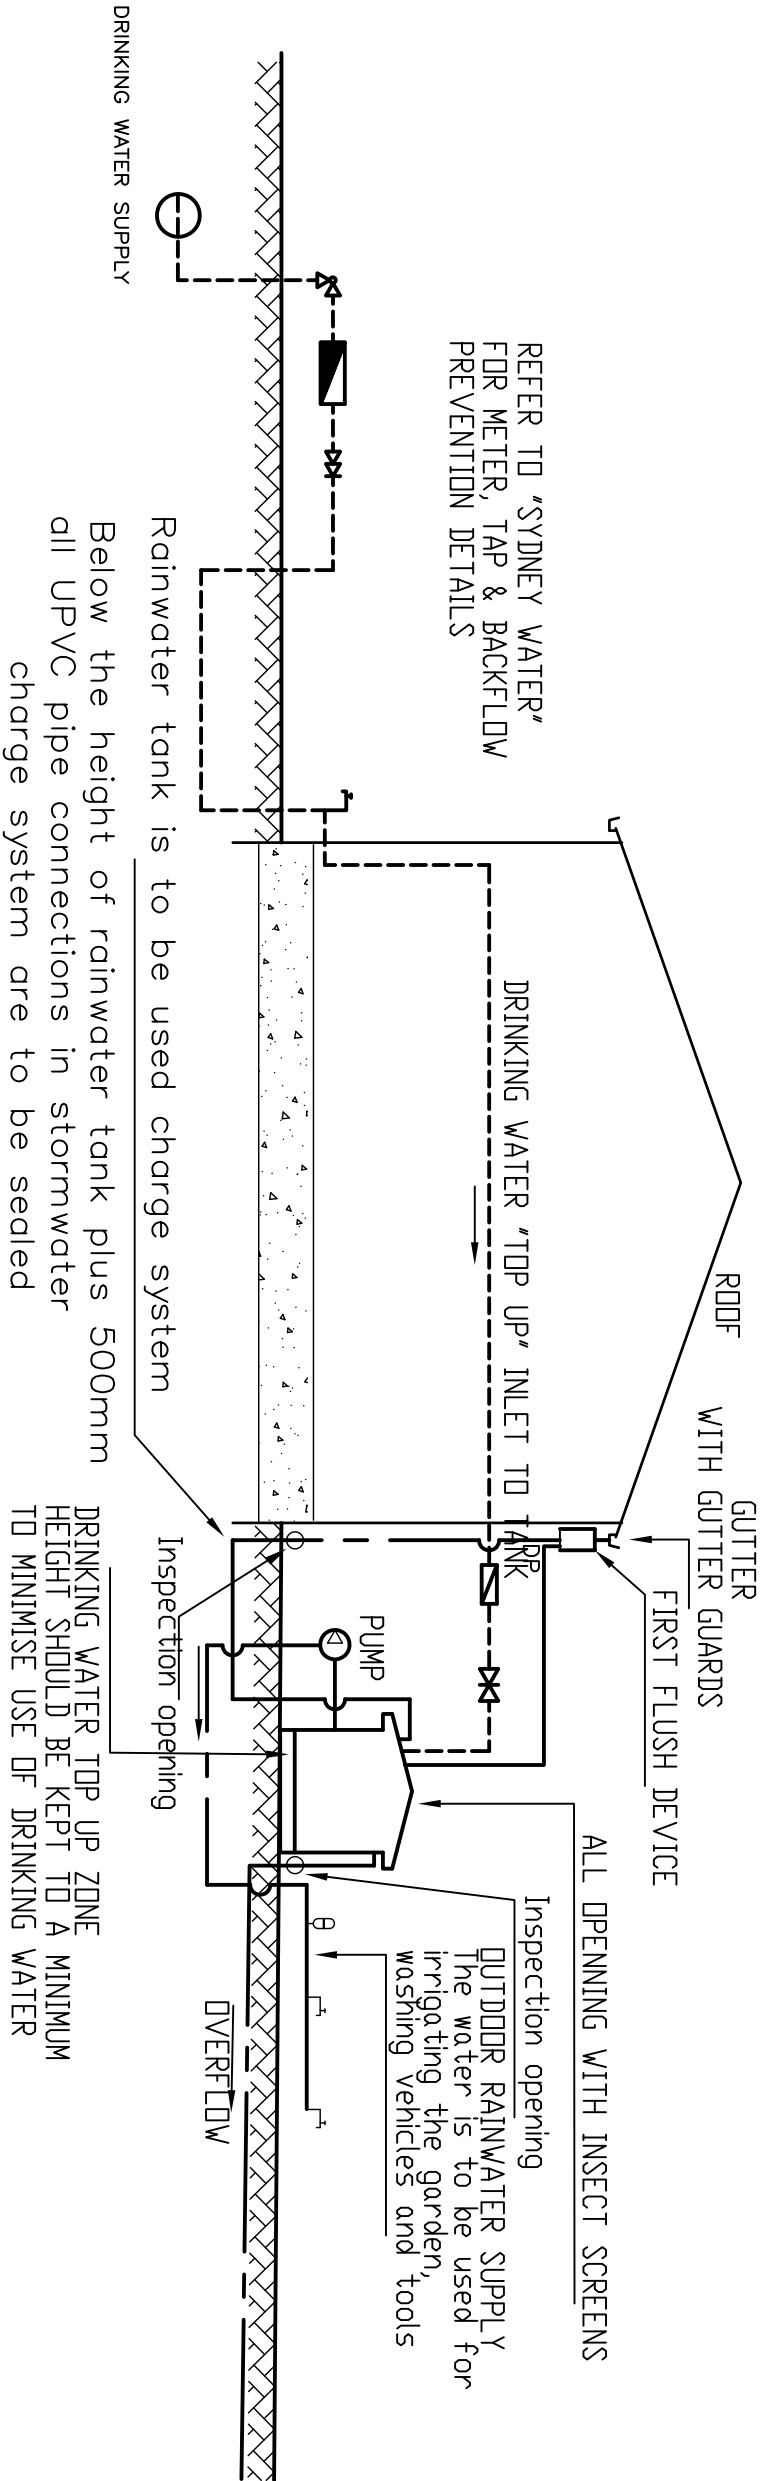

"SYDNEY WATER" RAINWATER TANK CONNECTION DIAGRAM

NOT TO SCALE

DIAGRAM NOTES:

1. DRAWING TO BE READ IN CONJUNCTION WITH SYDNEY WATER PLUMBING REQUIREMENTS
2. SYDNEY WATER'S APPROVAL IS REQUIRED FOR ANY TOP UP FROM DRINKING WATER SUPPLY, REGARDLESS OF TANK SIZE.
3. NO DIRECT CONNECTION IS ALLOWED BETWEEN THE DRINKING WATER SUPPLY AND THE RAINWATER TANK SUPPLY
4. RAINWATER PIPE WORK IS SHOWN ON THE DIAGRAM AS SUPPLYING INTERNAL & EXTERNAL RAINWATER USES. CUSTOMERS MAY WANT ONLY ONE OR THE OTHER.
5. THE INLET FILLING RATE FROM DRINKING WATER SUPPLY IS TO BE RESTRICTED TO A MAXIMUM OF TWO (2) LITRES PER MINUTE FOR EACH HOUSE. TOWN HOUSE OR UNIT SUPPLIED FROM THE TANK.

- BALL VALVE RIGHT ANGLE TYPE
- DUAL CHECK VALVE
- METER
- GARDEN TAP
- PRESSURE VESSEL
- PUMP
- FLOAT VALVE
- MAX. 2 L/min FLOW REGULATOR

Revision	Date	Details

38A Robinson St. Monterey NSW 2217 Phone: 02 95882616 Fax: 02 95930371 Mobile: 0412 655568		
ENOCH Building Design Pty Ltd		
PROPOSED ADDITIONS & ALTERATIONS AND GRANNY FLAT AT 72 CENTAUR STREET REVESBY		
Drawing title: Tank connection diagram	Drawn: Chun Yuan Huang BE, ME, PPL, ME, ASST, OFENG Membership No. 189554	Date: 17/2/25 Scale: A3