



SECTION J – ENERGY EFFICIENCY

NCC 2022, Volume 1
(NCC Class 5 and Class 4)

and

H6 ENERGY EFFICIENCY

NCC 2022, Volume 2
(NCC Class 1)

NCC Compliance Assessment of:

7 Rex Street, Goulburn

Climate Zone 7

Goulburn Mulwaree Council

V1.0

Report prepared by

Trish Campbell, ACT Sustainable Systems

22/05/2025

ACT Sustainable Systems
PO Box 436 Calwell ACT
ABN 40 836 387 634

Contents

1. Compliance Summary	4
2. Introduction	6
Part J2 Energy Efficiency – Volume One	7
NSW J2D1(1)	7
NSW J2D2	7
Part J3: Class 4 part of building	7
J3D2	7
BASIX COMMITMENTS – CLASS 4 Unit	8
J3D5	8
J3D6	8
J3D10(3)(5)(6)	9
Part J4 Building Fabric	10
NSW J4D2	10
NSW J4D3 Thermal Construction - general	11
NSW J4D4 Roof and ceiling construction	12
NSW J4D5 Roof Lights	12
NSW J4D6 Walls and glazing	13
NSW J4D7 Floors	14
Part J5 Building Sealing	15
NSW J5D2	15
NSW J5D3 Chimneys and flues	15
NSW J5D4 Roof lights	15
NSW J5D5 Windows and doors	15
NSW J5D6 Exhaust fans	16
NSW J5D7 Construction of ceilings, walls and floors	16
NSW J5D8 Evaporative coolers	17
Part J6 Air Conditioning and Ventilation	17
Part J7 Artificial lighting and power	17
NSW J7D3(2) Artificial lighting	17
NSW J7D4(4) Interior artificial lighting and power control	17
NSW J7D7 Boiling water and chilled water storage units	18
NSW J7D8 Lifts	18
NSW J7D9 Escalators and moving walkways	18
NSW J8D2 Heated Water Supply	18
NSW J8D3 Swimming pool heating and pumping	18
NSW J8D4 Spa pool heating and pumping	18
Part J9 Energy monitoring and on-site distributed energy resources	18
NSW J9D3 Facilities for energy monitoring	18
NSW J9D4 Facilities for electric vehicle charging equipment	19
NSW J9D5 Facilities for solar photovoltaic and battery systems	20

Part H6 Energy Efficiency – NCC 2022, Volume Two	20
BASIX COMMITMENTS – CLASS 1 UNITS	20
Disclaimer	21

1. Compliance Summary

Below is a summary of actions required to comply with the Deemed-To-Satisfy (DTS) provisions of Part J2 of NCC 2022 for the proposed Communal Building at 7 Rex Street, Goulburn as defined in NSW J4D2; the Caretaker residence as defined in NSW NCC 2022 Part J3; and NCC 2022 Volume 2, NSW Part H6 Energy Efficiency:

<u>Metal Frame</u>	<u>Not assumed for this development</u>
<u>BASIX</u> (Class 1 and Class 4-part)	<p><u>WATER</u></p> <ul style="list-style-type: none"> Dwelling fixtures: Showerheads – 4 star (>4.5 L/min and <7.5L/min); Toilets 4 star; Kitchen/Bathroom Taps 4 Star <p><u>THERMAL COMFORT</u></p> <ul style="list-style-type: none"> Glazing: Maximum U-Value 4.8 SHGC 0.48 - 0.54 (awning); Maximum U-Value 4.8 SHGC 0.56 - 0.62 (sliding, fixed) Insulation: Minimum R5 insulation to be installed to ceiling with R1.3 blanket; Minimum R2.5 insulation to be installed to external walls; Minimum R2 insulation to be installed to internal walls facing unconditioned zones (wc, ldry, bath) Lighting: Any downlights to be LED, IC-F compliant so as to allow full coverage of insulation. Ventilation: All exhaust fans to be sealed. Colour: Medium (SA 0.5) External walls, Roof and Windows <p><u>ENERGY</u></p> <ul style="list-style-type: none"> Hot water: 5-star gas instantaneous hot water system Ventilation: Bathroom, kitchen, laundry have individual exhaust fan ducted to roof/facade with manual switch on/off Heating/Cooling: 1 Phase/≥3.5 star (new rating) individual system in Living Lighting: LED, IC-F Compliant throughout Cooktop/oven: Electric cooktop & electric oven Fridge: Ventilated fridge space Clothes drying: Indoor clothes drying line
<u>NSW J4D3</u> (Class 5 and Class 4 part)	All reflective and bulk insulation must be installed in accordance NSW J4D3 Thermal Construction.
<u>NSW J4D4</u> (Class 5)	<ul style="list-style-type: none"> Add minimum R3.5 insulation to roof in accordance with NSW J4D4. Roof colour solar absorptance of upper surface of roof must be not more than SA0.45 (medium)
<u>NSW J4D6</u> (Class 5)	<ul style="list-style-type: none"> Refer to Attachment C.1 and Attachment C.2 which shows glazing for this development achieves U2.0 with Maximum U-value 4.8; SHGC 0.3 – 0.6 (and walls SA 0.5) as calculated in accordance with NSW J4D6 using Method 1 (SHGC 0.3) or Method 2 (SHGC 0.65) (Multiple aspects) External walls will comply with R2.5 insulation plus sisalation
<u>NSW J4D7</u> (Class 5)	<ul style="list-style-type: none"> Concrete slab on ground achieves total R-Value required for NSW J4D7, unless there is an in-slab heating or cooling system. For areas with in-slab heating or cooling systems (other than where used solely in a bathroom, amenity or the like) the R-Value of the floor needs to achieve 3.25 including R1.0 to vertical edge of slab perimeter.
<u>NSW J5D5</u> (Class 5)	Entrance doors must have a self-closing door and seal to restrict air infiltration in accordance with J5D5.

NSW J5D6 (Class 5)	Exhaust fans serving a conditioned space or habitable room must be fitted with a sealing device such as a self-closing damper
NSW J5D7 (Class 5 & Class 4 part)	Construction of ceilings, walls and floors must be constructed to minimise air leakage in accordance with NSW J5D7.
Part J6 (Class 5 & Class 4 part)	The air conditioning supplier must certify that the installation complies with Part J6 Air-conditioning and ventilation of NCC 2022 at Attachment E .
NSW J7D3(2) (Class 5)	The lighting supplier must certify that artificial lighting complies with NSW J7D3(2) of NCC 2022 at Attachment D
NSW J7D4(4) (Class 5)	The lighting supplier must certify that artificial lighting and power control complies with NSW J7D3 and Specification 40 at Attachment D .
NSW J7D7 (Class 5)	Boiling water and chilled water storage units must be fit with a time switch with manual override capability and efficiency measures as applicable and in accordance with NSW J7D7.
NSW J8D2 (Class 5 and Class 4 part)	A heated water supply system for food preparation and sanitary purposes must be designed and installed in accordance with Part B2 of NCC V3 – Plumbing Code of Australia.
NSW J9D3 (Class 5 and Class 4 part)	Install energy meters configured to record the time-of-use consumption of electricity (and gas if applicable) with development more than 500m2.
NSW J9D4	The development must have features that facilitate the future installation of electric vehicle charging equipment in accordance with NSW J9D4 including being sized to support the future installation of 7kW (32 A) type 2 electric vehicle chargers for 10% car spaces associated with Communal Building.
NSW J9D5 (Class 5)	At least 20% of Communal building roof area must be left clear for installation of solar PV system under the limitations of J9D5, J9D5(1)(a)(i) and (b).

2. Introduction

This report identifies and details the Deemed-to-Satisfy (DTS) provisions relevant to Part J2 Energy Efficiency of the NCC 2022 for the design of the proposed Communal Building at 7 Rex Street, Goulburn; the Caretaker residence as defined in NSW NCC 2022 Part J3; and NCC 2022 Volume 2, NSW Part H6 Energy Efficiency. The development is assessed under climate zone 7.

Documentation used in the development of this report are summarised in Table 1 below:

Table 1: Documentation used in Section J Report	
Description	Dwg No
Title	A-01
General Notes	A-02
Existing & Demolition Site Plan	A-03
Proposed Site Plan	A-04
Communal Building Floor Plan	A-14
Communal Building Elevations	A-15 & A-16
General Section	A-17
Typical Accessible Unit Floor Plan	A-05
Typical Unit Floor Plan	A-06
Typical Dual Key Unit Floor Plan	A-07
Accessible Unit Elevations	A-08 & A-09
Typical Unit Elevations	A-10 & A-11
Dual Key Unit Elevations	A-12 & A-13

Part J2 Energy Efficiency – Volume One

NSW J2D1(1)

Where a DTS Solution is proposed, Performance Requirements NSW J1P1 and NSW J1P4 is satisfied by complying with:

- a) [NSW J2D2](#); and
- b) NSW [J3D2 to J3D15](#); and
- c) NSW [J4D2](#) to J4D7; and
- d) NSW J5D2 to J5D8; and
- e) NSW J6D2 to J6D13; and
- f) NSW J7D2 to J7D9; and
- g) J8D2 to J8D4; and
- h) J9D2 to J9D5.

NSW J2D2

For a Class 5 building, Performance Requirements NSW J1P1 is satisfied by complying with

- a) for building fabric, Part J4; and
- b) for building sealing, Part J5; and
- c) for air conditioning and ventilation, Part J6; and
- d) for artificial lighting and power, Part J7; and
- d) for heating water supply, Part J7; and
- e) for facilities for monitoring, J9D3.

For a Class 4 part and Class 5 building, Performance Requirement J1P4 is satisfied by complying with J9D4 and J9D5.

For a Class 4 part of a building, Performance Requirement NSW J1P5, J1P6 and J1P7 is satisfied by complying with

- a) J3D5 and J3D6 for thermal breaks; and
- b) J4D3 for general thermal construction; and
- c) J3D10(3), J3D10(5) and J3D10(6) for floor edge insulation; and
- d) Part J5 for building sealing; and
- e) Part J6 for air conditioning and ventilation; and
- f) J8D2 for heated water supply; and
- g) J9D3 for facilities for energy monitoring.

Part J3: Class 4 part of building

J3D2

The Deemed-to-Satisfy Provisions of J3D2 apply to building elements forming the external building fabric and domestic services of a Class 4 part of a building.

J3D3, J3D4, J3D7, J3D8, J3D9, J3D11, J3D12, J3D13, J3D14 and J3D15 do not apply in NSW.

BASIX has been used to demonstrate compliance with thermal performance, water and energy requirements, combined under a multi-dwelling for the development as a whole. Refer to [Attachment F](#).

BASIX COMMITMENTS – CLASS 4 Unit

A pass was achieved for the Class 4 Unit under the following commitments:

WATER

- Dwelling fixtures: Showerheads – 4 star (>4.5 L/min and <7.5L/min); Toilets 4 star; Kitchen/Bathroom Taps 4 Star

THERMAL COMFORT

- Glazing: Maximum U-Value 4.8 SHGC 0.48 - 0.54 (awning); Maximum U-Value 4.8 SHGC 0.56 - 0.62 (sliding, fixed)
- Insulation: Minimum R5 insulation to be installed to ceiling with R1.3 blanket; Minimum R2.5 insulation to be installed to external walls; Minimum R2 insulation to be installed to internal walls facing unconditioned zones (wc, ldry, bath)
- Lighting: Any downlights to be LED, IC-F compliant so as to allow full coverage of insulation.
- Ventilation: All exhaust fans to be sealed.
- Colour: Medium (SA 0.5) External walls, Roof and Windows

ENERGY

- Hot water: 5-star gas instantaneous hot water system
- Ventilation: Bathroom, kitchen, laundry have individual exhaust fan ducted to roof/facade with manual switch on/off
- Heating/Cooling: 1 Phase/ ≥ 3.5 star (new rating) individual system in Living
- Lighting: LED, IC-F Compliant throughout
- Cooktop/oven: Electric cooktop & electric oven
- Fridge: Ventilated fridge space
- Clothes drying: Indoor clothes drying line

Refer to [Attachment A](#) and [A.7](#) for NatHERS and [Attachment F](#) for BASIX.

J3D5

- (1) A roof that—
- a. has metal sheet roofing directly fixed to metal purlins, metal rafters or metal battens; and
 - b. does not have a ceiling lining or has a ceiling lining fixed directly to those metal purlins, metal rafters or metal battens,
- must have a thermal break, consisting of a material with an R-Value of greater than or equal to R0.2, installed between the metal sheet roofing and its supporting metal purlins, metal rafters or metal battens.
- (2) The requirements of (1) do not apply to roofs constructed using insulated sandwich panels.

J3D6

- (1) A metal-framed wall that forms part of the building *envelope* must have a thermal break, consisting of a material with an *R-Value* of not less than R0.2, installed at all points of contact between the external cladding and the metal frame if the wall—
- a. does not have a wall lining or has a wall lining that is fixed directly to the same metal frame; and

- b. is clad with weatherboards, fibre-cement or the like, or metal sheeting fixed to a metal frame.
- (2) The requirements of (1) do not apply to walls constructed using insulated sandwich panels.

J3D10(3)(5)(6)

- (1) Does not apply in NSW.
- (2) Does not apply in NSW.
- (3) A concrete slab-on-ground with an in-slab or in-screed heating or cooling system must have insulation with an R-Value at least 1.0 installed around the vertical edge of its perimeter.
- (4) Does not apply in NSW.
- (5) Insulation required by (3) must be water resistant and be continuous from the adjacent finished ground level to a depth of not less than 300mm or for at least the full depth of the vertical edge of the concrete slab-on-ground
- (6) The requirements of (3) do not apply to an in-screed heating or cooling system used solely in a bathroom, amenity or the like.

Refer to J4D3, J5, J6, J8D2 and J9D3 of this document as defined for Class 5 which are also applicable to the Class 4 part of the development.


- a) Part J5 for building sealing; and
- b) Part J6 for air conditioning and ventilation; and
- c) J8D2 for heated water supply; and
- d) J9D3 for facilities for energy monitoring.

Part J4 Building Fabric

NSW J4D2

The DTS Provisions have been applied to the building envelope (including roofs, ceilings, roof lights, walls, glazing and floors), highlighted in Figure 1¹:

Figure 1: Envelop

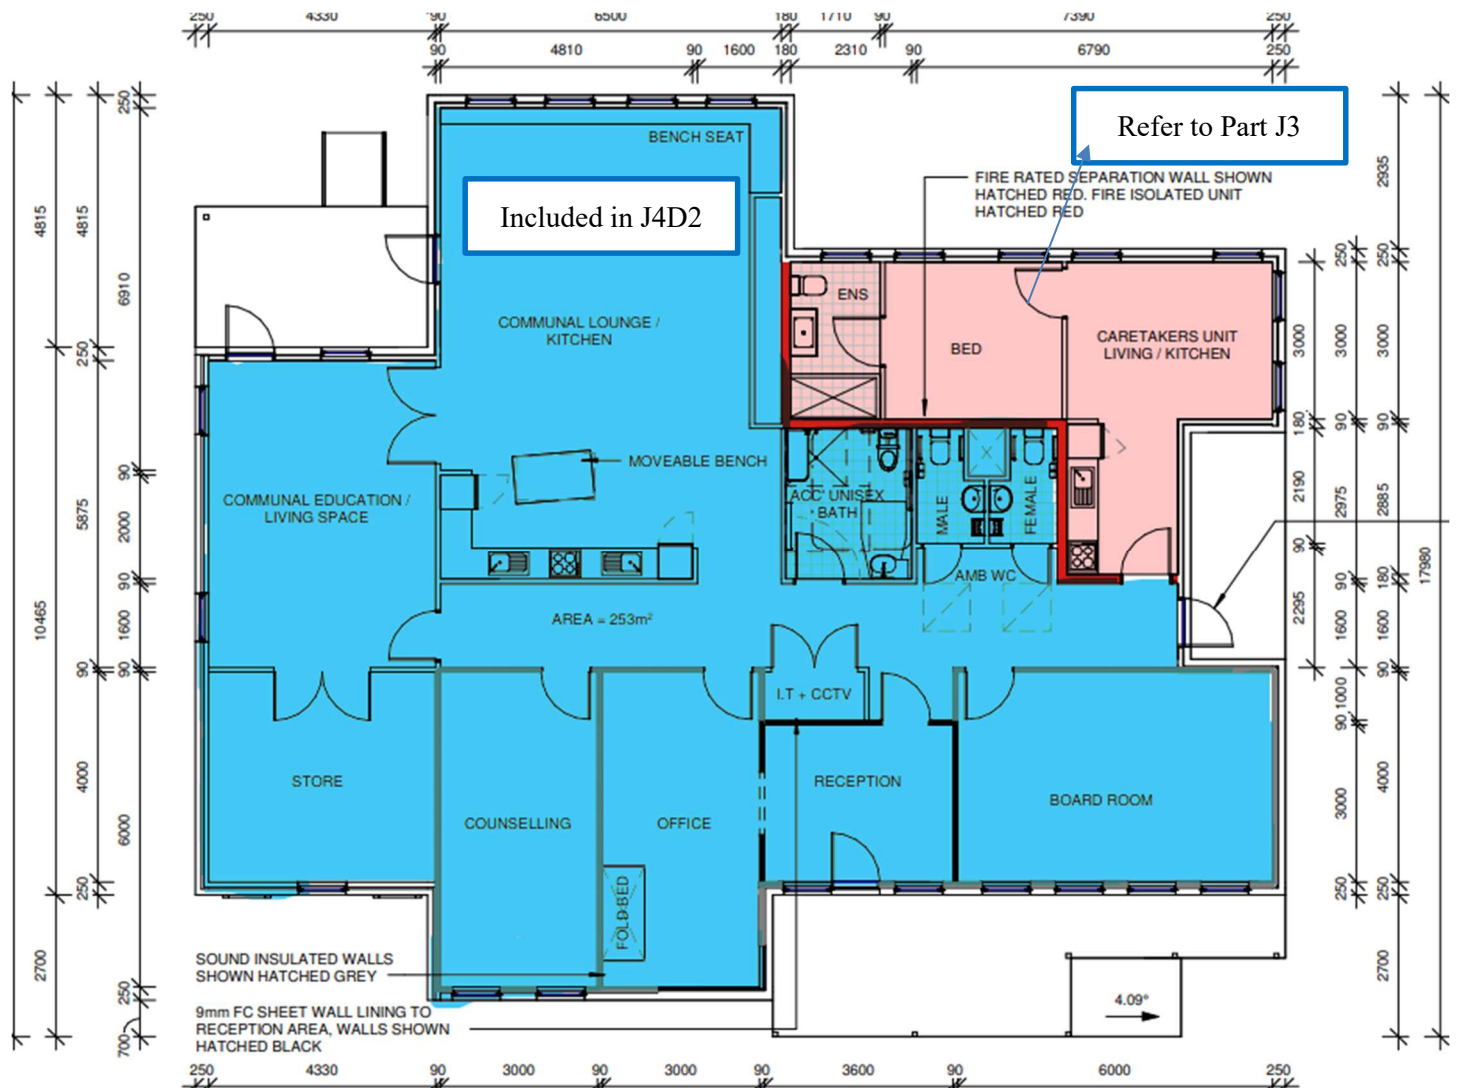


¹ For the purposes of Section J, envelop is defined as the part(s) of a building's fabric that separate a conditioned space or habitable room from i) the exterior of the building; or ii) a non-conditioned space including: 1. The floor of a rooftop plant room, lift-machine room or the like; and 2. The floor above a carpark or warehouse; and 3. The common wall with a carpark, warehouse or the like.

NSW J4D3 Thermal Construction - general

- 1) Where required, insulation must comply with AS/NZS 4859.1 and be installed so that it:
 - a) abuts or overlaps adjoining insulation other than at supporting members such as studs, noggings, joists, furring channels and the like where the insulation must be against the member; and
 - b) forms a continuous barrier with ceilings, walls, bulkheads, floors or the like that inherently contribute to the thermal barrier; and
 - c) does not affect the safe or effective operation of a service or fitting.
- 2) Where required, reflective insulation must be installed with:
 - a) the necessary airspace to achieve the required R-Value between a reflective side of the reflective insulation and a building lining or cladding; and
 - b) the reflective insulation closely fitted against any penetration, door or window opening; and
 - c) the reflective insulation adequately supported by framing members; and
 - d) each adjoining sheet of roll membrane being
 - i. overlapped not less than 50 mm; or
 - ii. taped together.
- 3) Where required, bulk insulation must be installed so that:
 - a) it maintains its position and thickness, other than where it is compressed between cladding and supporting members, water pipes, electrical cabling or the like; and
 - b) in a ceiling, where there is no bulk insulation or reflective insulation in the wall beneath, it overlaps the wall by not less than 50mm.
- 4) Roof, ceiling, wall and floor materials, and associated surface are deemed to have the thermal properties listed in Specification 36.
- 5) The required Total R-Value and Total System U-Value, including allowance for thermal bridging, must be
 - a) Calculated in accordance with AS/NZS 4859.2 for a roof or floor; or
 - b) Determined in accordance with Specification 37 for wall-glazing construction; or
 - c) Determined in accordance with Specification 39 or Section 3.5 of CIBSE Guide A for soil or sub-floor spaces.

NSW J4D4 Roof and ceiling construction

- 1) A roof or ceiling must achieve a Total R-Value greater than or equal to R3.7 for an upward direction of heat flow in climate zone 7.
- 2) In climate zone 7, the solar absorptance of the upper surface of a roof must be not more than 0.45.

Table 1 Communal Building Roof				
	Total R-Value required	R-Value of construction		R-Value of insulation required
Roof/Ceiling	3.7 Upward direction of heat flow	Outdoor air film	0.03	~3.5 ceiling insulation
		Metal Cladding	0.00	
		Plasterboard 10mm	0.06	
		Indoor air film	0.11	
		Total A	0.20	

- Add minimum R3.5 insulation to roof in accordance with NSW J4D4.
- Roof colour solar absorptance of upper surface of roof must be not more than SA0.45 (medium)

NSW J4D5 Roof Lights

Not applicable to this development.

NSW J4D6 Walls and glazing

- 1) The Total System U-Value of wall-glazing construction, including wall-glazing construction which wholly or partly forms the envelope internally, must not be greater than U2.0 for a Class 5, 6, 7, 8 or 9b building or a Class 9a building other than a ward area
- 2) The Total System U-Value of display glazing² must not be greater than U5.8
- 3) The Total System U-Value of wall-glazing construction must be calculated in accordance with Specification 37.
- 4) Wall components of a wall-glazing construction must achieve a minimum Total R-Value of
 - a) R1.0 where a wall is <80% of the area of the wall-glazing construction; or
 - b) R1.4 as per NSW Table J4D6a for Class 5/6 building in Climate Zone 7 with >80% wall area

NSW Table NSW J4D6a: Minimum wall Total R-Value - Wall area 80% or more of wall-glazing construction area

Climate zone	Class 5, 6, 7, 8 or 9b building or a Class 9a building other than a ward area	Class 3 or 9c building or Class 9a ward area
1	2.4	3.3
2	1.4	1.4
3	1.4	3.3
4	1.4	2.8
5	1.4	1.4
6	1.4	2.8
7	1.4	2.8
8	1.4	3.8

- Refer to [Attachment C.1](#) and [Attachment C.2](#) which shows glazing for this development achieves U2.0 with Maximum U-value 4.8; SHGC 0.3 – 0.6 (and walls SA 0.5) as calculated in accordance with NSW J4D6 using Method 1 (SHGC 0.3) or Method 2 (SHGC 0.65) (Multiple aspects)
- External walls will comply with R2.5 insulation plus sisalation

² Glazing used to display retail goods in a shop or showroom directly adjacent to a walkway or footpath, but not including that used in a café or restaurant.

Table 3	Total R-Value required	R-Value of construction ²		R-Value of insulation required
External Wall	1.4	Outdoor air film	0.03	~1.5 with R2.5 modelled/compliant
		Brickwork 110mm	0.18	
		Plasterboard	0.06	
		Indoor air film	0.12	
		Total	0.39	
External Wall	1.4	Outdoor air film	0.03	
		Weatherboard 12mm	0.12	
		Plasterboard	0.06	
		Indoor air film	0.12	
		Total	0.33	

The solar admittance of externally facing wall-glazing construction, excluding wall- glazing construction which is wholly internal, must not be greater than the value specified in NSW Table J4D6b for Class 5/6 building.

NSW Table J4D6b: Maximum wall-glazing construction solar admittance - Class 5, 6, 7, 8 or 9b building or Class 9a building other than a ward area

Climate zone	Eastern aspect solar admittance	Northern aspect solar admittance	Southern aspect solar admittance	Western aspect solar admittance
1	0.12	0.12	0.12	0.12
2	0.13	0.13	0.13	0.13
3	0.16	0.16	0.16	0.16
4	0.13	0.13	0.13	0.13
5	0.13	0.13	0.13	0.13
6	0.13	0.13	0.13	0.13
7	0.13	0.13	0.13	0.13
8	0.2	0.2	0.42	0.36

NSW J4D7 Floors

- 1) A floor must achieve the Total R-Value of 2.0 for Climate Zone 7 in accordance with Table J4D7, providing no in-slab or in-screed heating or cooling system.
- 2) For the purpose of (1), a slab on-ground that does not have an in-slab heating or cooling system is considered to achieve a Total R-Value of R2.0 for Class 5, 6, 7, 8.
- 3) If there is to be installed an in-slab or in-screed heating or cooling system (other than where used solely in a bathroom, amenity area or the like), the Total R-Value of the floor needs to achieve a Total R-Value of 3.25 including the vertical edge of the slab perimeter having an R-Value greater than or equal to 1.0.
- 4) Additionally, if an in-slab or in-screed heating or cooling system is used, the insulation must be water resistant and be continuous from the adjacent finished ground level to a depth not less than 300mm; or for the full depth of the vertical edge of the concrete slab-on-ground.

² As per NCC 2022 Specification 36 Material Properties
Section J

- Concrete slab on ground achieves total R-Value required for NSW J4D7, unless there is an in-slab heating or cooling system.
- For areas with in-slab heating or cooling systems (other than where used solely in a bathroom, amenity or the like) the R-Value of the floor needs to achieve 3.25 including R1.0 to vertical edge of slab perimeter.

Part J5 Building Sealing

NSW J5D2

The DTS provisions of this part apply to elements forming the envelop as defined in [J4D2 Table 1](#) other than where mechanical ventilation is a requirement by Part F6 providing sufficient pressurisation to prevent infiltration or parts of buildings cannot be fully enclosed.

NSW J5D3 Chimneys and flues

Not applicable to this development.

NSW J5D4 Roof lights

Not applicable to this development.

NSW J5D5 Windows and doors

- 1) A door, openable window or the like must be sealed when forming part of the envelop to restrict air infiltration in climate zone 7.
- 2) The requirements for 1) do not apply to
 - a. A window complying with AS 2047; or
 - b. A fire door or smoke door; or
 - c. A roller shutter door, roller shutter grill or other security door or device installed only for out-of-hours security
- 3) A seal to restrict air infiltration
 - a. For the bottom edge of a door, must be a draft protection device; and
 - b. For the other edges of a door or the edges of an openable window or other such opening, may be a foam or rubber compression strip, fibrous seal or the like.
- 4) An entrance to a building, if leading to a conditioned space must have an airlock, self-closing door, rapid roller door, revolving door or the like, other than
 - a. Where the conditioned space has a floor area of not more than 50m²; or
 - b. Where a café, restaurant, open front shop or the like has
 - i. A 3m deep un-conditioned zone between the main entrance, including an open front, and the conditioned space; and
 - ii. At all other entrances to the café, restaurant, open front shop or the like, self-closing doors.
- 5) A loading dock entrance, if leading to a conditioned space, must be fitted with a rapid roller door or the like.

- Entrance doors must have a self-closing door and seal to restrict air infiltration in accordance with J5D5.

NSW J5D6 Exhaust fans

An exhaust fan must be fitted with a sealing device such as a self-closing damper or the like when serving –

- a) A conditioned space; or
- b) A habitable room in climate zone 7

- Exhaust fans serving a conditioned space or habitable room must be fitted with a sealing device such as a self-closing damper in accordance with NSW J5D6.

NSW J5D7 Construction of ceilings, walls and floors

- 1) Ceilings, walls, floors and any opening such as a window frame, door frame, roof light frame or the like must be constructed to minimise air leaking in accordance with (2) When forming part of the envelope in climate zone 7.
- 2) Construction required by (1) must be –
 - a. Enclosed by internal lining systems that are close fitting at ceiling, wall and floor junctions; or
 - b. Sealed at junctions and penetrations with –

- i. Closed fitting architrave, skirting or cornice; or
 - ii. Expanding foam, rubber compressible strip; caulking or the like.
- 3) The requirements of (1) do not apply to openings, grilles or the like required for smoke hazard management.

- Construction of ceilings, walls and floors must comply with NSW J5D7.

NSW J5D8 Evaporative coolers

Not applicable to this development.

Part J6 Air Conditioning and Ventilation

the provisions for the efficiency and control of air-conditioning, space heating and ventilation equipment, the efficiency, sealing and insulation requirements for ductwork systems containing fans, and for the efficiency and insulation of pipework and pump systems are set out in Attachment E – Extract of NCC 2022 Part J6 Air-conditioning and ventilation.

- The air conditioning supplier must certify that the installation complies with Part J6 Air-conditioning and ventilation of NCC 2022 at Attachment E.

Part J7 Artificial lighting and power

NSW J7D3(2) Artificial lighting

The aggregate design illumination power load in a Class 3 or Class 5 to 9 building must not exceed the allowances as defined by NSW J7D3(2) and Table J7D3a as defined in Attachment D.

- The lighting supplier must certify that artificial lighting complies with NSW J7D3(2) of NCC 2022 at Attachment D.

NSW J7D4(4) Interior artificial lighting and power control

95% of the light fittings in a building, other than a Class 3 building of more than 250m² must be controlled by

- a) A time switch in accordance with Attachment D Specification 40; or
- b) An occupant sensing device such as
 - i. A security key card reader that registers a person entering and leaving a building; or
 - ii. A motion detector in accordance with Attachment D Specification 40.

- The lighting supplier must certify that artificial lighting and power control complies with NSW J7D3 and Specification 40 at Attachment D.

NSW J7D7 Boiling water and chilled water storage units

Boiling water and chilled water storage units must be fit with a time switch capable of switching on and off electric power at variable pre-programmed times and on variable pre-programmed days and in accordance with NSW J7D7.

A time switch for boiling water or chilled water storage units must be capable of being overridden by a manual switch or a security access system that senses a person's presence, overrides for a period of up to 2 hours, after which if there is no further presence detected, the time switch must resume control.

- Boiling water and chilled water storage units must be fit with a time switch with manual override capability and efficiency measures as applicable and in accordance with NSW J7D7.

NSW J7D8 Lifts

Not included in this report. Refer to BASIX certificate for energy provisions for lifts.

NSW J7D9 Escalators and moving walkways

Not applicable to this development.

NSW J8D2 Heated Water Supply

A heated water supply system for food preparation and sanitary purposes must be designed and installed in accordance with Part B2 of NCC V3 – Plumbing Code of Australia.

NSW J8D3 Swimming pool heating and pumping

Not applicable to this development.

NSW J8D4 Spa pool heating and pumping

Not applicable to this development.

Part J9 Energy monitoring and on-site distributed energy resources

NSW J9D3 Facilities for energy monitoring

- 1) The floor area of the development is more than 500m² and must have energy meters configured to record the time-of-use consumption of electricity [and gas if applicable].
- 2) This development is <2,500 m², so there is no requirement for the facility to record individual time-of-use energy data recording for systems noted in NCC 2022 J9D3 (2).

- Install energy meters configured to record the time-of-use consumption of electricity (and gas if applicable) with development more than 500m².

NSW J9D4 Facilities for electric vehicle charging equipment

A building must have features that facilitate the future installation of electric vehicle charging equipment as per J1P4.

- 1) Subject to (2), a carpark associated with a Class 2, 3, 5, 6, 7b, 8 or 9 building must be provided with electrical distribution boards dedicated to electric vehicle charging –
 - a. In accordance with Table J9D4 in each storey of the carpark; and
 - b. Labelled to indicate use for electric vehicle charging equipment.

Table J9D4: Electric vehicle distribution board requirement for each storey of a carpark

Carpark spaces per storey for electric vehicles	Electrical distribution boards for electric vehicle charging per storey
0 - 9	0
10 - 24	1
25 - 48	2
49 - 72	3
73 - 96	4
97 - 120	5
121 - 144	6
145 - 168	7

Table Notes

Where there are more than 168 *carpark* spaces per *storey*, one additional distribution board must be provided for each additional 24 spaces or part thereof.

- 2) Electrical distribution boards dedicated to serving electrical vehicle charging in a carpark must –
 - a. Be fitted with a charging control system with the ability to manage and schedule charging of electric vehicles in response to total building demand; and
 - b. When associated with a Class 2 building, have capacity for each circuit to support an electric vehicle charger able to deliver a minimum of 12 kWh from 11:00pm to 7:00am daily; and
 - c. When associated with a Class 5 to 9 building, have capacity for each circuit to support an electric vehicle charger able to deliver a minimum of 12 kWh from 11:00pm to 7:00 am daily; and
 - d. When associated with a Class 3 building, have capacity for each circuit to support an electric vehicle charger able to deliver a minimum of 48 kWh from 11:00pm to 7:00 am daily; and
 - e. Be sized to support the future installation of a 7kW (32 A) type 2 electric vehicle charger in
 - i. 100% of the car parking spaces associated with a Class 2 building; or
 - ii. 10% of car parking spaces associated with a Class 5 or 6 building; or
 - iii. 20% of car parking spaces associated with a Class 3, 7b, 8 or 9 building; and
 - f. Contain space of at least 36mm width of DIN rail per outgoing circuit for individual sub-circuit electricity metering to record electricity use of electrical vehicle charging equipment; and
 - g. Be labelled to indicate the use of the space required by (f) is for the future installation of metering equipment.

- The development must have features that facilitate the future installation of electric vehicle charging equipment in accordance with NSW J9D4 including being sized to support the future installation of 7kW (32 A) type 2 electric vehicle chargers for 10% car spaces associated with Communal Building.

NSW J9D5 Facilities for solar photovoltaic and battery systems

A building must have features that facilitate the future installation of on-site renewable energy generation and storage as per J1P4.

- 1) The main electrical switchboard of a building must
 - a. Contain at least two empty three-phase circuit breaker slots and four DIN rail spaces labelled to indicate the use of each space for
 - i. A solar photovoltaic system; and
 - ii. A battery system; and
 - b. Be sized to accommodate the installation of solar photovoltaic panels producing their maximum electrical output on at least 20% of the building roof area.
- 2) At least 20% of the roof area of a building must be left clear for the installation of solar photovoltaic panels, except for buildings
 - a. With installed solar photovoltaic panels on
 - i. At least 20% of the roof area; or
 - ii. An equivalent generation capacity elsewhere on-site; or
 - b. Where 100% of the roof area is shaded for more than 70% of daylight hours; or
 - c. With a roof area of not more than 55m²; or
 - d. Where more than 50% of the roof area is used as a terrace, carpark, roof garden, roof light or the like.

Limitations

- 1) The requirements of J9D5(1)(a)(i) and (b) do not apply to a building with solar photovoltaic panels installed on at least 20% of the roof area.
- 2) The requirements of J9D5(1)(a)(ii) and (b) do not apply to a building with battery systems installed.

- At least 20% of Communal building roof area must be left clear for installation of solar PV system under the limitations of J9D5, J9D5(1)(a)(i) and (b).

Part H6 Energy Efficiency – NCC 2022, Volume Two

In NSW, Class 1 buildings are subject to BASIX. BASIX has been used to demonstrate compliance with thermal performance, water and energy requirements, combined under a multi-dwelling for the development as a whole. Refer to [Attachment F](#).

BASIX COMMITMENTS – CLASS 1 UNITS

A pass was achieved for the Class 1 Units under the following commitments:

WATER

- Dwelling fixtures: Showerheads – 4 star (>4.5 L/min and <7.5L/min); Toilets 4 star; Kitchen/Bathroom Taps 4 Star

THERMAL COMFORT

- Glazing: Maximum U-Value 4.8 SHGC 0.48 - 0.54 (awning); Maximum U-Value 4.8 SHGC 0.56 - 0.62 (sliding, fixed)
- Insulation: Minimum R1.0 under slab insulation to Units 1 and 2; Minimum R5 insulation to be installed to ceiling with R1.3 blanket; Minimum R2.5 insulation to be installed to external

walls; Minimum R2 insulation to be installed to internal walls facing unconditioned zones (wc, ldry, bath)

- Lighting: Any downlights to be LED, IC-F compliant so as to allow full coverage of insulation.
- Ventilation: All exhaust fans to be sealed.
- Colour: Medium (SA 0.5) External walls, Roof and Windows

ENERGY

- Hot water: 5-star gas instantaneous hot water system
- Ventilation: Bathroom, kitchen, laundry have individual exhaust fan ducted to roof/facade with manual switch on/off
- Heating/Cooling: 1 Phase/ ≥ 3.5 star (new rating) individual system in Living
- Lighting: LED, IC-F Compliant throughout
- Cooktop/oven: Electric cooktop & electric oven
- Fridge: Ventilated fridge space
- Clothes drying: Indoor clothes drying line

Refer to Attachment A and A.1 to Attachment A.6 for NatHERS and Attachment F for BASIX.

Disclaimer

Although great care has been taken to prepare this report (“the Report”), ACT Sustainable Systems do not make any representations or give any warranties or assurances as to the accuracy or completeness of the information contained in the Report or that the Report is free from errors or omission. The Report has been prepared based on the information supplied. All conditions and warranties (express or implied) whether arising by statute or otherwise are expressly negated and excluded to the extent permitted by Law.

ACT Sustainable Systems and their employees and agents shall not be liable for any loss, damage, cost or expense whether direct, indirect or consequential, incurred by, or arising by reason of, any person using or relying on the Report and whether caused by reason or error, negligent act, omission or misrepresentation in the Report or otherwise.

Attachments

Attachment A, A.1 to A.7 – NatHERS Certificates

Attachment B – BASIX Certificate

Attachment C.1 to C.2 - Glazing façade calculators

Attachment D - Lighting

Attachment E – Heating and Air-Conditioning

<End Report>