



STORMWATER

CIVIL

FLOODING

STRUCTURAL

REMEDIAL

20250298



REVISION 01

PROPOSED STORMWATER DRAINAGE PLANS

Proposed Secondary Dwelling Development
42 Woodbine Street Yagoona 2199

Reference
20250298-S4.55-SW-DWG-01

Client
Dvŷne Design


































Architect
Dvŷne Design



Drawing Register		
Number	Name	Revision
S100	Cover Sheet	01
S101	Specifications Sheet	01
S200	Ground Floor Plan	01
S202	Roof Plan	01
S300	Details Sheet	01
S400	Erosion and Sediment Control. Plan	01

General Notes	
1.	All work shall be carried out in accordance with council's requirements, building code of Australia, NSW code of practice and the to the relevant service codes.
2.	These drawings shall be read in conjunction with all architectural and other consultants' drawings and specifications and with such other written instructions as may be issued during the course of the contract. All discrepancies shall be referred to the superintendent for decision before proceeding with the work.
3.	All dimensions shown on the drawings are in millimeters (u.n.o.). Dimensions shall not be obtained by scaling of these drawings. Use figured dimensions only.
4.	Benchmarks have been established where indicated on the drawings. All Levels are to Australian height datum A.H.D.). The contractor shall undertake all necessary survey work to ensure that the works are constructed to design line and level.
5.	Setting out dimensions and levels shown on the drawings shall be verified by the contractor.
6.	All materials shall be in accordance with the requirements of the relevant codes and the by-laws and ordinances of the relevant building authorities.
7.	It is the contractor's responsibility to provide all safety fences, warning signs, traffic diversions and the like during construction. All works to comply with work health and safety requirements and other relevant authority safety requirements.
8.	No trees shall be removed, cutback or relocated without the written instruction from the superintendent.
9.	Where new works abut existing the contractor shall ensure that a smooth even profile, free from abrupt changes is obtained.
10.	All works shall be carried out in accordance with the details shown on the drawings and these specifications.
11.	Design Levels given are to finished surface level and inclusive of topsoil. (topsoil depth varies)
12.	The contractor shall arrange all survey set out to be carried out by a registered surveyor.
13.	Care is to be taken when excavating near existing services. No mechanical excavations are to be undertaken over telecommunications or electrical services. Hand excavate in these areas.
14.	The locations of underground services shown on the drawing have been plotted from diagrams provided by service authorities. This information has been prepared solely for the authorities own use and may not necessarily be updated or accurate.
15.	The position of services as recorded by the authority at the time of installation may not reflect changes in the physical environment after installation.
16.	Deboke Engineering Consultants do not guarantee that the services information shown on the drawing shows more than the presence or absence of services, and will accept no liability for inaccuracies in the services information shown from any cause whatsoever.
17.	It is the contractor's responsibility to obtain from the utility services authorities a current copy of underground services search for the location of all existing services prior to commencement of any work and notify any conflict with the drawings immediately. Clearance shall be obtained from the relevant regulatory authority. Contractor to keep copy of underground services search on site at all times. Any damages to services or services adjustments shall be carried out by the contractor or relevant authority at the contractor's expense.
18.	Visit the site before submitting the final tender price to assess 'on site' conditions. Failure to do so will forfeit any claim for not being aware of conditions affecting the tender.
19.	The contractor shall prepare accurate work-as-executed drawings following the completion of all works.
20.	It is the contractor's responsibility to have in place & maintain traffic facilities at all times during construction.
21.	Contractor to provide workshop coordinated drawings prior to commencing works on site. Workshop drawings to be reviewed and approved by design engineer.

Stormwater Notes	
1. Contractor must verify all dimensions & existing levels, services & structures on site prior to commencement of work.	Under roadway Trench fill material shall consist of imported fill as specified herein of either high grade compaction sand or approved crushed road gravel conforming to TfNSW QA specification 3051 or similar.
2. Plans to be read in conjunction with approved Architectural, Landscape, Structural, Hydraulic, & other services drawings & specifications. If any discrepancies exist between the drawings, the builder shall report the discrepancies to the engineer prior to commencement of any works.	Other than roadway Trench material excavated shall consist of select fill as specified herein and shall not contain more than 20% of stones of size between 25mm and 75mm and none larger than 75mm. Prior to use of the excavated material it shall be inspected and approved by the engineer.
3. Where subsoil drainage lines pass under floor slabs & vehicular pavements, slotted uPVC sewer grade pipe shall be used.	38. Compact bedding, Embedment and trench fill materials as follow:- Embedment:- For granular fill material (non-cohesive soil) e.g. Coarse aggregate fill, the density index (id) shall be not less than 70%. Trench fill:- For granular material (non cohesive soils). The density index (id) shall be not less than 70%. For non-granular fill material (cohesive soils), the dry density ratio (rd) shall be not less than 95%.
4. Charged lines to be sewer grade & sealed.	39. Existing services Utility information shown on the plans is not intended to depict more than the presence of any services. Actual locations should be verified by hand excavation prior to construction.
5. All pipes to have min 150mm cover if located within property.	40. The contractor shall allow for the capping off, excavation and removal (if required) of all existing services in areas affected by the works.
6. All pits in driveways to be concrete & all pits in landscaped areas may be plastic.	41. The contractor shall ensure that services to all buildings not affected by the works are not disrupted at all times. The contractor shall construct temporary services to maintain existing supply to buildings remaining where required. Once the works are complete and commissioned the contractor shall remove all such temporary services and make good all disturbed areas.
7. Pits less than 600mm deep may be brick, precast or concrete.	42. Existing pipes which form no part of the drainage system shall be removed or sealed as indicated on the plans.
8. All balconies & roofs to be drained & to have safety overflows in accordance with relevant Australian standards.	43. Where downpipes pass under floor slabs, sewer grade uPVC with rubber ring joints are to be used.
9. All grates to have child proof locks.	44. Minimum grade to drainage pipes to be 1% (U.N.O.), min. Size 100mm diameter (U.N.O.).
10. All drainage works to avoid tree roots.	45. Pipe installation under trafficable areas shall be in accordance with concrete pipe association of Australia publication "concrete pipe selection & installation" type HS3 support.
11. Council's issued footway design levels to be incorporated into the finished levels once issued by council.	46. Equivalent strength FRC pipes may be used subject to authority approval.
12. All works shall be in accordance with NCC BCA 2019 & A.S.3500.3.	47. Minimum pipe cover to be 600mm under trafficable areas and 300mm elsewhere (U.N.O.).
13. Care to be taken around existing sewer. Structural advice required for sewer protection against additional loading from new pits, pipes, retaining walls & OSD basin water levels.	48. Contractor to supply and install all fittings and specials including various pipe adaptors to ensure proper connection between dissimilar pipework.
14. All Ø300 drainage pipes & larger shall be class 2 approved spigot & socket RCP pipes with rubber ring joints (U.N.O.). All drainage pipes up to & including Ø225 shall be sewer grade uPVC with solvent weld joints (U.N.O.).	49. Provide cleaning eyes to all downpipes not directly connected to pits.
15. All pipe junctions, bends & tapers up to & including Ø450 shall be via purpose made fittings.	50. Stormwater drainage connections to council's system shall be to the requirements and the satisfaction of the local council.
16. Contractor to supply & install all fittings including various pipe adaptors to ensure proper connection between dissimilar pipe work.	51. Drainage pits Pits deeper than 1200mm to be fitted with step irons at 300 centres to AS1657-2013 'fixed platforms, walkways, stairways and ladders - design, construction and installation'.
17. All connections to existing drainage pits shall be made in accordance with the NCC BCA 2019 and relevant Australian Standards. The internal wall of the pit at the point of entry shall be cement rendered to ensure a smooth finish.	52. All exposed edges to be rounded with 20mm radius, or chamfered 20mm x 20mm.
19. Where stormwater lines pass under floor slabs, sewer grade rubber ring joints are to be used.	53. Pit reinforcement - mesh SL82 Lap to be 400mm min. Clear cover 40 mm. Cast against blinding or formwork. Corner returns may be fabric or equivalent bars.
20. All pipes in covered balconies to be Ø65 uPVC cast in concrete slab.	54. Benching to be half outgoing pipe depth. Concrete for benching to be 20mpa mass concrete.
21. Ø65 PVC @ min 1.0% Ø90 PVC @ min 1.0% Ø100 PVC @ min 1.0% Ø150 PVC @ min 1.0% Ø225 PVC @ min 0.5% Ø300 PVC @ min 0.4% Unless Noted Otherwise	55. Approved precast pits may be used.
22. Contractor to provide a break / open void in rail / balustrade for stormwater emergency overflow.	56. 100mm diameter hole for subsoil drainage outlet to be located 100mm above invert of all inlet pipes. Subsoil drainage to extend for a distance of 3m upstream of pit (at each inlet trench) with the upstream end sealed.
23. All enclosed areas/planter boxes be fitted with floor wastes.	57. Pit grate, frames and solid covers shall be Class B in non traffic areas and Class D in trafficable areas in accordance with AS3946.
24. Downpipes to be checked by architect & plumber prior to construction.	58. Maximum front entry pipe:- a. Straight entry - Ø750 b. Skew entry 45° - Ø525
25. Provide 3.0m length of Ø100 subsoil drainage pipe wrapped in fabric sock, at upstream end of each pit.	59. Subsoil drainage Subsoil pipes shall be laid at a min grade of 0.5% (U.N.O.).
26. All the cleaning eyes (or inspection eyes) for the underground pipes must be taken up to the finished ground level for easy identification & maintenance purposes.	60. Additional subsoil drainage shall be laid to suit site conditions and groundwater presence as directed.
27. All sub-soil drainage shall be provided with a filter sock. The subsoil drainage shall be installed in accordance with details to be provided by the landscape architect.	61. Subsoil pipes shall be laid behind kerbs in cut areas of the site.
28. Prior to commencing any works, the builder shall ensure that the invert levels of where the site stormwater system connects into the council's kerb/drainage system matched the design levels. Any discrepancies shall be reported to the design engineer immediately.	62. Grates to pits in footpath areas shall be heel safe complying with the disabled access code.
29. For stormwater drainage pipes that exceed 1:5 grade, reinforced concrete anchor blocks shall be installed. Anchor blocks to be constructed to specifications set out in AS3500.3-2003 section 8.10	63. Contractor to provide workshop coordinated drawings prior to commencing works on site. Workshop drawings to be reviewed and approved by design engineer.
30. Existing services shown in approximate locations only. Confirm exact locations and depths on site prior to commencing work.	64. All external area to have a minimum 1% fall to outlets provided.
31. Coordinate the installation of new services with all new & existing services & structural provisions as determined on site.	65. Provide overflows to all areas to architect's specifications.
32. All pipework is to be tested in accordance with the requirements as set out in AS3500.3-2003. All in-ground pipework to be inspected by the superintendent under test conditions prior to backfilling. Backfilling and bedding to AS3500.3-2003.	66. All rainwater outlets to open areas shall be SPS TRUFLO type TIA100F unless noted otherwise. Do not install balcony outlets or similar in areas subject to direct rainfall.

Legend	
	RAINWATER TANK LINES
	STORMWATER LINE
	SUBSOIL LINE
	STORMWATER RISING MAIN
	HIGH LEVEL STORMWATER LINE
	OVERFLOW LINE
	EXISTING STORMWATER LINE
	AUTHORITY STORMWATER LINE
	AUTHORITY SEWER LINE
	AUTHORITY WATER LINE
	AUTHORITY GAS LINE
	AUTHORITY ELECTRICITY LINE
	AUTHORITY UNDERGROUND ELECTRICITY LINE
	AUTHORITY FIBRE OPTIC LINE
	AUTHORITY COMMS LINE
	FENCE LINE
	GRATED SURFACE INLET PIT
	JUNCTION PIT
	KERB INLET PIT
	EXISTING KERB INLET PIT
	EXISTING TELSTRA PIT
	EXISTING HYDRANT
	EXISTING STOP VALVE
	EXISTING POWER POLE
	EXISTING SEWER MANHOLE
	OVERLAND FLOW PATH
	RAINWATER OUTLET
	CLEAR OUT POINT
	CAPPING
	DOWNPIPE DROP
	DOWNPIPE
	SPOT LEVELS
	BENCHMARK

	Project No. 20250298-S4.55-SW-DWG-01	Drawing No. S101	Rev.	Description	Design	Date	 Architect	 Client	Project Proposed Secondary Dwelling Development Application Section 4.55 Address 42 Woodbine Street Yagoona 2199 LGA CANTERBURY-BANKSTOWN Council	Drawn	BA	Designed	ZZ	Discipline	Consultant	Reference	Revision	Date	 E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688 COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.
	Title Specifications Sheet	01	Issued For Section 4.55 (S4.55)	ZZ	23-06-2025	Reviewed				JD	Date	23-06-2025	Architect	Dvyne Design	----	A	19.06.2025		
	Scale									Approved	AA	Date	23-06-2025	Surveyor	Radon Associates Pty Ltd	----	A	30.10.2023	
										Andrew Arida B.E Civil/Structural MIEAust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455)				Geotechnical					

General Notes

SITE IS LOCATED IN CANTERBURY-BANKSTOWN COUNCIL.

SITE AREA = 452.3m²

SITE IS GOVERNED BY CANTERBURY-BANKSTOWN DEVELOPMENT CONTROL PLAN 2023.

OSD IS NOT REQUIRED IN ACCORDANCE WITH CANTERBURY-BANKSTOWN DCP 2023, SECTION 7.4 AS THE TOTAL IMPERVIOUS AREA IS LESS THAN 70% OF THE TOTAL SITE AREA

CONTRACTOR TO INSTALL ABOVE GROUND RAINWATER TANK TO COLLECT REQUIRED ROOF AREA IN ACCORDANCE WITH BASIX CERTIFICATE.

RAINWATER TANK TO BE EQUIPPED WITH FIRST FLUSH AND MOSQUITO PREVENTION DEVICES.

ALL DOWNPIPES SHOWN ON PLAN ARE Ø100mm uPVC U.N.O.

ALL NEW STORMWATER PIPES TO HAVE A MINIMUM OF 100mm CONCRETE OR 300mm TOPSOIL COVER U.N.O.

Key Notes

1. ALL EXISTING STORMWATER PIPES AND DOWNPIPES ARE TO BE RETAINED U.N.O (TYP). PLUMBER TO ASSESS CONDITION AND STATE OF REPAIR. ALLOW FOR REPLACEMENT IF REQUIRED.
2. CONTRACTOR TO ENSURE LOCATION OF NEW DWELLING DOES NOT ADVERSELY IMPACT EXISTING STORMWATER SYSTEM. IF SO, CONTRACTOR TO CONTACT STORMWATER ENGINEER PRIOR TO COMMENCING ANY WORKS.
3. CONTRACTOR PERMITTED TO CONNECT TO EXISTING STORMWATER SYSTEM IF FOUND TO BE IN GOOD CONDITION DURING CONSTRUCTION. STORMWATER ENGINEER TO BE CONTACTED PRIOR TO COMMENCING ANY WORKS WHICH VARY FROM THE APPROVED STORMWATER PLANS.
4. IF EXISTING STORMWATER SYSTEM IS CONNECTED TO SEWER, CONTRACTOR IS TO RECTIFY STORMWATER DESIGN AND CREATE A NEW CONNECTION AS PER COUNCIL SPECIFICATIONS AND AUSTRALIAN STANDARDS. CONTRACTOR TO CONTACT STORMWATER ENGINEER PRIOR TO COMMENCING ANY WORKS.


[illegible]

CATCHMENT PLAN

1:250


CATCHMENT CALCULATION		
TERRAIN	AREA (m ²)	PERCENTAGE (%)
IMPERVIOUS	291.778	47.586
PERVIOUS	321.382	52.414
TOTAL	613.16	100.000

The diagram is a site plan showing a building complex and its surrounding catchment area. The building is divided into several sections, each labeled with its function and area in square meters (m²). The sections are: LITTER BOX (174.1000), PUBLIC SEWER (117.6780), PUBLIC TOILET (10.0000), PUBLIC WASH (10.0000), PUBLIC TOILET (10.0000), PUBLIC WASH (10.0000), and PUBLIC SEWER (10.0000). The plan also shows a scale bar from 0m to 20m and a north arrow pointing towards the top right.

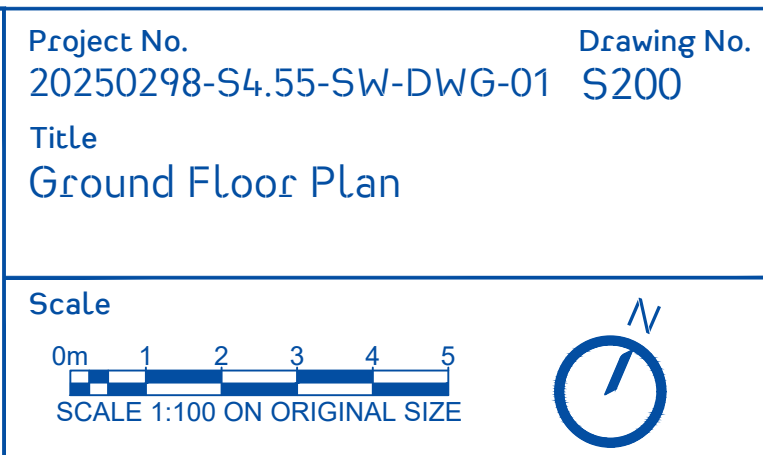[illegible]

Address
42 Woodbine Street Yagoona 2199

LGA
CANTERBURY-BANKSTOWN
Council

Drawn	BA	Designed	ZZ
Reviewed	JD	Date	23-06-2025
Approved	AA	Date	23-06-2025
Andrew Arida B.E Civil/Structural MIE(Aust. NO: 5579488) Professional Engineer (PRE00000268) Design Practitioner (DEP0000045)			

Discipline	Consultant	Reference	Revision	Date
Architect	Dwyne Design	----	A	19.06.2025
Surveyor	Radon Associates Pty Ltd	----	A	30.10.2023
Landscape				
Geotechnical				
Structural				
Hydraulic/Fire				
Mechanical				



Roof Notes

DOWNPIPES SHOWN ON PLAN ARE TO BE Ø100mm uPVC U.N.O. (TYP).

PROPOSED DOWNPIPE LOCATIONS ARE NOMINAL AND TO BE CONFIRMED DURING CONSTRUCTION (TYP).

LYSAGHT® gutter areas and downpipes.

Minimum standard downpipe sizes to suit gutters (gutter gradient ≥ 1:500)

	Slotted	Effective # cross section	Round (diameter)	Rectangular or square
	YES/NO	mm²	mm	mm
Quad Hi-Front	YES	5255	90	100x50
	NO	5809	90	100x50
Quad Lo-Front	NO	6165	90	100x50
	YES	7600	100	100x75
SHEERLINE®	NO	8370	§	100x75
	YES	6244	90	100x50
TRIMLINE®	NO	7800	100	100x75
	YES	4675	90	100x50
150 HaLf Round	NO	7042	100	100x75
	YES	4602	90	100x50
150 HaLf Round Flat Back	NO	7042	100	100x75
	NO	4300	75	100x50*
HaLf Round 100	NO	6300	90	100x50'
HaLf Round 125	NO	9200	§	100x75*
HaLf Round 150	NO	14500	§	§
HaLf Round 200	NO	24500	§	§
HaLf Round 250	NO	35300	§	§
HaLf Round 300	NO			

Values calculated in accordance with AS/NZS 3500.3.
§ Non standard downpipe and nozzle/pop is required.
* Non standard nozzle/pop is required to suit rectangular downpipe.

ROOF PLAN

1:100

Downpipe And Eaves Gutters									
Catchment	Area (m2)	Slope (DEG)	Type	Runoff (L/s)	Suggested DP	Number Required	Gutter Area (mm²)	Minimum Gutter Width (mm)	Minimum Gutter Depth (mm)
1	95.787	22.0	SHEERLINE®	5.19	Ø100mm	2	10787	145	75

DENOTES DIRECTION OF FALL IN EAVES GUTTER (TYP).

DENOTES DOWNPIPE DROP.

DENOTES HIGH POINT IN EAVES GUTTER (TYP).

ROOF AREA DRAINING TO EAVES GUTTER. REFER TO TABLE FOR FURTHER DETAILS.

deboke

CIVIL

Project No. 20250298-S4.55-SW-DWG-01

Drawing No. S202

Title

Roof Plan

Scale

0m 1 2 3 4 5

SCALE 1:100 ON ORIGINAL SIZE

N

Rev.	Description	Design	Date
01	Issued For Section 4.55 (S4.55)	ZZ	23-06-2025

d

dvynedesign

Architect

d

dvynedesign

Client

Project

Proposed Secondary Dwelling Development

Application

Section 4.55

Address

42 Woodbine Street Yagoona 2199

LGA

CANTERBURY-BANKSTOWN Council

Drawn	BA	Designed	ZZ
Reviewed	JD	Date	23-06-2025
Approved	AA	Date	23-06-2025

Andrew Arida

B.E Civil/Structural

MIEAust (NO. 5579488)

Professional Engineer (PRE0000268)

Design Practitioner (DEP0000455)

Arida

Discipline	Consultant	Reference	Revision	Date
Architect	Dvyn Design	----	A	19.06.2025
Surveyor	Radon Associates Pty Ltd	----	A	30.10.2023
Landscape				
Geotechnical				
Structural				
Hydraulic/Fire				
Mechanical				

deboke

ENGINEERING CONSULTANTS

E admin@deboke.com.au

W deboke.com.au

A 17 William Street Ryde NSW 2112

P 02 9188 0688


COPYRIGHT

This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.

SPS Truflo 100mm & 150mm RWO
with Dome Grate & Membrane Clamp


Specification codes:
TIA100D2 (CI body, aluminium dome grate & membrane ring)
TIB100D2 (CI body, bronze dome grate & membrane ring)
TBA100D2 (all-bronze assembly)
- for 80mm outlet, use "100/80" instead of "100"
- for 150mm outlet, use "150" instead of "100"

Suggested application:
Roof decks

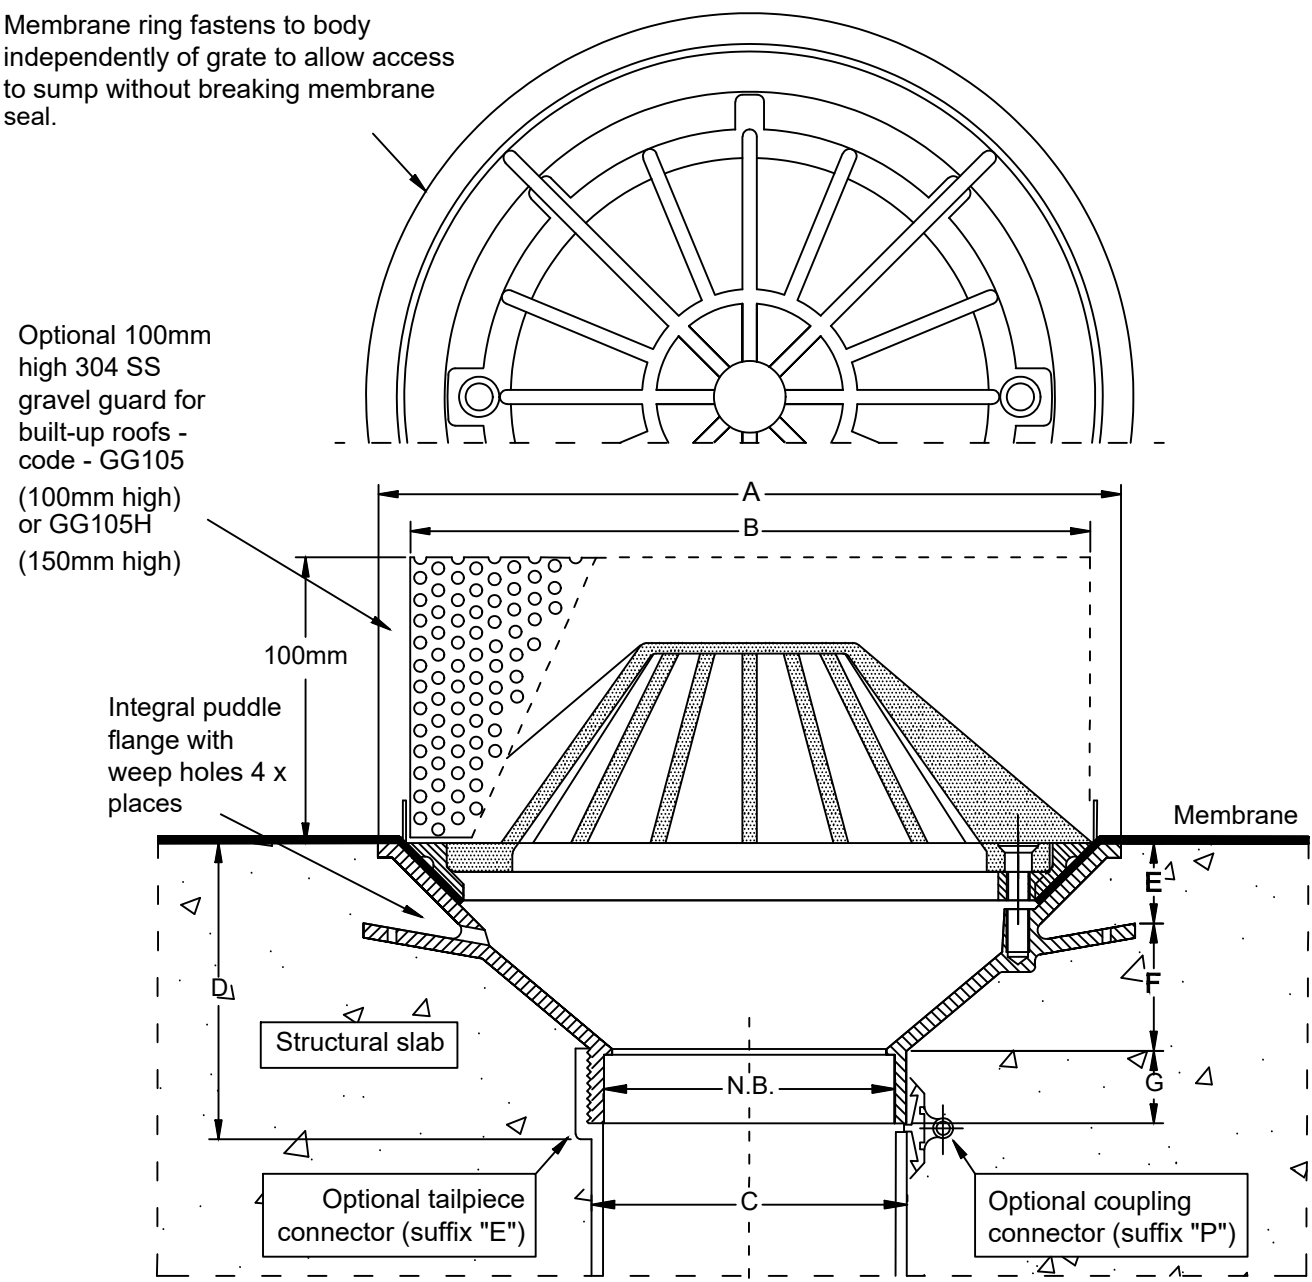


*For flow rate data please refer to appendix.



Speciality Plumbing Supplies Pty Ltd

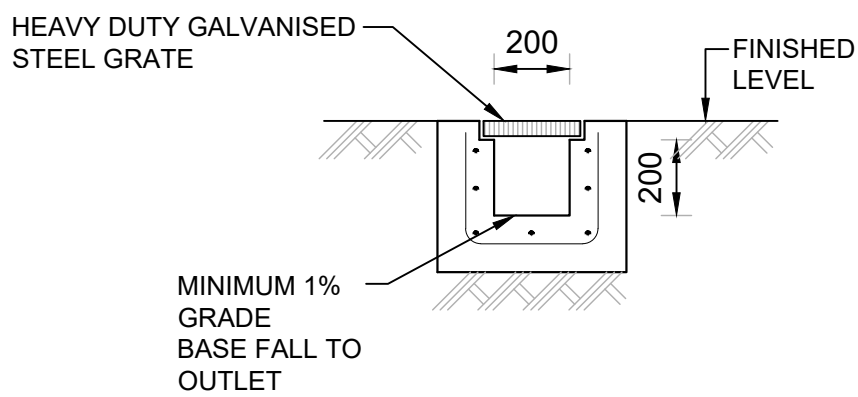


GRATED TRENCH DRAIN
SCALE 1:20

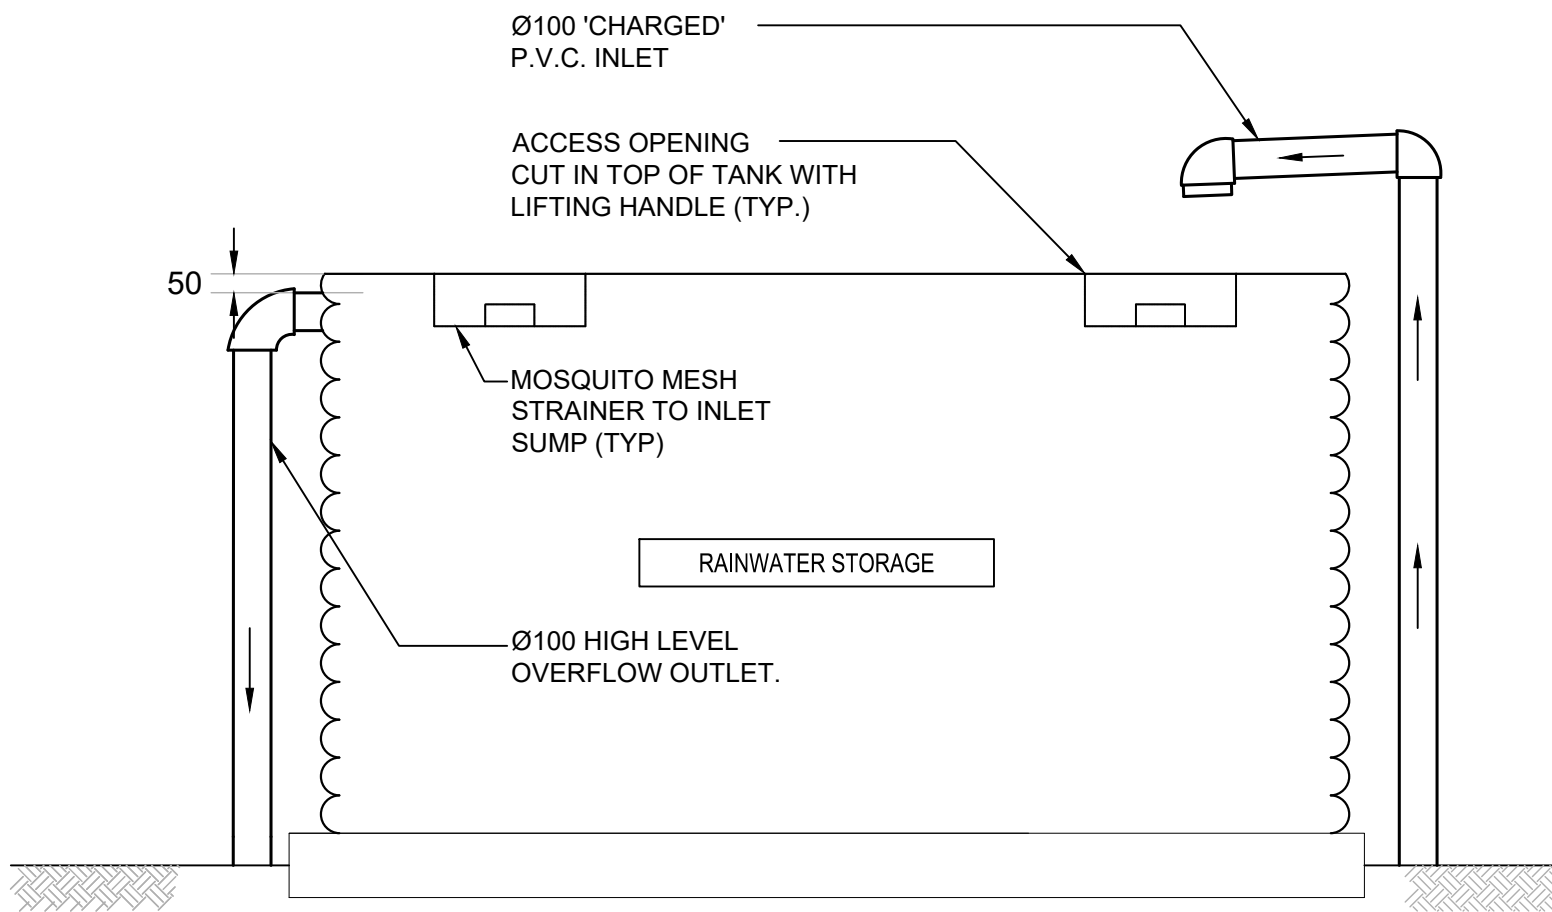

TYPICAL ABOVE GROUND
RAINWATER TANK
NOT TO SCALE

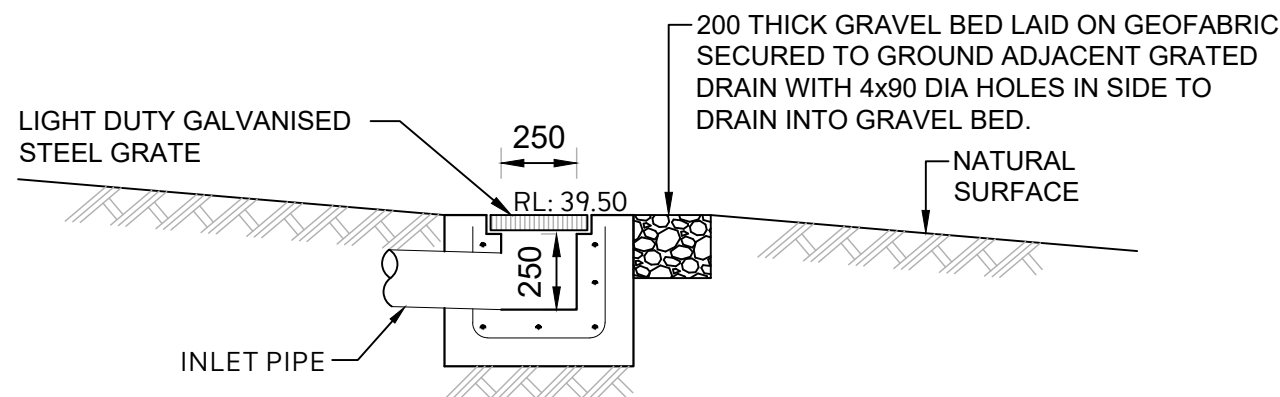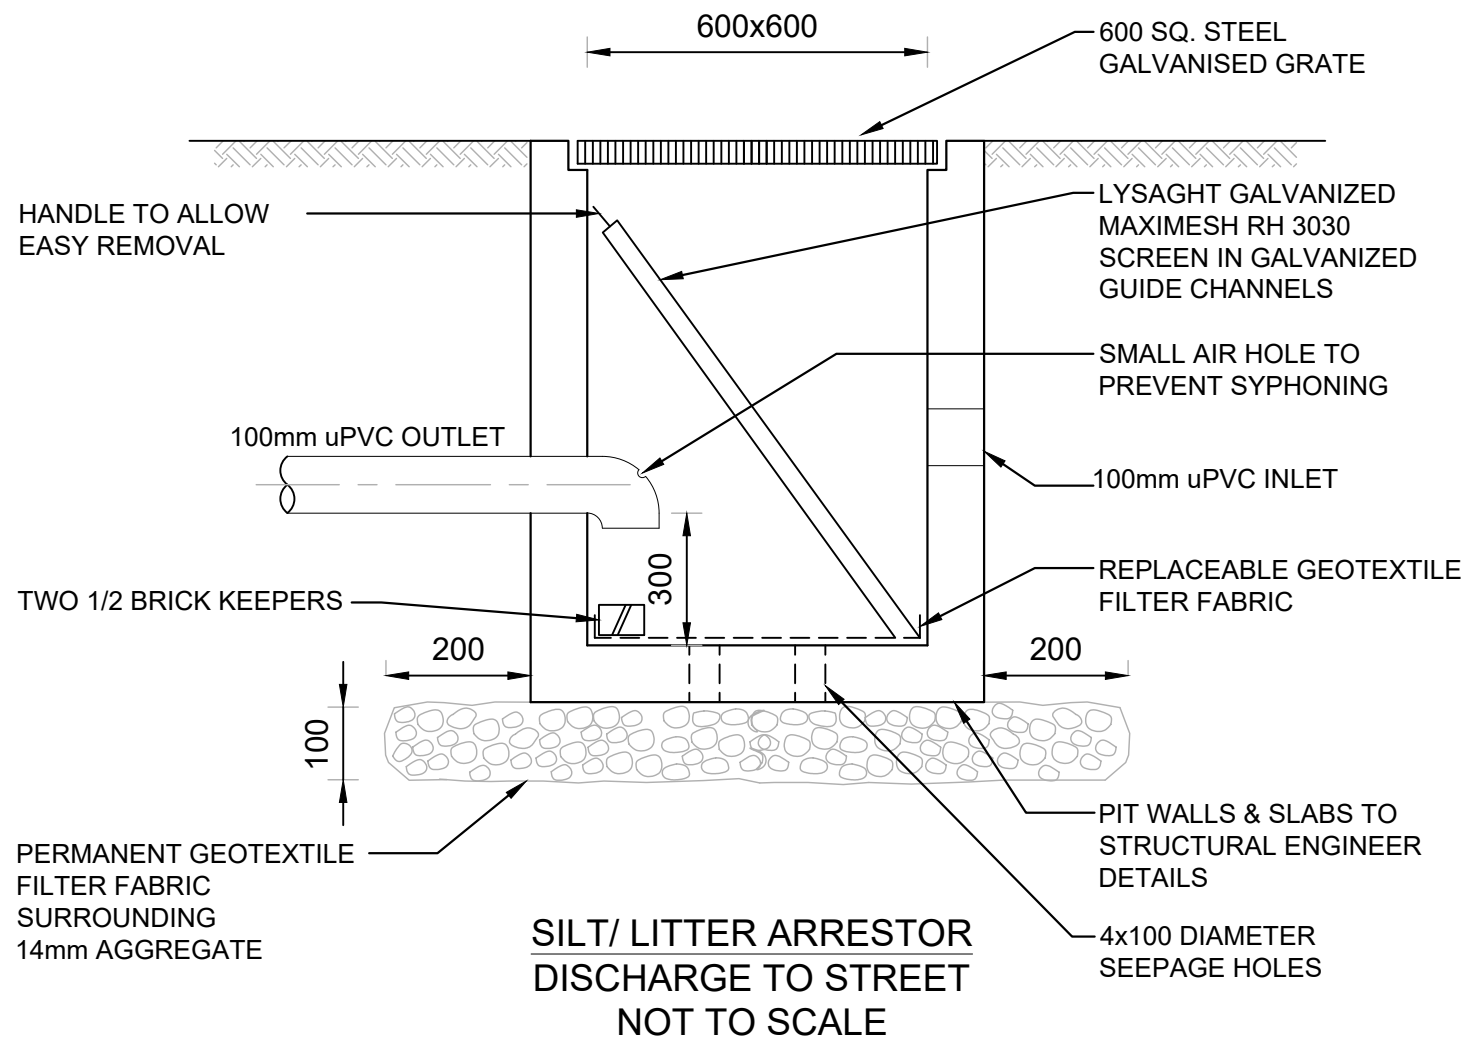

LEVEL SPREADER
NOT TO SCALE

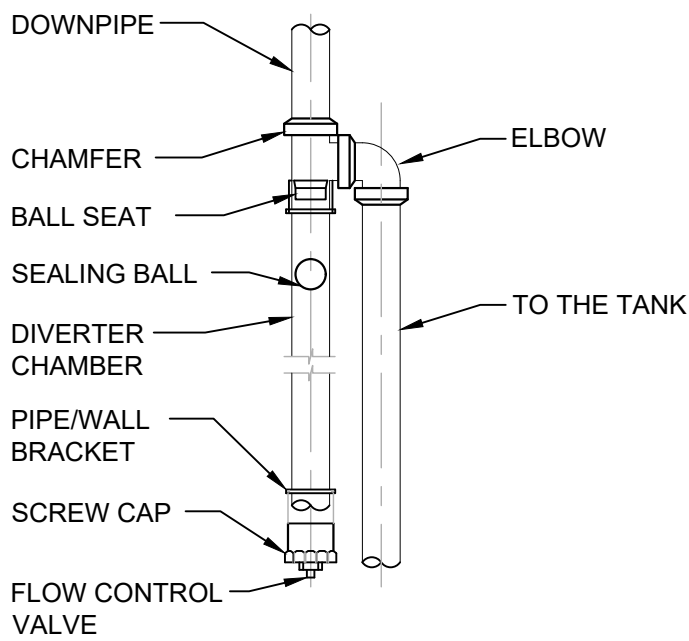


FIRST FLUSH DIVERTER
SCALE 1:20

LEGEND:
BACKGROUND IS YELLOW
TEXT IS WHITE ON BLACK
BACKGROUND







RAINWATER SIGN
SCALE 1:10

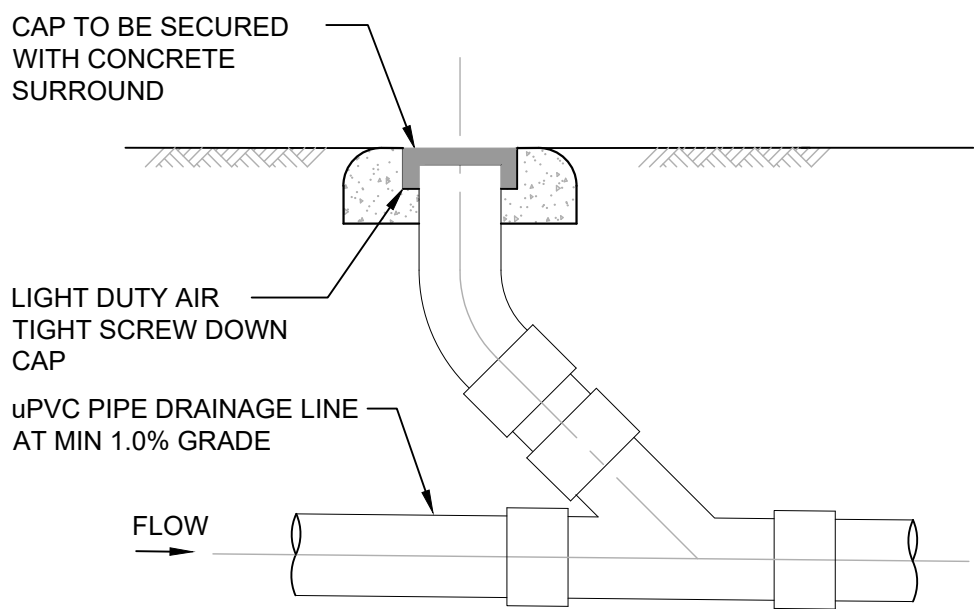


CLEANING EYE
SCALE 1:20

	Project No. 20250298-S4.55-SW-DWG-01	Drawing No. S300	Rev.	Description	Design	Date			Project Proposed Secondary Dwelling Development Application Section 4.55 Address 42 Woodbine Street Yagoona 2199 LGA CANTERBURY-BANKSTOWN Council	Drawn	BA	Designed	ZZ	Discipline	Consultant	Reference	Revision	Date	 E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688 COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.
	Title Details Sheet	Scale 0m 0.2 0.4 0.6 0.8 1.0 SCALE 1:20 ON ORIGINAL SIZE	01	Issued For Section 4.55 (S4.55)	ZZ	23-06-2025				Reviewed	JD	Date	23-06-2025	Architect	Dvyne Design	----	A	19.06.2025	
										Approved	AA	Date	23-06-2025	Surveyor	Radon Associates Pty Ltd	----	A	30.10.2023	
										Andrew Arida B.E Civil/Structural MIEAust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455) 				Landscape					
														Geotechnical					
														Structural					
														Hydraulic/Fire					
														Mechanical					

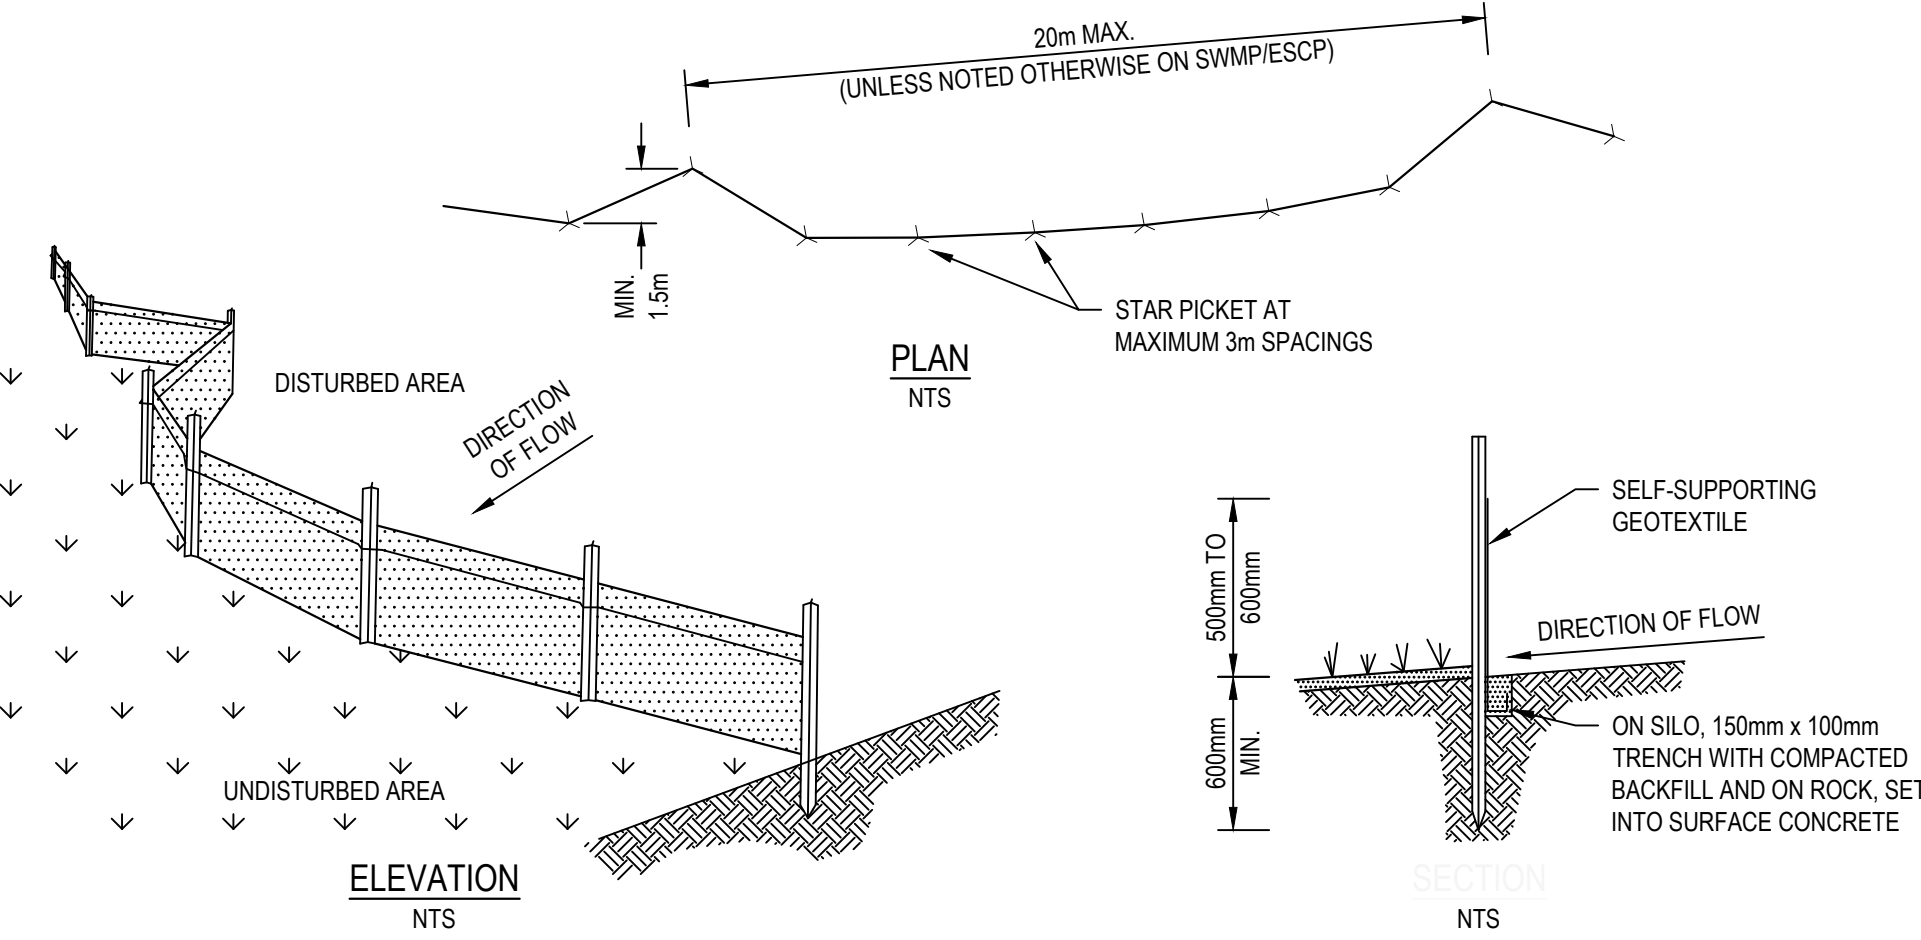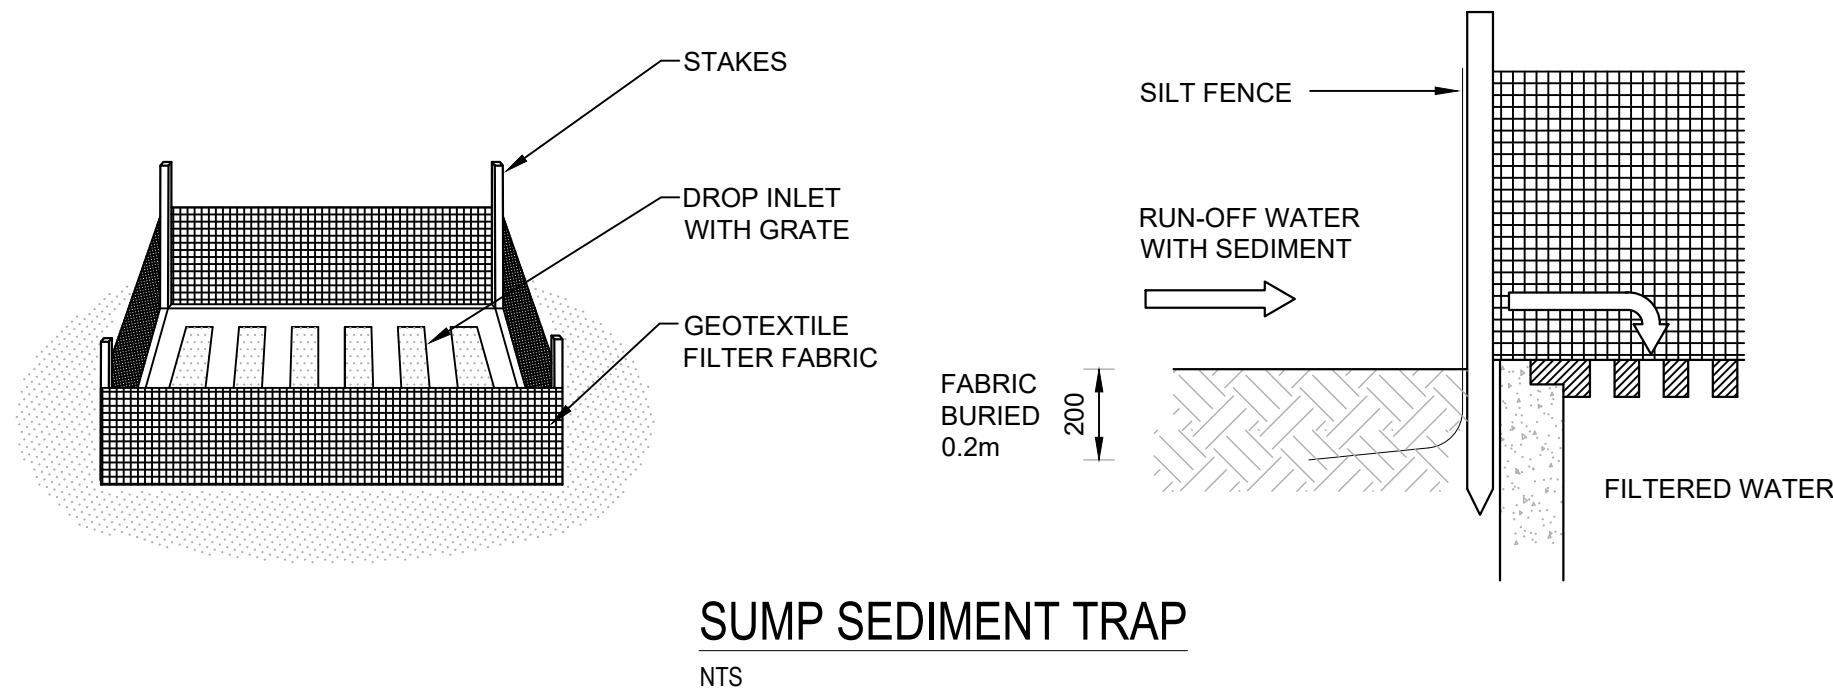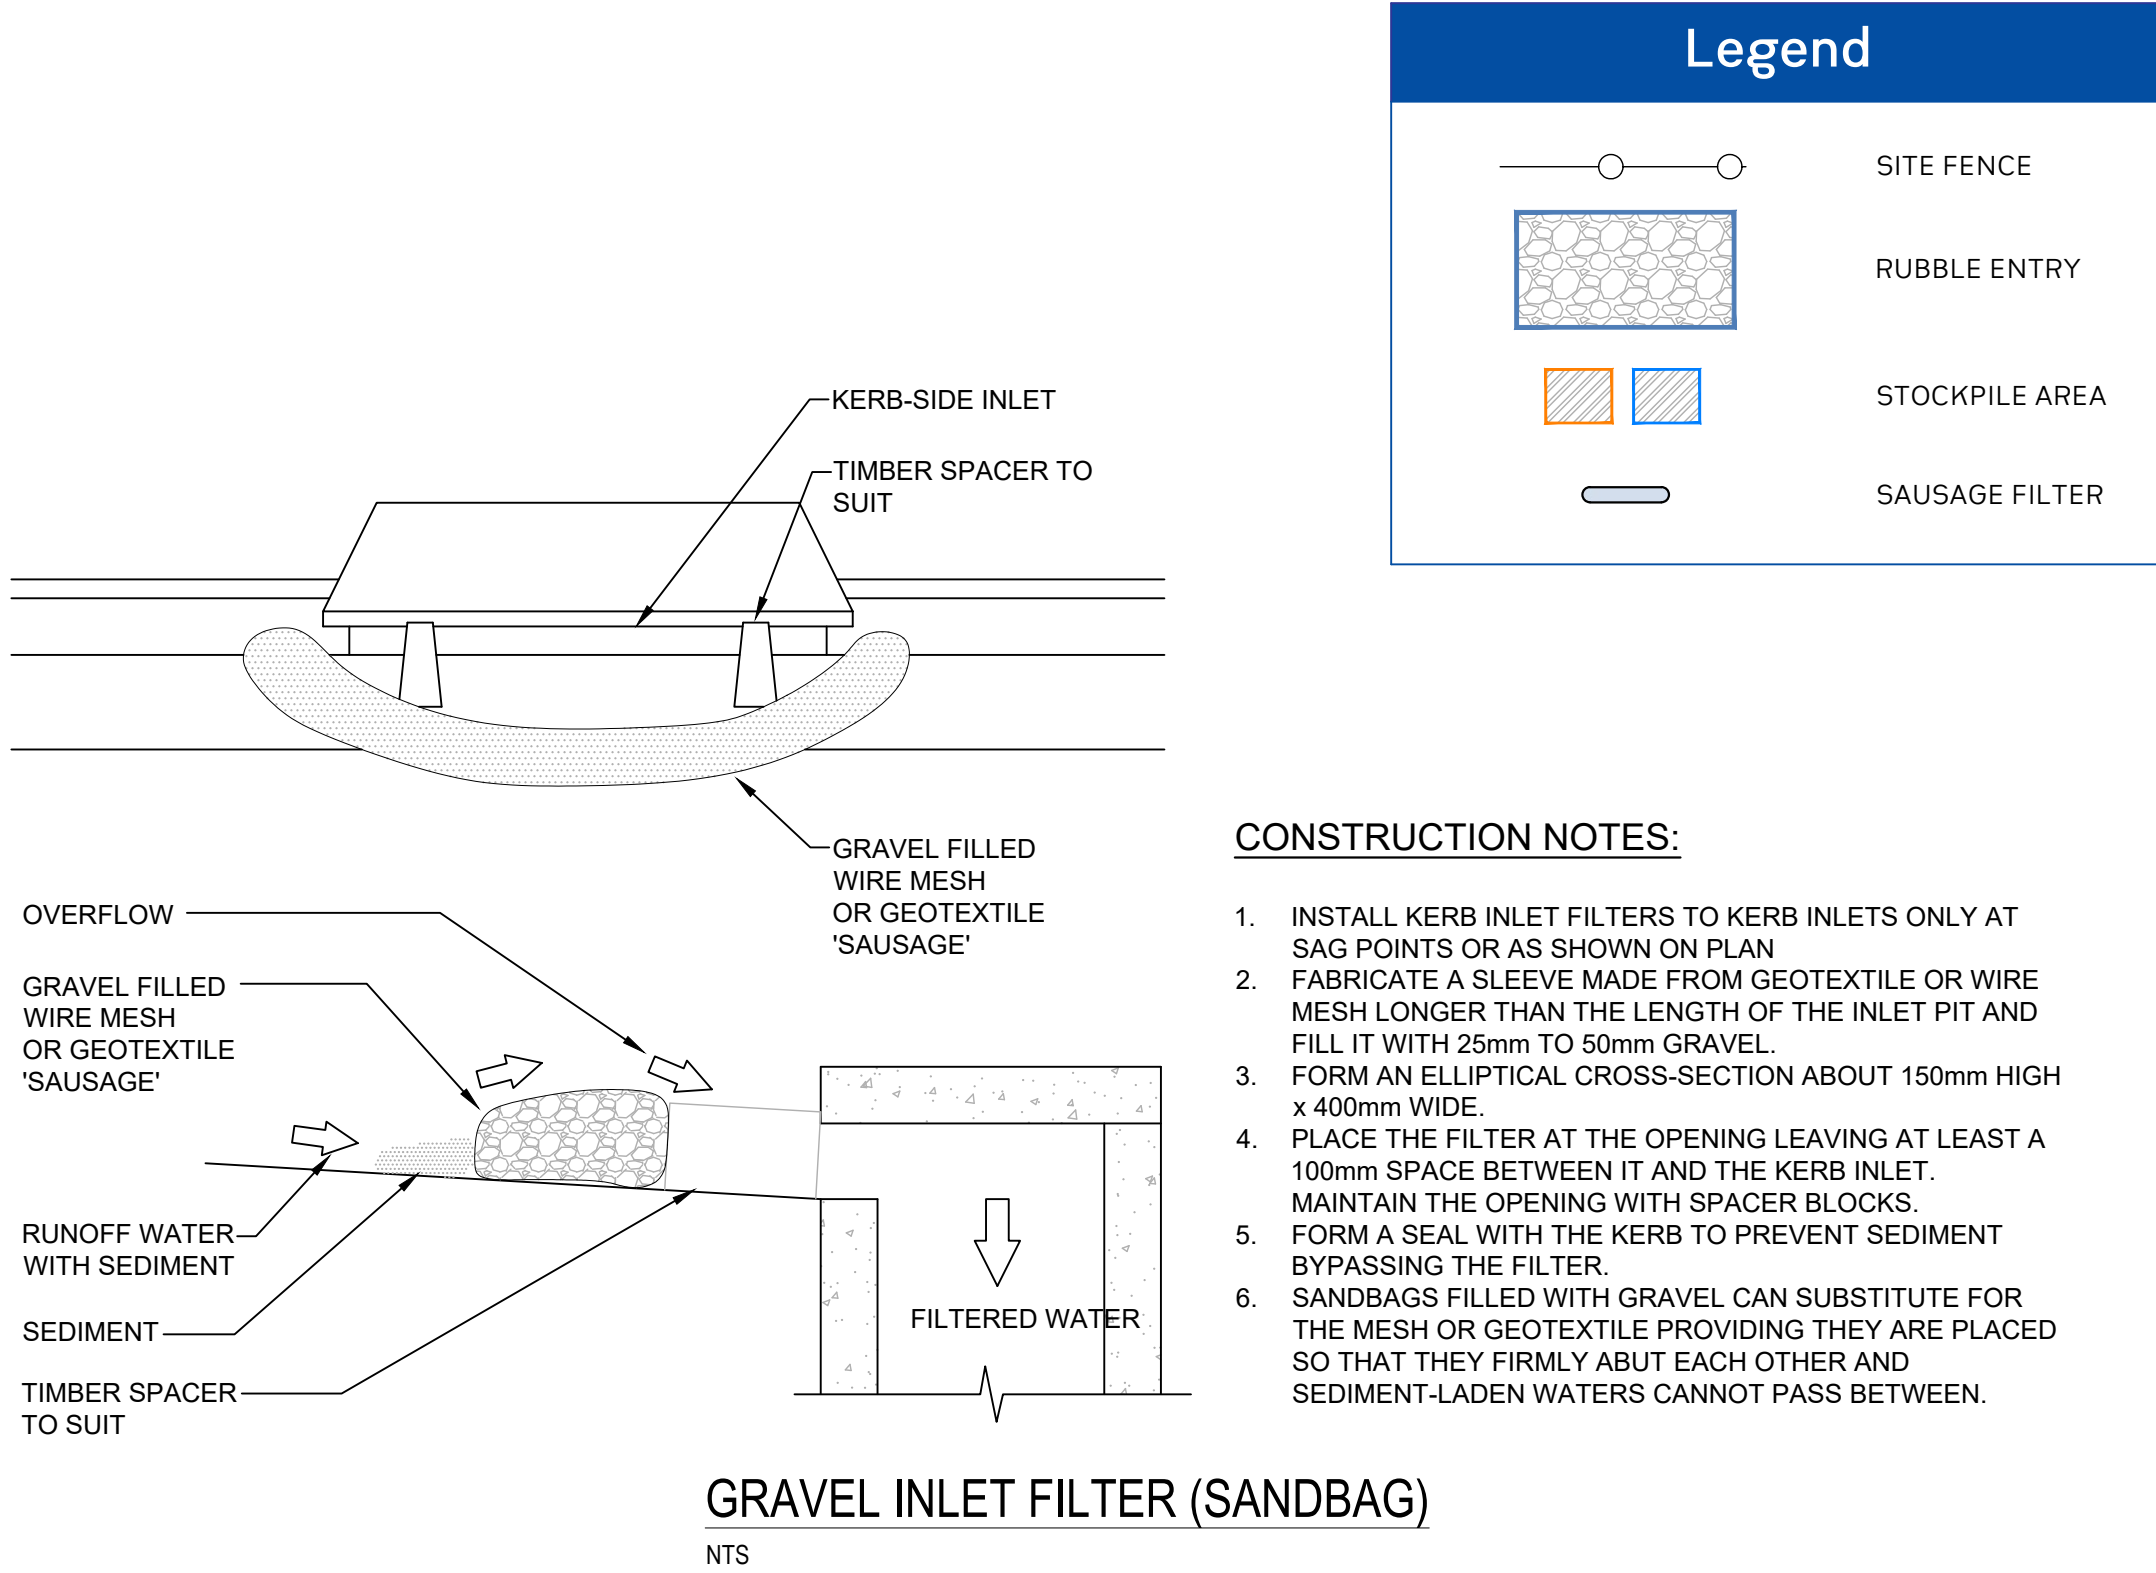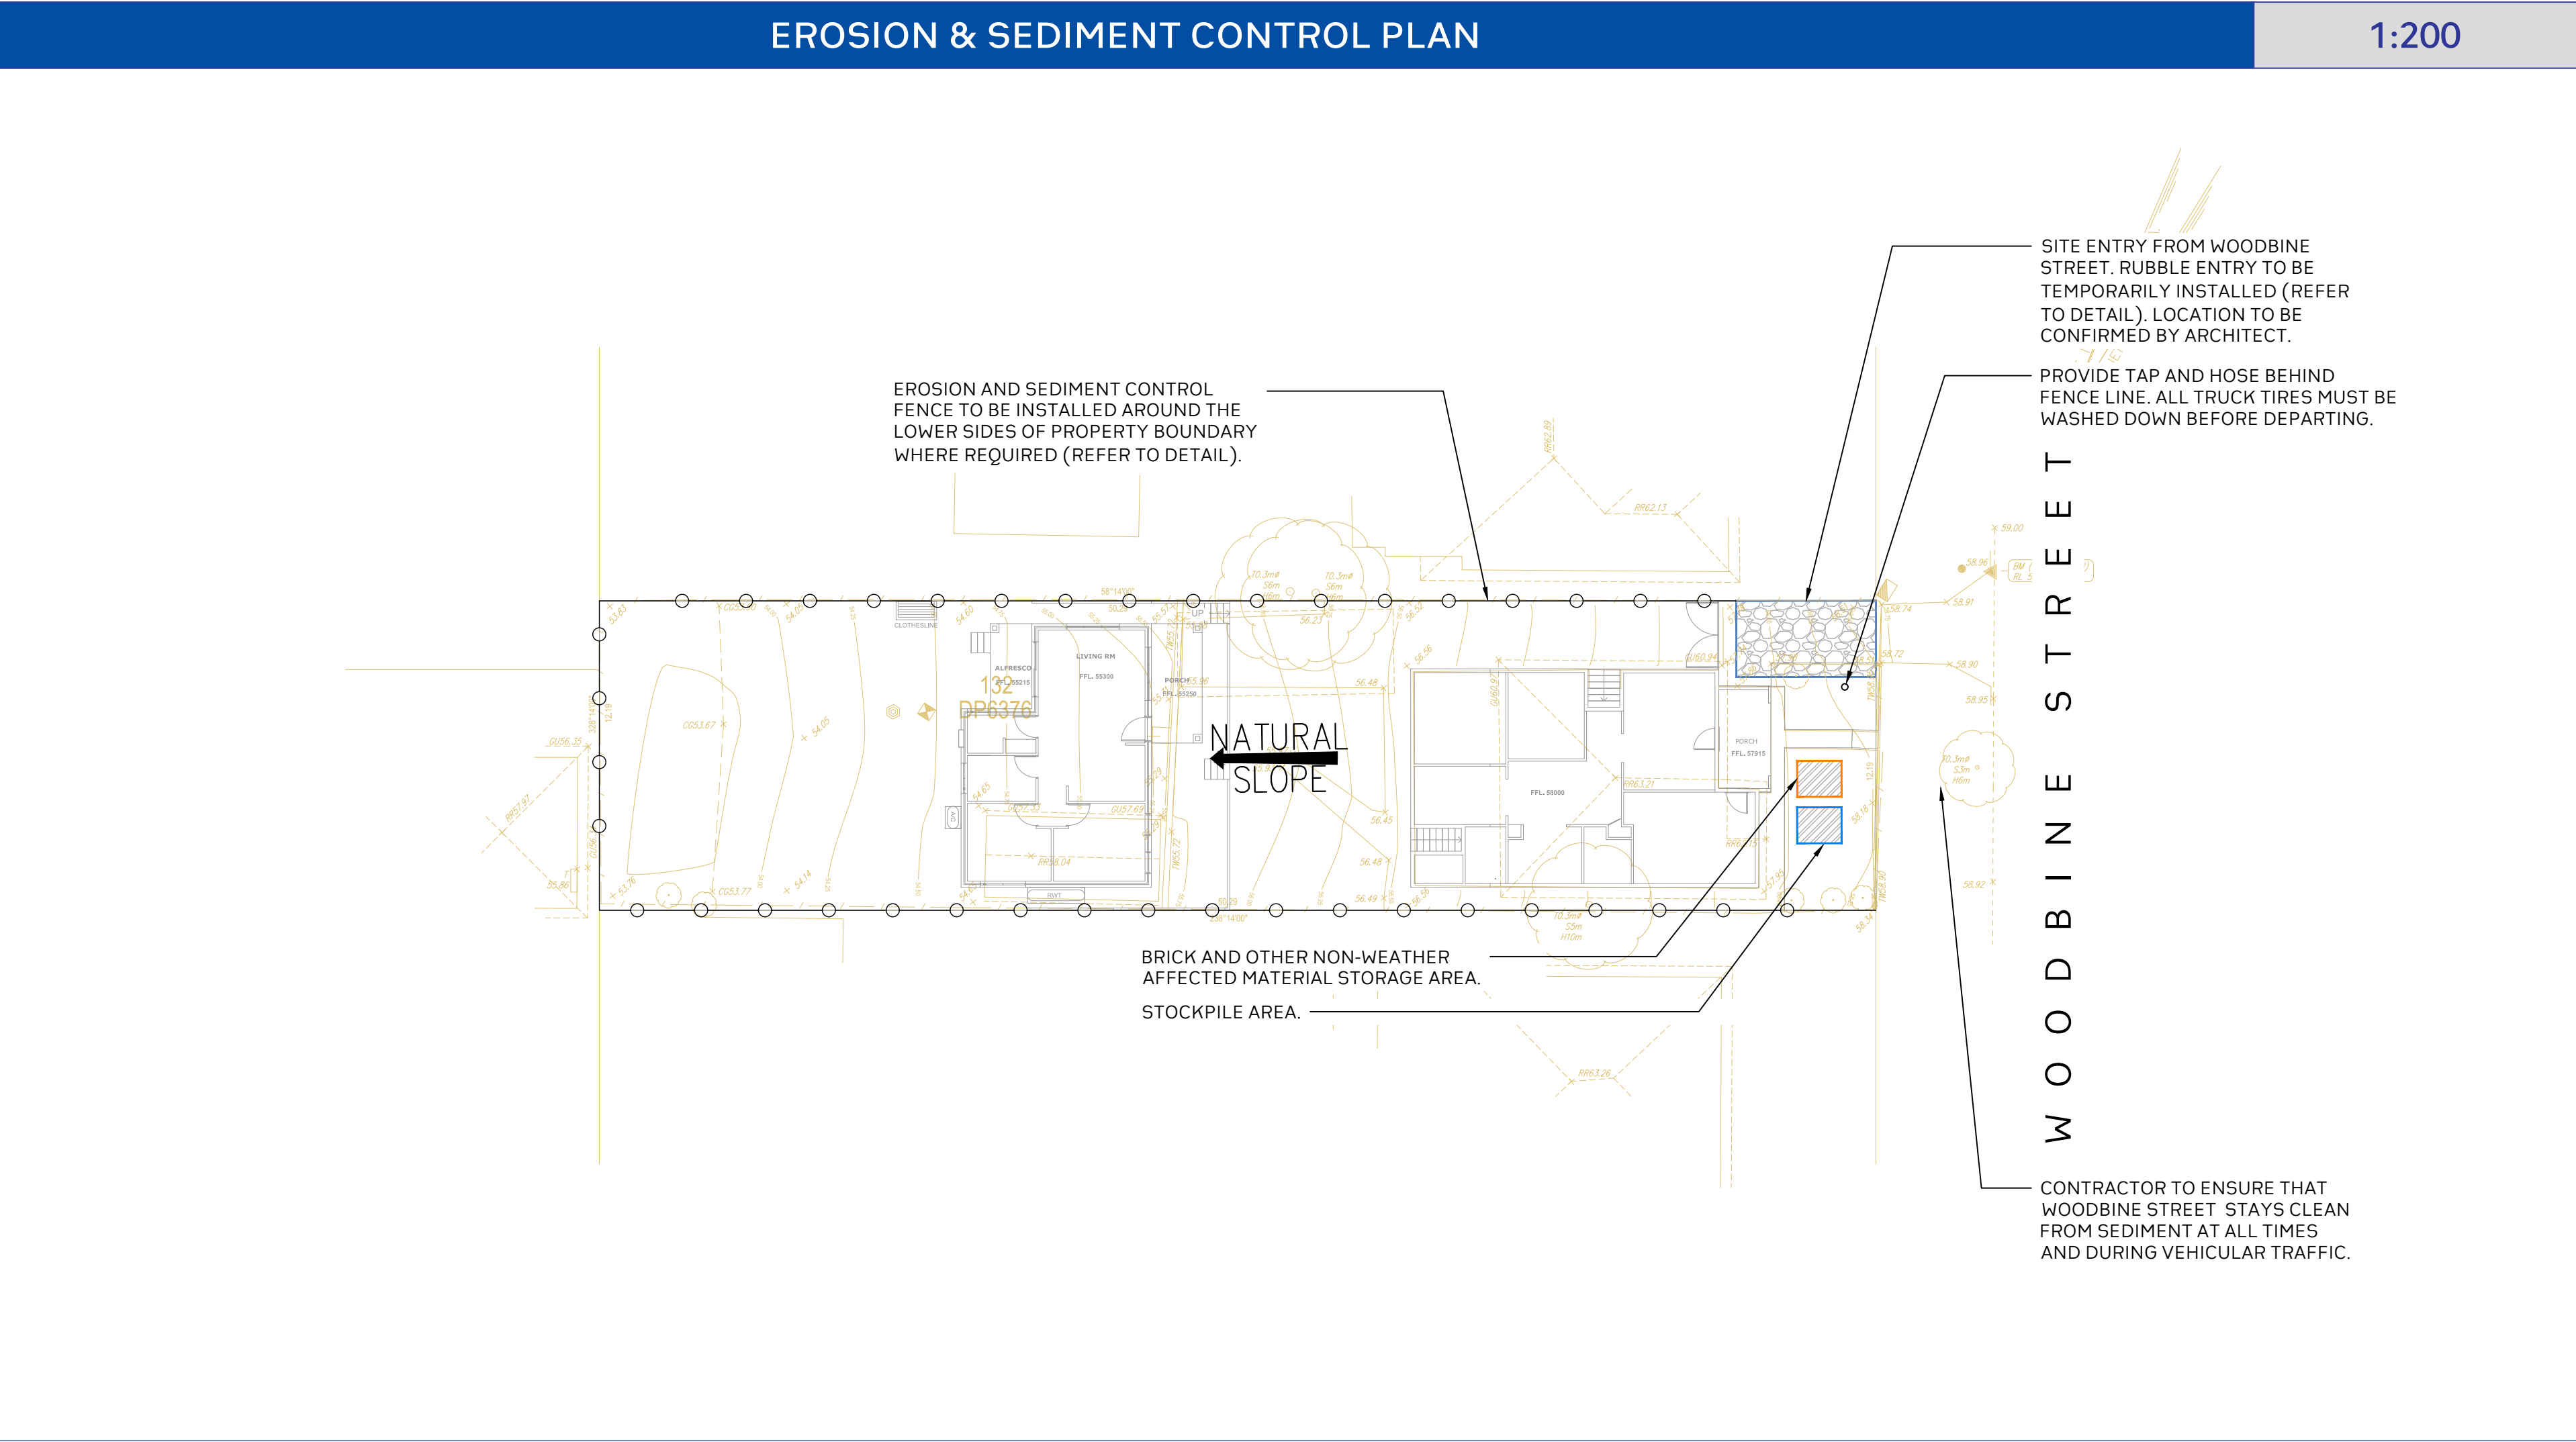


GENERAL CONSTRUCTION NOTES

- CONSTRUCTION SEDIMENT FENCES AS CLOSE AS POSSIBLE TO PARALLEL TO THE CONTOURS OF THE SITE
- DIVE 1.5m LONG STAR PICKETS INTO GROUND, 3m APART
- DIG A 150mm DEEP TRENCH ALONG THE UPSLOPE LINE OF THE FENCE FOR THE BOTTOM OF THE FABRIC TO BE ENTRENCHED
- BACKFILL TRENCH OVER BASE OF FABRIC
- FIX SELF-SUPPORTING GEOTEXTILE TO UPSLOPE SIDE OF POSTS WITH WIRE TIES OR AS RECOMMENDED BY GEOTEXTILE MANUFACTURER
- JOIN SECTIONS OF FABRIC AT A SUPPORT POST WITH A 150mm OVERLAP

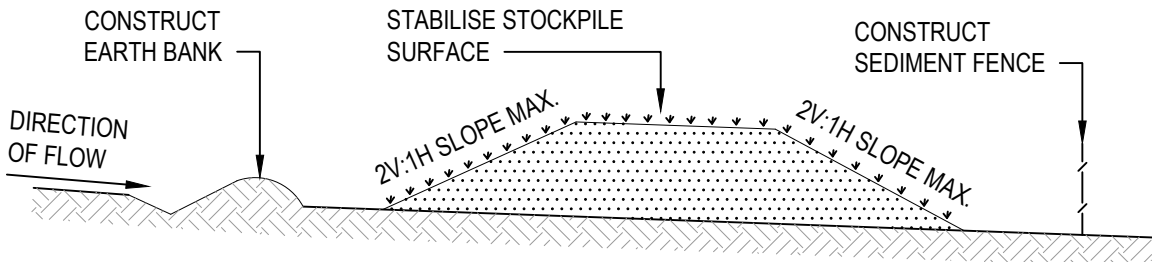


GENERAL CONSTRUCTION NOTES

- LOCATE STOCKPILE AT LEAST 5m FROM EXISTING VEGETATION, CONCENTRATED WATER FLOWS, ROADS AND HAZARD AREAS
- CONSTRUCT ON THE CONTOUR AS A LOW, FLAT, ELONGATED MOUND
- WHERE THERE IS SUFFICIENT AREA TOPSOIL STOCKPILES SHALL BE LESS THAN 2m IN HEIGHT
- REHABILITATE IN ACCORDANCE WITH THE SWMP/ESCP
- CONSTRUCT EARTH BANK ON THE UPSLOPE SIDE TO DIVERT RUN OFF AROUND THE STOCKPILE AND A SEDIMENT FENCE 1 TO 2m DOWNSLOPE OF STOCKPILE

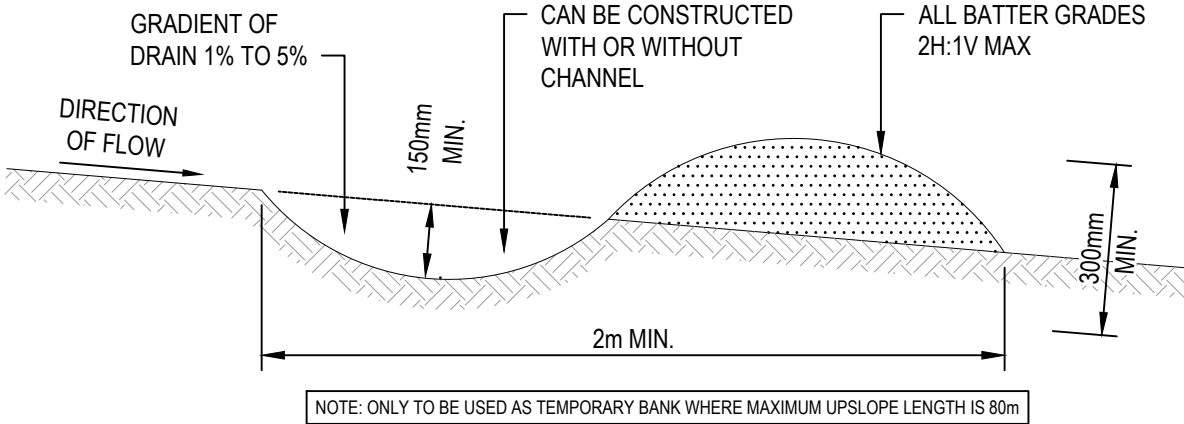

GENERAL CONSTRUCTION NOTES

- CONSTRUCT WITH GRADIENT OF 1% TO 5%
- AVOID REMOVING TREES AND SHRUBS IF POSSIBLE
- DRAINS TO BE CIRCULAR, PARABOLIC OR TRAPEZOIDAL CROSS SECTION NOT V-SHAPED
- EARTH BANKS TO BE ADEQUATELY COMPACTED IN ORDER TO PREVENT FAILURE
- PERMANENT OR TEMPORARY STABILISATION OF THE EARTH BANK TO BE COMPLETED WITHIN 10 DAYS OF CONSTRUCTION
- ALL OUTLETS FROM DISTURBED LANDS ARE TO FEED INTO A SEDIMENT BASIN OR SIMILAR
- DISCHARGE RUNOFF COLLECTED FROM UNDISTURBED LANDS ONTO EITHER A STABILISED OR AN UNDISTURBED DISPOSAL SITE WITHIN THE SAME SUBCATCHMENT AREA FROM WHICH THE WATER ORIGINATED
- COMPACT BANK WITH A SUITABLE IMPLEMENT IN SITUATIONS WHERE THEY ARE REQUIRED TO FUNCTION FOR MORE THAN FIVE DAYS
- EARTH BANKS TO BE FREE OF PROJECTIONS OR OTHER IRREGULARITIES THAT WILL IMPEDED NORMAL FLOW

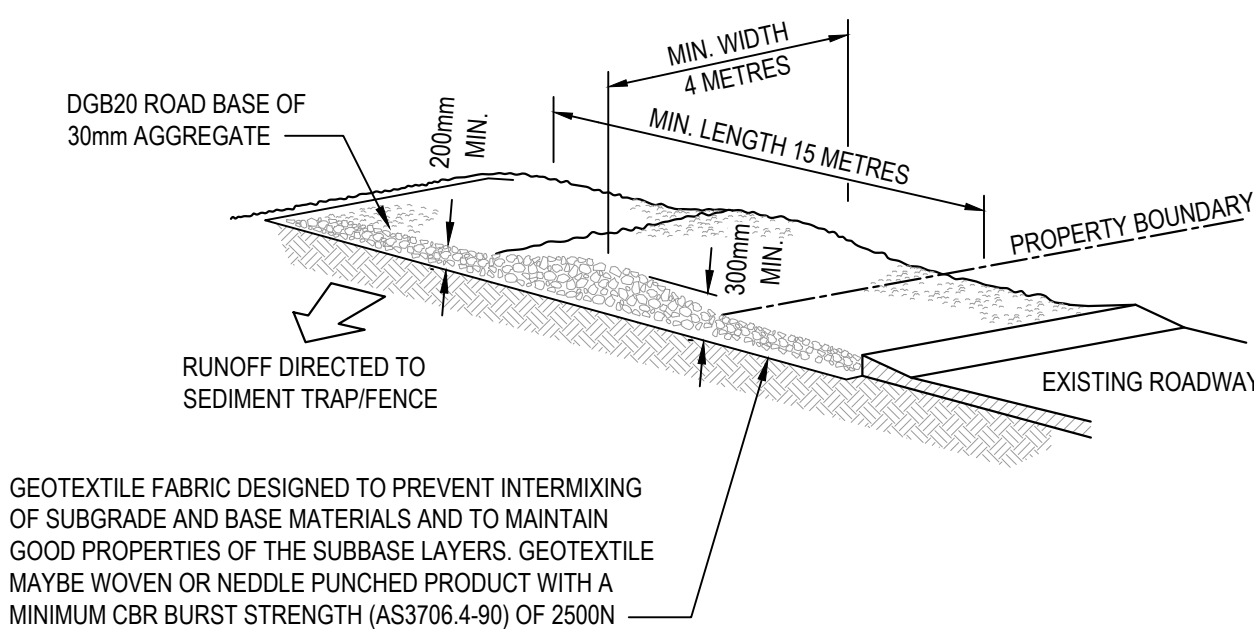

STABILISED SITE ACCESS CONSTRUCTION NOTES:

- STRIP THE TOPSOIL, LEVEL THE SITE AND COMPACT THE SUBGRADE.
- COVER THE AREA WITH NEEDLE - PUNCHED GEOTEXTILE.
- CONSTRUCT A 200mm THICK PAD OVER THE GEOTEXTILE USING ROAD BASE OR 30mm AGGREGATE.
- ENSURE THE STRUCTURE IS AT LEAST 15 METRES LONG OR TO BUILDING ALIGNMENT AND AT LEAST 3 METRES WIDE.
- WHERE A SEDIMENT FENCE JOINS ONTO THE STABILISED ACCESS, CONSTRUCT A HUMP IN THE STABILISED ACCESS TO DIVERT WATER TO SEDIMENT FENCE.

	Project No. 20250298-S4.55-SW-DWG-01	Drawing No. S400	Rev.	Description	Design	Date			Project Proposed Secondary Dwelling Development	Drawn	BA	Designed	ZZ	Discipline	Consultant	Reference	Revision	Date	 E admin@deboke.com.au W deboke.com.au A 17 William Street Ryde NSW 2112 P 02 9188 0688 COPYRIGHT This drawing and the information shown hereon is the property of deboke engineering consultants and may not be used for any purposes than for which supplied.
	Title Erosion and Sediment Control Plan		01	Issued For Section 4.55 (S4.55)	ZZ	23-06-2025			Application Section 4.55	Reviewed	JD	Date	23-06-2025	Architect	Dvyne Design	---	A	19.06.2025	
Scale 0m 2 4 6 8 10 SCALE 1:200 ON ORIGINAL SIZE							Architect	Client	Address 42 Woodbine Street Yagoona 2199	Approved	AA	Date	23-06-2025	Surveyor	Radon Associates Pty Ltd	---	A	30.10.2023	
									LGA CANTERBURY-BANKSTOWN Council	Andrew Arida B.E Civil/Structural MIEAust (NO: 5579488) Professional Engineer (PRE0000268) Design Practitioner (DEP0000455)				Landscape					
														Geotechnical					
														Structural					
														Hydraulic/Fire					
														Mechanical					