

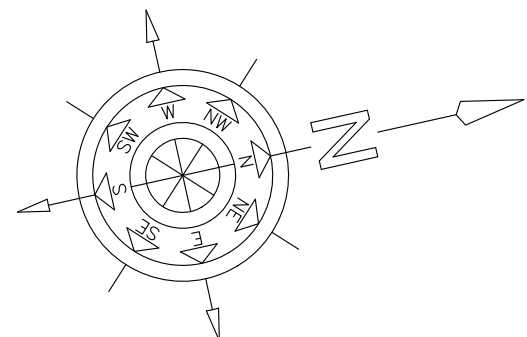


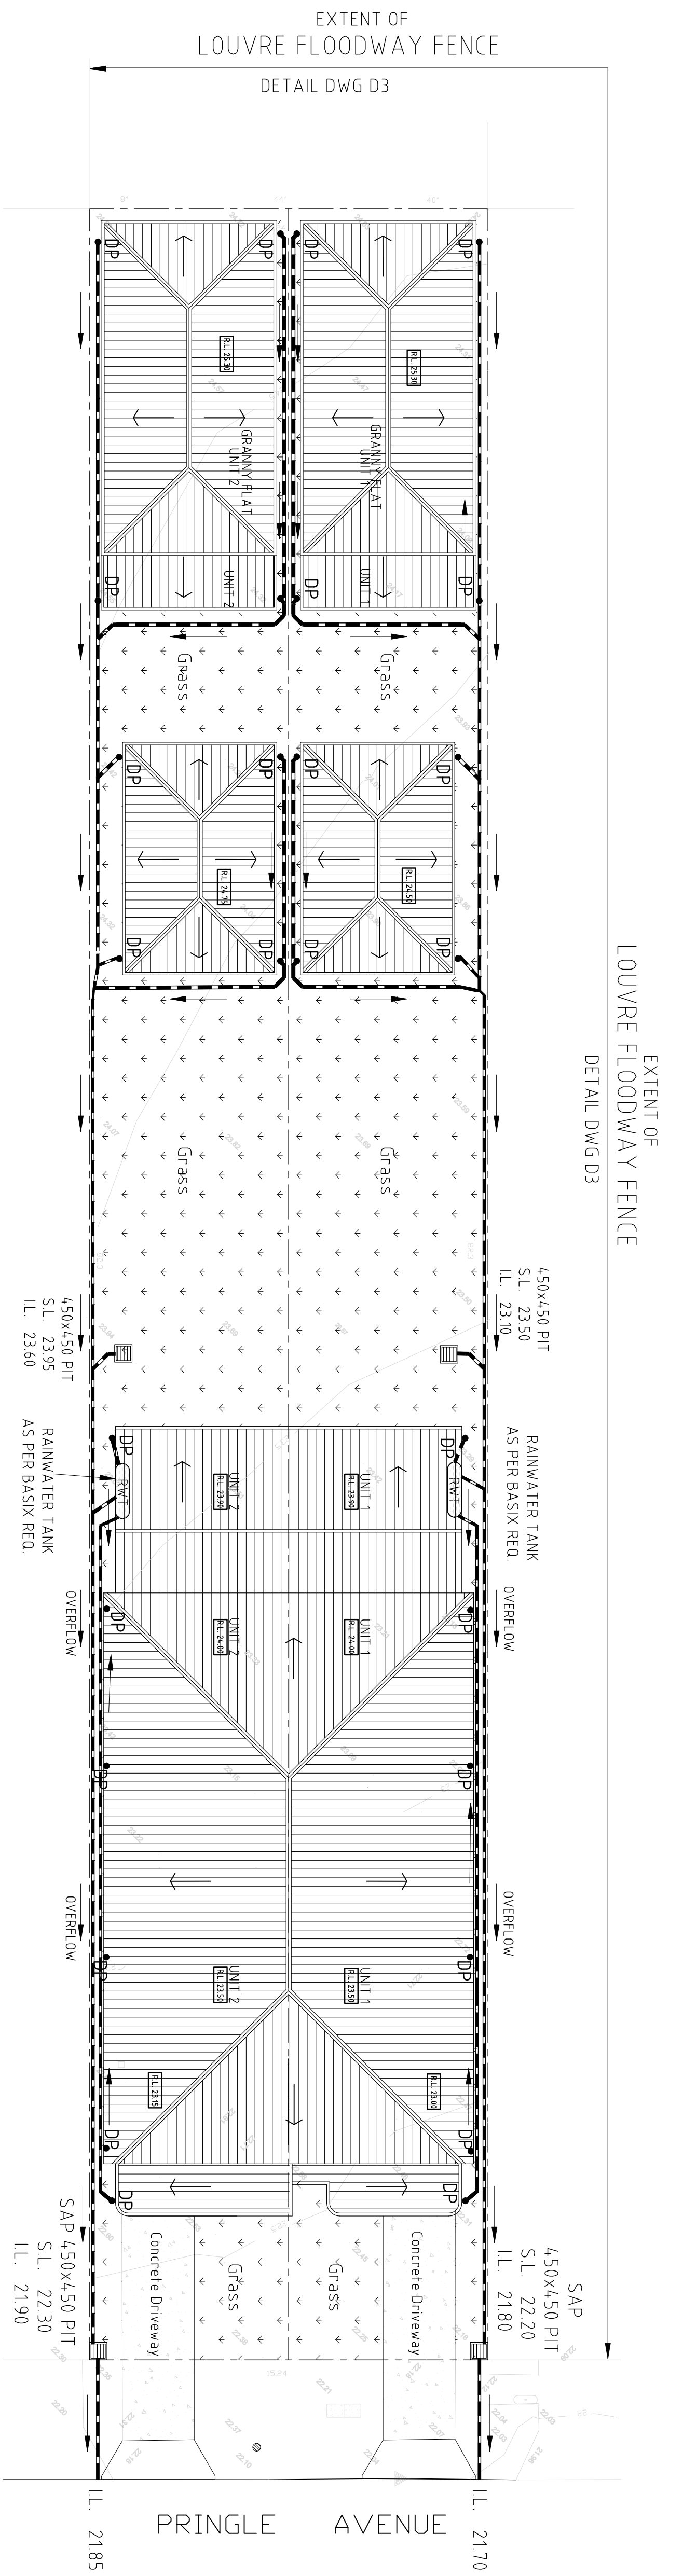

ROOF AND SITE DRAINAGE LAYOUT



1:150

LOCATION OF DOWN PIPES TO
BE CONFIRMED BY THE ARCHITECT

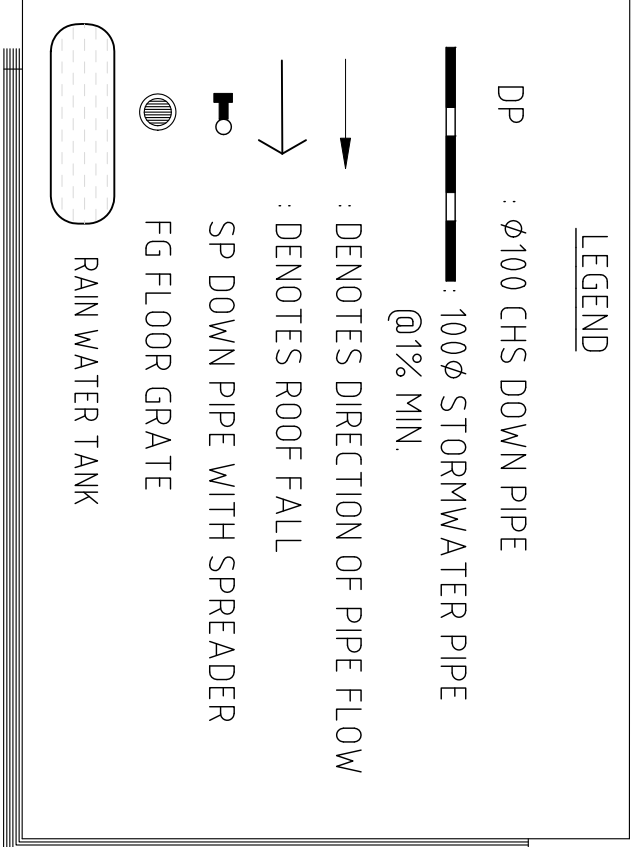

GENERAL DRAINAGE NOTES:

- 1 THIS DRAINAGE PLAN SHOULD BE READ STRICTLY IN ACCORDANCE WITH THE COUNCIL APPROVED ARCHITECTURAL PLANS.
- 2 LOCATIONS OF DOWN PIPES TO BE CONFIRMED BY THE ARCHITECT.
- 3 DEPTH AND LOCATION OF SERVICES TO BE ESTABLISHED PRIOR TO COMMENCEMENT OF DRAINAGE WORKS.
- 4 ALL GUTTERS TO BE MIN STRAMIT 115 QUAD OR EQUIVALENT.
- 5 ALL BALCONIES TO HAVE FLOOR WASTE CONNECTED TO DOWNPPIPE.
- 6 ALL DRAINAGE PIPES ARE TO BE UPVC GRADE, UNLESS NOTED OTHERWISE.
- 7 THE MINIMUM COVER OVER ALL DRAINAGE PIPES IS TO BE 150mm.
- 8 ALL DRAINAGE PIPES ARE TO HAVE A MINIMUM PIPE GRADIENT OF 1 %.
- 9 ALL DRAINAGE PITS ARE TO BE INSTALLED WITH A CHILD PROOF SAFETY LATCH ON THE ACCESS GATE.
- 10 ALL DOWNPPIPES ARE TO BE 100 x 50 SQUARE BOX SECTIONS UNLESS NOTED OTHERWISE.
- 11 ALL PITS TO BE CONSTRUCTED ARE SHOWN IN REINFORCED CONCRETE, HOWEVER PRECAST OR BRICK PITS OF SIMILAR SIZE AND CONSTRUCTION AND TO THE SAME LEVELS ARE ACCEPTABLE.

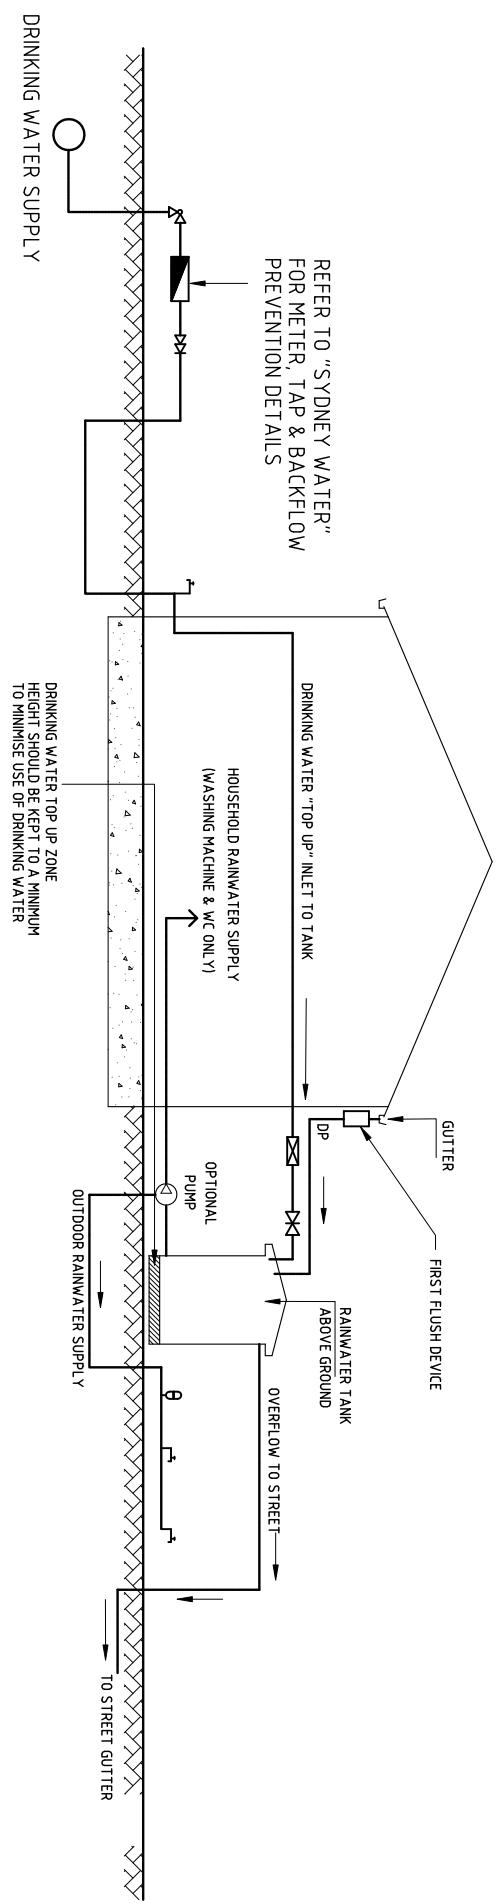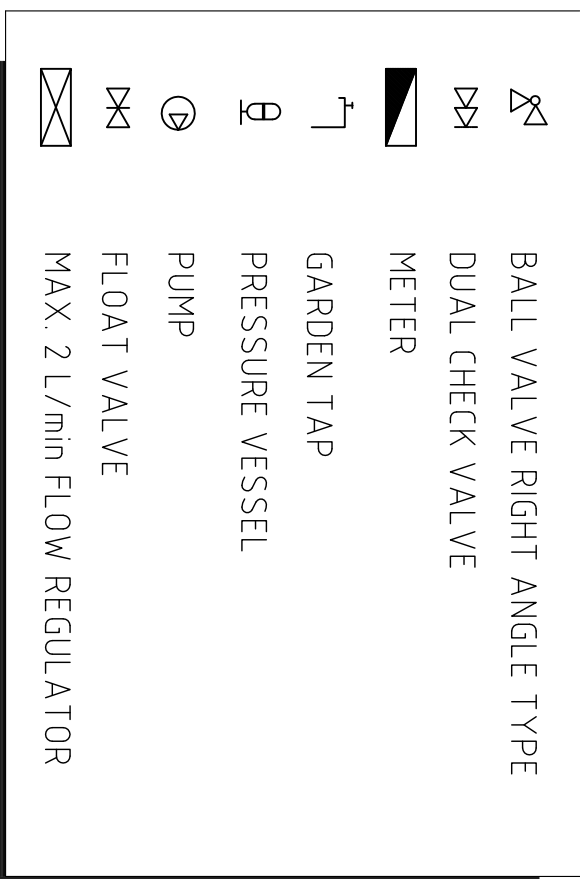


RAINWATER TANK CONNECTION DIAGRAM

NOT TO SCALE

DIAGRAM NOTES:



1. DRAWING TO BE READ IN CONJUNCTION WITH SYDNEY WATER PLUMBING REQUIREMENTS
2. SYDNEY WATER'S APPROVALS IS REQUIRED FOR ANY TOP UP FROM DRINKING WATER SUPPLY, REGARDLESS OF TANK SIZE.
3. NO DIRECT CONNECTIONS IS ALLOWED BETWEEN THE DRINKING WATER SUPPLY AND THE RAINWATER TANK SUPPLY
4. RAINWATER PIPE WORK IS SHOWN ON THE DIAGRAM AS SUPPLYING INTERNAL & EXTERNAL RAINWATER USES. CUSTOMERS MAY WANT ONLY ONE OR THE OTHER.
5. THE INLET FILLING RATE FROM DRINKING WATER SUPPLY IS TO BE RESTRICTED TO A MAXIMUM OF TWO (2) LITRES PER MINUTE FOR EACH HOUSE. TOWN HOUSE OR UNIT SUPPLIED FROM THE TANK.

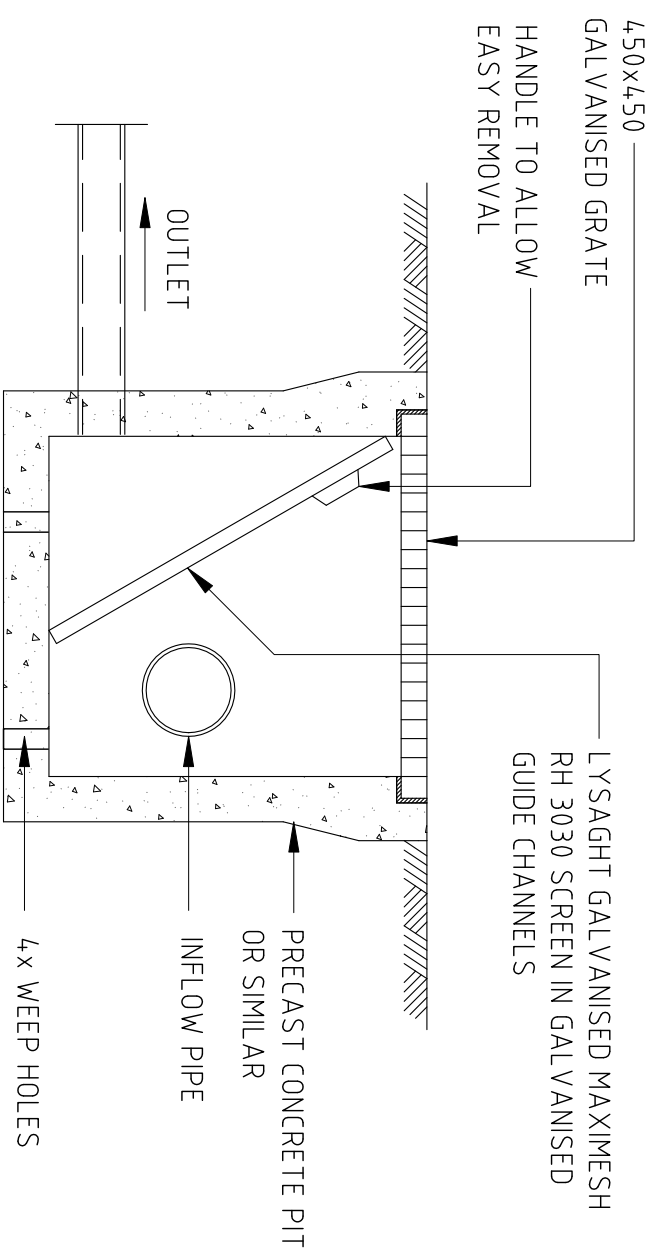

SILT ARRESTOR PIT (SAP)

N.T.S.

[illegible]

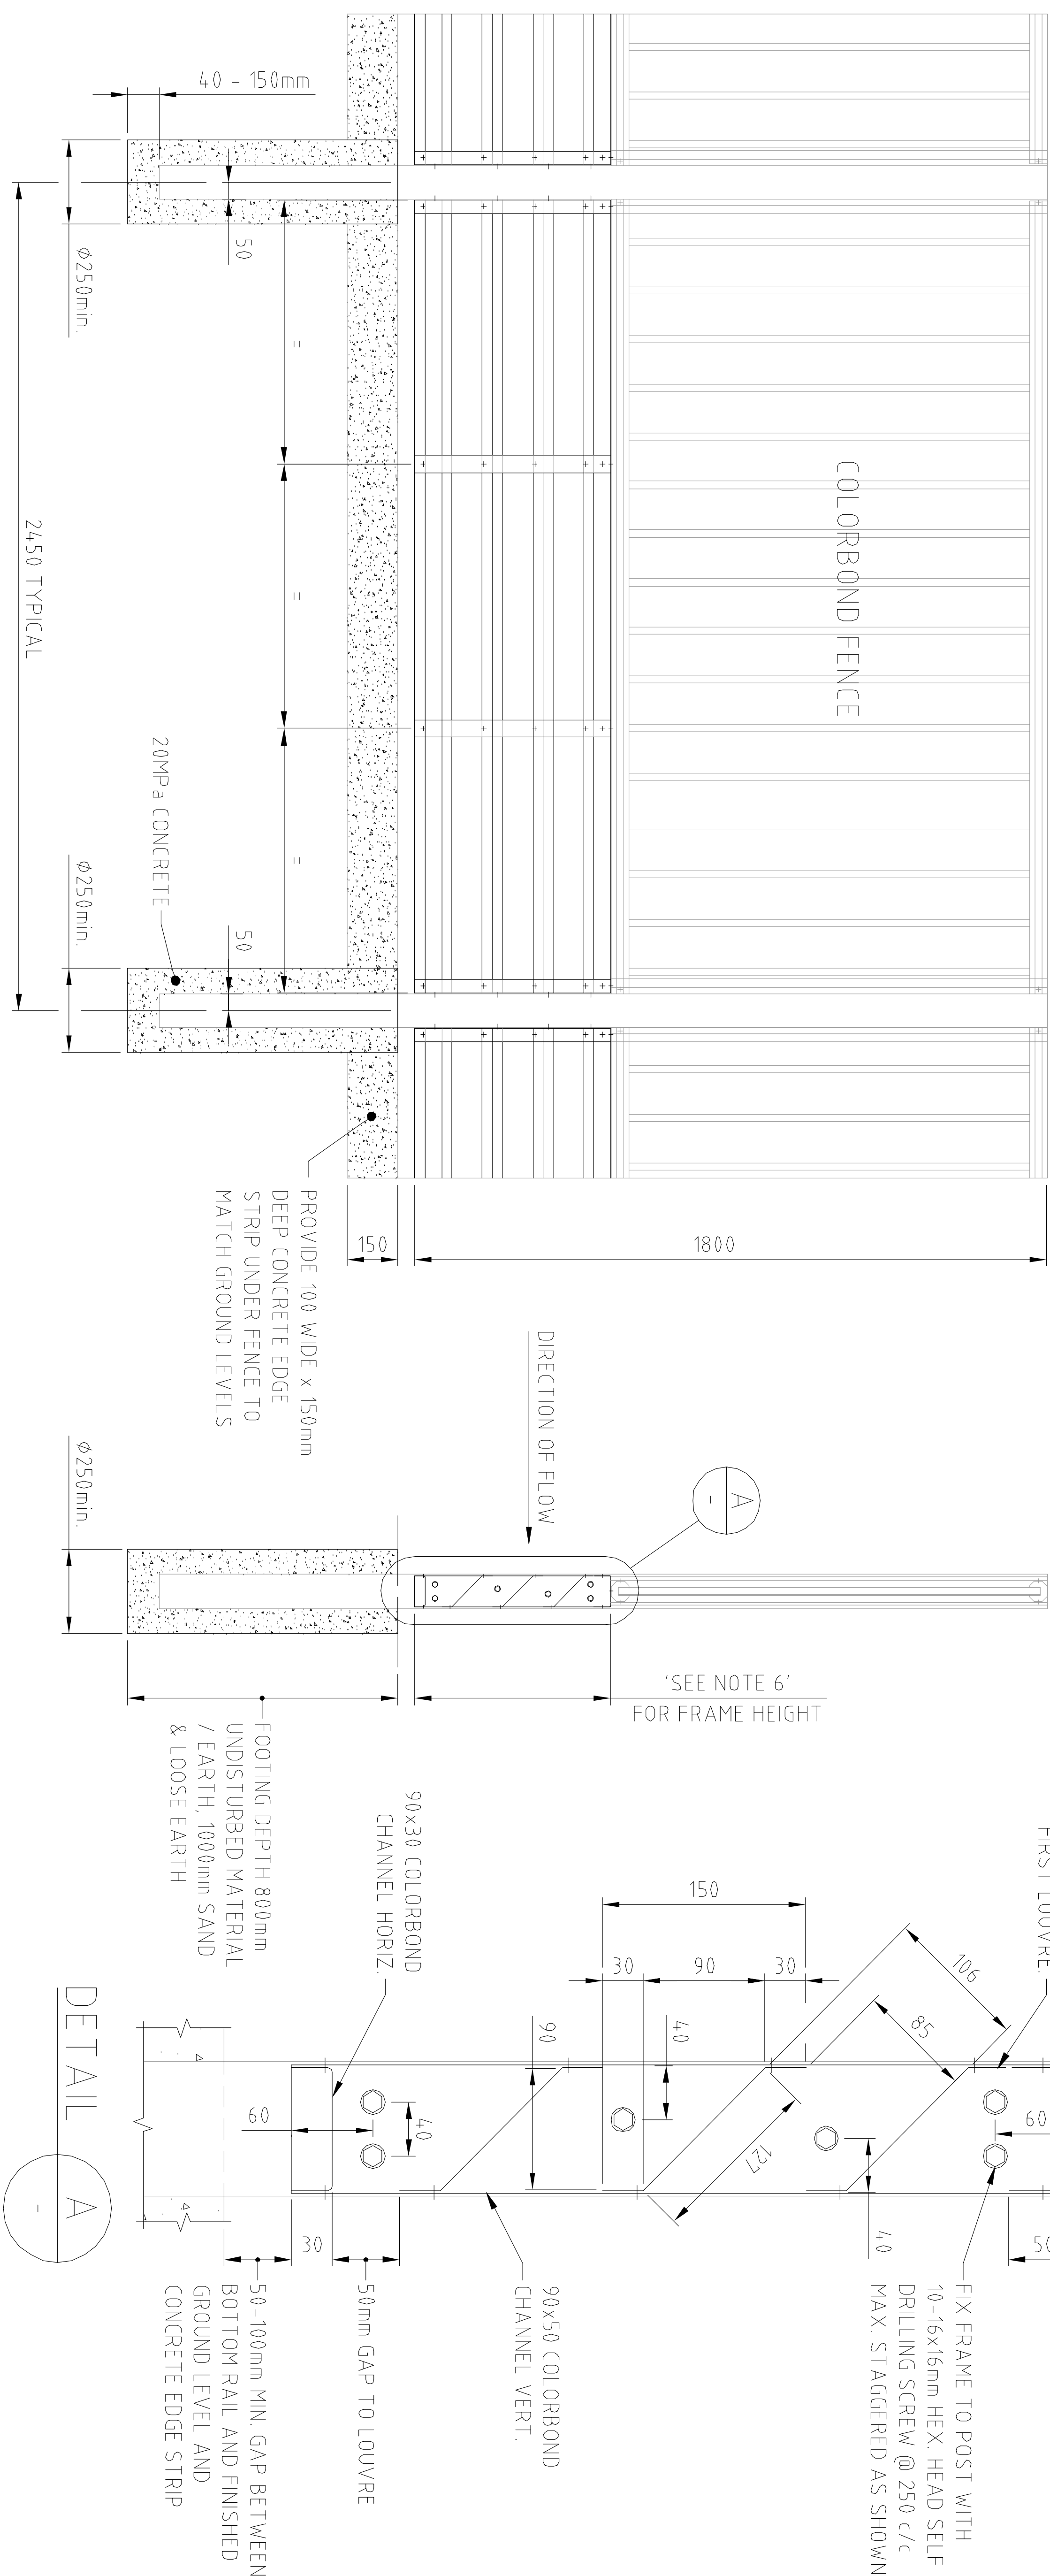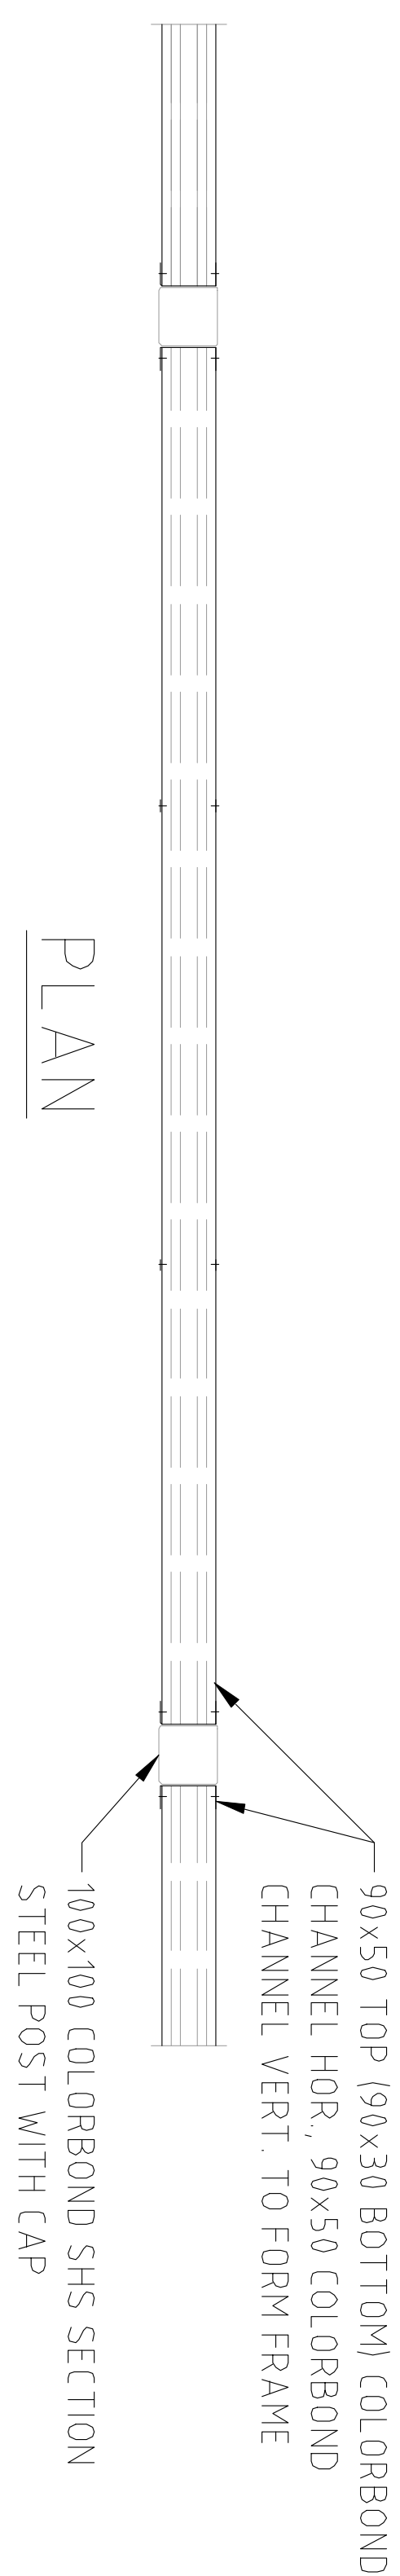

1. ALL SHARP EDGES AND CORNERS TO BE REMOVED.
2. USE LYSAGHT INTEGRITY 820 COLORBOND STEEL WITH BMT (BASE METAL THICKNESS) 0.48mm TO FORM LOUVRES AND FRAME.
3. SELF DRILLING & SELF TAPPING SCREWS WITH HEX WASHER HEAD TO CONFORM TO AS3566 CLASS 3.
4. FIX SCREWS MINIMUM OF 25mm FROM EDGES.
5. ALL LOOSE MATERIAL AROUND FOOTINGS IS TO BE RAMMED AND COMPACTED.
6. FRAME HEIGHT = 130+ (N*150)mm WHERE N = NUMBER OF LOUVRES AND FRAME HEIGHT MUST BE GREATER THAN OPENING HEIGHT APPROVED BY COUNCIL.
7. ALL DIMENSIONS ARE IN MILLIMETRES

ELEVATION

[illegible]