

Report Type: DA Access Report

Reference Number: 19242

Client: C & S Partners Mortgage and Insurance Pty Ltd with I Dream Property Pty Ltd

Site Address: 971 Richmond Road, Marsden Park NSW.



ACCESS REPORT

Vista Access Architects

Company Details

Vista Access Architects Pty. Ltd
ABN 82 124 411 614 ARN 6940
ACAA 281, CP 006, LHA 10032

Postal Address

POBox 353
Kingswood
NSW 2747

Contact details

www.accessarchitects.com.au
admin@accessarchitects.com.au
Farah Madon 0412 051 876

Project Summary:

This Access Compliance Report is to accompany a Development Application for the development proposed at 971 Richmond Road, Marsden Park, NSW.

This development proposes a six (6) New Building with 236 residential units and 16 commercial unit yield as per the table below:

| Building | Residential Units | Commercial Units | Stage | Adaptable |
|----------------|-------------------|------------------|-------|-----------|
| A | 39 | 3 | 2 | 7 |
| B | 30 | 2 | 2 | 0 |
| C | 35 | 4 | 2 | 4 |
| Total of A+B+C | 104 | | | 11 |
| D | 48 | 3 | 1 | 4 |
| E | 42 | 1 | 1 | 7 |
| F | 42 | 3 | 1 | 3 |
| Total of D+E+F | | | | 14 |
| Total | 236 | 16 | | 25 |

The blocks are identified as per the diagram below:



BCA considers Buildings A, B, C to be 1 building (due to common basement) and Building D, E, F to be one building. Therefore, Building A, B, C has a yield of 104 residential units and requires 11 Adaptable units (and 11 Accessible parking spaces for the adaptable units) to be provided in total within buildings A, B and C. Building D, E, F has a yield of 132 residential unit and requires 14 Adaptable units (and 14 Accessible parking spaces for adaptable units) to be provided in total within buildings D, E and F

The development is within Blacktown Council LGA that requires the provision of 10% Adaptable units and therefore the development proposes 25 Adaptable units.

The project also requires 48 Silver level Livable units to comply with the SEPP 65 Objective 4Q1, that requires 20% of the units to incorporate the features of the Silver level of the Livable Housing Guidelines. These are to be distributed as per the table above.

The development has building classification as detailed below;

- Class 2 (building containing more than 2 SOUs i.e. sole-occupancy units)
- Class 5 (office building for professional or commercial use)
- Class 6 (shops, sale of goods and services by retail)
- Class 7a (car park)
- Class 9b (assembly building, school)

This Access report is based on the relevant components of;

- Building Code of Australia (BCA) 2019, Volume 1- Performance requirements of DP1, DP2, DP8, DP9, EP3.4, FP2.1 and Parts D2, D3, E3 and F2 (where applicable)
- Disability (Access to Premises-Building) Standards 2010 (henceforth referred to as APS)
- AS1428.1-2009 Part 1: General requirements for access, including any amendments
- AS1428.4.1-2009 Part 4.1: TGSIs (Tactile ground surface indicators), including any amendments
- AS2890.6-2009 Part 6: Off-street parking for people with disabilities.
- AS4299-1995 Adaptable Housing
- AS1735 Lifts types included in the BCA including Part 12: Facilities for persons with disabilities
- State Environmental Planning Policy 65 (SEPP 65), Objective 4Q1, relating to requirements of the provision of Livable Housing Australia's Silver Level Apartments
- Livable Housing Australia's Livable Housing Design Guidelines- Fourth Edition

The assessment of the proposed development has been undertaken to the extent necessary to issue DA (Development application) consent under the Environmental Planning and Assessment Act. The proposal achieves the spatial requirements to provide access for people with a disability and it is assumed that assessment of the detailed requirements such as assessment of internal fit-out, details of stairs, ramps and other features will occur at CC (Construction Certificate) stage.

Paths of travel as designed as per the requirements of AS1428.1 – Design for access and mobility for all uses of the development, including commercial areas, childcare and common use residential areas as required under the BCA.

By compliance with the recommendation in this report, the development complies with the requirements of Access Code of Disability (Access to Premises-Building) Standards 2010, the Disability Access relevant sections of Building Code of Australia 2019, the requirements of SEPP 65 related to Objective 4Q1 - Livable Housing, and the essential criteria of AS4299-Adaptable Housing.

Assessed by



Vanessa Griffin

Access Consultant and LHA Assessor
ACAA Accredited Membership number 500
LHA Assessor Licence number 20035

Peer reviewed by



Farah Madon

Accredited Access Consultant and LHA Assessor
ACAA Accredited Membership number 281
LHA Assessor Licence number 10032

Vista Access Architects Pty. Ltd.

Relevant dates:

Fee proposal, number FP-9321 dated 06-08-2019. Fee proposal was accepted by Client on 06-08-2019.

Assessed Drawings:

The following drawings by Architex Architects have been assessed for compliance.

| Drawing no | Issue | Date | Details |
|------------|-------|------------|-------------------------------------|
| 01b | C | 15-07-2021 | Lot 1- Staging Plan |
| 02 | G | 15-07-2021 | Overall Site Plan |
| 03 | F | 05-10-2021 | Basement Level 3 |
| 04 | F | 05-10-2021 | Basement Level 2 |
| 05 | G | 05-10-2021 | Basement Level 1 |
| 06 | H | 05-10-2021 | Level 1/ Ground Floor |
| 07 | H | 05-10-2021 | Level 2 |
| 08 | G | 15-07-2021 | Level 3 |
| 09 | G | 15-07-2021 | Level 4 |
| 10 | H | 05-10-2021 | Level 5 |
| 11 | H | 05-10-2021 | Level 6 |
| 12 | H | 05-10-2021 | Level 7 |
| 13 | H | 05-10-2021 | Level 8 |
| 14 | H | 05-10-2021 | Roof Plan |
| 15 | C | 15-07-2021 | Level 02 – Block A |
| 16 | C | 15-07-2021 | Level 03-04 – Block A |
| 17 | C | 15-07-2021 | Level 05 – Block A |
| 18 | C | 15-07-2021 | Level 06 -08– Block A |
| 20 | C | 15-07-2021 | Level 02, 03, 04 Block B |
| 21 | C | 15-07-2021 | Level 05- 07 & Roof Level - Block B |
| 22 | C | 15-07-2021 | Level 02 Block C |
| 23 | C | 15-07-2021 | Level 03 - 04 Block C |
| 24 | C | 15-07-2021 | Level 05 Block C |
| 25 | C | 15-07-2021 | Level 06 - 08 Block C |
| 27 | D | 05-10-2021 | Level 02 – Block D |
| 28 | C | 15-07-2021 | Level 03-04 – Block D |
| 29 | D | 05-10-2021 | Level 05 – Block D |
| 30 | D | 05-10-2021 | Level 06-08 – Block D |
| 31 | D | 05-10-2021 | Roof Level – Block D |
| 32 | D | 05-10-2021 | Level 02– Block E |
| 33 | C | 15-07-2021 | Level 03-04– Block E |
| 34 | C | 15-07-2021 | Level 05– Block E |
| 35 | C | 15-07-2021 | Level 06-08– Block E |
| 37 | C | 15-07-2021 | Level 02 Block F |
| 38 | C | 15-07-2021 | Level 03-04Block F |
| 39 | C | 15-07-2021 | Level 05 Block F |
| 40 | C | 15-07-2021 | Level 06-08 Block F |
| 54 | A | 06-04-2020 | Post-Adaptable Layouts |

Document Issue:

| Issue | Date | Details |
|---------|------------|-------------------------------|
| Draft 1 | 15-10-2018 | Issued for Architect's review |
| Draft 2 | 27-02-2019 | Issued for Architect's review |
| Draft 3 | 27-03-2020 | Issued for Architect's review |
| A | 28-03-2020 | Issued for DA |
| B | 15-08-2021 | Issued for SOFC |
| C | 12-10-2021 | Issued for DA |
| D | 15-10-2021 | Issued for DA |

Limitations and Copyright information:

This report is based on discussions with the project architect and a review of drawings and other relevant documentation provided to us. No site visit was undertaken for the purposes of this project.

This assessment is based on the provided drawings and not based on constructed works, hence the assessment will provide assurance of compliance only if all the recommendations as listed in this report are complied with and constructed in accordance with the requirements of the current BCA, AS1428.1-2009 and other latest, relevant standards and regulations applicable at the time of construction. Assessment is based on classification/use of the building. If the Class of the building changes to any other building Class, this access report will have to be updated accordingly.

Unless stated otherwise, all dimensions mentioned in the report are net (CLEAR) dimensions and are not be reduced by projecting skirting, kerbs, handrails, lights, fire safety equipment, door handles less than 900mm above FFL (finished floor level) or any other fixtures/fit out elements. When we check drawings, we assume that the dimensions noted are CLEAR dimensions and therefore the Architect / Builder is to allow for construction tolerances. Only some numerical requirements from relevant AS (Australian Standards) have been noted in the report and for further details and for construction purposes refer to the latest relevant AS.

This report and all its contents are a copyright of Vista Access Architects Pty Ltd (VAA) and can only be used for the purposes of this particular project. This document may also contain Standards Australia Ltd copyrighted material that is distributed by SAI Global on Standards Australia Ltd.'s behalf. It may be reproduced in accordance with the terms of SAI Global Ltd.'s Licence 1801c001. Standards Australia Ltd.'s material is not for resale, reproduction or distribution in whole or in part without written permission from SAI Global Ltd.

This report is does not assess compliance matters related to WHS, Structural design, Services design, Parts of DDA other than those related to APS or Parts of BCA or Parts of AS other than those directly referenced in this report. VAA gives no warranty or guarantee that this report is correct or complete and will not be liable for any loss arising from the use of this report. We will use our best judgement in regards to the LHA assessments. However, we are not to be held responsible if another licenced LHA assessor comes to a different conclusion about compliance, certification or allocation of a particular Quality mark to us as a number of items are subject to interpretation.

We have no ability to check for slip resistance of surfaces. All wet areas, parking areas, pavement markings shall have the appropriate slip resistance for the location. We also have no ability to check for wall reinforcements once the walls have already been constructed. The builder is to take full responsibility that the requirements listed in this report are met and the construction to be as per requirements of AS1428.1/ AS4299 / AS2890.6/ AS3661/ AS4586

A report issued for DA (development application) is not suitable for use for CC (construction certificate) application.

Compliance assessment with Access related requirements of BCA
and Disability (Access to Premises-Building) Standards 2010 (APS)
BCA Part D3 Access for People with a Disability


| | |
|----------------------------|---|
| | BCA D3.1 General building Access requirements SOU refers to a Sole Occupancy Unit |
| Requirement | <p>Class 2</p> <p>For residential use components, access is required:</p> <ul style="list-style-type: none"> - From a required accessible pedestrian entrance to at least 1 floor with SOUs and till the entry of door of each SOU on that level. - To and within 1 of each type of room or space in common use. - Where floor is accessed by an AS1428.1 ramp or lift, access is required to the entry doorway of each SOU on that level and to and within all common use areas on that level. |
| Compliance Comments | <p>Complies with spatial requirements</p> <p>Building A</p> <ul style="list-style-type: none"> - Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts. - Access has been provided to at least 1 of each common use space such as communal room on ground level. - Access has been provided to common use garbage chutes and storage rooms on each floor level. <p>Building B</p> <ul style="list-style-type: none"> - Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts. - Access has been provided to at least 1 of each common use space such as communal garden Roof Top Level. - Where common use areas are on a floor that is accessible by means of a ramp or lift (roof top in this case), access has been provided to the same. - Access has been provided to common use garbage chutes and storage rooms on each floor level. <p>Building C</p> <ul style="list-style-type: none"> - Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts. - Access has been provided to at least 1 of each common use space such as communal garden on ground level - Access has been provided to common use garbage chutes and storage rooms on each floor level. <p>Building D</p> <ul style="list-style-type: none"> - Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts. - Access has been provided to at least 1 of each common use space such as communal garden on the Roof Top Level. - Where common use areas are on a floor that is accessible by means of a ramp or lift (roof top in this case), access has been provided to the same. - Access has been provided to common use garbage chutes and storage rooms on each floor level. <p>Building E</p> <ul style="list-style-type: none"> - Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts. - Access has been provided to at least 1 of each common use space such as communal garden on level 2. - Where common use areas are on a floor that is accessible by means of a ramp or lift (Levels 2 in this case), access has been provided to the same. - Access has been provided to common use garbage chutes and storage rooms on each floor level. |

Building F

- Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts.
- Access has been provided to at least 1 of each common use space such as common room on ground level.
- Access has been provided to common use garbage chutes and storage rooms on each floor level.



Details to be verified at CC stage of works.


Key plan shown below

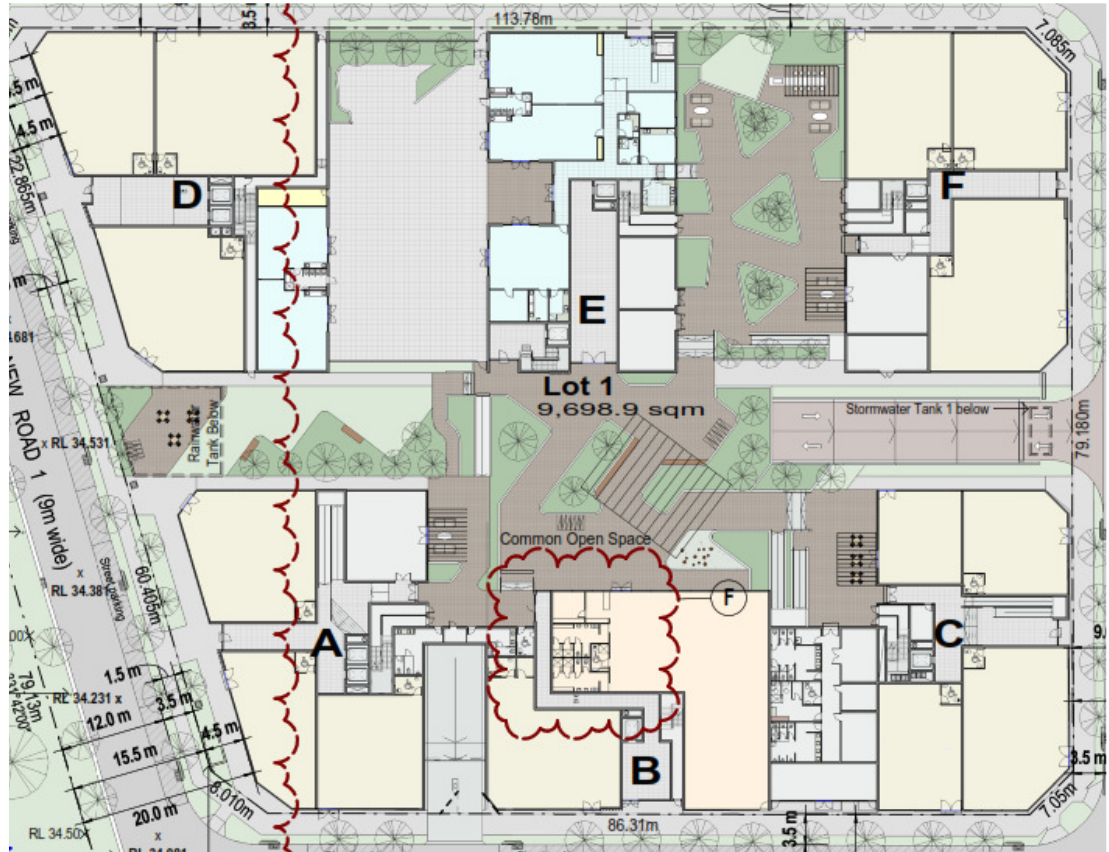

| | |
|----------------------------|---|
| Requirement | Class 5 / 6 |
| Compliance Comments | <ul style="list-style-type: none"> - To and within all areas that are normally used by the occupants. <p>Complies with spatial requirements</p> <ul style="list-style-type: none"> - Access has been provided to and within all areas required to be accessible. - Access is provided to the common use bin storage room for the commercial component. <p>Details to be verified at CC stage of works.</p> |
| Requirement | Class 7a- Covered car park. |
| Compliance Comments | <ul style="list-style-type: none"> - To and within any level containing accessible carparking spaces. <p>Complies with spatial requirements</p> <p>Access has been provided to all levels containing Accessible carparking spaces.</p> <p>Details to be verified at CC stage of works.</p> |
| Requirement | Class 9b- Schools and early childhood centres. |
| Compliance Comments | <ul style="list-style-type: none"> - To and within all areas that are normally used by the occupants. <p>Complies with spatial requirements</p> <p>Access has been provided to and within all areas required to be accessible.</p> <p>Details to be verified at CC stage of works.</p> |

| | |
|----------------------------|--|
| Requirement | Class 9b- Assembly building not being a schools and early childhood centres. <ul style="list-style-type: none"> - To wheelchair seating spaces (if applicable have been assessed further on in the report). - To all areas except tiers that do not contain wheelchair seating spaces. |
| Compliance Comments | Complies with spatial requirements Access has been provided to and within all areas required to be accessible. Wheelchair seating requirements have been discussed in detail further on in the report. Details to be verified at CC stage of works. |
| | |
| | BCA Part D3.2 Access to buildings |
| Requirement | Accessway is required from; <ul style="list-style-type: none"> - Main pedestrian entry at the site boundary for new buildings. - Any other accessible building connected by a pedestrian link. - Accessible car parking spaces. |
| Compliance Comments | Complies <u>Residential</u> Building A <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts. Building B <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts. Building C <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts. Building D <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts. Building E <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts. Building F <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts. <u>Commercial</u> Building A <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts and an accessible path of travel via the common open space between buildings ABC and DEF. Building B <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts and an accessible path of travel via the common open space between buildings ABC and DEF. Building C <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts and an accessible path of travel via the common open space between buildings ABC and DEF. Building D <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts |

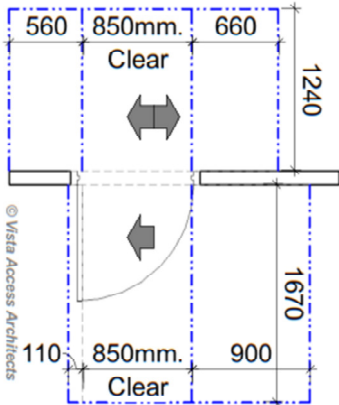
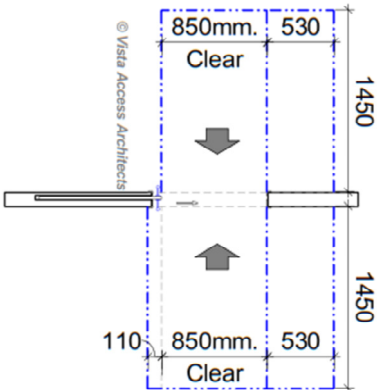
| | |
|----------------------------|--|
| | <p>Building E</p> <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts <p>Building F</p> <ul style="list-style-type: none"> - Level Access has been provided from the main pedestrian entry at the site boundary. - Access has been provided from accessible car parking spaces by means of lifts <p>Note: commercial parking has been restricted to building DEF, to restrict vehicular movements in the basement and provide access to a public lift. The commercial units to building ABC are still allocated parking as required. This is to increase foot traffic within the common open space for passive surveillance and retail purposes.</p> <p>Details to be verified at CC stage of works.</p> |
| Requirement | External Walkway / Pedestrian Access- to be as per requirements of AS1428-2009. |
| Compliance Comments | Capable of compliance. Details to be verified at CC stage of works. |
| Requirement | <p>Accessway is required through:</p> <ul style="list-style-type: none"> - Main entry; and - Not less than 50% of all pedestrian entrances; and - In building with floor area over 500m², non-accessible entry and accessible entry to be not more than 50M apart. |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |
| Requirement | <p>Where accessible pedestrian entry has Multiple doorways:</p> <ul style="list-style-type: none"> - At least 1 to be accessible if 3 provided - At least 50% to be accessible, if more than 3 provided - Where doorway has multiple leaves, at least 1 leaf is to have clear opening of 850mm (excluding automatic doors) |
| Compliance Comments | <p>Capable of compliance.</p> <p>In common use areas, all single hinged doors and in case of multiple leaf doorways, at least 1 operable leaf is required to provide a clear opening of 850mm with the door circulations spaces as per AS1428.1-2009.</p> <div style="display: flex; justify-content: space-around; align-items: flex-start;">   </div> |

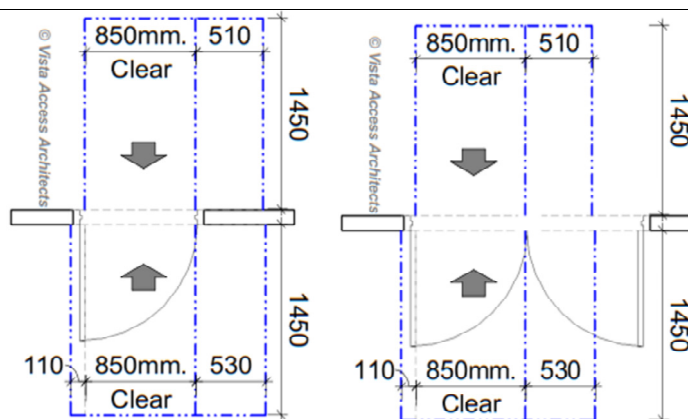

Note that the circulation spaces (other than doorway threshold ramp) to have a maximum floor grade of 1:40. Where there is a level difference at the door threshold, the maximum level difference can be 35mm if provided with a 1:8 doorway threshold ramp. This is achievable and the door selections are to be verified at CC stage of works.

BCA Part D3.3 Parts of buildings required to be accessible

| | |
|----------------------------|--|
| Requirement | Every Ramp with grades steeper than 1:20 and less than or equal to 1:14 (excluding fire-isolated ramp) is to be compliant with: <ul style="list-style-type: none"> - AS1428.1-2009 (including but not limited to - maximum grade of 1:14 with appropriate landings at a maximum of 9M of a flight of ramp). - 1M clear width to be provided between handrails / kerb / kerbrails. - Handrails and kerbs to be provided on both sides with appropriate handrails extensions. - Slip resistance of ramp and landings to comply with BCA Table D2.14 |
| Compliance Comments | Capable of compliance Detailed features of the ramp will be assessed with the requirements of AS1428.1-2009 at the CC stage of works |
| Requirement | Step ramp if provided is to be compliant with: <ul style="list-style-type: none"> - AS1428.1-2009 including max grade of 1:10, max height of 190mm, max length of 1.9M - Slip resistance of ramp and landings to comply with BCA Table D2.14. |
| Compliance Comments | N/A Not identified in the development |
| Requirement | Kerb ramp if provided is to be compliant with: <ul style="list-style-type: none"> - AS1428.1-2009 including max grade of 1:8, max height of 190mm, max length of 1.52M - Slip resistance of ramp and landings to comply with BCA Table D2.14. |
| Compliance Comments | N/A Not identified in the development |
| Requirement | Every Stairway (excluding fire-isolated stairway) is to be compliant with: <ul style="list-style-type: none"> - AS1428.1-2009 (including but not limited to opaque risers, handrails on both sides including appropriate handrail extensions between 1M clear width and compliant nosing strips). - Slip resistance to comply with BCA Table D2.14 when tested in accordance with AS4586. |
| Compliance Comments | Complies with spatial requirements. Where non-fire-isolated stairways have been provided, the features of the stairway will be assessed with the requirements of AS1428.1-2009 at the CC stage of works. |
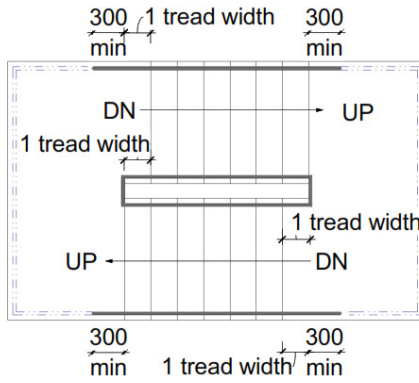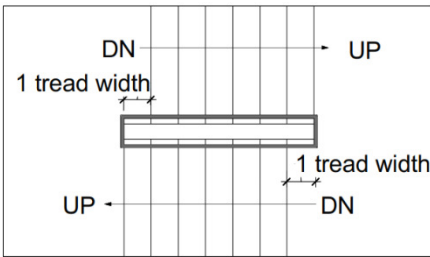
| | <div></div> <div><p>Note: In some cases, the stairway from the basement to the ground floor level is considered to be non-fire-isolated, in which case full compliance will be required as per AS1428.1-2009. Verify with the BCA consultant.</p><p>Note: For stairways with 90° to 180° turns at landings, in order for the handrails to comply with the consistent height requirement, the risers have to be offset at the mid-landings OR provided with a 300mm handrail extension, so that no vertical sections are created in the handrails. This applies to both non- fire-isolated and fire-isolated stairways.</p></div> | | | | | | | | | | | | | | | | | |
|--|--|-------------|--------------------|--|-----|-----|------------------------|-----------|-----------|--|-----------|-----------|--------------------------|-----------|-----------|------------------------------|----|----|
| Requirement | Handrail cross-section – for stairways and ramps to comply with AS1428.1-2009. <ul style="list-style-type: none">- Diameter of handrails to be between 30mm-50mm and located not less than 50mm from adjacent walls with no obstructions to top 270° arc. | | | | | | | | | | | | | | | | | |
| Compliance Comments | Capable of compliance. Details to be verified at CC stage of works. | | | | | | | | | | | | | | | | | |
| Requirement | Every Fire-isolated Stairway is to be compliant with AS1428.1-2009 in the following aspects: <ul style="list-style-type: none">- Handrail on one side (requirement under D2.17) with 1M clear space. Handrail extensions are not required however since the handrails cannot have any vertical sections and since handrail is required to be at a consistent height throughout the stairway including at landings, it may be essential to either provide handrail extensions or offset first riser going up at mid landings to achieve this at 90° to 180° turns.- Nosing strips 50mm-75mm wide with minimum of 30% luminance contrast and- Slip resistance to comply with BCA Table D2.14. | | | | | | | | | | | | | | | | | |
| Compliance Comments | Capable of compliance Detailed features of the fire-isolated stairways will be assessed with the requirements of AS1428.1 at the CC stage of works. <div><div></div><div><p>Note: For stairways with 90° to 180° turns at landings, in order for the handrails to comply with the consistent height requirement, the risers have to be offset at the mid-landings OR provided with a 300mm handrail extension, so that no vertical sections are created in the handrails. This applies to both non-fire-isolated and fire-isolated stairways.</p></div></div> | | | | | | | | | | | | | | | | | |
| Requirement | Slip resistance requirements as per BCA BCA Table D2.14 has the following Slip –resistance requirements when tested in accordance with AS4586: <table><tr><th rowspan="2">Application</th><th colspan="2">Surface conditions</th></tr><tr><th>Dry</th><th>Wet</th></tr><tr><td>Ramp steeper than 1:14</td><td>P4 or R11</td><td>P5 or R12</td></tr><tr><td>Ramp steeper than 1:20 but not steeper than 1:14</td><td>P3 or R10</td><td>P4 or R11</td></tr><tr><td>Tread or landing surface</td><td>P3 or R10</td><td>P4 or R11</td></tr><tr><td>Nosing or landing edge strip</td><td>P3</td><td>P4</td></tr></table> | Application | Surface conditions | | Dry | Wet | Ramp steeper than 1:14 | P4 or R11 | P5 or R12 | Ramp steeper than 1:20 but not steeper than 1:14 | P3 or R10 | P4 or R11 | Tread or landing surface | P3 or R10 | P4 or R11 | Nosing or landing edge strip | P3 | P4 |
| Application | Surface conditions | | | | | | | | | | | | | | | | | |
| | Dry | Wet | | | | | | | | | | | | | | | | |
| Ramp steeper than 1:14 | P4 or R11 | P5 or R12 | | | | | | | | | | | | | | | | |
| Ramp steeper than 1:20 but not steeper than 1:14 | P3 or R10 | P4 or R11 | | | | | | | | | | | | | | | | |
| Tread or landing surface | P3 or R10 | P4 or R11 | | | | | | | | | | | | | | | | |
| Nosing or landing edge strip | P3 | P4 | | | | | | | | | | | | | | | | |
| | Slip resistance requirements as per AS4299 AS4299 has slip resistance requirements based on requirements of AS3661 (Slip resistance of pedestrian surfaces) for the following areas: <ul style="list-style-type: none">- Floor surfaces in sanitary facilities including all toilets and bathrooms (essential feature).- Floor surfaces in the kitchens and Laundries (essential feature).- Pathways / walkways within the site, within landscaped areas, balconies and other external paved areas (desirable feature for Class A or B developments).- AS3661.1-1993 is an old Australian standard which has been superseded with AS4586:2013 (Slip resistance classification of new pedestrian surface materials). | | | | | | | | | | | | | | | | | |

| | |
|----------------------------|--|
| | HB 197/ HB198 An introductory guide to the slip resistance of pedestrian surface materials provides guidelines for the selection of slip-resistant pedestrian surfaces |
| Compliance Comments | Capable of compliance. For Slip resistance of surfaces the builder is required to provide a Certificate stating that the Slip resistance of the surfaces comply with the above listed requirements when tested as per AS4586. Details to be provided at the CC stage of works. |
| Requirement | Every Passenger lift is to comply with the requirements of BCA E3.6. |
| Compliance Comments | This has been assessed further in the report in the Lifts section. Refer to Lifts section. |
| Requirement | Passing spaces requirement It is a requirement to provide passing spaces in accessways complying with AS1428.1 at maximum 20 M intervals, where a direct line of sight is not available. Space required is 1800x2800mm (in the direction of travel). Chamfer of 400x400mm is permitted at corners. |
| Compliance Comments | N/A There are no accessways over 20M lengths in the development where a direct line of sight is not available. |
| Requirement | Turning spaces requirement It is a requirement to provide turning spaces in accessways complying with AS1428.1-2009 within 2M of the end of accessways where it is not possible to continue travelling and at every 20M intervals. CLEAR Space required is 1540mm x 2070mm in the direction of travel (measured from skirting to skirting). |
| Compliance Comments | Capable of compliance <ul style="list-style-type: none"> - Adequate turning spaces have been provided with minimum common use passageway widths being 1540mm clear or alternatively a space of 1540mm x 2070mm provided at or within 2M of the end of the passageway. - A space of 1540mm x 2070mm is also required / provided in front of all passenger lift doors. Details to be verified at CC stage of works. |
| Requirement | Carpet specifications Carpet if used in areas required to be accessible are to be provided with pile height or thickness not more than 11mm and carpet backing not more than 4mm bringing the total height to a maximum of 15mm. |
| Compliance Comments | Capable of compliance if carpets are provided in the common use areas and commercial use areas. Carpet selections generally take place at CC stage of works. Selection of carpets as specified above will lead to compliance. Details to be verified at CC stage of works. |
| | |
| | BCA Part D3.4 Exemption |
| Requirement | Access is not required to be provided in the following areas: <ul style="list-style-type: none"> - Where access would be inappropriate because of the use of the area - Where area would pose a health and safety risk - Any path which exclusively provides access to an exempted area |
| Compliance Comments | For information only. Areas such as lift machine rooms, fire services room, commercial kitchens etc. in the development are exempted from providing access under this clause due to WHS concerns. Where a care taker is provided in the development, the toilet provided exclusively for use by the caretaker can be excluded from providing access based on the provisions in this clause. Where exclusive staff use areas / amenities have been nominated in a child care facility, then the staff only use amenities can be excluded from providing access based on the provisions in this clause. |
| | |

| | |
|--|-------------------------------------|
| | BCA Part D3.5 Accessible Carparking |
|--|-------------------------------------|

| | |
|--------------------|--|
| Requirement | <p>Class 2</p> <p>There are no Accessible carparking requirements for a Class 2 under the BCA.</p> <p>If adaptable housing has been mandated by the Council, then carparking spaces for Adaptable units will be required under the requirements of AS4299- Adaptable housing.</p> |
|--------------------|--|

| | |
|--------------------|--|
| Requirement | <p>Class 2</p> <p>There are no Accessible carparking requirements for a Class 2 under the BCA.</p> <p>If adaptable housing has been mandated by the Council, then carparking spaces for Adaptable units will be required under the requirements of AS4299- Adaptable housing.</p> |
|--------------------|--|

| | |
|--------------------|--|
| Requirement | <p>Class 2</p> <p>There are no Accessible carparking requirements for a Class 2 under the BCA.</p> <p>If adaptable housing has been mandated by the Council, then carparking spaces for Adaptable units will be required under the requirements of AS4299- Adaptable housing.</p> |
|--------------------|--|

| | |
|----------------------------|--|
| Compliance Comments | <p>Capable of compliance</p> <p>Blacktown Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 233 units. 10% of 233 = 24 required Adaptable units.</p> <p>The accessible spaces have been shown highlighted in yellow below:</p> <p>As Building A, B and C are over and common basement and similarly Building D, E and F the following table details carparking:</p> |
|----------------------------|--|

| | |
|----------------------------|--|
| Compliance Comments | <p>Capable of compliance</p> <p>Blacktown Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 233 units. 10% of 233 = 24 required Adaptable units.</p> <p>The accessible spaces have been shown highlighted in yellow below:</p> <p>As Building A, B and C are over and common basement and similarly Building D, E and F the following table details carparking:</p> |
|----------------------------|--|


| | |
|----------------------------|--|
| Compliance Comments | <p>Capable of compliance</p> <p>Blacktown Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 233 units. 10% of 233 = 24 required Adaptable units.</p> <p>The accessible spaces have been shown highlighted in yellow below:</p> <p>As Building A, B and C are over and common basement and similarly Building D, E and F the following table details carparking:</p> |
|----------------------------|--|

| | |
|----------------------------|--|
| Compliance Comments | <p>Capable of compliance</p> <p>Blacktown Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 233 units. 10% of 233 = 24 required Adaptable units.</p> <p>The accessible spaces have been shown highlighted in yellow below:</p> <p>As Building A, B and C are over and common basement and similarly Building D, E and F the following table details carparking:</p> |
|----------------------------|--|

| | |
|----------------------------|--|
| Compliance Comments | <p>Capable of compliance</p> <p>Blacktown Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 233 units. 10% of 233 = 24 required Adaptable units.</p> <p>The accessible spaces have been shown highlighted in yellow below:</p> <p>As Building A, B and C are over and common basement and similarly Building D, E and F the following table details carparking:</p> |
|----------------------------|--|

| | |
|----------------------------|--|
| Compliance Comments | <p>Capable of compliance</p> <p>Blacktown Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 233 units. 10% of 233 = 24 required Adaptable units.</p> <p>The accessible spaces have been shown highlighted in yellow below:</p> <p>As Building A, B and C are over and common basement and similarly Building D, E and F the following table details carparking:</p> |
|----------------------------|--|

Basement 3 Building D, E, F (8 x residential spaces)








Basement 2 Building
D, E, F (7 x residential spaces)
A, B, C (4 x residential spaces)



Basement 1 Building
D, E, F (3 x commercial, 1 x childcare, 1 x gym spaces)
A, B, C (7 x residential spaces)



| | |
|--|---|
| | <p>One accessible compliant parking space is required to be allocated to each of the Adaptable units. Refer to the table and provide a distribution of Adaptable units.</p> <p>Detailed features of the accessible parking spaces are to be verified at CC stage of works.</p> |
| Requirement | <p>Class 5,</p> <ul style="list-style-type: none"> - 1 Accessible car parking space per 100 carparking spaces <p>Class 6</p> <ul style="list-style-type: none"> - 1 Accessible car parking space per 50 carparking spaces (up to 1000 spaces) and additional 1 Accessible car parking space per additional 100 spaces provided |
| Compliance Comments | <p>Capable of compliance</p> <p><u>Building A, B C</u></p> <p>Note: commercial parking has been restricted to building DEF, to restrict vehicular movements in the basement and provide access to a public lift. The commercial units to building ABC are still allocated parking as required. This is to increase foot traffic within the common open space for passive surveillance and retail purposes.</p> <p><u>Building D, E, F</u></p> <p>Total number of Accessible parking spaces required / provided for the commercial component of the development =3</p> <p>Detailed features of the accessible parking space to be verified at CC stage of works.</p> |
| Requirement | <p>Class 9b</p> <p>School - 1 Accessible car parking space per 100 spaces provided</p> <p>Other assembly building - 1 Accessible car parking space per 50 spaces provided and then additional 1 Accessible car parking space per additional 100 spaces provided</p> |
| Compliance Comments | <p>Capable of compliance</p> <p>Total number of Accessible parking spaces required / provided in the development = 2 x accessible spaces (1 space for childcare and 1 space for the gym)</p> <p>Note: commercial parking has been restricted to building DEF, to restrict vehicular movements in the basement and provide access to a public lift. The commercial units to building ABC are still allocated parking as required. This is to increase foot traffic within the common open space for passive surveillance and retail purposes.</p> <p>Detailed features of the accessible parking space to be verified at CC stage of works.</p> |
| AS2890.6-2009 requirements for Accessible car parking space | |
| Requirement | <ul style="list-style-type: none"> - Dedicated space 2.4Mx5.4M, Shared space 2.4Mx5.4M at the same level - Slip resistant flooring surface with maximum fall 1:40 in any direction or maximum 1:33 if bituminous and outdoors. - Central Bollard in shared space at 800+/-50mm from entry point . - Pavement marking in dedicated space by means of access symbol between 800mm-1000mm high placed on a blue rectangle of maximum 1200mm and between 500mm-600mm from its entry point (marking not required where allocated to an Adaptable unit). - Minimum headroom of 2.2M at entrances and 2.5M is required over shared zones as well as dedicated spaces. - Non-trafficked area of the shared space to have marking strips at 45°, 150-200mm wide at 200mm-300mm spaces (not required where driveways are used as shared spaces) |
| Compliance Comments | <p>Complies with spatial requirements.</p> <p>Details to be verified at the CC stage of works.</p> <p>Refer to diagrams below for requirements, especially in regards to head height requirements.</p> <p>Note: The pavement marking shall have the appropriate slip resistance for the location. This requirement is to be added to the project specifications to ensure compliance.</p> |

| | | |
|----------------------------|--|---|
| Compliance Comments | <p>Capable of compliance.</p> <p>Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works.</p> | |
| Requirement | <p>Braille and Tactile signage is required immediately outside an airlock or doorway that leads to separate male, female and accessible toilets.</p>  | |
| Compliance Comments | <p>Capable of compliance.</p> <p>Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works</p> | |
| Requirement | <p>Braille and Tactile signage is required to identify Ambulant Sanitary facilities</p> <p>Place sign on ambulant toilet cubicle door.</p>  | |
| Compliance Comments | <p>Capable of compliance</p> <p>Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance.</p> | |
| Requirement |  | <p>Braille and Tactile signage is required to identify Hearing Augmentation</p> <p>International sign of deafness is required to signage to identify a space with hearing augmentation, also identify the type of hearing augmentation, area covered and location of receivers if used.</p> |
| Compliance Comments | <p>Capable of compliance.</p> <p>If Hearing augmentation is provided, the signage for the same will be required.</p> <p>Details of selected signage to be verified at CC stage of works.</p> | |
| Requirement |  | <p>Braille and Tactile signage is required to identify a Fire exit door</p> <p>required by E4.5 by stating the 'Exit' and 'Level', followed by either:</p> <ul style="list-style-type: none"> - The floor level number or - Floor level descriptor or - A combination of both of the above. <p>Sign must be located on the side that faces a person seeking egress</p> <p>The "?" shown in image above is to be replaced with the floor level where the door is located. Image of the running person is optional.</p> |
| Compliance Comments | <p>Capable of compliance.</p> <p>All doors nominated as Exit doors require signage as described above.</p> <p>Signage selections generally take place at CC stage of works. Selection of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works.</p> | |
| Requirement |  | <p>Signage is required to a non-accessible pedestrian entrance</p> <p>as per AS1428.1-2009 to direct to the nearest accessible pedestrian entry.</p> <p><i>Arrow direction on this signage is indicative only and the direction of the arrow will be based on the location of the accessible entry.</i></p> |
| Compliance Comments | <p>Capable of compliance.</p> <p>Signage selections generally take place at CC stage of works. Selection of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works.</p> | |
| Requirement | <p>Signage is required where a bank of sanitary facilities is not provided with an accessible unisex sanitary facility.</p> | |

| | | | | | | | | | | | | | | | |
|---|---|--|--|-----------|----------|---------------------|---------|------------------------|------------------------------------|-----------|--------------------------|---|--------|----------------------------|--|
| Compliance Comments | N/A | | | | | | | | | | | | | | |
| Requirement | All signage is required to be as per Specification D3.6 Braille and Tactile Signs This includes location of signage, specifications in regards to braille and tactile characters, luminance contrast and lighting. | | | | | | | | | | | | | | |
| Compliance Comments | Capable of compliance. Signage selections generally take place at CC stage of works. Selection of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works. | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | |
| BCA Part D3.7 Hearing Augmentation | | | | | | | | | | | | | | | |
| Requirement | Hearing Augmentation is only required where an inbuilt amplification system (other than emergency) is installed in a Class 9b building, or in an auditorium, conference / meeting room or a reception area where a screen is used. | | | | | | | | | | | | | | |
| Compliance Comments | N/A No areas with inbuilt amplification have been identified in the development. This will be verified at the CC stage of works. | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | |
| BCA Part D3.8 Tactile indicators (TGSIs) | | | | | | | | | | | | | | | |
| Requirement | TGSIs are required when approaching: <ul style="list-style-type: none">- Stairways other than fire-isolated stairways.- Escalators / passenger conveyor / moving walk.- Ramp (other than fire-isolated ramps / kerb or step or swimming pool ramps).- Under an overhead obstruction of <2M if no barrier is provided.- When accessway meets a vehicular way adjacent to a pedestrian entry (if no kerb / kerb ramp provided at the location). Compliance is required with AS1428.4.1 including Luminance contrast and slip resistance requirements for all TGSIs. | | | | | | | | | | | | | | |
| Compliance Comments | Capable of compliance. TGSIs selections generally take place at CC stage of works. Selection of TGSIs as specified will lead to compliance and these selection details are to be verified at CC stage of works. | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | |
| BCA Part D3.9 Wheelchair seating spaces in Class 9b assembly buildings | | | | | | | | | | | | | | | |
| Requirement | Wheelchair seating spaces to be as below; <table><tr><td>Up to 150</td><td>3 spaces</td><td>1single+1group of 2</td></tr><tr><td>151-800</td><td>3 spaces+1/50 over 150</td><td>1single+1group of 2, ≥5 in a group</td></tr><tr><td>801-10000</td><td>16 spaces+1/100 over 800</td><td>< 2 single+<2groups of 2, ≥5 in a group</td></tr><tr><td>>10000</td><td>108spaces+1/200 over 10000</td><td>< 5 single+<5groups of 2, ≥10 in a group</td></tr></table> <ul style="list-style-type: none">- When <300 seats, wheelchair spaces are not to be in the front row- When >300 seats, 75%, wheelchair spaces are not to be in the front row- Locations to represent the range of seating options available | | | Up to 150 | 3 spaces | 1single+1group of 2 | 151-800 | 3 spaces+1/50 over 150 | 1single+1group of 2, ≥5 in a group | 801-10000 | 16 spaces+1/100 over 800 | < 2 single+<2groups of 2, ≥5 in a group | >10000 | 108spaces+1/200 over 10000 | < 5 single+<5groups of 2, ≥10 in a group |
| Up to 150 | 3 spaces | 1single+1group of 2 | | | | | | | | | | | | | |
| 151-800 | 3 spaces+1/50 over 150 | 1single+1group of 2, ≥5 in a group | | | | | | | | | | | | | |
| 801-10000 | 16 spaces+1/100 over 800 | < 2 single+<2groups of 2, ≥5 in a group | | | | | | | | | | | | | |
| >10000 | 108spaces+1/200 over 10000 | < 5 single+<5groups of 2, ≥10 in a group | | | | | | | | | | | | | |
| Compliance Comments | N/A No fixed seating has been identified within the development | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | |
| BCA Part D3.11 Limitations on Ramps | | | | | | | | | | | | | | | |
| Requirement | On an accessway: <ul style="list-style-type: none">- A series of connected ramps must not have a combined vertical rise of more than 3.6M;- And a landing for a step ramp must not overlap a landing for another step ramp or ramp. | | | | | | | | | | | | | | |
| Compliance Comments | Complies. Details to be verified at CC stage of works. | | | | | | | | | | | | | | |

| | |
|----------------------------|---|
| | |
| | BCA Part D3.12 Glazing on Accessways |
| Requirement | Glazing requirements: Where there is no chair rail, handrail or transom, all frameless or fully glazed doors, sidelights and any glazing capable of being mistaken for a doorway or opening are required to have a glazing strip as per requirements of AS1428.1 |
| Compliance Comments | Capable of compliance Glazing strips are required to be provided to full length glazed areas (doors and windows) used in common use areas such as lift lobbies, common passageways and in all commercial use areas and childcare centre areas. Glazing strip selections generally take place at CC stage of works. Selection of glazing strips as specified above will lead to compliance and these selection details are to be verified at CC stage of works. |
| | |
| | BCA Part F Accessible Sanitary Facilities |
| | BCA F2.4 Accessible sanitary facilities |
| Requirement | Accessible unisex toilet is to be provided in accessible part of building such that; <ul style="list-style-type: none"> - It can be entered without crossing an area reserved for 1 sex only - Where male and female sanitary facilities are provided at different locations, Accessible unisex toilet is only required at one of the locations - Even distribution of LH and RH facilities - An accessible facility is not required on a level with no lift / ramp access. |
| Compliance Comments | Capable of compliance 18 unisex accessible toilets have been provided in the development. <p><u>Residential A, B, C</u></p> <ul style="list-style-type: none"> - Building B: 1 unisex accessible RH transfer toilet to the roof top <p><u>Residential D, E, F</u></p> <ul style="list-style-type: none"> - Building D: 1 unisex accessible RH transfer toilet to the roof top <p><u>Commercial A, B, C</u></p> Unit 101 - 1 unisex accessible LH transfer toilet Unit 102 - 1 unisex accessible LH transfer toilet Unit 104 – 1 unisex accessible RH transfer toilet Unit 105 - 1 unisex accessible LH transfer toilet Unit 106 - 1 unisex accessible LH transfer toilet Unit 107 - 1 unisex accessible RH transfer toilet and shower Unit 108 - 1 unisex accessible RH transfer toilet Unit 109 - 1 unisex accessible RH transfer toilet <p><u>Commercial common use A, B, C</u></p> Ground Level - 1 unisex accessible LH transfer toilet Ground Level - 1 unisex accessible RH transfer toilet Roof top to Building B - 1 unisex accessible RH transfer toilet <p><u>Commercial D, E, F</u></p> Unit 110 - 1 unisex accessible LH transfer toilet Unit 111 - 1 unisex accessible RH transfer toilet Unit 112 - 1 unisex accessible LH transfer toilet Unit 113 - 1 unisex accessible LH transfer toilet Unit 114 - 1 unisex accessible RH transfer toilet Unit 115 - 1 unisex accessible RH transfer toilet Childcare Centre - 1 unisex accessible LH transfer toilet and shower <p>This detail is capable of compliance at the CC stage of works.</p> |
| Requirement | Accessible unisex toilet are to be designed in accordance with AS1428.1-2009 |
| Compliance | Capable of compliance. |

| | |
|-----------------------------------|--|
| <p>Comments</p> | <p>Detailed features of the Accessible unisex toilet will be assessed with the requirements of AS1428.1-2009 at the CC stage of works.</p> <div data-bbox="363 241 1117 784"> </div> <p><i>RH transfer toilet shown above</i> <i>LH transfer toilet shown above</i> Note: Location of door is indicative only.</p> |
| <p>Requirement</p> | <p>Ambulant use male / female toilets are to be provided if an additional toilet to the Accessible unisex toilet is provided</p> |
| <p>Compliance Comments</p> | <p>Capable of compliance</p> <p>The following Ambulant facilities are to be provided: Building A, B, C – commercial Common Use Building A : 1 x Male and 1 x Female ambulant Common Use Building C : 1 x Male and 1 x Female ambulant Unit 107 (gym) : 1 x Male and 1 x Female ambulant</p> <p>Details to be verified at CC stage of works.</p> |
| <p>Requirement</p> | <p>Ambulant use toilets are to be designed in accordance with AS1428.1-2009</p> |
| <p>Compliance Comments</p> | <p>Capable of compliance. Detailed features of the Ambulant use toilets will be assessed with the requirements of AS1428.1 at the CC stage of works.</p> <div data-bbox="343 1366 1125 1792"> </div> |

| | |
|----------------------------|--|
| | |
| | |
| | BCA F2.4(a) Accessible unisex sanitary compartments |
| Requirement | Class 2 - At least 1 unisex Accessible toilet when sanitary compartments are provided in common areas. |
| Compliance Comments | Capable of compliance 2 unisex accessible toilets have been provided in the development. <u>Residential A, B, C</u> - Building B: 1 unisex accessible RH transfer toilet to the roof top <u>Residential D, E, F</u> - Building D: 1 unisex accessible RH transfer toilet to the roof top |
| Requirement | Class 5, 6, 9 - 1 unisex Accessible toilet on every storey containing sanitary compartments. - Where more than 1 bank of sanitary compartments on a level, at 50% of banks |
| Compliance Comments | Complies The following unisex accessible WC's are provided to the development: <u>Commercial A, B, C</u> Unit 101 - 1 unisex accessible LH transfer toilet Unit 102 - 1 unisex accessible LH transfer toilet Unit 104 - 1 unisex accessible RH transfer toilet Unit 105 - 1 unisex accessible LH transfer toilet Unit 106 - 1 unisex accessible LH transfer toilet Unit 107 - 1 unisex accessible RH transfer toilet and shower Unit 108 - 1 unisex accessible RH transfer toilet Unit 109 - 1 unisex accessible RH transfer toilet <u>Commercial common use A, B, C</u> Ground Level - 1 unisex accessible LH transfer toilet Ground Level - 1 unisex accessible RH transfer toilet <u>Commercial D, E, F</u> Unit 110 - 1 unisex accessible LH transfer toilet Unit 111 - 1 unisex accessible RH transfer toilet Unit 112 - 1 unisex accessible LH transfer toilet Unit 113 - 1 unisex accessible LH transfer toilet Unit 114 - 1 unisex accessible RH transfer toilet Unit 115 - 1 unisex accessible RH transfer toilet Childcare Centre - 1 unisex accessible LH transfer toilet and shower |
| | |
| | BCA F2.4(b) Requirements for Accessible unisex showers |
| Requirement | Class 2 - At least 1 unisex Accessible shower when showers are provided in common areas. |
| Compliance Comments | N/A No common use shower facilities have been identified in the residential component of the development. |
| Requirement | Class 5, 6, 9 - When BCA requires provision of 1 or more showers, then 1 for every 10 showers. |
| Compliance Comments | Capable of compliance <u>Commercial A, B, C</u> Unit 107 - 1 unisex accessible RH transfer toilet and shower <u>Commercial D, E, F</u> Childcare Centre - 1 unisex accessible LH transfer toilet and shower |

| | |
|----------------------------|---|
| | |
| | |
| | BCA Part E Lift Installations |
| | |
| | BCA E3.2 Stretcher facility in lifts |
| Requirement | A Stretcher lift is to be provided if a passenger lift is installed to serve any storey with an effective height of 12M. The space requirement is 600mm wide x 2000mm deep x 1400mm high above the floor level. Confirm this requirement with your BCA consultant. |
| Compliance Comments | For information only Check requirement with BCA consultant. |
| | |
| | BCA E3.6 Passenger lift |
| Requirement | In an accessible building, Every Passenger Lift (excluding electric passenger lift, electrohydraulic passenger lift, inclined lift) must be subject to limitations on use and must comply with Tables E3.6a and E3.6b |
| Compliance Comments | Capable of compliance. A certificate of compliance from the lift supplier will be required at the CC stage of works stating that the proposed lift complies with the requirements of BCA Part E3- Lift installations. |
| Requirement | Limitations on use of Stairway platform lifts, Low-rise platform lift, Low-rise, low-speed constant pressure lift and small sized, low-speed automatic lift |
| Compliance Comments | N/A Not identified in the development. |
| Requirement | Handrail requirements for passenger lifts. Apart from stairway platform lift and low-rise lifts, a handrail is required as per AS1735.12. |
| Compliance Comments | Capable of compliance. Details to be verified at CC stage of works. |
| Requirement | Lift floor dimensions (excluding stairway platform lift) - Lifts traveling 12M or under, floor size, 1100mm wide x 1400mm deep - Lifts travelling more than 12M, floor size 1400mm wide x 1600mm deep |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. Additional lift car size may apply if stretcher lift is required under the BCA. |
| Requirement | Minimum Door opening size complying with AS1735.12, not less than 900mm clear (excluding stairway platform lift). |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |
| Requirement | All lifts with a power operated door are required to have a Passenger protection system complying with AS1735.12. |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |
| Requirement | Lift landing doors to be provided at upper landing (excluding stairway platform lift). |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |
| Requirement | Lift car and landing control buttons to comply with AS1735.12 (excluding stairway platform lift and low-rise platform lift). |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |
| Requirement | Lighting (for all enclosed lift cars) to be provided in accordance with AS1735.12 and AS1680. Minimum illuminance of 100 lx is required at the level of the car floor and average of 50 lx is required on the control panel surface. |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |

| | |
|----------------------------|--|
| Requirement | To all lifts serving more than 2 levels , audible and visual indication to be provided as per AS1735.12. |
| Compliance Comments | Capable of compliance. Details to be verified at CC stage of works. |
| Requirement | Emergency hands free communication (excluding stairway platform lift) – provide a button that alerts a call centre and a light that the call has been received. |
| Compliance Comments | Capable of compliance Details to be verified at CC stage of works. |

Additional Features required as per AS1428

Refer to AS1428 for full list of requirements.

| | |
|----------------------------|--|
| | <p>The following accessibility requirements apply only to:</p> <ul style="list-style-type: none"> - Common use areas within the residential component (including passageways leading to SOUs) - To all areas within the commercial use components and Child care center. |
| Requirement | <p>Accessway width requirements</p> <ul style="list-style-type: none"> - All Accessway widths are to be a minimum of 1M clear (measured from skirting to skirting) with vertical clearance of at least 2M |
| Compliance Comments | <p>Complies.</p> <p>Details to be verified at CC stage of works.</p> |
| Requirement | <p>Doorway requirements</p> <ul style="list-style-type: none"> - All common use doorways in the development to be in accordance with AS1428.1 - Door thresholds are to be level or they can incorporate a Threshold ramp as per AS1428.1 i.e. max 1:8 grade, max height of 35mm and located within 20mm of door leaf. - Distance between successive doorways in airlocks to be 1450mm which is measured when the door is in open position in case of swinging doors. |
| Compliance Comments | <p>Capable of compliance.</p> <p>Details to be verified at CC stage of works.</p> |
| Requirement | <p>Door hardware requirements</p> <ul style="list-style-type: none"> - Door hardware including door handles, door closers and the in-use indicators / snibs in accessible and ambulant toilets are required to comply with requirements of AS1428.1. |
| Compliance Comments | <p>Capable of compliance.</p> <p>Door hardware selections generally take place at CC stage of works.</p> <p>Selection of door hardware as specified above will lead to compliance and these selection details are to be verified at CC stage of works.</p> |
| Requirement | <p>Luminance contrast requirements for doorways.</p> <ul style="list-style-type: none"> - All doorways to have a minimum luminance contrast of 30% provided as per AS1428.1 with the minimum width of the luminance contrast to be 50mm. |
| Compliance Comments | <p>Capable of compliance.</p> <p>Painting schedule is generally developed at the CC stage of works. The painting schedule of walls/doors and door frames are to consider the above requirements when colours are selected. Generally a light colour door with a dark colour frame will satisfy requirements. Selection details are to be verified at CC stage of works.</p> |
| Requirement | <p>Floor or ground surfaces</p> <ul style="list-style-type: none"> - Use slip-resistant surfaces. The texture of the surface is to be traversable by people who use a wheelchair and those with an ambulant or sensory disability. - Abutment of surfaces is to have a smooth transition. Construction tolerances to be as per AS1428.1 - Grates if used in the accessible path of travel is required to comply with the requirements as per AS1428.1 |
| Compliance Comments | <p>Capable of compliance.</p> <p>Floor surface selections generally take place at CC stage of works.</p> <p>Selection of floor surfaces as specified above will lead to compliance and these selection details are to be verified at CC stage of works.</p> |
| | <p>Switches, Controls and Lighting requirements</p> <ul style="list-style-type: none"> - All switches and controls (including controls for intercom facilities and external lift control buttons) on an accessible path of travel, Accessible SOUs and Accessible sanitary facilities to be located as per requirements of AS1428.1 |
| Compliance Comments | <p>Capable of compliance.</p> <p>Lighting fixture selections and locations generally take place at CC stage of works. Selection of lighting fixtures and locating them as specified above will lead to compliance. These selection/location details are to be verified at CC stage of works.</p> |

AS4299.1995- Adaptable Housing

Appendix A of AS4299 schedule is a list of features to be incorporated into a housing unit for it to be termed an 'Adaptable House'.

There are 3 Classification levels for Adaptable Housing

Adaptable Class A in which all 119 essential and all desirable features are to be incorporated.

Adaptable Class B in which all essential and 50% of 64 available desirable features are to be incorporated

Adaptable Class C in which all essential features are to be incorporated.

25 Adaptable units are required by the Council's DCP to a Class C level.


The units designated as adaptable are unit numbers

| Building | Adaptable Units No's | Total |
|----------|--|----------|
| A, B, C | A206, A305, A405, A504, A604, A704, A804, C204, C304, C404, C503 | 11 Units |
| D, E, F | D501, D601, D701, D801, E204, E304, E404, E504, E604, E704, E804, F203, F303, F403 | 14 Units |


At DA stage there is insufficient information to certify compliance with the Standard, however, in accordance with the table below, the nominated units can comply with the spatial requirements of AS4299 for Adaptable Housing.

Building A, B, C


Pre-adaptation layout

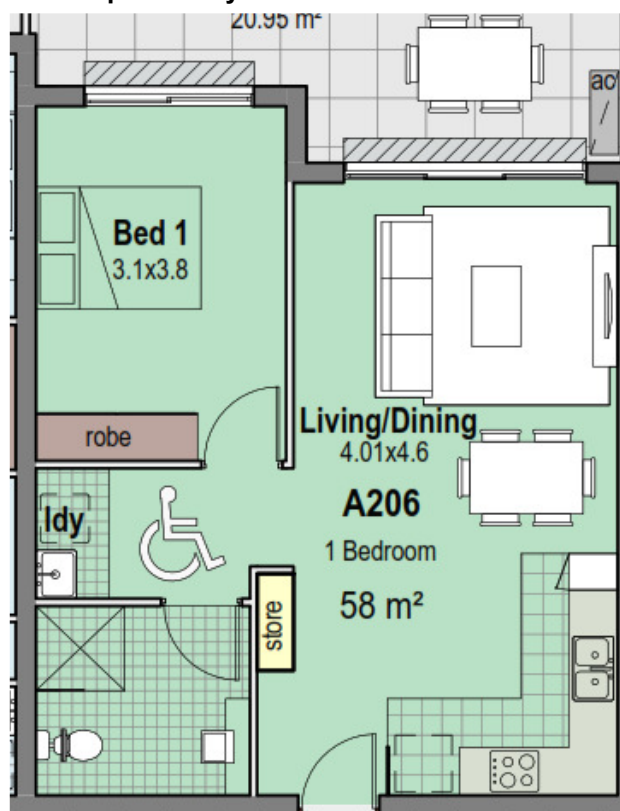


Post-adaptation layout

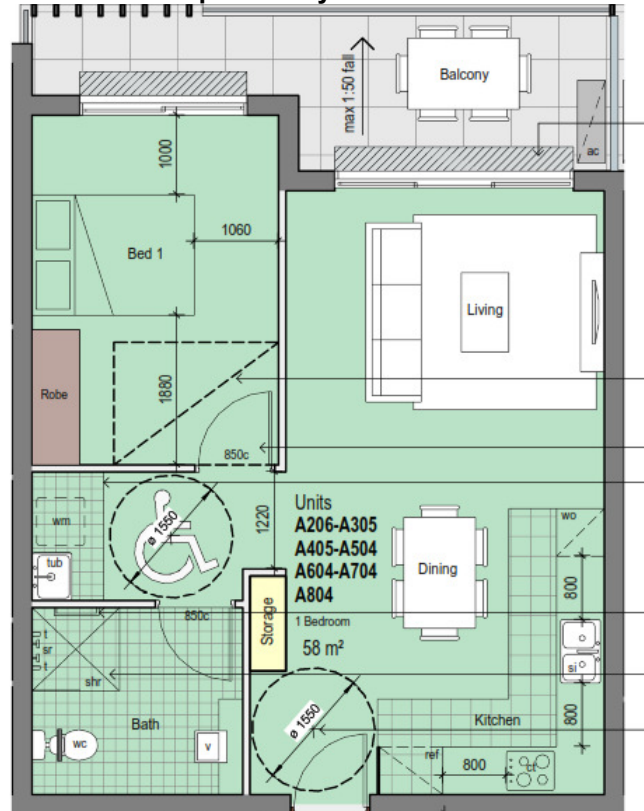

Building C, E, F Pre-adaptation layout

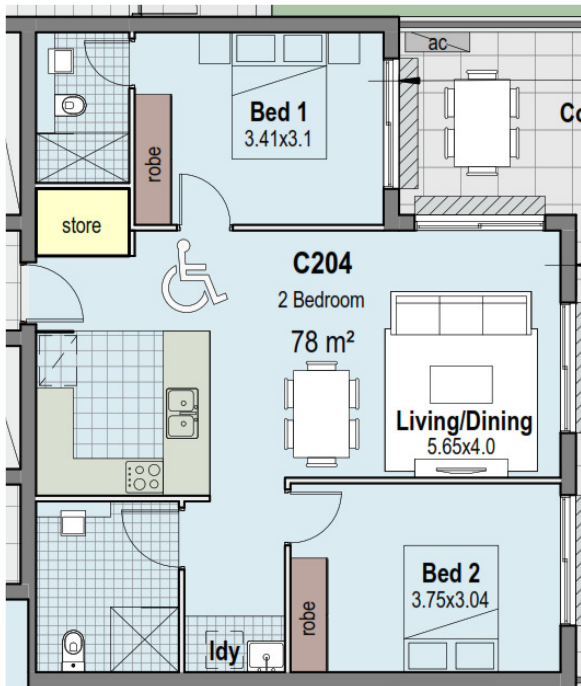


Post-adaptation layout

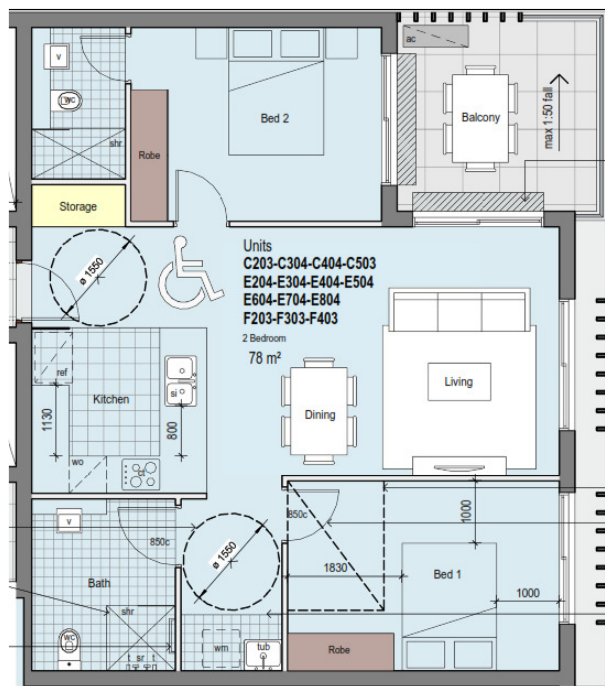

Note: Unit C203 is noted on the post adapt plan and this should be C204.


Note: At post adaptation a minimum clear space of 1550mm is required between the kitchen benchtops

Building D Pre-adaptation layout

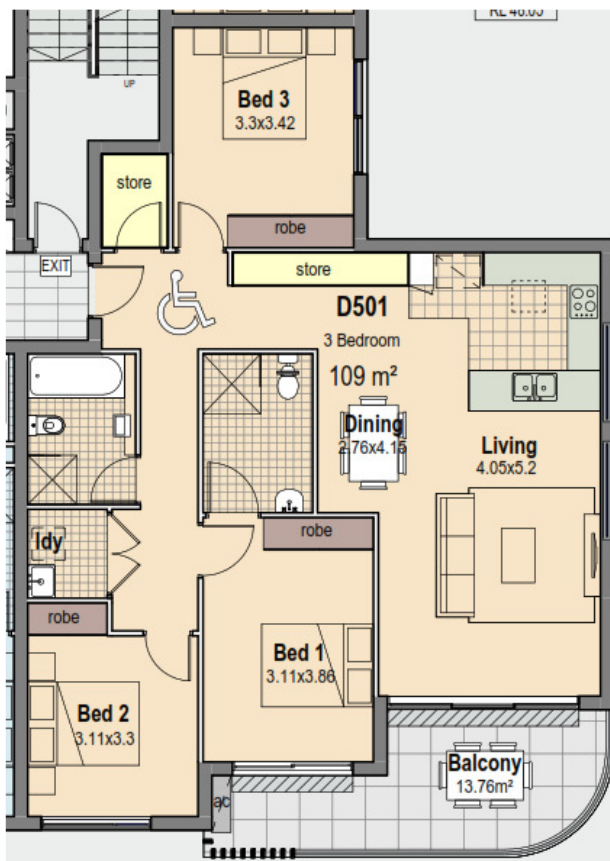

Post-adaptation layout

- Blocks C, E & F

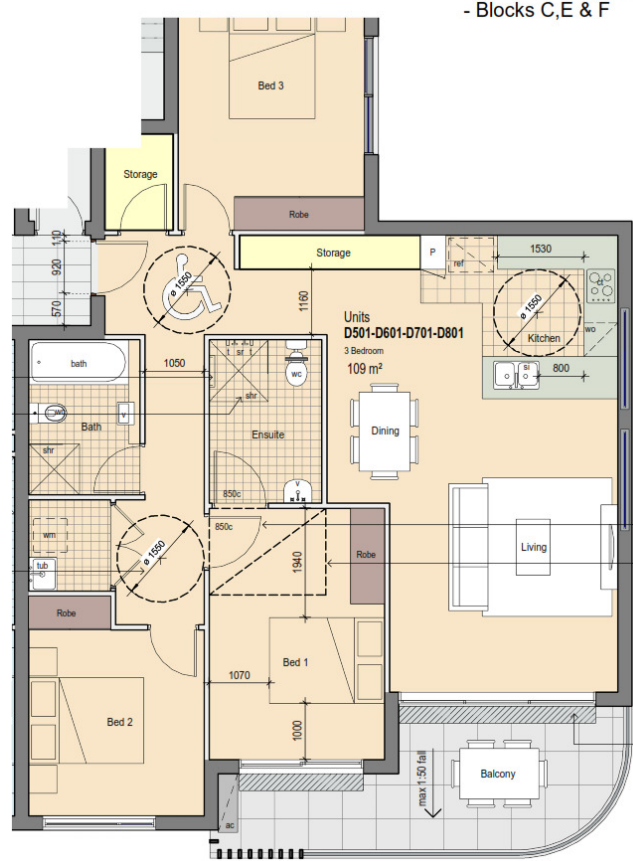

By incorporating the essential requirements listed Checklist below in the Specifications, the nominated Adaptable units can achieve full compliance with Adaptable House Class C


AS4299.1995 - Class C – Essential requirements.

R☑= Required;

C☑ =Capable of compliance at **by adding the requirement to the project specifications** or in some cases capable of compliance at post adaptation stage (where noted in comments).

| Requirements as per AS4299 | R | C | Comments |
|--|---|---|--|
| Siting | | | |
| An AS1428.1 compliant, continuous accessible path of travel is required from street frontage and vehicle parking to entry doorway of the Adaptable unit. | ☑ | ☑ | Complies. Access is provided from street by means of an AS1428.1 compliant ramp / walkway and from accessible parking space by means of a lift. Details to be verified at the CC stage |
| Letter boxes | | | |
| Letterboxes to be on hard standing area connected to accessible pathway | ☑ | ☑ | Capable of compliance. Details to be verified at the CC stage |
| Parking | | | |
| Car parking space or garage of minimum 6.0Mx 3.8M or a hard surfaced level outside of 5.4Mx3.8M is to be provided as a sheltered car park or can be provided in the future | ☑ | ☑ | Complies. Space can also be provided as per AS2890.6 Details to be verified at the CC stage |


Accessible Entry

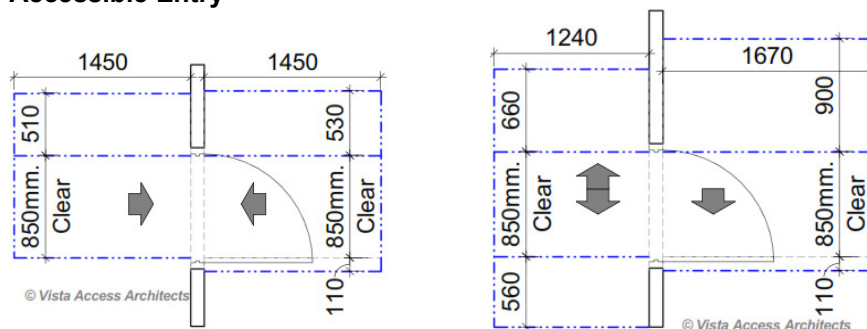

| | | | |
|--|---|---|---|
| Door circulation requirements of AS1428.1 with approach directions shown with arrows below. Accessible entry to be provided with, <ul style="list-style-type: none"> - An accessible door threshold - 1550mm diameter landing - 850mm clear opening door with clearances, door hardware operable with one hand and located 900-1100mm above floor | ☑ | ☑ | Capable of compliance. Details to be verified at the CC stage |
| Interior: General | | | |
| <ul style="list-style-type: none"> - Internal doors to have 820mm minimum clearance with provision for compliance with AS1428.1 for door approaches and minimum corridors width of 1M - Door hardware operable with one hand and located 900-1100mm above floor | ☑ | ☑ | Capable of compliance. Provide an 850mm clear opening door to the adaptable bathroom and 1 main bedroom. Rest to have 820mm clear opening. Details to be verified at the CC stage |
| Living room and dining room | | | |
| Circulation space of minimum 2250mm diameter. | ☑ | ☑ | Complies. |
| Kitchen | | | |
| It is general industry practice to accept that kitchen is something that has a very short life span and can be completely replaced when required to be adapted. As such only the following requirements apply, <u>Potential of achieving the following at Post- Adaptation:</u> <ul style="list-style-type: none"> - Minimum width 2.7M and 1550mm clear between benches - Provision for circulation at doors to comply with AS1428.1 (if doors provided) | ☑ | ☑ | Can be compliant post adaptation. Details to be verified at the CC stage |


| | | | |
|---|--|--|--|
| - Provision for benches, taps, cooktops, ovens as required under AS4299 | | | |
|---|--|--|--|

Main bedroom

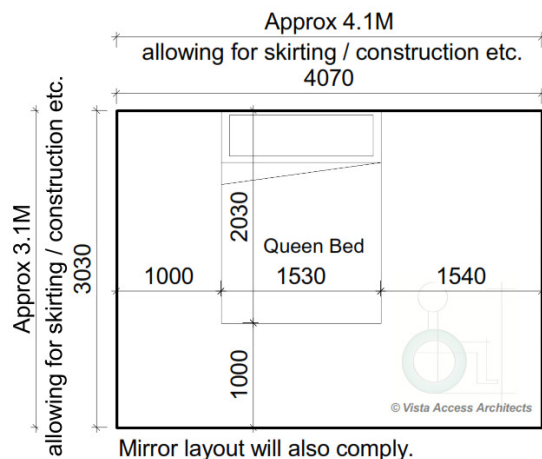

| | | | |
|---|-------------------------------------|-------------------------------------|--|
| At least one bedroom of area sufficient to accommodate a queen size bed and wardrobe and circulation space requirements of AS1428.2 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Complies Details to be verified at the CC stage |
|---|-------------------------------------|-------------------------------------|--|

Main Adaptable bathroom

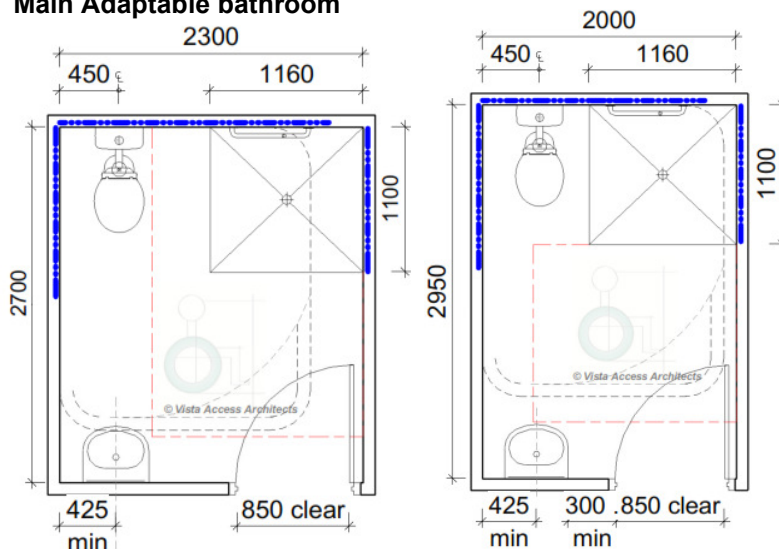


Post Adaptation bathroom layout shown
 Noted dimensions in these diagrams are approximate and depend on selected features such as size of the basin. These dimensions include allowances for reinforcements and normal construction tolerances.
 Thick blue line indicates the location of wall reinforcements which are to be provided at pre-adaptation itself. Red dotted line indicates the shower circulation space. Black dotted line indicates the WC pan circulation space.

| | | | |
|---|-------------------------------------|-------------------------------------|--|
| <ul style="list-style-type: none"> - Provision for bathroom area with Circulation spaces of Shower and WC (including fixtures) to comply with AS1428.1. - Note that wall reinforcements and waterproofing details to comply with AS4299 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Complies A bathroom with minimum space of 2Mx 2.95M or 2.3Mx2.7M or 2.4Mx2.45M is achievable. Wall reinforcement details to be verified at the CC stage. |
|---|-------------------------------------|-------------------------------------|--|

Wall reinforcement requirements at Pre-adaptation

Reinforcement requirements for the Adaptable unit for WC and shower (in post-adaptive position) showed hatched. Refer to AS4299 for further details.

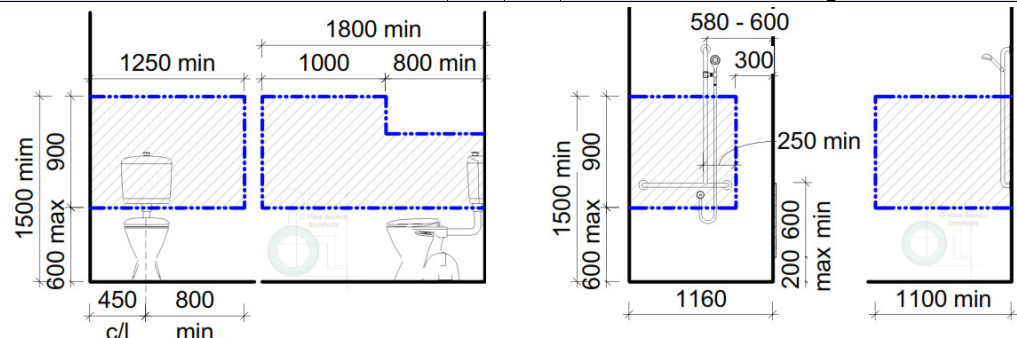

| | | | |
|--|-------------------------------------|-------------------------------------|--|
| Laundry | | | |
| <ul style="list-style-type: none"> - Provision for adequate circulation space in front of or besides appliances (minimum 1550mm depth) - Circulation at doors to comply with AS1428.1 - Provision for automatic washing machine | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Capable of compliance. Details to be verified at the CC stage |

| | | | | |
|---|---|-------------------------------------|-------------------------------------|--|
| Other General requirements | | | | |
| <ul style="list-style-type: none"> - All surfaces to be Slip resistant to AS3661 and AS 4586 - All GPOs and Lighting/ lux requirements as per AS4299 - All waterproofing as per AS4730 | | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Capable of compliance. Details to be verified at the CC stage |
| Requirement | <ul style="list-style-type: none"> - Where the location of fixtures such as WC pans, wash basins, sinks, laundry fixtures and any other fixtures are to be relocated post-adaptation to comply with AS1428.1, then the service pipes (waste and water supply pipes) have to be laid in the correct AS1428.1 specified position at pre-adaptation itself and the services to be capped off for future use. | | | |
| General recommendations (Advisory only / not mandatory) | <ul style="list-style-type: none"> - It is recommended that where balconies / outdoor areas have been provided to Adaptable units, provide the sliding doors such that the floor tracks are recessed, so level access can be provided to the balcony / outdoor areas from inside the unit. - Sliding doors in the living areas leading to outdoor areas are to be such that opening of the door is able to provide a clear opening space of 850mm with a latch side space of 530mm. - If the balcony is to be brought up to the same level as the unit at post-adaptation by means of decking etc. then ensure that the minimum handrail height requirements required under the BCA are complied with, considering the raised height of the balcony. - Consideration to be given to recess the slab in the wet areas so that there is no level difference once the floor finishes are applied (i.e. flush transition from carpeted area to tiles area). | | | |

SEPP 65 – Part 4Q1

Compliance assessment with Objective 4Q1 that requires 20% of the units to incorporate the features of the **Livable Housing Guidelines Silver level**.

Total number of residential units in the development = 20% of 236 = 47.2 = **48** required Livable units.


Since **25** of the units (as per the table below) already comply with the Adaptable unit requirements, these units are also capable of satisfying the intent of Silver level of Livable Housing Guidelines as noted in the table below.

| Building | Adaptable Units Numbers | Total |
|----------|--|----------|
| A, B, C | A205, A305, A405, A504, A604, A704, A804, C204, C304, C404, C503 | 11 Units |
| D, E, F | D501, D601, D701, D801, E204, E304, E404, E504, E604, E704, E804, F203, F303, F404 | 14 Units |


In addition to the adaptable units provided the units **as shown on the table below** are capable of providing compliance with the features of Silver level of Livable Housing Guidelines as noted in the table below.

| Building | Livable Unit Numbers | Total |
|----------|--|----------|
| A, B, C | B202, B302, B402, B502, B602, B702, C501, C601, C603, C701, C703, C801, C803 | 13 Units |
| D, E, F | D203, D206, D304, D307, D404, D407, D 505, D605, D705, D805, | 10 Units |


Unit B202, 302, 402, 502, 602, 702

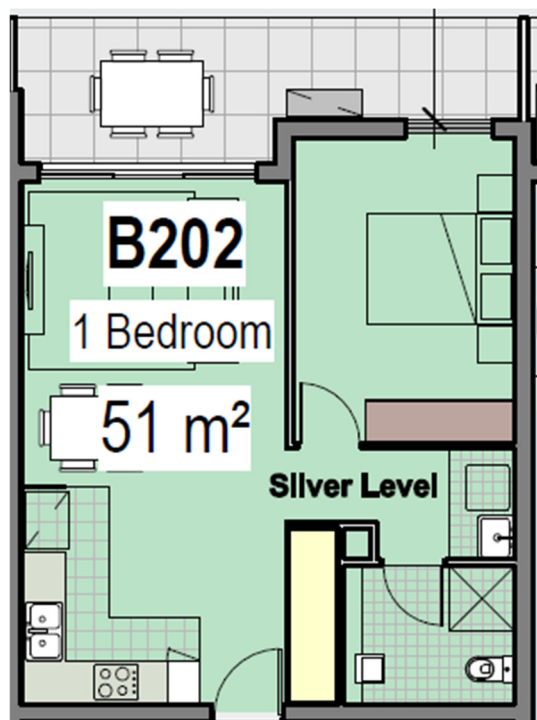


Unit C501, C601, C603, C701, C703, C801, C803

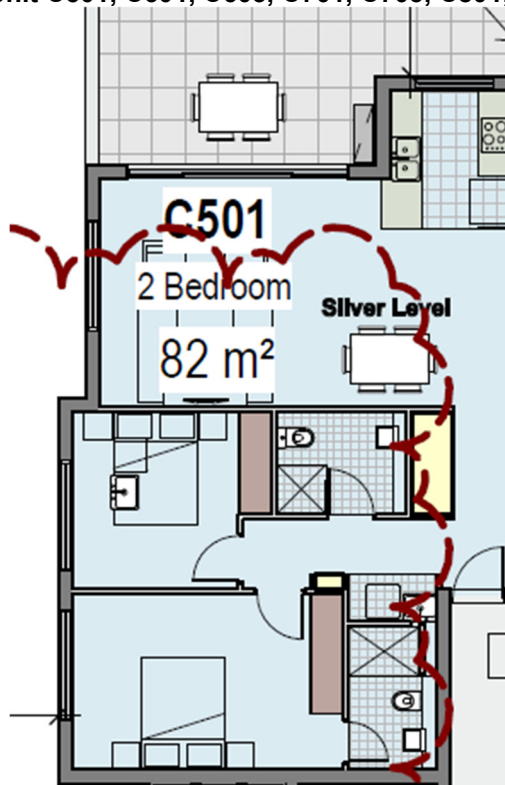

Unit D203, D304, D404

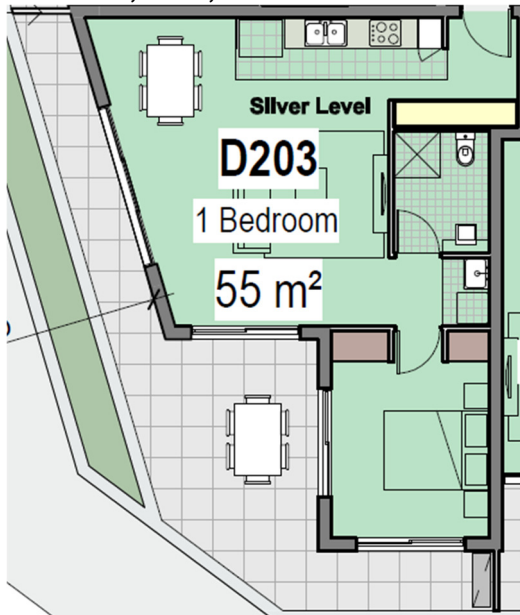

Unit D206, D307, D407, D505, D605, D705, D805


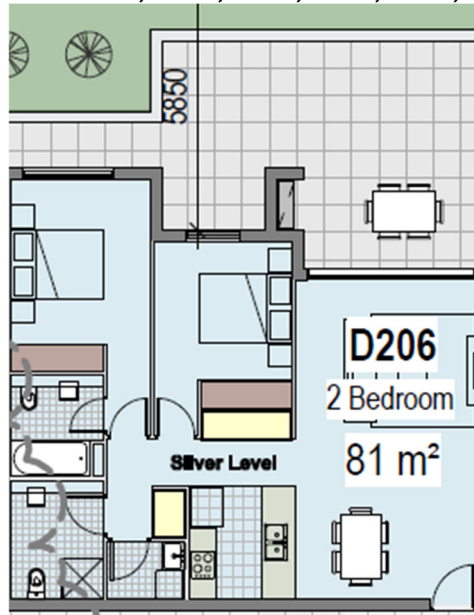


By incorporating the requirements of the below Checklist in the Specifications of the project, the nominated Livable units can achieve full compliance with Livable Housing Guidelines- Silver Level

Note that in this case the adaptable units are also be counted as Livable / LHA Silver level unit in which case the below requirements apply in addition to the AS4299 requirements.

| Design Element | Requirements (All dimensions noted are required to be clear of finishes as required under AS1428.1) | Compliance / Comments |
|-----------------------------|---|---|
| 1 Dwelling Access | (a) Provide a safe and continuous 1M clear width pathway from front site boundary to an entry door to the dwelling. | Complies. Verify at CC |
| | (b) Path including any ramps and walkways to have no steps, even firm, slip-resistant surface, max 1:40 crossfall, max slope of 1:14 with landings of 1.2M every 9M and landings every 15M for 1:20 walkways. 1.2M clear width of ramps are required. | |
| | (c) Pathway may be provided via an associated car parking in which case the car parking space to be - 3200 (width) x5400 (length), - even, firm and slip resistant, level surface of 1:40 max grade and 1:33 max grade for bitumen | N/A Access is provided from the site boundary. |
| | (d) Step ramp may be provided at an entrance doorway. The step ramp to be max 190mm height, max 1:10 grade, max 1900mm length. | N/A |
| | (e) Level landings of 1200mm are required exclusive of the swing of the door or gate and to be provided at the head and foot of the ramp. | N/A |
| 2 Dwelling entry | (a) Dwelling Entry should provide an entrance door with (i) min clear opening width of door to be 820mm (ii) Step free threshold of max 5mm with rounded or bevelled lip (iii) reasonable shelter from the weather | Capable of compliance. Verify at CC |
| | (b) Level landing of 1200x1200mm at step-free entrance door on the arrival / external side of the entrance door. | Complies Verify at CC |
| | (c) Max permissible threshold is less than 56mm where provided with a 1:8 grade threshold ramp. | N/A |
| | (d) Entrance to be connected to a pathway (specified under Element 1) Note: The entrance to incorporate waterproofing and termite management requirements as specified in the NCC | Complies |
| 3 | (a) Doors to rooms on the entry level used for living, dining, bedroom, bathroom, kitchen, laundry and sanitary compartments to be (i) 820mm clear opening and | Capable of compliance. Verify at CC |

| | | |
|---|---|-------------------------------------|
| Internal doors and corridors | (ii) provided with a level threshold of max 5mm between abutting surfaces with rounded or bevelled lip | |
| | (b) Internal corridors and passageways to doorway to be min 1M clear (measured from skirting to skirting) | Capable of compliance. Verify at CC |
| 4 Toilet | (a) One Toilet to be provided on the ground or entry level that provides, (i) Min 900mm between walls or amenities (ii) Min 1200mm clear space in forward of the WC pan exclusive of door swing. (iii) The toilet pan to be positioned in the corner of a room to enable handrails | Complies. Verify at CC |
| 5 Shower | (a) One bathroom should feature a slip resistant, hobless shower recess. Shower screens are permitted provided they can be easily removed at a later date. (b) The shower recess should be located in the corner of the room to enable the installation of grabrails at a future date. | Capable of compliance. Verify at CC |
| | For hobless specification please see Australian Standard AS3740-3.6. Reinforcement guidelines for walls in bathrooms and toilets are found in element 6 | |
| 6 Reinforcement of bathroom & toilet walls | (a) Except for walls constructed of solid masonry or concrete, the walls around the shower, bath (if provided) and toilet should be reinforced to provide a fixing surface for the safe installation of grabrails. | Capable of compliance. Verify at CC |
| | (b), (c) and (d) the walls around toilet, bath and shower to be via: (i) Noggins with a thickness of at least 25mm (ii) Sheeting with a thickness of at least 12mm Refer to diagrams provided in the Livable Housing Guideline document. | Capable of compliance. Verify at CC |

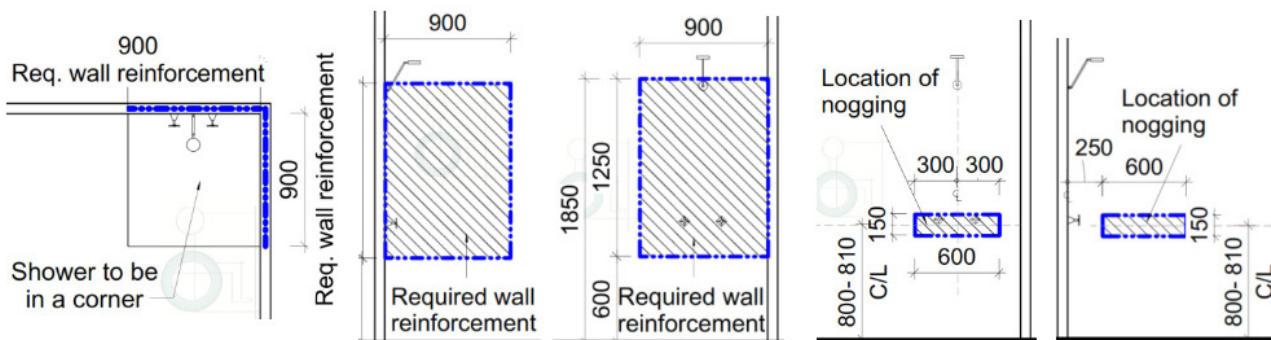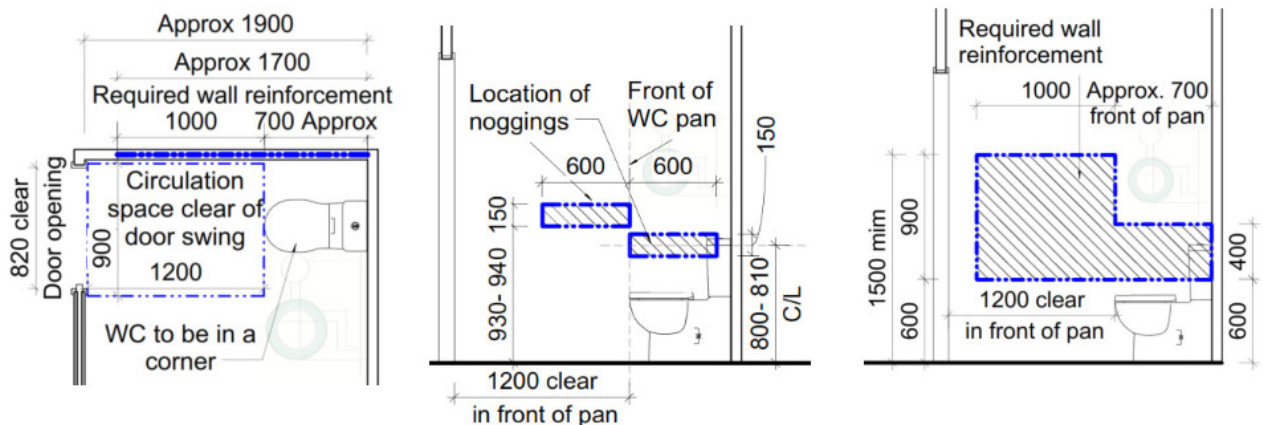

| | | |
|----------|--|---------------------------------------|
| 7 | Stairways in dwellings must feature: (i) a continuous handrail on one side of the stairway where there is a rise of more than 1m. a minimum clear width of 1000mm | N/A No internal stairway in units. |
|----------|--|---------------------------------------|

Disability Discrimination Act

Advisory Only

The Federal Disability Discrimination Act 1992 (DDA) provides protection for everyone in Australia against discrimination based on disability. Section 32 of the DDA focuses on the provision of equitable and dignified access to services and facilities for people with mobility, sensory and cognitive disabilities.

Disability discrimination happens when people with a disability and their relatives, friends, carers, co-workers or associates are treated less fairly than people without a disability.

Compliance with Access to Premises Standards give certainty to building certifiers, building developers and building managers that, if access to (new parts) of buildings is provided in accordance with these Standards, the provision of that access, to the extent covered by these Standards, will not be unlawful under the DDA. This however applies only to the new building or new parts of an existing building and its affected part. All areas outside the scope of these areas are still subject to the DDA. We cannot guarantee or certify for DDA compliance because DDA compliance can only be assessed by the Courts.

Scope of DDA extends beyond the building fabric and also includes furniture and fittings.

Some recommendations to address common furniture and fittings have been listed below. Non-provision of the below recommendations may not affect compliance under the BCA but may leave the building owner vulnerable to a claim under the DDA.

Where furniture layouts have been decided in developments such as restaurants, ensure that 1M clear space is available around all furniture and that a turning space of 1540x2070 (in the direction of travel) is provided in areas where travel is no longer possible and a person in a wheelchair would be required to make a 180 ° turn.

For new kitchens / BBQ areas in residential common use areas / common use commercial use areas, it is suggested that this kitchen could be made partially accessible by providing a width of 900mm next to the sink as vacant space (without cabinetry under the bench top) and a long lever tap with spout and handle within 300mm from the front of the benchtop. The distance in between the benches to be 1550mm. 1 double GPO to be provided within 300mm from the edge of the benchtop. This would allow a person in a wheelchair to independently move within the kitchen and use basic facility, being the sink independently.

For new reception tables/bar areas or counter serveries in restaurants/cafes etc., it is recommended that a lower section for a width of 900mm could be provided to be able to be used by a person in a wheelchair. Height of the FFL (finished floor level) to the top of the table to be 850+/-20mm and height of clearance beneath the unit from the FFL to be 820+/-20mm.

Statement of Experience

Farah Madon- Director

ACAA Accredited Access Consultant, NDIS SDA Assessor, Livable Housing Assessor & Changing Places Assessor

- Accredited member of the Association of Consultants in Access Australia (ACAA). Membership no 281
- Architect registered with the NSW Architect's Registration Board. Reg number 6940
- Member of Australian Institute of Architects (RAIA), A+ Practice member. No 49397
- Registered Assessor of Livable Housing Australia. Licence no 10032
- Internationally Certified Access Consultant GAATES ICAC. Membership BE-02-021-20
- Registered Assessor of Changing Places Australia. Registration no CP006

Farah's Educational Profile and Qualifications include:

- Bachelor of Architecture Degree with Honours (B.Arch.)
- International Certification of Accessibility Consultants– Built Environment (ICAC-BE) Program, Level 2 Advanced Accessibility Consultant
- Diploma of Access Consulting CPP50711
- Accredited Specialist Disability Accommodation (SDA) Assessor's Course
- Standards Australia's course on 'Writing Australian Standards'
- OHS Construction Induction Training Certificate
- Changing Places Australia's Training for Assessors

Farah has 20 years of experience of working in the field of Architecture and Access. Farah specialises in access consultancy services, including NDIS SDA Assessments, access related advise, auditing and reporting services, performance solution assessments for access related issues under the BCA.

Farah is the lead author of the NDIS SDA Design Standard. She has been invited as an expert witness for Access related matters in the Land and Environment Court.

Farah currently participates on the following key committees concerning access for people with disabilities, on an honorary basis:

- Committee member of ME-064 Committee of Standards Australia responsible for the AS4299 and AS1428 suite of standards.
- Community Representative Member of the Penrith City Council's Access Committee
- Member of Australian Institute of Architect's (RAIA) National Access Work Group (NAWG)
- Management Committee member of NSW Network of Access Consultants
- Livable Housing Australia's Industry Reference Group (IRG) Member

Farah has previously held the following roles:

- Vice President of ACAA from 2016 to 2019 and Management committee member of ACAA from 2011 till 2019.
- Convener of the ACAA's Access related Practice and Advisory Notes

Meet our team

Vanessa Griffin- ACAA Accredited Access Consultant, NDIS SDA Assessor, Livable Housing Assessor & Changing Places Assessor

- Accredited member of ACAA. Membership no 500
- Registered Assessor of Livable Housing Australia.
- Member of AIBS – Australian Institute of Building Surveyors

Vanessa's Educational Profile and Qualifications include:

- Diploma of Surveying and Diploma of Health and Building Surveying
- Certificate IV in Access Consulting
- OHS Construction Induction Training Certificate
- Changing Places Australia's Training for Assessors
- Accredited Specialist Disability Accommodation (SDA) Assessor's Course

Jenny Desai- ACAA Accredited Access Consultant

- Accredited member of ACAA. Membership no 572

Jenny's Educational Profile and Qualifications include:

- Master of Design (M.Des) from University of Technology, Sydney
- Certificate IV in Access Consulting
- OHS Construction Induction Training Certificate

