

Precise Planning

Salinity Assessment:
Lot 1 DP 996286,
95 Great Southern Road, Bargo, NSW



ENVIRONMENTAL



WATER



WASTEWATER



GEOTECHNICAL



CIVIL



PROJECT
MANAGEMENT



P1504741JR02V01
July 2016

Copyright Statement

Martens & Associates Pty Ltd (Publisher) is the owner of the copyright subsisting in this publication. Other than as permitted by the Copyright Act and as outlined in the Terms of Engagement, no part of this report may be reprinted or reproduced or used in any form, copied or transmitted, by any electronic, mechanical, or by other means, now known or hereafter invented (including microcopying, photocopying, recording, recording tape or through electronic information storage and retrieval systems or otherwise), without the prior written permission of Martens & Associates Pty Ltd. Legal action will be taken against any breach of its copyright. This report is available only as book form unless specifically distributed by Martens & Associates in electronic form. No part of it is authorised to be copied, sold, distributed or offered in any other form.

The document may only be used for the purposes for which it was commissioned. Unauthorised use of this document in any form whatsoever is prohibited. Martens & Associates Pty Ltd assumes no responsibility where the document is used for purposes other than those for which it was commissioned.

Limitations Statement

The sole purpose of this report and the associated services performed by Martens & Associates Pty Ltd is to complete a Salinity Assessment in accordance with the scope of services set out by Precise Planning (hereafter known as the Client). That scope of works and services were defined by the requests of the Client, by the time and budgetary constraints imposed by the Client, and by the availability of access to the site.

Martens & Associates Pty Ltd derived the data in this report primarily from a number of sources including site inspections, correspondence regarding the proposal, examination of records in the public domain, interviews with individuals with information about the site or the project, and field explorations conducted on the dates indicated. The passage of time, manifestation of latent conditions or impacts of future events may require further examination / exploration of the site and subsequent data analyses, together with a re-evaluation of the findings, observations and conclusions expressed in this report.

In preparing this report, Martens & Associates Pty Ltd may have relied upon and presumed accurate certain information (or absence thereof) relative to the site. Except as otherwise stated in the report, Martens & Associates Pty Ltd has not attempted to verify the accuracy or completeness of any such information (including for example survey data supplied by others).

The findings, observations and conclusions expressed by Martens & Associates Pty Ltd in this report are not, and should not be considered an opinion concerning the completeness and accuracy of information supplied by others. No warranty or guarantee, whether express or implied, is made with respect to the data reported or to the findings, observations and conclusions expressed in this report. Further, such data, findings and conclusions are based solely upon site conditions, information and drawings supplied by the Client *etc.* in existence at the time of the investigation.

This report has been prepared on behalf of and for the exclusive use of the Client, and is subject to and issued in connection with the provisions of the agreement between Martens & Associates Pty Ltd and the Client. Martens & Associates Pty Ltd accepts no liability or responsibility whatsoever for or in respect of any use of or reliance upon this report by any third party.

© July 2016
Copyright Martens & Associates Pty Ltd
All Rights Reserved

Head Office
Suite 201, 20 George Street
Hornsby, NSW 2077, Australia
ACN 070 240 890 ABN 85 070 240 890
Phone: +61-2-9476-9999
Fax: +61-2-9476-8767
Email: mail@martens.com.au
Web: www.martens.com.au

Document and Distribution Status								
Author(s)			Reviewer(s)		Project Manager		Signature	
Grant Taylor			Jeff Fulton Ralph Erni		Jeff Fulton			
Revision No.	Status	Release Date	Document Location					
			File Copy	Precise Planning				
1	Draft	09/07/2015	1E, 1H, 1P	1P				
1	Final	28/07/2016	1E, 1H, 1P	1P				

Distribution Types: F = Fax, H = Hard copy, P = PDF document, E = Other electronic format. Digits indicate number of document copies.

Contents

1 INTRODUCTION.....	5
1.1 Overview	5
1.2 Proposed Development	5
1.3 Assessment Objectives	5
1.4 Investigation Scope of Works	6
2 SITE CONDITIONS	7
2.1 Site Details	7
2.2 Sub-Surface Conditions	8
2.3 Groundwater	10
3 SALINITY ASSESSMENT.....	11
3.1 Documented Salinity Risk Potential	11
3.2 Broad Scale Salinity Processes	11
3.3 Signs of Potential Saline Soils at the site	11
3.4 Possible Site Conditions Impacting Site Salinity	11
3.5 Assessed Salinity Risk Potential	12
3.6 Salinity Laboratory Results	13
3.7 Discussion and Recommendations	16
4 LIMITATIONS.....	17
5 REFERENCES	18
6 ATTACHMENT A - FIGURES.....	19
7 ATTACHMENT B - BOREHOLE LOGS.....	23
8 ATTACHMENT C - SALINITY LABORATORY REPORT	37
9 ATTACHMENT D - NOTES ABOUT THIS REPORT.....	45

1 Introduction

1.1 Overview

This report documents the findings of a salinity assessment completed at 95 Great Southern Road, Bargo, NSW as part of a range of investigations to determine the suitability of the site for rezoning for residential development. The site location is shown on Figure 1, Attachment A.

1.2 Proposed Development

The proposed development concept was not available at the time of reporting this assessment. We have assumed for the purpose of this assessment that the proposed development will consist of site subdivision for low density residential development, which will generally include:

- Earthworks for preparation of development platforms.
- Construction of above-ground buildings requiring limited bulk excavation, assumed <1m below ground level (bgl).
- Installation of stormwater infrastructure (possibly OSD or biofiltration systems).
- Construction of new local access roads.
- Landscaping.

1.3 Assessment Objectives

The objective of the salinity assessment is to assess the risk of soil salinity so that consideration can be given to local prevailing salinity conditions and the impacts of, and on, the proposed development. This assessment has been carried out in general accordance with the following guidelines:

- Department of Infrastructure, Planning and Natural Resources (DIPNR, 2002), *Salinity Potential in Western Sydney Map*.
- Department of Land and Water Conservation (DLWC, 2002), *Site Investigations for Urban Salinity*.
- Australian Standard (AS) 3600 (2009), *Concrete structures*.

- Australian Standard (AS) 3798 (2007), *Guidelines on earthworks for commercial and residential developments*.

1.4 Investigation Scope of Works

Site investigation undertaken on June 11, 2015, included:

- A site walkover survey to confirm expected topography, geology and geomorphology based on desktop study results, to assess existing site conditions such as soil/ rock exposures, surface drainage and vegetation and to identify evidence of possible saline soil or groundwater conditions.
- Thirteen boreholes (BH101 to BH113) to characterise sub-surface materials, drilled up to 2.0 m bgl using either: a 4WD truck-mounted hydraulic drill rig with spiral augers fitted with a V-shaped bit (V-bit) or tungsten carbide bit (TC-bit); or hand auger (where rig access limited).
- Collection of soil samples for laboratory testing and future reference.

Investigation locations are shown in Figure 1, Attachment A.

2 Site Conditions

2.1 Site Details

Table 1 presents a summary of general site details. Existing site features are shown in Figure 1, Attachment A.

Table 1: Site background information.

Item	Description/Detail
Site address (Lot/DP)	Lot 1 DP996286, 95 Great Southern Road, Bargo, NSW
Local Government Area (LGA)	Wollondilly Shire Council
Site area	Approximately 28.2 ha
Existing site development	The site is primarily used for rural residential purposes with existing dwelling and sheds, and a small dam to south of the dwelling. The south western corner of the site was previously used by Sydney Water as a storage depot for the Bargo Wastewater Scheme and has recently been rehabilitated. The remainder of the site is predominantly grassed grazing paddock. Bordered by rural residential allotments to the north, east and south, residential development to the south west and Great Southern Road to the west
Proposed development	Residential (low density)
Typical slopes/aspect/elevation	The site typically has moderate grades less than 10% towards the west and the east, with the watercourse in the eastern portion of the site the lowest elevation at 302 mAHD. Site elevation rises to 321 mAHD in the south western corner and 311 mAHD in the south eastern corner.
Existing vegetation	Trees and grasses
Easements	None identified
Drainage	A mapped unnamed watercourse draining south/north is located in the eastern portion of the site and is intersected by another drainage depression draining from west to east. The site drains to the north east, intercepting Dogtrap Creek (approximately 1.2 km north east) and eventually the Bargo River (approximately 3.6 km north east).

2.2 Sub-Surface Conditions

2.2.1 Expected Geology

The *Wollongong 1:250,000 Geological Series Sheet SI/56-09* (DME, 1966) identifies the site as being underlain by Bringelly Shale, overlying Ashfield Shale, overlying Mittagong Formation.

The NSW Environment and Heritage eSPADE website identifies the western quarter of the site as having soils of the Blacktown soil landscapes consisting of shallow to moderately deep hardsetting mottled texture contrast soils, red and brown podzolic soils on crests grading to yellow podzic soils on lower slopes and in drainage lines. The remainder of the site is identified as having Lucas Heights soil landscapes consisting of moderately deep hardsetting yellow podzolic soils and yellow soloths on ridges and plateau surfaces and earthy sands in valley flats.

2.2.2 Sub-Surface Materials

Ashfield Shale was encountered above approximately 307 m AHD, inferred to be underlain by Mittagong Formation down to approximately 303 m AHD. Hawkesbury Sandstone outcrop was observed in the northern portion of the natural watercourse below approximately 303 m AHD.

Table 2 summarises sub-surface materials and conditions, inferred from borehole test results, to investigation termination depth. Encountered conditions are described in more detail on borehole logs, Attachment B, and associated explanatory notes, Attachment D.

Table 2: Generalised inferred sub-surface profile to termination depth.

Layer ¹	Depth (m bgl) ²												
	BH101	BH102	BH103	BH104	BH105	BH106	BH107	BH108	BH109	BH110	BH111	BH112	BH113
TOPSOIL: SANDY/SILTY CLAY	0.0 – 0.2	0.0 – 0.2	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15	0.0 – 0.15
RESIDUAL SOIL: SANDY CLAY Low to Medium Plasticity	-	-	-	-	-	0.15 – 0.8 ³	0.15 – 0.5 ⁴	-	0.15 – 0.5 ⁴	0.15 – 0.5 ⁴	-	-	-
RESIDUAL SOIL: CLAY Medium Plasticity	0.2 – 1.0	0.2 – 0.7	0.15 – 0.65 ⁴	0.15 – 0.5 ⁴	0.15 – 0.75	-	-	0.15 – 0.55 ^{4/5}	-	-	0.15 – 0.8	0.15 – 0.7	0.15 – 0.6
RESIDUAL SOIL: CLAY High Plasticity	1.0 – 1.6 ³	0.7 – 1.6 ³	-	-	0.75 – 2.0 ³	-	-	-	-	-	0.8 – 1.6 ³	0.7 – 1.4 ³	0.6 – 1.7 ³

Notes:

- 1 Refer to borehole logs for more detailed material descriptions at test locations.
- 2 Indicative depth range in metres below ground level, which may vary across site depending on local geological conditions.
- 3 Borehole terminated on inferred weathered rock.
- 4 Hand auger refusal.
- 5 Some sandy clay bands observed between 0.15m and 0.4m bgl

2.3 Groundwater

Groundwater inflow was not observed in any of the boreholes to investigation termination depths of up to 2.0m bgl. Review of NSW Office of Water's Real Time groundwater database indicates that 3 groundwater bores are located within 1km of the site (Figure 2, Attachment A). Details are provided in Table 3.

Table 3: Available hydrogeological information.

Groundwater Bore Identification	Direction and Distance	Depth To Groundwater (mBGL)	Intended Use	Water Bearing Zone Substrate
GW007445	South(50m)	62.5	Irrigation	Sandstone
GW111810	North west (600m)	79.9	Stock domestic	Sandstone
GW107547	East (1000)	17.5	Monitoring bore	Sandstone

From review of the information in Table 3, groundwater in the vicinity of the site is likely to be greater than 17.5 m bgl. Further investigation would be required to characterise site hydrogeology.

3 Salinity Assessment

3.1 Documented Salinity Risk Potential

The 1:100,000 Salinity Potential in Western Sydney map (DIPNR, 2002) indicates that the site is located in an area of moderate salinity potential (Figure 3, Attachment A).

3.2 Broad Scale Salinity Processes

In producing the Salinity Potential Map, DIPNR developed a number of alternative models of processes by which salinity may occur in Western Sydney (WSROC, 2004, pg. 16).

A list of key broad scale salinity processes likely to impact the site, including summarised descriptions of each process, is presented in Table 4.

3.3 Signs of Potential Saline Soils at the site

No obvious signs of saline conditions were observed at the site:

- Vegetation growth appeared healthy and uninhibited.
- No water marks or salt crystals were observed on the ground surface.
- Site surface drainage appeared generally good.
- No evidence of concentrated surface erosion was observed.

3.4 Possible Site Conditions Impacting Site Salinity

Site conditions that may impact salinity potential at the site include:

- Dams may facilitate increased surface water infiltration.
- Drainage depressions bisecting the site.
- Although groundwater was not encountered down to investigation depths, perched groundwater from surface water infiltration through near surface sands may occur as a result of rainfall events.

3.5 Assessed Salinity Risk Potential

In Table 4, the broad scale salinity processes have been assessed in terms of likelihood of occurring at the site, considering the proposed development, site observations and investigation findings.

Table 4: Potential for broad scale salinity processes at the site.

Key Salinity Process	Description	Potential at subject site
Localised concentration of salinity	Localised concentration of salts due to relatively high evaporation rates. Usually associated with waterlogged soil and poor drainage. Exacerbated by increased water use and/or blocking of surface and sub-surface water flow associated with urban development.	Low – No evidence of excessive water use or areas of poor drainage at the time of inspection. No evidence of localised salt concentration observed.
Shale Soil Landscapes	In poorly drained duplex (texture contrast) soils, shallow sub-surface water flows laterally across a clayey upper B-Horizon with salt usually accumulating in the clayey sub-soil. Salt concentrations may increase where sub-surface water accumulates and evaporates, e.g. on lower slopes or natural and constructed flats in mid-slope. Exacerbated by sub-soils exposure through deep cutting, by installing buildings into the B-horizon and by impeding sub-surface water flows. Highly dispersive, erodible and poorly draining sodic soils due to salinity.	Moderate to High – The site is underlain by partly deep and low permeable clays overlying shale/sandstone. Excavations likely required into the clayey B-Horizon. No evidence of impeded surface vegetation growth or surface soil erosion observed.
Deep Groundwater Salinity	Brackish or saline groundwater rises to a level where, through capillary action in the soil, the water with dissolved salts reaches the ground surface and evaporates, resulting in localised salt concentration. Groundwater rises are typically caused by increased water infiltration, e.g. above average rainfall, vegetation loss, irrigation, increased water use in urban areas, construction of surface pits. Exacerbated by buildings or infrastructure intercepting the zone of groundwater level fluctuation.	Low to moderate – Groundwater infiltration in creeks. Groundwater was not encountered in boreholes to 2.0m bgl. The proposed development is not expected to intercept or raise groundwater levels. Proposed structures are to be constructed with appropriate drainage measures installed.
Deeply Weathered Soil Landscape	High salt loads with high sulphate levels related to un-mapped deeply weathered soil landscapes beneath fluvial gravel, sand and clay. Usually in mid-slope or on hilltops affected by perched saline groundwater.	Low to moderate – soils in site drainage depressions are likely deeply weathered, however, site soils appear to be residual, not depositional.

3.6 Salinity Laboratory Results

3.6.1 Overview

Thirty seven soil samples from 12 boreholes were submitted to Envirolab Services, a National Association of Testing Authorities (NATA) accredited laboratory, for chemical testing (Electrical Conductivity (EC), pH and soluble SO₄) to assess salinity characterisation and exposure classification for design of buried concrete structures. Sampling was targeted to achieve a representative coverage of site conditions in line with assessed subsurface profiles, proposed earthworks and investigation scope.

Groundwater was not observed down to investigation depth limits, being 2.0m bgl.

3.6.2 Results – Salinity Classification

Testing results are summarised in Table 5.

Table 5: Salinity test results.

Sample ID ¹	Material	EC _(1:5) (dS/m)	EC _e (dS/m) ²	Salinity Classification ³
4741/101/0.15	Silty Clay	0.077	0.655	Non-Saline
4741/101/0.4	Clay	0.022	0.176	Non-Saline
4741/101/0.9	Clay	0.036	0.252	Non-Saline
4741/101/1.5	Clay	0.029	0.174	Non-Saline
4741/102/0.1	Silty Clay	0.034	0.289	Non-Saline
4741/102/0.5	Clay	0.038	0.304	Non-Saline
4741/102/1.1	Clay	0.054	0.378	Non-Saline
4741/102/1.5	Clay	0.054	0.378	Non-Saline
4741/103/0.1	Silty Clay	0.310	2.635	Slightly Saline
4741/103/0.4	Clay	0.074	0.592	Non-Saline
4741/103/0.6	Clay	0.067	0.536	Non-Saline
4741/104/0.1	Silty Clay	0.170	1.445	Non-Saline
4741/104/0.4	Clay	0.130	1.040	Non-Saline
4741/105/0.1	Silty Clay	0.031	0.264	Non-Saline
4741/105/0.5	Clay	0.018	0.144	Non-Saline
4741/105/0.9	Clay	0.026	0.182	Non-Saline
4741/105/1.6	Clay	0.048	0.288	Non-Saline

Sample ID ¹	Material	EC _(1:5) (dS/m)	EC _e (dS/m) ²	Salinity Classification ³
4741/106/0.1	Silty Clay	0.011	0.094	Non-Saline
4741/106/0.5	Sandy Clay	0.013	0.104	Non-Saline
4741/106/0.7	Sandy Clay	0.011	0.088	Non-Saline
4741/107/0.1	Silty Clay	0.029	0.247	Non-Saline
4741/107/0.4	Sandy Clay	0.012	0.096	Non-Saline
4741/108/0.1	Silty Clay	0.060	0.510	Non-Saline
4741/108/0.3	Sandy Clay	0.021	0.168	Non-Saline
4741/108/0.5	Clay	0.020	0.160	Non-Saline
4741/109/0.1	Silty Clay	0.080	0.680	Non-Saline
4741/109/0.4	Sandy Clay	0.014	0.112	Non-Saline
4741/110/0.1	Silty Clay	0.032	0.272	Non-Saline
4741/110/0.4	Sandy Clay	0.014	0.112	Non-Saline
4741/111/0.1	Silty Clay	0.030	0.255	Non-Saline
4741/111/0.5	Clay	0.039	0.312	Non-Saline
4741/111/0.9	Clay	0.057	0.456	Non-Saline
4741/111/1.5	Clay	0.043	0.258	Non-Saline
4741/113/0.1	Silty Clay	0.064	0.544	Non-Saline
4741/113/0.5	Clay	0.093	0.744	Non-Saline
4741/113/1.5	Clay	0.061	0.366	Non-Saline

Notes:

- 1 Project#/Borehole#/Depth (m bgl)
- 2 Based on EC to EC_e multiplication factors from Table 6.1 in DLWC (2002). i.e. (silty clay = 8.5, sandy clay = 8, clay = 6, 7 and 8)
- 3 Based on Table 6.2 of DLWC (2002) where EC_e <2 dS/m = non-saline, EC_e of 2-4 dS/m = slightly saline, EC_e of 4-8 dS/m = moderately saline, EC_e of 8-16 dS/m = very saline and EC_e of >16 dS/m = highly saline.

Results indicate sub-surface materials are almost entirely classified as non-saline. One surface sample (0.1m bgl) in BH103 located adjacent to a drainage depression indicates soils near drainage depressions or in areas of poor drainage may be slightly saline.

3.6.3 Results – Exposure Classification

Sulphate and pH test results are summarised in Table 6. Laboratory test certificates are presented in Attachment C.

Table 6: Exposure classification test results.

Sample ID ¹	EC _e (dS/m) ²	pH	Sulfate (SO ₄) (mg/kg)	Exposure Classification ²
4741/101/0.15	0.655	6.1	NA	A1
4741/101/0.4	0.176	5.6	24	A1
4741/101/0.9	0.252	5.6	NA	A1
4741/101/1.5	0.174	5.5	33	A1
4741/102/0.1	0.289	5.8	NA	A1
4741/102/0.5	0.304	6.0	22	A1
4741/102/1.1	0.378	5.6	<10	A1
4741/102/1.5	0.378	5.5	NA	A1
4741/103/0.1	2.635	5.6	NA	A1
4741/103/0.4	0.592	6.0	48	A1
4741/103/0.6	0.536	5.6	NA	A1
4741/104/0.1	1.445	5.9	NA	A1
4741/104/0.4	1.04	5.8	42	A1
4741/105/0.1	0.264	5.9	NA	A1
4741/105/0.5	0.144	5.7	10	A1
4741/105/0.9	0.182	5.4	10	A1
4741/105/1.6	0.288	5.4	NA	A1
4741/106/0.1	0.094	6.0	NA	A1
4741/106/0.5	0.104	6.0	10	A1
4741/106/0.7	0.088	5.9	NA	A1
4741/107/0.1	0.2465	5.8	10	A1
4741/107/0.4	0.096	6.0	NA	A1
4741/108/0.1	0.51	6.2	<10	A1
4741/108/0.3	0.168	6.3	10	A1
4741/108/0.5	0.16	6.1	NA	A1
4741/109/0.1	0.68	6.2	<10	A1
4741/109/0.4	0.112	5.8	NA	A1
4741/110/0.1	0.272	5.6	<10	A1
4741/110/0.4	0.112	5.5	NA	A1
4741/111/0.1	0.255	5.4	50	A1
4741/111/0.5	0.312	5.4	40	A1

Sample ID ¹	EC _e (dS/m) ²	pH	Sulfate (SO ₄) (mg/kg)	Exposure Classification ²
4741/111/0.9	0.456	5.6	NA	A1
4741/111/1.5	0.258	5.8	NA	A1
4741/113/0.1	0.544	4.7	170	A1
4741/113/0.5	0.744	5.1	22	A1
4741/113/1.5	0.366	5.8	NA	A1

Notes:

1 Project#/Borehole#/Depth (m bgl)

2 Exposure classification for buried reinforced concrete based on Tables 4.8.1 and 4.8.2 of AS 3600 (2009).

In accordance with AS3600 (2009), an exposure classification for concrete of 'A1' may be adopted for preliminary design of buried concrete structures.

3.7 Discussion and Recommendations

From results of EC testing, the site is assessed as having a very low salinity risk. No further assessment of salinity is considered necessary prior to the residential development.

Future buried concrete structures should be designed in accordance with the concrete cover specifications in AS 3600 (2009) for an exposure classification of 'A1'.

4 Limitations

The recommendations presented in this report are based on limited preliminary investigations and include specific issues to be addressed during the design and construction phases of the project. In the event that any of the recommendations presented in this report are not implemented, the general recommendations may become inapplicable and Martens & Associates accept no responsibility whatsoever for the performance of the works undertaken where recommendations are not implemented in full and properly tested, inspected and documented.

Occasionally, sub-surface conditions between and below the completed boreholes or other tests may be found to be different (or may be interpreted to be different) from those expected. Variation can also occur with groundwater conditions, especially after climatic changes. If such differences appear to exist, we recommend that you immediately contact Martens & Associates.

5 References

Australian Standard 1726 (1993) *Geotechnical Site Investigations*.

Australian Standard 3600 (2009) *Concrete structures*.




Department of Land and Water Conservation (2002), *Site Investigations for Urban Salinity*.

Department of Infrastructure Planning and Natural Resources (DIPNR, 2002) *Salinity Potential in Western Sydney Map*.


DMR (1966), *Wollongong 1:250,000 Geological Series Sheet SI/56-09*.

Western Sydney Regional Organisation of Councils (2004), *Western Sydney Salinity Code of Practice*.


6 Attachment A - Figures

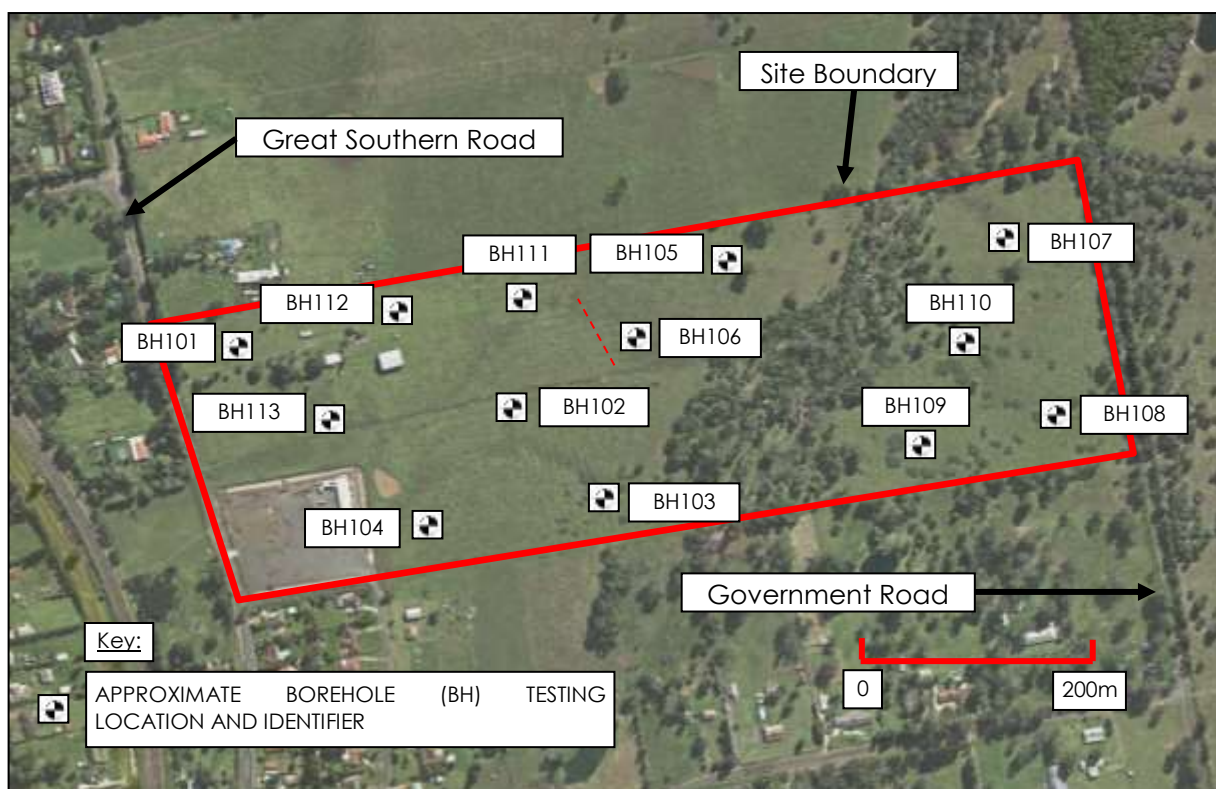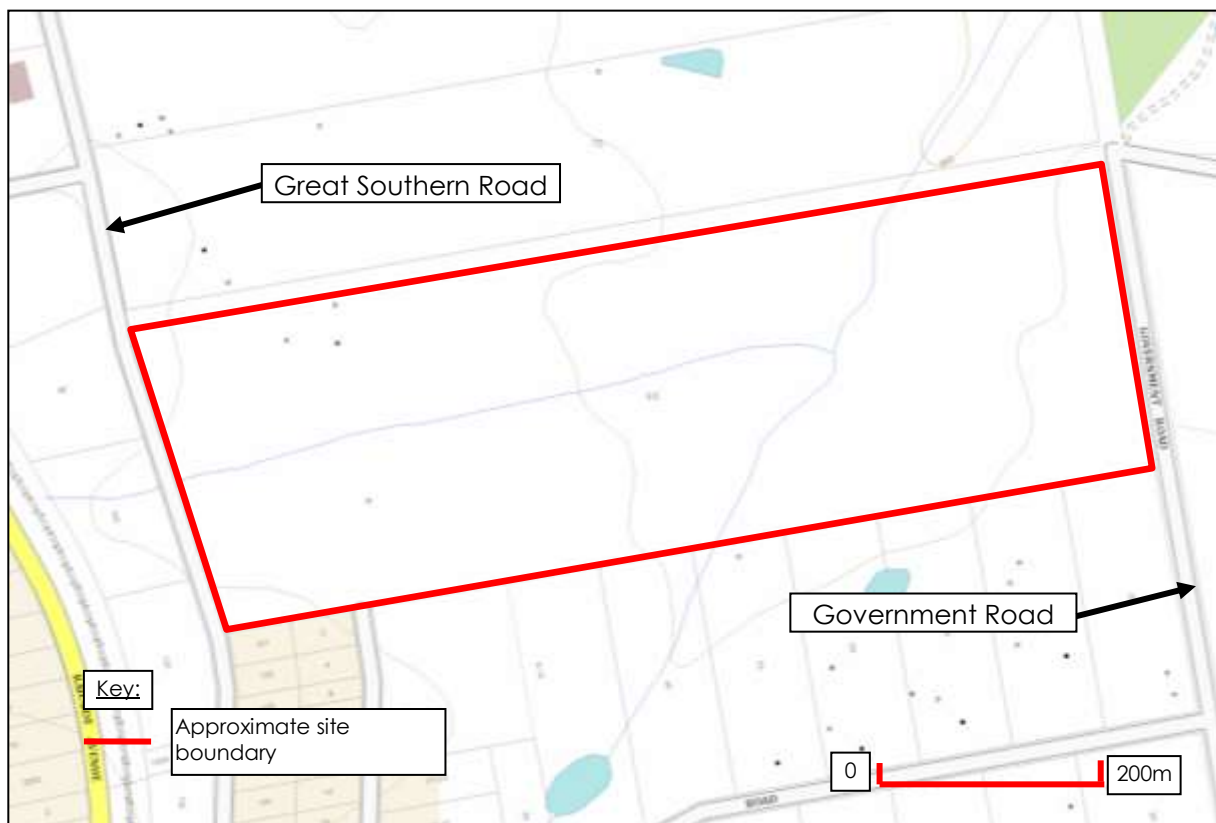

Martens & Associates Pty Ltd ABN 85 070 240 890		Environment Water Wastewater Geotechnical Civil Management	
Drawn:	GMT	Site location, borehole locations and boundaries 95 Great Southern Road, Bargo Source: SIX Maps, 2014	Drawing No:
Approved:	JF		FIGURE 1
Date:	03.06.2015		
Scale:	NA		Job No: P1504741JD01V01

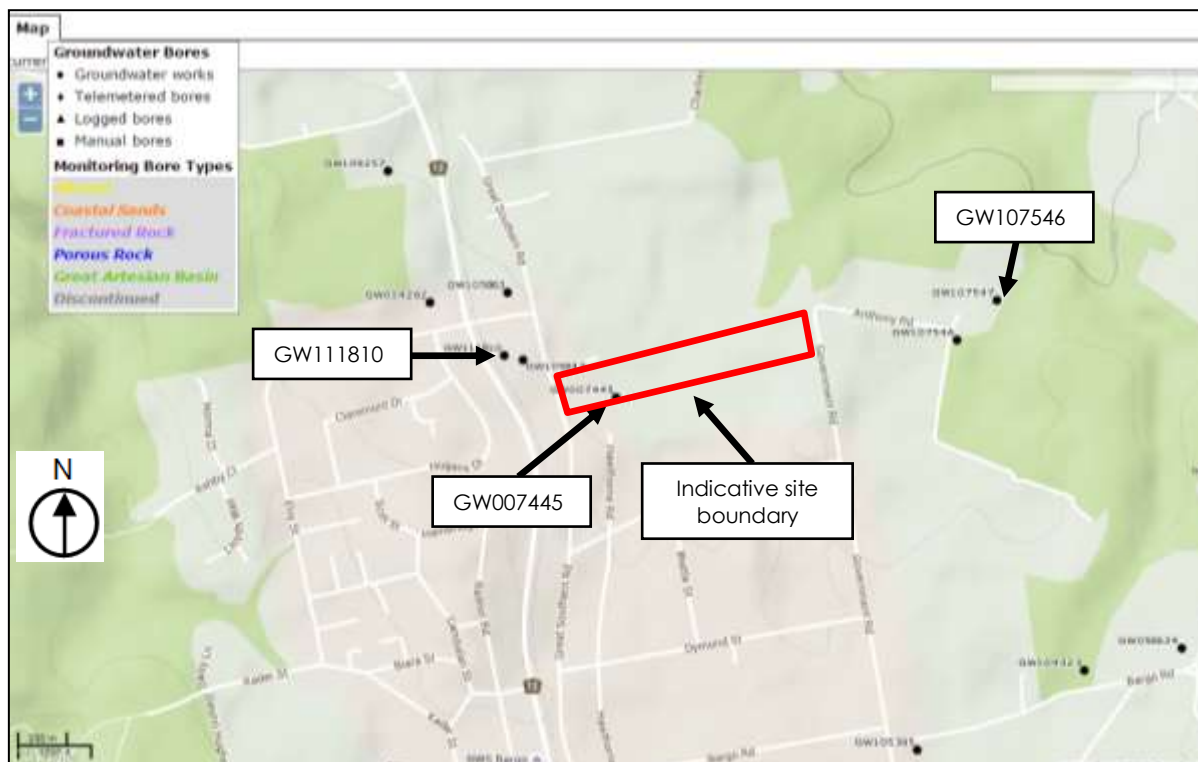

Martens & Associates Pty Ltd ABN 85 070 240 890		Environment Water Wastewater Geotechnical Civil Management	
Drawn:	GMT	Department of Primary Industries Groundwater Bores Source: Department of Primary Industries – Office of Water	Drawing No:
Approved:	JF		FIGURE 2
Date:	29.06.2015		
Scale:	Not to Scale		Job No: P1504741JD03V01

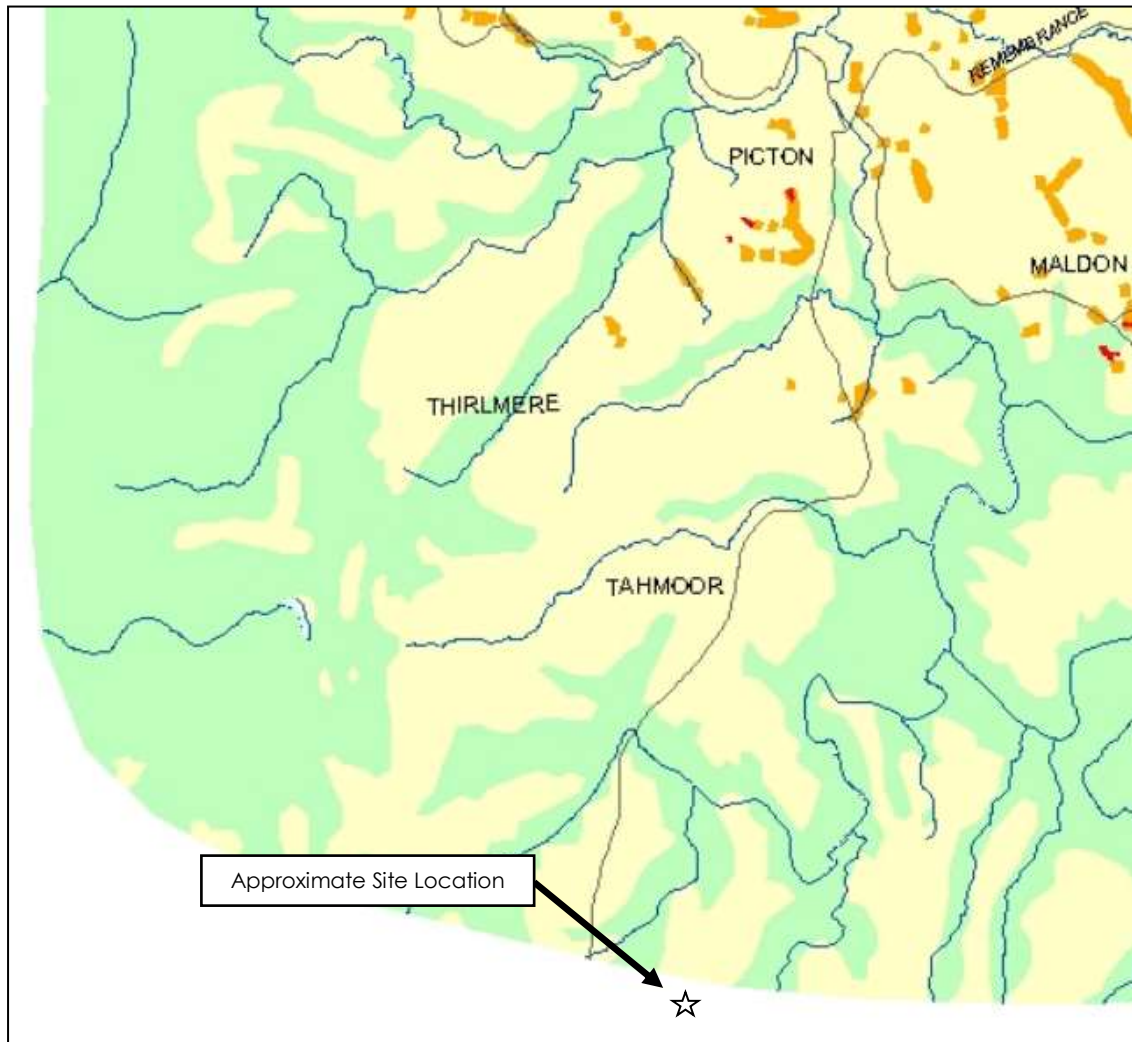

MAPPING CATEGORY	ASSOCIATED SOIL LANDSCAPES	LANDFORM - GEOLOGY
KNOWN SALINITY Areas where there is a known occurrence of saline soil, or where air photo interpretation and field observations have confirmed more than one of these: a - scalding b - salt efflorescence c - vegetation dieback d - salt tolerant plant species e - waterlogging A high relative wetness index occurs in these areas.	* Salinity outbreaks occur in Blacktown (bt), Luddenham (lu) and Richmond (ri) Soil Landscapes - common at breaks of slope, lower slopes and drainage lines. * Berkshire Park (bp) and Upper Cattlereagh (up) Soil Landscapes have localised salinity due to the impermeable nature of the clay parent material. * South Creek (sc), Monkey Creek (mk), Freemans Reach (fr) and Theresa Park (tp) Soil Landscapes have common saline outbreaks due to high run-on and low local relief. * Soils in the above landscapes have high clay content in subsoils and are imperfectly to poorly drained.	* Break of slope, lower slope and drainage lines of Wianamatta Shales (Rwb, Rwa and Rwm). * Localised salinity also occurs at the geological boundary between Tertiary Gravels (Ti, Tr) and underlying Wianamatta Shales (Rwb, Rwa, Rwm). * Localised salinity occurs in Quaternary Alluvium (Qal, Qpn, Qpd, Qpc, Qgp) which underlies many of the drainage systems and wetland margins.
HIGH SALINITY POTENTIAL Areas where soil, geology, topography and groundwater conditions predispose a site to salinity. These conditions are similar to areas of known salinity (see above). These areas are most common in lower slopes and drainage systems where water accumulation is high (i.e. high relative wetness index).	* Soil Landscapes include Birrong (bi), Blacktown (bt), Berkshire Park (bp), Freemans Reach (fr), South Creek (sc), Theresa Park (tp), Richmond (ri) and Luddenham (lu). Drainage system and convergent slopes are areas of highest risk. * Soils in these landscapes have high clay content in the subsoils, low permeability and high run-on. * Soil profiles may display signs of high salt concentrations at depth (i.e. >0.5m).	* Salinity is most likely to occur in lower slopes, foot-slopes, floodplains and creek lines on Quaternary Sediments (Qal, Qpn, Qpd, Qpc, Qgp, Qha) Wianamatta Shales (Rwb, Rwa, Rwm) where run-on is high, resulting in seasonally high water tables and soil saturation.
MODERATE SALINITY POTENTIAL Areas on Wianamatta Group Shales and Tertiary Alluvial Terraces. Scattered areas of sodding and indicator vegetation have been noted but no concentrations have been mapped. Saline areas may occur in this zone, which have not yet been identified or may occur if risk factors change adversely.	* Areas of Agnes Banks (ab), Berkshire Park (bp), Blacktown (bt), Luddenham (lu) and Lucas Heights (lh). * Steeper areas with moderate to high local relief and well drained subsoils such as Pidon (pn), West Pennant Hills (wp) and Glenorie (gn) are at a lower risk of developing salinity. * Soils are moderate to well-drained due to their elevated position in the landscape.	* Hill-slopes and hill-crests on Wianamatta Shales (Rwb, Rwm, Rwa). * Raised abandoned alluvial terraces and drainage lines on Quaternary Alluvium (Qal, Qpn, Qpd, Qpc, Qgp) from Richmond to Camden and east to Rookwood. Localised areas of elevated, well-drained Tertiary Gravels (Ta, Ti, Tr).
VERY LOW SALINITY POTENTIAL Areas where salinity processes do not operate or are of minor significance. Soils are rapidly drained and underlying strata (Hawkesbury/Nambeen Sandstone) are highly permeable, resulting in continual flushing and removal of salts in the landscape. No salinity has been observed in these areas and is not expected to occur.	* Rapidly drained soil landscapes with shallow soils include Warragamba (wb) and Hawkesbury (ha). * Gymea (gy) and Faulconbridge (fb) Soil Landscapes consist of highly permeable sands with well-drained subsoils. * Soils are well to rapidly drained. * Soils have high sand content.	* Occurring on Hawkesbury and Nambeen Sandstone (Rh, Rno). * Groundwater is relatively fresh in these areas due to the sandstone's elevated position in the landscape and highly permeable nature, resulting in continuous flushing of the system (removal of any accumulated salts).

Martens & Associates Pty Ltd ABN 85 070 240 890

Environment | Water | Wastewater | Geotechnical | Civil | Management

Drawn: GMT

Approved: GT

Date: 29.06.2015

Scale: Not to Scale

**1:100,000 SALINITY POTENTIAL IN WESTERN SYDNEY MAP
(DIPNR, 2002)**
95 Great Southern Road, Bargo

Drawing No:

FIGURE 3

Job No: P1504741 JD02V01

7 **Attachment B - Borehole Logs**

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH101							
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1							
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741							
EQUIPMENT	Hydraulic Auger	EASTING	NA	RL SURFACE	NA								
EXCAVATION DIMENSIONS	Ø95mm X 1.6m depth	NORTHING	NA	ASPECT	East	SLOPE	<2%						
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING							
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.													
V	Nil	N	M	0.2			CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.15	- TOPSOIL 4741/101/ 0.15
V	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St		A	0.4	- RESIDUAL 4741/101/ 0.4
V	Nil	N	M	0.5			CH	CLAY - High plasticity, brown/light brown.	St-VSt		A	0.9	- RESIDUAL 4741/101/ 0.9
V	Nil	N	M	0.75									
V	Nil	N	M	1.0									
V	Nil	N	M	1.25									
V	Nil	N	M	1.5									
V	Nil	N	M	1.6									
				1.75				V-bit refusal at 1.6m on inferred very low strength shale.					
				2.0									
				2.25									
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube													
SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support													
WATER N None observed X Not measured Water level Water outflow Water inflow													
MOISTURE D Dry M Moist W Wet Wp Plastic limit Wl Liquid limit													
DRILLING RESISTANCE L Low M Moderate H High R Refusal													
CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable													
DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense													
SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio													
VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample													
CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS													
MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au													
Engineering Log - Borehole													

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH102																															
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																															
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																															
EQUIPMENT	Hydraulic Auger	EASTING	NA	RL SURFACE	NA																																
EXCAVATION DIMENSIONS	Ø95mm X 1.6m depth	NORTHING	NA	ASPECT	East	SLOPE	<5%																														
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																															
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																								
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																					
V	Nil	N	M	0.1			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/102/ 0.1																								
V	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St		A	0.5	- RESIDUAL 4741/102/ 0.5																								
V	Nil	N	M	0.75			CH	CLAY - High plasticity, brown/light brown.	St-VSt		A	1.1	- RESIDUAL 4741/102/ 1.1																								
V	Nil	N	M	1.5							A	1.5	4741/102/ 1.5																								
				1.75				V-bit refusal at 1.6m on inferred very low strength shale.																													
				2.0																																	
				2.25																																	
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support				WATER N None observed X Not measured Water level Water outflow Water inflow		MOISTURE D Dry M Moist W Wet Wp Plastic limit Wl Liquid limit		DRILLING RESISTANCE L Low M Moderate H High R Refusal		CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable		DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense		SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio		VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample		CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural					
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																					
 (C) Copyright Martens & Associates Pty. Ltd . 2015														MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au														Engineering Log - Borehole									

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH103																																																																																																																																					
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																																																																																																																																					
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																																																																																																																																					
EQUIPMENT	Hand Auger	EASTING	NA	RL SURFACE	NA																																																																																																																																						
EXCAVATION DIMENSIONS	Ø90mm X 0.65m depth	NORTHING	NA	ASPECT	East	SLOPE	<5%																																																																																																																																				
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																																																																																																																																					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																																																																																																																														
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																																																																																																																											
HA	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/103/ 0.1																																																																																																																														
HA	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St		A	0.4	- RESIDUAL 4741/103/ 0.4																																																																																																																														
				0.5							A	0.6	4741/103/ 0.6																																																																																																																														
				0.65				Hand auger refusal at 0.65m on stiff clay.																																																																																																																																			
				0.75																																																																																																																																							
				1.0																																																																																																																																							
				1.25																																																																																																																																							
				1.5																																																																																																																																							
				1.75																																																																																																																																							
				2.0																																																																																																																																							
				2.25																																																																																																																																							
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support														WATER N None observed X Not measured Water level Water outflow Water inflow														MOISTURE D Dry M Moist W Wet Wp Plastic limit WI Liquid limit														DRILLING RESISTANCE L Low M Moderate H High R Refusal														CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable														DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense														SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio														VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample														CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																																																																																																																											
martens														MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au														Engineering Log - Borehole																																																																																																															

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH104																																																																																																																																					
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																																																																																																																																					
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																																																																																																																																					
EQUIPMENT	Hand Auger	EASTING	NA	RL SURFACE	NA																																																																																																																																						
EXCAVATION DIMENSIONS	Ø90mm X 0.5m depth	NORTHING	NA	ASPECT	East	SLOPE	<5%																																																																																																																																				
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																																																																																																																																					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																																																																																																																														
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																																																																																																																											
HA	Nil	N	M	0.15			CL- CI	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/104/ 0.1																																																																																																																														
HA	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St		A	0.4	- RESIDUAL 4741/104/ 0.4																																																																																																																														
				0.5				Hand auger refusal at 0.5m on stiff clay.																																																																																																																																			
				0.75																																																																																																																																							
				1.0																																																																																																																																							
				1.25																																																																																																																																							
				1.5																																																																																																																																							
				1.75																																																																																																																																							
				2.0																																																																																																																																							
				2.25																																																																																																																																							
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support														WATER N None observed X Not measured ▽ Water level △ Water outflow ▽ Water inflow														MOISTURE D Dry M Moist W Wet Wp Plastic limit WI Liquid limit														DRILLING RESISTANCE L Low M Moderate H High R Refusal														CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable														DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense														SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio														VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample														CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																																																																																																																											
 Martens (C) Copyright Martens & Associates Pty. Ltd . 2015 MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au Engineering Log - Borehole																																																																																																																																											

Quality Sheet No. 4

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH106																																																																																																																																					
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																																																																																																																																					
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Sandstone	VEGETATION	Grass	PROJECT NO. P1504741																																																																																																																																					
EQUIPMENT	Hydraulic Auger		EASTING	NA	RL SURFACE	NA																																																																																																																																					
EXCAVATION DIMENSIONS	Ø95mm X 0.8m depth		NORTHING	NA	ASPECT	East	SLOPE <10%																																																																																																																																				
EXCAVATION DATA			MATERIAL DATA			SAMPLING & TESTING																																																																																																																																					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																																																																																																																														
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																																																																																																																											
V	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/106/ 0.1																																																																																																																														
V	Nil	N	M	0.25			CL-CL	Sandy CLAY - Low to medium plasticity, fine grained, brown, with sandstone gravels (2-10mm, sub-angular).	St-VSt		A	0.5	- RESIDUAL 4741/106/ 0.5																																																																																																																														
				0.75				V-bit refusal at 0.8m on inferred very low strength sandstone.																																																																																																																																			
				1.0																																																																																																																																							
				1.25																																																																																																																																							
				1.5																																																																																																																																							
				1.75																																																																																																																																							
				2.0																																																																																																																																							
				2.25																																																																																																																																							
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support														WATER N None observed X Not measured Water level Water outflow Water inflow														MOISTURE D Dry M Moist W Wet Wp Plastic limit WL Liquid limit														DRILLING RESISTANCE L Low M Moderate H High R Refusal														CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable														DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense														SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio														VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample														CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																																																																																																																											
martens (C) Copyright Martens & Associates Pty. Ltd . 2015														MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au														Engineering Log - Borehole																																																																																																															

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH107																																																																																																																																					
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																																																																																																																																					
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																																																																																																																																					
EQUIPMENT	Hand Auger	EASTING	NA	RL SURFACE	NA																																																																																																																																						
EXCAVATION DIMENSIONS	Ø90mm X 0.5m depth	NORTHING	NA	ASPECT	East	SLOPE	<5%																																																																																																																																				
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																																																																																																																																					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																																																																																																																														
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																																																																																																																											
HA	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/107/ 0.1																																																																																																																														
HA	Nil	N	M	0.25			CL-CL	Sandy CLAY - Low to medium plasticity, fine grained, brown, with sandstone gravels (2-20mm, angular).	St		A	0.4	- RESIDUAL 4741/107/ 0.4																																																																																																																														
				0.5				Hand auger refusal at 0.5m on gravels.																																																																																																																																			
				0.75																																																																																																																																							
				1.0																																																																																																																																							
				1.25																																																																																																																																							
				1.5																																																																																																																																							
				1.75																																																																																																																																							
				2.0																																																																																																																																							
				2.25																																																																																																																																							
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support														WATER N None observed X Not measured Water level Water outflow Water inflow														MOISTURE D Dry M Moist W Wet Wp Plastic limit WI Liquid limit														DRILLING RESISTANCE L Low M Moderate H High R Refusal														CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable														DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense														SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio														VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample														CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																																																																																																																											
martens (C) Copyright Martens & Associates Pty. Ltd . 2015														MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au														Engineering Log - Borehole																																																																																																															

CLIENT		Precise Planning				COMMENCED		11/6/15		COMPLETED		11/6/15		REF		BH108	
PROJECT		Salinity Assessment				LOGGED		GMT		CHECKED		RE		Sheet 1 of 1			
SITE		95 Great Southern Road, Bargo, NSW				GEOLOGY		Shale		VEGETATION		Grass		PROJECT NO. P1504741			
EQUIPMENT		Hand Auger				EASTING		NA		RL SURFACE		NA					
EXCAVATION DIMENSIONS		Ø90mm X 0.55m depth				NORTHING		NA		ASPECT		East		SLOPE		<5%	
EXCAVATION DATA						MATERIAL DATA						SAMPLING & TESTING					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION		CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS			
								SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.									
HA	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.		F		A	0.1	- TOPSOIL 4741/108/ 0.1			
HA	Nil	N	M	0.25			CL-CL	Sandy CLAY - Low to medium plasticity, fine grained, brown, with sandstone gravels (2-20mm, angular).		F-St		A	0.3	- RESIDUAL 4741/108/ 0.3			
HA	Nil	N	M	0.5			CL	CLAY - Medium plasticity, light brown.		St		A	0.5	- RESIDUAL 4741/108/ 0.5			
				0.55				Hand auger refusal at 0.55m on stiff clay.									
				0.75										0.75			
				1.0										1.0			
				1.25										1.25			
				1.5										1.5			
				1.75										1.75			
				2.0										2.0			
				2.25										2.25			
EQUIPMENT / METHOD		SUPPORT	WATER	MOISTURE	DRILLING RESISTANCE	CONSISTENCY	DENSITY	SAMPLING & TESTING		VS		CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION					
N Natural exposure		SH Shoring	N None observed	D Dry	L Low	VS Very Soft	VL Very Loose	A Auger sample		VS Vane shear		USCS					
X Existing excavation		SC Shotcrete	X Not measured	M Moist	M Moderate	S Soft	L Loose	B Bulk sample		DCP Dynamic cone penetrometer		N Agricultural					
BH Backhoe bucket		RB Rock Bolts	Water level	W Wet	H High	F Firm	MD Medium Dense	U Undisturbed sample		FD Field density							
HA Hand auger		Nil No support	Water outflow	Wp Plastic limit	R Refusal	St Stiff	D Dense	D Disturbed sample		M Moisture content							
S Spade			Water inflow	WI Liquid limit		VSt Very Stiff	VD Very Dense	Ux Tube sample (x mm)		WS Water sample							
V V-Bit						H Hard		pp Pocket penetrometer									
TC Tungsten Carbide Bit						F Friable		S Standard penetration test									
PT Push tube								CBR California Bearing Ratio									
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																	
 Martens (C) Copyright Martens & Associates Pty. Ltd . 2015 MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au Engineering Log - Borehole																	

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH109																																																																																																																																					
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																																																																																																																																					
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																																																																																																																																					
EQUIPMENT	Hand Auger	EASTING	NA	RL SURFACE	NA																																																																																																																																						
EXCAVATION DIMENSIONS	Ø90mm X 0.5m depth	NORTHING	NA	ASPECT	East	SLOPE	<5%																																																																																																																																				
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																																																																																																																																					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																																																																																																																														
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																																																																																																																											
HA	Nil	N	M	0.15			CL-CI	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/109/ 0.1																																																																																																																														
HA	Nil	N	M	0.25			CL-CI	Sandy CLAY - Low to medium plasticity, fine grained, brown, with sandstone gravels (2-20mm, angular).	F-St		A	0.4	- RESIDUAL 4741/109/ 0.4																																																																																																																														
				0.5				Hand auger refusal at 0.5m on gravels.																																																																																																																																			
				0.75																																																																																																																																							
				1.0																																																																																																																																							
				1.25																																																																																																																																							
				1.5																																																																																																																																							
				1.75																																																																																																																																							
				2.0																																																																																																																																							
				2.25																																																																																																																																							
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support														WATER N None observed X Not measured Water level Water outflow Water inflow														MOISTURE D Dry M Moist W Wet Wp Plastic limit Wl Liquid limit														DRILLING RESISTANCE L Low M Moderate H High R Refusal														CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable														DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense														SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio														VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample														CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION USCS Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																																																																																																																											
martens														MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au														Engineering Log - Borehole																																																																																																															

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH110																									
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																									
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																									
EQUIPMENT	Hand Auger	EASTING	NA	RL SURFACE	NA																										
EXCAVATION DIMENSIONS	Ø90mm X 0.5m depth	NORTHING	NA	ASPECT	East	SLOPE	<5%																								
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																									
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																		
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																															
HA	Nil	N	M	0.15			CL-Cl	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/110/ 0.1																		
HA	Nil	N	M	0.25			CL-Cl	Sandy CLAY - Low to medium plasticity, fine grained, brown, with sandstone gravels (2-20mm, angular).	F-St		A	0.4	- RESIDUAL 4741/110/ 0.4																		
				0.5				Hand auger refusal at 0.5m on gravels.																							
				0.75																											
				1.0																											
				1.25																											
				1.5																											
				1.75																											
				2.0																											
				2.25																											
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support		WATER N None observed X Not measured ▽ Water level △ Water outflow ▽ Water inflow		MOISTURE D Dry M Moist W Wet Wp Plastic limit WI Liquid limit		DRILLING RESISTANCE L Low M Moderate H High R Refusal		CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable		DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense		SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio		VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample		CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural	
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																															
 (C) Copyright Martens & Associates Pty. Ltd . 2015													MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au										Engineering Log - Borehole								

CLIENT Precise Planning				COMMENCED 11/6/15		COMPLETED 11/6/15		REF BH111	
PROJECT Salinity Assessment				LOGGED GMT		CHECKED RE		Sheet 1 of 1	
SITE 95 Great Southern Road, Bargo, NSW				GEOLOGY Shale		VEGETATION Grass		PROJECT NO. P1504741	
EQUIPMENT Hydraulic Auger				EASTING NA		RL SURFACE NA			
EXCAVATION DIMENSIONS Ø95mm X 1.6m depth				NORTHING NA		ASPECT West		SLOPE <2%	

EXCAVATION DATA				MATERIAL DATA				SAMPLING & TESTING						
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS	
								SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.						
V	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/111/ 0.1	
V	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St		A	0.5	- RESIDUAL 4741/111/ 0.5	
V	Nil	N	M	0.75			CH	CLAY - High plasticity, brown/light brown.	St-VSt		A	0.9	- RESIDUAL 4741/111/ 0.9	
V	Nil	N	M	1.5							A	1.5	4741/111/ 1.5	
				1.6				V-bit refusal at 1.6m on inferred very low strength shale.						
				1.75									1.75	
				2.0									2.0	
				2.25									2.25	

EQUIPMENT / METHOD		SUPPORT		WATER		MOISTURE		DRILLING RESISTANCE		CONSISTENCY		DENSITY		SAMPLING & TESTING		CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION	
N	Natural exposure	SH	Shoring	N	None observed	D	Dry	VS	Very Soft	VL	Very Loose	A	Auger sample	VS	Vane shear	Y	USCS
X	Existing excavation	SC	Shotcrete	X	Not measured	M	Moist	S	Soft	L	Loose	B	Bulk sample	DCP	Dynamic cone penetrometer	N	Agricultural
BH	Backhoe bucket	RB	Rock Bolts	▽	Water level	W	Wet	F	Firm	MD	Medium Dense	U	Undisturbed sample				
HA	Hand auger	Nil	No support	△	Water outflow	Wp	Plastic limit	St	Stiff	D	Dense	Dx	Disturbed sample	FD	Field density		
S	Spade			▽	Water inflow	WL	Liquid limit	VSt	Very Stiff	VD	Very Dense	Ux	Tube sample (x mm)	M	Moisture content		
CC	Concrete Corer							H	Hard			pp	Pocket penetrometer	WS	Water sample		
V	V-Bit							F	Friable			S	Standard penetration test				
TC	Tungsten Carbide Bit												CBR California Bearing Ratio				
PT	Push tube																

EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS

martens

(C) Copyright Martens & Associates Pty. Ltd . 2015

MARTENS & ASSOCIATES PTY LTD

Suite 201, 20 George St, Hornsby, NSW 2077 Australia

Phone: (02) 9476 9999 Fax: (02) 9476 8767

mail@martens.com.au WEB: http://www.martens.com.au

Engineering Log - Borehole

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH112																											
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																											
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																											
EQUIPMENT	Hydraulic Auger	EASTING	NA	RL SURFACE	NA																												
EXCAVATION DIMENSIONS	Ø95mm X 1.6m depth	NORTHING	NA	ASPECT	West	SLOPE	<2%																										
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																											
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																				
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																	
V	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/112/ 0.1																				
V	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St		A	0.5	- RESIDUAL 4741/112/ 0.5																				
V	Nil	N	M	0.75			CH	CLAY - High plasticity, brown/light brown.	St-VSt		A	0.9	- RESIDUAL 4741/112/ 0.9																				
V	Nil	N	M	1.3				V-bit refusal at 1.4m on inferred very low strength shale.																									
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket HA Hand auger S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support		WATER N None observed X Not measured Water level Water outflow Water inflow		MOISTURE D Dry M Moist Wp Plastic limit Wl Liquid limit		DRILLING RESISTANCE L Low M Moderate H High R Refusal		CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable		DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense		SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio		VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample		CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural			
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																	
martens												MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au												Engineering Log - Borehole									

CLIENT	Precise Planning	COMMENCED	11/6/15	COMPLETED	11/6/15	REF BH113																																																																																																																																					
PROJECT	Salinity Assessment	LOGGED	GMT	CHECKED	RE	Sheet 1 of 1																																																																																																																																					
SITE	95 Great Southern Road, Bargo, NSW	GEOLOGY	Shale	VEGETATION	Grass	PROJECT NO. P1504741																																																																																																																																					
EQUIPMENT	Hydraulic Auger	EASTING	NA	RL SURFACE	NA																																																																																																																																						
EXCAVATION DIMENSIONS	Ø95mm X 1.7m depth	NORTHING	NA	ASPECT	South East	SLOPE	<5%																																																																																																																																				
EXCAVATION DATA		MATERIAL DATA				SAMPLING & TESTING																																																																																																																																					
METHOD	SUPPORT	WATER	MOISTURE	DEPTH (M)	DRILLING RESISTANCE	GRAPHIC LOG	CLASSIFICATION	MATERIAL DESCRIPTION	CONSISTENCY	DENSITY INDEX	TYPE	DEPTH (M)	RESULTS AND ADDITIONAL OBSERVATIONS																																																																																																																														
SOIL NAME, plasticity or particle characteristics, colour, secondary and minor components, moisture condition, consistency/relative density, ROCK NAME, grain size, texture/fabric, colour, strength, weathering.																																																																																																																																											
V	Nil	N	M	0.15			CL-CL	Silty CLAY - Low to medium plasticity, dark brown, with rootlets.	F		A	0.1	- TOPSOIL 4741/113/ 0.1																																																																																																																														
V	Nil	N	M	0.25			CI	CLAY - Medium plasticity, brown.	St				- RESIDUAL 0.25																																																																																																																														
V	Nil	N	M	0.5							A	0.5	4741/113/ 0.5 0.5																																																																																																																														
V	Nil	N	M	0.6									- RESIDUAL																																																																																																																														
V	Nil	N	M	0.75									0.75																																																																																																																														
V	Nil	N	M	1.0			CH	CLAY - High plasticity, brown/light brown.	St-VSt		A	0.9	4741/113/ 0.9 1.0																																																																																																																														
V	Nil	N	M	1.25									1.25																																																																																																																														
V	Nil	N	M	1.5							A	1.5	4741/113/ 1.5 1.5																																																																																																																														
V	Nil	N	M	1.7																																																																																																																																							
				1.75				V-bit refusal at 1.7m on inferred very low strength shale.					1.75																																																																																																																														
				2.0									2.0																																																																																																																														
				2.25									2.25																																																																																																																														
EQUIPMENT / METHOD N Natural exposure X Existing excavation BH Backhoe bucket S Spade CC Concrete Corer V V-Bit TC Tungsten Carbide Bit PT Push tube														SUPPORT SH Shoring SC Shotcrete RB Rock Bolts Nil No support														WATER N None observed X Not measured Water level Water outflow Water inflow														MOISTURE D Dry M Moist W Wet Wp Plastic limit WL Liquid limit														DRILLING RESISTANCE L Low M Moderate H High R Refusal														CONSISTENCY VS Very Soft S Soft F Firm St Stiff VSt Very Stiff H Hard F Friable														DENSITY VL Very Loose L Loose MD Medium Dense D Dense VD Very Dense														SAMPLING & TESTING A Auger sample B Bulk sample U Undisturbed sample D Disturbed sample Ux Tube sample (x mm) pp Pocket penetrometer S Standard penetration test CBR California Bearing Ratio														VS Vane shear DCP Dynamic cone penetrometer FD Field density M Moisture content WS Water sample														CLASSIFICATION SYMBOLS AND SOIL DESCRIPTION Y USCS N Agricultural													
EXCAVATION LOG TO BE READ IN CONJUNCTION WITH ACCOMPANYING REPORT NOTES AND ABBREVIATIONS																																																																																																																																											
martens (C) Copyright Martens & Associates Pty. Ltd . 2015														MARTENS & ASSOCIATES PTY LTD Suite 201, 20 George St, Hornsby, NSW 2077 Australia Phone: (02) 9476 9999 Fax: (02) 9476 8767 mail@martens.com.au WEB: http://www.martens.com.au														Engineering Log - Borehole																																																																																																															

8 **Attachment C - Salinity Laboratory Report**

CERTIFICATE OF ANALYSIS

129460

Client:

Martens & Associates Pty Ltd
Suite 201, 20 George St
Hornsby
NSW 2077

Attention: Grant Taylor, J Fulton

Sample log in details:

Your Reference:	<u>P1504741 - 95 Great Southern Rd, Bargo</u>
No. of samples:	36 Soils
Date samples received / completed instructions received	12/06/15 / 12/06/15

Analysis Details:

Please refer to the following pages for results, methodology summary and quality control data.
Samples were analysed as received from the client. Results relate specifically to the samples as received.
Results are reported on a dry weight basis for solids and on an as received basis for other matrices.
Please refer to the last page of this report for any comments relating to the results.

Report Details:

Date results requested by: / Issue Date:	19/06/15 / 16/06/15
Date of Preliminary Report:	Not Issued

NATA accreditation number 2901. This document shall not be reproduced except in full.
Accredited for compliance with ISO/IEC 17025. **Tests not covered by NATA are denoted with *.**

Results Approved By:



Jacinta Hurst
Laboratory Manager

Misc Inorg - Soil						
Our Reference:	UNITS	129460-1	129460-2	129460-3	129460-4	129460-5
Your Reference	-----	4741/101	4741/101	4741/101	4741/101	4741/102
Depth	-----	0.15	0.4	0.9	1.5	0.1
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	6.1	5.6	5.6	5.5	5.8
Electrical Conductivity 1:5 soil:water	µS/cm	77	22	36	29	34
Sulphate, SO4 1:5 soil:water	mg/kg	[NA]	24	[NA]	33	[NA]

Misc Inorg - Soil						
Our Reference:	UNITS	129460-6	129460-7	129460-8	129460-9	129460-10
Your Reference	-----	4741/102	4741/102	4741/102	4741/103	4741/103
Depth	-----	0.5	1.1	1.5	0.1	0.4
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	6.0	5.6	5.5	5.6	6.0
Electrical Conductivity 1:5 soil:water	µS/cm	38	54	54	310	74
Sulphate, SO4 1:5 soil:water	mg/kg	22	<10	[NA]	[NA]	48

Misc Inorg - Soil						
Our Reference:	UNITS	129460-11	129460-12	129460-13	129460-14	129460-15
Your Reference	-----	4741/103	4741/104	4741/104	4741/105	4741/105
Depth	-----	0.6	0.1	0.4	0.1	0.5
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	5.6	5.9	5.8	5.9	5.7
Electrical Conductivity 1:5 soil:water	µS/cm	67	170	130	31	18
Sulphate, SO4 1:5 soil:water	mg/kg	[NA]	[NA]	42	[NA]	10

Misc Inorg - Soil						
Our Reference:	UNITS	129460-16	129460-17	129460-18	129460-19	129460-20
Your Reference	-----	4741/105	4741/105	4741/106	4741/106	4741/107
Depth	-----	0.9	1.6	0.1	0.5	0.1
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	5.4	5.4	6.0	6.0	5.9
Electrical Conductivity 1:5 soil:water	µS/cm	26	48	11	13	29
Sulphate, SO4 1:5 soil:water	mg/kg	10	[NA]	[NA]	10	[NA]

Misc Inorg - Soil						
Our Reference:	UNITS	129460-21	129460-22	129460-23	129460-24	129460-25
Your Reference	-----	4741/107	4741/108	4741/108	4741/108	4741/109
Depth	-----	0.4	0.1	0.3	0.5	0.1
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	5.8	6.0	6.2	6.3	6.1
Electrical Conductivity 1:5 soil:water	µS/cm	12	60	21	20	80
Sulphate, SO4 1:5 soil:water	mg/kg	10	[NA]	<10	10	[NA]

Misc Inorg - Soil						
Our Reference:	UNITS	129460-26	129460-27	129460-28	129460-29	129460-30
Your Reference	-----	4741/109	4741/110	4741/110	4741/111	4741/111
Depth	-----	0.4	0.1	0.4	0.1	0.5
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	6.2	5.8	5.6	5.5	5.4
Electrical Conductivity 1:5 soil:water	µS/cm	14	32	14	30	39
Sulphate, SO4 1:5 soil:water	mg/kg	<10	[NA]	<10	[NA]	50

Misc Inorg - Soil						
Our Reference:	UNITS	129460-31	129460-32	129460-33	129460-34	129460-35
Your Reference	-----	4741/111	4741/111	4741/113	4741/113	4741/113
Depth	-----	0.9	1.5	0.1	0.5	1.5
Date Sampled		11/06/2015	11/06/2015	11/06/2015	11/06/2015	11/06/2015
Type of sample		Soils	Soils	Soils	Soils	Soils
Date prepared	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
Date analysed	-	15/06/2015	15/06/2015	15/06/2015	15/06/2015	15/06/2015
pH 1:5 soil:water	pH Units	5.4	5.6	5.8	4.7	5.1
Electrical Conductivity 1:5 soil:water	µS/cm	57	43	64	93	61
Sulphate, SO4 1:5 soil:water	mg/kg	40	[NA]	[NA]	170	22

Misc Inorg - Soil		
Our Reference:	UNITS	129460-36
Your Reference	-----	4741/106
Depth	-----	0.7
Date Sampled		11/06/2015
Type of sample		Soils
Date prepared	-	15/06/2015
Date analysed	-	15/06/2015
pH 1:5 soil:water	pH Units	5.8
Electrical Conductivity 1:5 soil:water	µS/cm	11

Method ID	Methodology Summary
Inorg-001	pH - Measured using pH meter and electrode in accordance with APHA latest edition, 4500-H+. Please note that the results for water analyses are indicative only, as analysis outside of the APHA storage times.
Inorg-002	Conductivity and Salinity - measured using a conductivity cell at 25oC in accordance with APHA latest edition 2510 and Rayment & Lyons.
Inorg-081	Anions - a range of Anions are determined by Ion Chromatography, in accordance with APHA latest edition, 4110-B.

Client Reference: P1504741 - 95 Great Southern Rd, Bargo

QUALITYCONTROL	UNITS	PQL	METHOD	Blank	Duplicate Sm#	Duplicate results	Spike Sm#	Spike % Recovery
Misc Inorg - Soil						Base Duplicate %RPD		
Date prepared	-			15/06/2015	129460-1	15/06/2015 15/06/2015	LCS-1	15/06/2015
Date analysed	-			15/06/2015	129460-1	15/06/2015 15/06/2015	LCS-1	15/06/2015
pH 1:5 soil:water	pH Units		Inorg-001	[NT]	129460-1	6.1 6.1 RPD: 0	LCS-1	102%
Electrical Conductivity 1:5 soil:water	µS/cm	1	Inorg-002	<1	129460-1	77 72 RPD: 7	LCS-1	98%
Sulphate, SO4 1:5 soil:water	mg/kg	10	Inorg-081	<10	[NT]	[NT]	LCS-1	120%
QUALITYCONTROL Misc Inorg - Soil	UNITS	Dup. Sm#		Duplicate Base + Duplicate + %RPD		Spike Sm#	Spike % Recovery	
Date prepared	-	129460-11		15/06/2015 15/06/2015		LCS-2	15/06/2015	
Date analysed	-	129460-11		15/06/2015 15/06/2015		LCS-2	15/06/2015	
pH 1:5 soil:water	pH Units	129460-11		5.6 5.6 RPD: 0		LCS-2	101%	
Electrical Conductivity 1:5 soil:water	µS/cm	129460-11		67 67 RPD: 0		LCS-2	97%	
Sulphate, SO4 1:5 soil:water	mg/kg	[NT]		[NT]		LCS-2	117%	
QUALITYCONTROL Misc Inorg - Soil	UNITS	Dup. Sm#		Duplicate Base + Duplicate + %RPD		Spike Sm#	Spike % Recovery	
Date prepared	-	129460-21		15/06/2015 15/06/2015		129460-4	15/06/2015	
Date analysed	-	129460-21		15/06/2015 15/06/2015		129460-4	15/06/2015	
pH 1:5 soil:water	pH Units	129460-21		5.8 5.9 RPD: 2		[NR]	[NR]	
Electrical Conductivity 1:5 soil:water	µS/cm	129460-21		12 13 RPD: 8		[NR]	[NR]	
Sulphate, SO4 1:5 soil:water	mg/kg	129460-21		10 10 RPD: 0		129460-4	130%	
QUALITYCONTROL Misc Inorg - Soil	UNITS	Dup. Sm#		Duplicate Base + Duplicate + %RPD				
Date prepared	-	129460-31		15/06/2015 15/06/2015				
Date analysed	-	129460-31		15/06/2015 15/06/2015				
pH 1:5 soil:water	pH Units	129460-31		5.4 5.4 RPD: 0				
Electrical Conductivity 1:5 soil:water	µS/cm	129460-31		57 52 RPD: 9				
Sulphate, SO4 1:5 soil:water	mg/kg	129460-31		40 34 RPD: 16				
QUALITYCONTROL Misc Inorg - Soil	UNITS	Dup. Sm#		Duplicate Base + Duplicate + %RPD				
Date prepared	-	129460-2		15/06/2015 15/06/2015				
Date analysed	-	129460-2		15/06/2015 15/06/2015				
pH 1:5 soil:water	pH Units	129460-2		5.6 [N/T]				
Electrical Conductivity 1:5 soil:water	µS/cm	129460-2		22 [N/T]				
Sulphate, SO4 1:5 soil:water	mg/kg	129460-2		24 21 RPD: 13				

Report Comments:

Asbestos ID was analysed by Approved Identifier:
Asbestos ID was authorised by Approved Signatory:

Not applicable for this job
Not applicable for this job

INS: Insufficient sample for this test
NA: Test not required
<: Less than

PQL: Practical Quantitation Limit
RPD: Relative Percent Difference
>: Greater than

NT: Not tested
NA: Test not required
LCS: Laboratory Control Sample

Quality Control Definitions

Blank: This is the component of the analytical signal which is not derived from the sample but from reagents, glassware etc, can be determined by processing solvents and reagents in exactly the same manner as for samples.

Duplicate: This is the complete duplicate analysis of a sample from the process batch. If possible, the sample selected should be one where the analyte concentration is easily measurable.

Matrix Spike: A portion of the sample is spiked with a known concentration of target analyte. The purpose of the matrix spike is to monitor the performance of the analytical method used and to determine whether matrix interferences exist.

LCS (Laboratory Control Sample): This comprises either a standard reference material or a control matrix (such as a blank sand or water) fortified with analytes representative of the analyte class. It is simply a check sample.

Surrogate Spike: Surrogates are known additions to each sample, blank, matrix spike and LCS in a batch, of compounds which are similar to the analyte of interest, however are not expected to be found in real samples.

Laboratory Acceptance Criteria

Duplicate sample and matrix spike recoveries may not be reported on smaller jobs, however, were analysed at a frequency to meet or exceed NEPM requirements. All samples are tested in batches of 20. The duplicate sample RPD and matrix spike recoveries for the batch were within the laboratory acceptance criteria.

Filters, swabs, wipes, tubes and badges will not have duplicate data as the whole sample is generally extracted during sample extraction.

Spikes for Physical and Aggregate Tests are not applicable.

For VOCs in water samples, three vials are required for duplicate or spike analysis.

Duplicates: <5xPQL - any RPD is acceptable; >5xPQL - 0-50% RPD is acceptable.

Matrix Spikes, LCS and Surrogate recoveries: Generally 70-130% for inorganics/metals; 60-140% for organics (+/-50% surrogates) and 10-140% for labile SVOCs (including labile surrogates), ultra trace organics and speciated phenols is acceptable.

In circumstances where no duplicate and/or sample spike has been reported at 1 in 10 and/or 1 in 20 samples respectively, the sample volume submitted was insufficient in order to satisfy laboratory QA/QC protocols.

When samples are received where certain analytes are outside of recommended technical holding times (THTs), the analysis has proceeded. Where analytes are on the verge of breaching THTs, every effort will be made to analyse within the THT or as soon as practicable.

9 **Attachment D - Notes About This Report**

Subsurface conditions cause more construction problems than any other factor. These notes have been prepared by Martens to help you interpret and understand the limitations of your report. Not all of course, are necessarily relevant to all reports, but are included as general reference.

Engineering Reports - Limitations

Geotechnical reports are based on information gained from limited sub-surface site testing and sampling, supplemented by knowledge of local geology and experience. For this reason, they must be regarded as interpretative rather than factual documents, limited to some extent by the scope of information on which they rely.

Engineering Reports – Project Specific Criteria

Engineering reports are prepared by qualified personnel and are based on the information obtained, on current engineering standards of interpretation and analysis, and on the basis of your unique project specific requirements as understood by Martens. Project criteria typically include the general nature of the project; its size and configuration; the location of any structures on the site; other site improvements; the presence of underground utilities; and the additional risk imposed by scope-of-service limitations imposed by the Client.

Where the report has been prepared for a specific design proposal (eg. a three storey building), the information and interpretation may not be relative if the design proposal is changed (eg. to a twenty storey building). Your report should not be relied upon if there are changes to the project without first asking Martens to assess how factors that changed subsequent to the date of the report affect the report's recommendations. Martens will not accept responsibility for problems that may occur due to design changes if they are not consulted.

Engineering Reports – Recommendations

Your report is based on the assumption that the site conditions as revealed through selective point sampling are indicative of actual conditions throughout an area. This assumption often cannot be substantiated until project implementation has commenced and therefore your site investigation report recommendations should only be regarded as preliminary.

Only Martens, who prepared the report, are fully familiar with the background information needed to assess whether or not the report's recommendations are valid and whether or not changes should be considered as the project develops. If another party undertakes the implementation of the recommendations of this report there is a risk that the report will be misinterpreted and Martens cannot be held responsible for such misinterpretation.

Engineering Reports – Use For Tendering Purposes

Where information obtained from this investigation is provided for tendering purposes, Martens recommend that all information, including the written report and discussion, be made available. In circumstances where the discussion or comments section is not relevant to the contractual situation, it may be appropriate to prepare a specially edited document. Attention is drawn to the document 'Guidelines for the Provision of Geotechnical Information in Tender Documents', published by the Institution of Engineers, Australia.

The Company would be pleased to assist in this regard and/or to make additional report copies available for contract purposes at a nominal charge.

Engineering Reports – Data

The report as a whole presents the findings of the site assessment and the report should not be copied in part or altered in any way.

Logs, figures, drawings etc are customarily included in a Martens report and are developed by scientists, engineers or geologists based on their interpretation of field logs (assembled by field personnel) and laboratory evaluation of field samples. These data should not under any circumstances be redrawn for inclusion in other documents or separated from the report in any way.

Engineering Reports – Other Projects

To avoid misuse of the information contained in your report it is recommended that you confer with Martens before passing your report on to another party who may not be familiar with the background and the purpose of the report. Your report should not be applied to any project other than that originally specified at the time the report was issued.

Subsurface Conditions - General

Every care is taken with the report as it relates to interpretation of subsurface conditions, discussion of geotechnical aspects, relevant standards and recommendations or suggestions for design and construction. However, the Company cannot always anticipate or assume responsibility for:

- Unexpected variations in ground conditions - the potential for will depend partly on test point (eg. excavation or borehole) spacing and sampling frequency which are often limited by project imposed budgetary constraints.
- Changes in guidelines, standards and policy or interpretation of guidelines, standards and

policy by statutory authorities.

- o The actions of contractors responding to commercial pressures.
- o Actual conditions differing somewhat from those inferred to exist, because no professional, no matter how qualified, can reveal precisely what is hidden by earth, rock and time.

The actual interface between materials may be far more gradual or abrupt than assumed based on the facts obtained. Nothing can be done to change the actual site conditions which exist, but steps can be taken to reduce the impact of unexpected conditions

If these conditions occur, the Company will be pleased to assist with investigation or advice to resolve the matter.

Subsurface Conditions - Changes

Natural processes and the activity of man create subsurface conditions. For example, water levels can vary with time, fill may be placed on a site and pollutants may migrate with time. Reports are based on conditions which existed at the time of the subsurface exploration.

Decisions should not be based on a report whose adequacy may have been affected by time. If an extended period of time has elapsed since the report was prepared, consult Martens to be advised how time may have impacted on the project.

Subsurface Conditions - Site Anomalies

In the event that conditions encountered on site during construction appear to vary from those that were expected from the information contained in the report, the Company requests that it immediately be notified. Most problems are much more readily resolved at the time when conditions are exposed, rather than at some later stage well after the event.

Report Use By Other Design Professionals

To avoid potentially costly misinterpretations when other design professionals develop their plans based on a report, retain Martens to work with other project professionals who are affected by the report. This may involve Martens explaining the report design implications and then reviewing plans and specifications produced to see how they have incorporated the report findings.

Subsurface Conditions - Geoenvironmental Issues

Your report generally does not relate to any findings, conclusions, or recommendations about the potential for hazardous or contaminated materials existing at the site unless specifically required to do so as part of the Company's proposal for works.

Specific sampling guidelines and specialist equipment, techniques and personnel are typically used to perform geoenvironmental or site contamination assessments. Contamination can create major health, safety and environmental risks. If you have no information about the potential for your site to be contaminated or create an environmental hazard, you are advised to contact Martens for information relating to such matters.

Responsibility

Geotechnical reporting relies on interpretation of factual information based on professional judgment and opinion and has an inherent level of uncertainty attached to it and is typically far less exact than the design disciplines. This has often resulted in claims being lodged against consultants, which are unfounded.

To help prevent this problem, a number of clauses have been developed for use in contracts, reports and other documents. Responsibility clauses do not transfer appropriate liabilities from Martens to other parties but are included to identify where Martens' responsibilities begin and end. Their use is intended to help all parties involved to recognize their individual responsibilities. Read all documents from Martens closely and do not hesitate to ask any questions you may have.

Site Inspections

Martens will always be pleased to provide engineering inspection services for aspects of work to which this report is related. This could range from a site visit to confirm that conditions exposed are as expected, to full time engineering presence on site. Martens is familiar with a variety of techniques and approaches that can be used to help reduce risks for all parties to a project, from design to construction.

Soil Data

Explanation of Terms (1 of 3)

Definitions

In engineering terms, soil includes every type of uncemented or partially cemented inorganic or organic material found in the ground. In practice, if the material does not exhibit any visible rock properties and can be remoulded or disintegrated by hand in its field condition or in water it is described as a soil. Other materials are described using rock description terms.

The methods of description and classification of soils and rocks used in this report are based on Australian Standard 1726 and the S.A.A Site Investigation Code. In general, descriptions cover the following properties - strength or density, colour, structure, soil or rock type and inclusions.


Particle Size

Soil types are described according to the predominating particle size, qualified by the grading of other particles present (eg. sandy clay). Unless otherwise stated, particle size is described in accordance with the following table.

Division	Subdivision	Size
BOULDERS		>200 mm
COBBLES		60 to 200 mm
GRAVEL	Coarse	20 to 60 mm
	Medium	6 to 20 mm
	Fine	2 to 6 mm
SAND	Coarse	0.6 to 2.0 mm
	Medium	0.2 to 0.6 mm
	Fine	0.075 to 0.2 mm
SILT		0.002 to 0.075 mm
CLAY		< 0.002 mm

Plasticity Properties

Plasticity properties can be assessed either in the field by tactile properties, or by laboratory procedures.

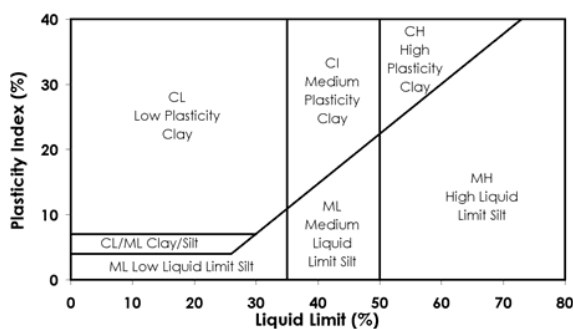

Moisture Condition

Dry	Looks and feels dry. Cohesive and cemented soils are hard, friable or powdery. Uncemented granular soils run freely through hands.
Moist	Soil feels cool and damp and is darkened in colour. Cohesive soils can be moulded. Granular soils tend to cohere.
Wet	As for moist but with free water forming on hands when handled.

Consistency of Cohesive Soils

Cohesive soils refer to predominantly clay materials.

Term	C_u (kPa)	Approx SPT "N"	Field Guide
Very Soft	<12	2	A finger can be pushed well into the soil with little effort.
Soft	12 - 25	2 to 4	A finger can be pushed into the soil to about 25mm depth.
Firm	25 - 50	4 - 8	The soil can be indented about 5mm with the thumb, but not penetrated.
Stiff	50 - 100	8 - 15	The surface of the soil can be indented with the thumb, but not penetrated.
Very Stiff	100 - 200	15 - 30	The surface of the soil can be marked, but not indented with thumb pressure.
Hard	> 200	> 30	The surface of the soil can be marked only with the thumbnail.
Friable	-	-	Crumbles or powders when scraped by thumbnail

Density of Granular Soils

Non-cohesive soils are classified on the basis of relative density, generally from the results of standard penetration test (SPT) or Dutch cone penetrometer tests (CPT) as below:

Relative Density	%	SPT 'N' Value (blows/300mm)	CPT Cone Value (q_c Mpa)
Very loose	< 15	< 5	< 2
Loose	15 - 35	5 - 10	2 - 5
Medium dense	35 - 65	10 - 30	5 - 15
Dense	65 - 85	30 - 50	15 - 25
Very dense	> 85	> 50	> 25

Minor Components

Minor components in soils may be present and readily detectable, but have little bearing on general geotechnical classification. Terms include:

Term	Assessment	Proportion of Minor component In:
Trace of	Presence just detectable by feel or eye, but soil properties little or no different to general properties of primary component.	Coarse grained soils: < 5 % Fine grained soils: < 15 %
With some	Presence easily detectable by feel or eye, soil properties little different to general properties of primary component.	Coarse grained soils: 5 - 12 % Fine grained soils: 15 - 30 %

Soil Data

Explanation of Terms (2 of 3)

Soil Agricultural Classification Scheme

In some situations, such as where soils are to be used for effluent disposal purposes, soils are often more appropriately classified in terms of traditional agricultural classification schemes. Where a Martens report provides agricultural classifications, these are undertaken in accordance with descriptions by Northcote, K.H. (1979) *The factual key for the recognition of Australian Soils*, Rellim Technical Publications, NSW, p 26 - 28.

Symbol	Field Texture Grade	Behaviour of moist bolus	Ribbon length	Clay content (%)
S	Sand	Coherence nil to very slight; cannot be moulded; single grains adhere to fingers	0 mm	< 5
LS	Loamy sand	Slight coherence; discolours fingers with dark organic stain	6.35 mm	5
CLS	Clayey sand	Slight coherence; sticky when wet; many sand grains stick to fingers; discolours fingers with clay stain	6.35mm - 1.3cm	5 - 10
SL	Sandy loam	Bolus just coherent but very sandy to touch; dominant sand grains are of medium size and are readily visible	1.3 - 2.5	10 - 15
FSL	Fine sandy loam	Bolus coherent; fine sand can be felt and heard	1.3 - 2.5	10 - 20
SCL	Light sandy clay loam	Bolus strongly coherent but sandy to touch, sand grains dominantly medium size and easily visible	2.0	15 - 20
L	Loam	Bolus coherent and rather spongy; smooth feel when manipulated but no obvious sandiness or silkiness; may be somewhat greasy to the touch if much organic matter present	2.5	25
Lfsy	Loam, fine sandy	Bolus coherent and slightly spongy; fine sand can be felt and heard when manipulated	2.5	25
SiL	Silt loam	Coherent bolus, very smooth to silky when manipulated	2.5	25 + > 25 silt
SCL	Sandy clay loam	Strongly coherent bolus sandy to touch; medium size sand grains visible in a finer matrix	2.5 - 3.8	20 - 30
CL	Clay loam	Coherent plastic bolus; smooth to manipulate	3.8 - 5.0	30 - 35
SiCL	Silty clay loam	Coherent smooth bolus; plastic and silky to touch	3.8 - 5.0	30- 35 + > 25 silt
FSCL	Fine sandy clay loam	Coherent bolus; fine sand can be felt and heard	3.8 - 5.0	30 - 35
SC	Sandy clay	Plastic bolus; fine to medium sized sands can be seen, felt or heard in a clayey matrix	5.0 - 7.5	35 - 40
SiC	Silty clay	Plastic bolus; smooth and silky	5.0 - 7.5	35 - 40 + > 25 silt
LC	Light clay	Plastic bolus; smooth to touch; slight resistance to shearing	5.0 - 7.5	35 - 40
LMC	Light medium clay	Plastic bolus; smooth to touch, slightly greater resistance to shearing than LC	7.5	40 - 45
MC	Medium clay	Smooth plastic bolus, handles like plasticine and can be moulded into rods without fracture, some resistance to shearing	> 7.5	45 - 55
HC	Heavy clay	Smooth plastic bolus; handles like stiff plasticine; can be moulded into rods without fracture; firm resistance to shearing	> 7.5	> 50

Explanation of Terms (3 of 3)

Unified Soil Classification Scheme (USCS)

FIELD IDENTIFICATION PROCEDURES (Excluding particles larger than 63 mm and basing fractions on estimated mass)					USCS	Primary Name	
COARSE GRAINED SOILS More than 50 % of material less than 63 mm is larger than 0.075 mm	(A 0.075 mm particle is about the smallest particle visible to the naked eye)	GRAVELS More than half of coarse fraction is larger than 2.0 mm.	CLEAN GRAVELS (Little or no fines)	Wide range in grain size and substantial amounts of all intermediate particle sizes.	GW	Gravel	
				Predominantly one size or a range of sizes with more intermediate sizes missing	GP	Gravel	
			GRAVELS WITH FINES (Appreciable amount of fines)	Non-plastic fines (for identification procedures see ML below)	GM	Silty Gravel	
				Plastic fines (for identification procedures see CL below)	GC	Clayey Gravel	
		SANDS More than half of coarse fraction is smaller than 2.0 mm	CLEAN SANDS (Little or no fines)	Wide range in grain sizes and substantial amounts of intermediate sizes missing.	SW	Sand	
				Predominantly one size or a range of sizes with some intermediate sizes missing	SP	Sand	
			SANDS WITH FINES (Appreciable amount of fines)	Non-plastic fines (for identification procedures see ML below)	SM	Silty Sand	
				Plastic fines (for identification procedures see CL below)	SC	Clayey Sand	
FINE GRAINED SOILS More than 50 % of material less than 63 mm is smaller than 0.075 mm	(A 0.075 mm particle is about the smallest particle visible to the naked eye)	IDENTIFICATION PROCEDURES ON FRACTIONS < 0.2 MM					
		DRY STRENGTH (Crushing Characteristics)	DILATANCY	TOUGHNESS	DESCRIPTION	USCS	Primary Name
		None to Low	Quick to Slow	None	Inorganic silts and very fine sands, rock flour, silty or clayey fine sands with slight plasticity	ML	Silt
		Medium to High	None	Medium	Inorganic clays of low to medium plasticity, gravely clays, sandy clays, silty clays, lean clays	CL	Clay
		Low to Medium	Slow to Very Slow	Low	Organic silts and organic silty clays of low plasticity	OL	Organic Silt
		Low to Medium	Slow to Very Slow	Low to Medium	Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts	MH	Silt
		High	None	High	Inorganic clays of high plasticity, fat clays	CH	Clay
		Medium to High	None	Low to Medium	Organic clays of medium to high plasticity	OH	Organic Silt
HIGHLY ORGANIC SOILS	Readily identified by colour, odour, spongy feel and frequently by fibrous texture				Pt	Peat	
Low Plasticity – Liquid Limit W_L < 35 % Medium Plasticity – Liquid limit W_L 35 to 60 % High Plasticity - Liquid limit W_L > 60 %							

Rock Data

Explanation of Terms (1 of 2)

Definitions

Descriptive terms used for Rock by Martens are given below and include rock substance, rock defects and rock mass.

Rock Substance	In geotechnical engineering terms, rock substance is any naturally occurring aggregate of minerals and organic matter which cannot, unless extremely weathered, be disintegrated or remoulded by hand in air or water. Other material is described using soil descriptive terms. Rock substance is effectively homogeneous and may be isotropic or anisotropic.
Rock Defect	Discontinuity or break in the continuity of a substance or substances.
Rock Mass	Any body of material which is not effectively homogeneous. It can consist of two or more substances without defects, or one or more substances with one or more defects.

Degree of Weathering

Rock weathering is defined as the degree in rock structure and grain property decline and can be readily determined in the field.

Term	Symbol	Definition
Residual Soil	Rs	Soil derived from the weathering of rock. The mass structure and substance fabric are no longer evident. There is a large change in volume but the soil has not been significantly transported.
Extremely weathered	EW	Rock substance affected by weathering to the extent that the rock exhibits soil properties - ie. it can be remoulded and can be classified according to the Unified Classification System, but the texture of the original rock is still evident.
Highly weathered	HW	Rock substance affected by weathering to the extent that limonite staining or bleaching affects the whole of the rock substance and other signs of chemical or physical decomposition are evident. Porosity and strength may be increased or decrease compared to the fresh rock usually as a result of iron leaching or deposition. The colour and strength of the original rock substance is no longer recognisable.
Moderately weathered	MW	Rock substance affected by weathering to the extent that staining extends throughout the whole of the rock substance and the original colour of the fresh rock is no longer recognisable.
Slightly weathered	SW	Rock substance affected by weathering to the extent that partial staining or discolouration of the rock substance usually by limonite has taken place. The colour and texture of the fresh rock is recognisable.
Fresh	Fr	Rock substance unaffected by weathering

Rock Strength

Rock strength is defined by the Point Load Strength Index (Is 50) and refers to the strength of the rock substance in the direction normal to the bedding. The test procedure is described by the International Society of Rock Mechanics.

Term	Is (50) MPa	Field Guide	Symbol
Extremely weak	< 0.03	Easily remoulded by hand to a material with soil properties.	EW
Very weak	0.03 - 0.1	May be crumbled in the hand. Sandstone is 'sugary' and friable.	VW
Weak	0.1 - 0.3	A piece of core 150mm long x 50mm diameter may be broken by hand and easily scored with a knife. Sharp edges of core may be friable and break during handling.	W
Medium strong	0.3 - 1	A piece of core 150mm long x 50mm diameter can be broken by hand with considerable difficulty. Readily scored with a knife.	MS
Strong	1 - 3	A piece of core 150mm long x 50mm diameter cannot be broken by unaided hands, can be slightly scratched or scored with a knife.	S
Very Strong	3 - 10	A piece of core 150mm long x 50mm diameter may be broken readily with hand held hammer. Cannot be scratched with pen knife.	VS
Extremely strong	> 10	A piece of core 150mm long x 50mm diameter is difficult to break with hand held hammer. Rings when struck with a hammer.	ES

Rock Data

Explanation of Terms (2 of 2)

Degree of Fracturing

This classification applies to diamond drill cores and refers to the spacing of all types of natural fractures along which the core is discontinuous. These include bedding plane partings, joints and other rock defects, but excludes fractures such as drilling breaks.

Term	Description
Fragmented	The core is comprised primarily of fragments of length less than 20mm, and mostly of width less than core diameter.
Highly fractured	Core lengths are generally less than 20mm-40mm with occasional fragments.
Fractured	Core lengths are mainly 30mm-100mm with occasional shorter and longer sections.
Slightly fractured	Core lengths are generally 300mm-1000mm with occasional longer sections and occasional sections of 100mm-300mm.
Unbroken	The core does not contain any fractures.

Test Methods

Explanation of Terms (1 of 2)

Sampling

Sampling is carried out during drilling or excavation to allow engineering examination (and laboratory testing where required) of the soil or rock.

Disturbed samples taken during drilling provide information on colour, type, inclusions and, depending upon the degree of disturbance, some information on strength and structure.

Undisturbed samples may be taken by pushing a thin-walled sample tube into the soils and withdrawing a soil sample in a relatively undisturbed state. Such samples yield information on structure and strength, and are necessary for laboratory determination of shear strength and compressibility. Undisturbed sampling is generally effective only in cohesive soils. Other sampling methods may be used. Details of the type and method of sampling are given in the report.

Drilling Methods

The following is a brief summary of drilling methods currently adopted by the Company and some comments on their use and application.

Hand Excavation – in some situations, excavation using hand tools such as mattock and spade may be required due to limited site access or shallow soil profiles.

Hand Auger - the hole is advanced by pushing and rotating either a sand or clay auger generally 75-100mm in diameter into the ground. The depth of penetration is usually limited to the length of the auger pole, however extender pieces can be added to lengthen this.

Test Pits - these are excavated with a backhoe or a tracked excavator, allowing close examination of the *in-situ* soils if it is safe to descend into the pit. The depth of penetration is limited to about 3m for a backhoe and up to 6m for an excavator. A potential disadvantage is the disturbance caused by the excavation.

Large Diameter Auger (eg. Pengo) - the hole is advanced by a rotating plate or short spiral auger, generally 300mm or larger in diameter. The cuttings are returned to the surface at intervals (generally of not more than 0.5m) and are disturbed but usually unchanged in moisture content. Identification of soil strata is generally much more reliable than with continuous spiral flight augers, and is usually supplemented by occasional undisturbed tube sampling.

Continuous Sample Drilling - the hole is advanced by pushing a 100mm diameter socket into the ground and withdrawing it at intervals to extrude the sample. This is the most reliable method of drilling in soils, since moisture content is unchanged and soil structure, strength *etc.* is only marginally affected.

Continuous Spiral Flight Augers - the hole is advanced using 90 - 115 mm diameter continuous spiral flight augers which are withdrawn at intervals to allow sampling or *in-situ* testing. This is a relatively economical means of drilling in clays and in sands above the water table. Samples are returned to the surface or, or may be collected after withdrawal of the auger flights, but they are very disturbed and may be contaminated. Information from the drilling (as distinct from specific sampling by SPTs or undisturbed samples) is of relatively lower reliability, due to remoulding, contamination or softening of samples by ground water.

Non-core Rotary Drilling - the hole is advanced by a rotary bit, with water being pumped down the drill rods and

returned up the annulus, carrying the drill cuttings. Only major changes in stratification can be determined from the cuttings, together with some information from 'feel' and rate of penetration.

Rotary Mud Drilling - similar to rotary drilling, but using drilling mud as a circulating fluid. The mud tends to mask the cuttings and reliable identification is again only possible from separate intact sampling (eg. from SPT).

Continuous Core Drilling - a continuous core sample is obtained using a diamond tipped core barrel, usually 50mm internal diameter. Provided full core recovery is achieved (which is not always possible in very weak rocks and granular soils), this technique provides a very reliable (but relatively expensive) method of investigation.

Standard Penetration Tests

Standard penetration tests are used mainly in non-cohesive soils, but occasionally also in cohesive soils as a means of determining density or strength and also of obtaining a relatively undisturbed sample. The test procedure is described in AS 1289 Methods of Testing Soils for Engineering Purposes - Test F3.1.

The test is carried out in a borehole by driving a 50mm diameter split sample tube under the impact of a 63 kg hammer with a free fall of 760mm. It is normal for the tube to be driven in three successive 150 mm increments and the 'N' value is taken as the number of blows for the last 300mm. In dense sands, very hard clays or weak rock, the full 450mm penetration may not be practicable and the test is discontinued.

The test results are reported in the following form:

(i) In the case where full penetration is obtained with successive blow counts for each 150mm of say 4, 6 and 7 blows:

as 4, 6, 7

N = 13

(ii) In a case where the test is discontinued short of full penetration, say after 15 blows for the first 150mm and 30 blows for the next 40mm

as 15, 30/40 mm.

The results of the tests can be related empirically to the engineering properties of the soil. Occasionally, the test method is used to obtain samples in 50mm diameter thin walled sample tubes in clays. In such circumstances, the test results are shown on the borelogs in brackets.

CONE PENETROMETER TESTING AND INTERPRETATION

Cone penetrometer testing (sometimes referred to as Dutch Cone - abbreviated as CPT) described in this report has been carried out using an electrical friction cone penetrometer. The test is described in AS 1289 - Test F4.1.

In the test, a 35mm diameter rod with a cone tipped end is pushed continuously into the soil, the reaction being provided by a specially designed truck or rig which is fitted with an hydraulic ram system. Measurements are made of the end bearing resistance on the cone and the friction resistance on separate 130mm long sleeve, immediately behind the cone. Transducers in the tip of the assembly are connected by electrical wires passing through the centre of the push rods to an amplifier and recorder unit mounted on the control truck.

As penetration occurs (at a rate of approximately 20mm per second) the information is output on continuous chart

Test Methods

Explanation of Terms (2 of 2)

recorders. The plotted results given in this report have been traced from the original records.

The information provided on the charts comprises:

Cone resistance - the actual end bearing force divided by the cross sectional area of the cone - expressed in MPa.

Sleeve friction - the frictional force of the sleeve divided by the surface area - expressed in kPa.

Friction ratio - the ratio of sleeve friction to cone resistance - expressed in percent.

There are two scales available for measurement of cone resistance. The lower (A) scale (0 - 5 Mpa) is used in very soft soils where increased sensitivity is required and is shown in the graphs as a dotted line. The main (B) scale (0 - 50 Mpa) is less sensitive and is shown as a full line.

The ratios of the sleeve resistance to cone resistance will vary with the type of soil encountered, with higher relative friction in clays than in sands. Friction ratios of 1%-2% are commonly encountered in sands and very soft clays rising to 4%-10% in stiff clays.

In sands, the relationship between cone resistance and SPT value is commonly in the range:

$$q_c \text{ (Mpa)} = (0.4 \text{ to } 0.6) N \text{ (blows/300mm)}$$

In clays, the relationship between undrained shear strength and cone resistance is commonly in the range:

$$q_c = (12 \text{ to } 18) c_u$$

Interpretation of CPT values can also be made to allow estimation of modulus or compressibility values to allow calculation of foundation settlements.

Inferred stratification as shown on the attached reports is assessed from the cone and friction traces and from experience and information from nearby boreholes etc. This information is presented for general guidance, but must be regarded as being to some extent interpretive. The test method provides a continuous profile of engineering properties, and where precise information on soil classification is required, direct drilling and sampling may be preferable.

DYNAMIC CONE (HAND) PENETROMETERS

Hand penetrometer tests are carried out by driving a rod into the ground with a falling weight hammer and measuring the blows for successive 150mm increments of penetration. Normally, there is a depth limitation of 1.2m but this may be extended in certain conditions by the use of extension rods. Two relatively similar tests are used.

Perth sand penetrometer - a 16 mm diameter flat ended rod is driven with a 9kg hammer, dropping 600mm (AS 1289 - Test F 3.3). This test was developed for testing the density of sands (originating in Perth) and is mainly used in granular soils and filling.

Cone penetrometer (sometimes known as the Scala Penetrometer) - a 16mm rod with a 20mm diameter cone end is driven with a 9kg hammer dropping 510mm (AS 1289 - Test F 3.2). The test was developed initially for pavement sub-grade investigations, with correlations of the test results with California bearing ratio published by various Road Authorities.

LABORATORY TESTING

Laboratory testing is carried out in accordance with AS 1289 Methods of Testing Soil for Engineering Purposes. Details of the test procedure used are given on the individual report forms.

TEST PIT / BORE LOGS

The test pit / bore log(s) presented herein are an engineering and/or geological interpretation of the subsurface conditions and their reliability will depend to some extent on frequency of sampling and the method of excavation / drilling. Ideally, continuous undisturbed sampling or excavation / core drilling will provide the most reliable assessment, but this is not always practicable, or possible to justify on economic grounds. In any case, the boreholes represent only a very small sample of the total subsurface profile.

Interpretation of the information and its application to design and construction should therefore take into account the spacing of boreholes, the frequency of sampling and the possibility of other than 'straight line' variation between the boreholes.

GROUND WATER

Where ground water levels are measured in boreholes, there are several potential problems:

In low permeability soils, ground water although present, may enter the hole slowly, or perhaps not at all during the time it is left open.

A localised perched water table may lead to an erroneous indication of the true water table.

Water table levels will vary from time to time with seasons or recent prior weather changes. They may not be the same at the time of construction as are indicated in the report.

The use of water or mud as a drilling fluid will mask any ground water inflow. Water has to be blown out of the hole and drilling mud must first be washed out of the hole if water observations are to be made.

More reliable measurements can be made by installing standpipes which are read at intervals over several days, or perhaps weeks for low permeability soils. Piezometers sealed in a particular stratum, may be advisable in low permeability soils or where there may be interference from a perched water table.