

On-site effluent management study

Lot 4 in the proposed subdivision of 172 Spring Hill Road,
Springhill NSW 2800



Document control					
Client Ian Stewart c/- iPlan Projects 91 Heifer Station Lane Orange NSW 2800					
Rev	Report number	Date	Prepared by	Checked by	Revision details/status
0	R14501e4	27/06/2022	Thilak Suresh MEng Geotechnical Engineer	Leah Desborough CEnvP Senior Environmental Scientist	

Envirowest Consulting Pty Ltd
9 Cameron Place
PO Box 8158
Orange NSW 2800
T 02 6361 4954

6/72 Corporation Avenue
Bathurst NSW 2795
T 02 6334 3312

E admin@envirowest.net.au
W envirowest.net.au

1. Summary

Proposed development and situation	A rural-residential lot requires evaluation for suitability of on-site application of effluent from a proposed new residential dwelling. This report describes the assessment and recommends a suitable effluent treatment and application system.
Investigation	<p>A site assessment and soil assessment were undertaken using the Australian Standard 1547, <i>On-site domestic wastewater management</i>, and the Environment and Health Protection Guidelines, <i>On-site sewage management for single households</i> (1998), Department of Urban Affairs and Planning, as guidelines. Suitable wastewater application systems, sizing and location for the site are recommended.</p> <p>The evaluation is based on a proposed dwelling with four bedrooms.</p>
Type of land application and treatment systems considered best suited to the site	<p>The recommended system is</p> <ul style="list-style-type: none"> • Surface irrigation with an irrigation area of 488 square metres. Gypsum should be applied to the application area during construction. • Secondary wastewater treatment system accredited by NSW Health.
Location	The location of the effluent application area is identified in Appendix 1.
Notes	<p>Construction of the treatment and application systems should be according to AS1547 and Sydney Catchment Authority guidelines, <i>Designing and Installing On-site Wastewater Systems</i> (2019).</p> <p>Gypsum should be applied to the application area during construction and annually to maintain permeability.</p> <p>Secondary treatment systems require regular maintenance to ensure effective operation. Maintenance scheduling should be undertaken in accordance with manufacturers and NSW Health guidelines.</p> <p>The water balance is calculated using full water saving devices such as dual flush toilets (6/3litre water closets), water reduction cycles on dishwashers, aerator faucets fitted to taps, front loader washing machines and water reducing shower heads.</p> <p>A maintained grass sward is the recommended vegetation over the irrigation area. Appendix 4 is a checklist of do's and don'ts to ensure correct operation of the wastewater system. Gypsum should be applied every two years to maintain permeability.</p>

2. Introduction

A rural-residential lot requires evaluation for on-site application of effluent from a proposed new residential dwelling. A site and soil assessment were undertaken on 3 June 2022. Boreholes were drilled to 1.0m depth and soil samples collected for analysis. This report describes the site and soil investigation and recommends a suitable effluent treatment and application system.

3. Scope

A site assessment and soil assessment were undertaken using Australian Standard 1547, *On-site domestic wastewater management*, Sydney Catchment Authority (SCA) guidelines, *Designing and Installing On-site Wastewater Systems (2019)* and the Environment and Health Protection Guidelines, *On-site sewage management for single households (1998)*, Department of Urban Affairs and Planning, as guidelines. Suitable wastewater application systems, sizing and location for the site are recommended.

4. Site information

Address of site	Lot 4 in the proposed subdivision of 172 Spring Hill Road, Spring Hill NSW 2800
Local Government	Cabonne Shire Council
Client	Ian Stewart
Size	Approximately 2.0ha
Location, shape, layout	A plan of the relevant areas of the site and proposed effluent application area is described in Appendix 1.
Photograph(s) attached	Yes
Intended water supply	Rainwater Reticulated water supply Bore/Groundwater
Development	New residential dwelling
Expected wastewater flows	<p>Number of bedrooms – 4</p> <p>Number of persons – 5</p> <p>Flows per person – 120 litres/person</p> <p>Total expected wastewater flow is 600 litres/day</p> <p>Flows are calculated using full water saving devices such as dual flush toilets (6/3 litre water closets), water reduction cycles on dishwashers, aerator faucets fitted to taps, front loader washing machines and water reducing shower heads.</p> <p>Re-calculation of the hydraulic balance and application area is required for dwellings containing a differing number of potential bedrooms.</p>
Local experience of on-site management systems nearby	All systems are known to work satisfactorily in the locality providing they are adequately designed and maintained.

Setting	This lot is in a rural setting where the average dwelling density is less than 1 dwelling per 2ha and therefore less than the 1 per 0.4 hectares required for groundwater protection (Geary & Gardner 1996, Land Management for Urban Development, Australian Society of Soil Sciences, Qld).
Current land-use	Grazing
Climate	Summers are warm to hot and winters are cold with little or no effective evaporation. Rainfall is distributed evenly throughout the year with an average annual rainfall of 832mm and pan evaporation of 1,335mm (Bureau of Meteorology, Orange).

5. Site assessment

Work undertaken	Details
Date	03 June 2022
Details	Site inspection, borehole drilling to 1.0m depth or refusal, soil sampling and analysis
Weather on day and preceding week	Overcast, windy, >25mm rain in preceding week

Site feature	Assessment	Limitation
Vegetation	Grasses, plantain, clover, broadleaved weeds	Minor
Flood potential: 1 in 20 year 1 in 100 year	Nil Nil	Minor
Exposure Site aspect Shelter belts Topographical feature or structure	High South Nil Nil	Minor
Slope	0-1% in application area	Minor
Landform	Mid-slope	Minor
Run-on and seepage: Comment	Run-on and sub-surface seepage is expected to be low. Diversion banks may be required to divert flows from upslope sources.	Minor
Erosion potential: Erodibility and erosion hazard	The topsoil and subsoil have a low erodibility. Erosion hazard is low and is reduced when vegetated.	Minor

Site drainage	Moderate. Mottled clays identified from 200mm.	Moderate
Fill	Nil	Minor
Groundwater: Level of protection Bores and wells in the area and their purpose	<p>Low</p> <p>A groundwater bore (GW058711) is located within 500m of the recommended application area on the adjacent block. The licence for the bore has been cancelled.</p> <p>The bores are licenced for stock and domestic use with standing water level is 12m and water bearing zone ranges from 46m to 55m.</p> <p>No impact on groundwater is expected from the application of effluent on the site.</p>	Minor
<p>Surface water: Permanent waters, streams, lakes (Recommended buffer distance 100m)</p> <p>Other waters, intermittent waterways (Recommended buffer distance 40m)</p>	<p>Nil</p> <p>Dam approximately 50m south</p> <p>A drainage line 20m southeast of the lot</p>	Moderate
<p>Buffer distances from recommended application area to:</p> <p>Boundary premises (Recommended buffer distance 6-12m)</p> <p>Swimming pools (Recommended buffer distance 6-12m)</p> <p>Buildings (Recommended buffer distance 6-12m)</p>	<p>>6m</p> <p>Nil</p> <p>>6m</p>	Minor
<p>Area required for application system(s):</p> <p>Area available (including buffers):</p>	<p>63m² minimum area required for trench systems.</p> <p>488m² minimum area required for irrigation systems.</p> <p>Potential application area of greater than 2,000m² available (Appendix 1).</p>	Minor
Surface rocks, rock outcrops	Surface rocks and rock outcrops were sparsely scattered across the site.	Moderate
Geology	The site is within the Spring Hill Soil Landscape. This soil landscape occupies a large area south and south-east of Orange. Krasnozems are dominant soils. Yellow Podzolic soils occur on the lower slopes with Yellow Solodic soils in drainage lines. The geological unit is tertiary volcanics from	Minor

	Mount Canobolas. Parent rock consists of basalt flows which are separated by volcanic ash forming layers of clay and slate. Parent material consists of in situ materials or colluvium derived from Tertiary volcanics (eSPADE v2.2).	
Environmental concerns: Native plants intolerant of phosphorous High water table Water way/wetland Community water storage	Nil Nil None nearby None nearby	Minor
Site stability: Is expert assessment necessary	No, not expected to affect system performance	Minor

6. Soil assessment

Soil was assessed on site on 3 June 2022 by borehole construction to a depth of 1.0 metres or drill refusal with a ute mounted hydraulic corer.

The soil profile was described, and representative samples collected for the determination of physical and chemical properties. Soil physical property measurements undertaken included Emerson aggregate test (dispersion description), texture, colour, pH, and salinity (ECe). The laboratory tests for physical properties were undertaken by Envirowest Testing Services and results are presented in the following table.

Depth (mm)	Description	Sampled (mm)	Texture group	Moisture	Emerson aggregate test*	pH (1:5 water)	ECe dS/m
Test hole 1							
0-200	Dark grey silty clay loam with trace coarse sand	100	ZCL	M	5	6.2	0.09
200-700	Yellowish brown silty clay with fine gravels and trace grey mottles	600	ZC	M	5	6.2	0.08
700-1000	Brown silty clay with abundant fine to medium ironstone gravels and heavily mottled grey clay	900	ZC	W	5	6.5	0.08
1000	End of hole at investigation depth						
Test hole 2							
0-200	Dark reddish brown silty clay with fine gravels	100	ZC	M	3	6.3	0.23
200-700	Weak red silty clay with fine gravels	600	ZC	M	5	6.4	0.23
700-1000	Reddish brown silty clay with fine to medium ironstone gravels and heavily mottled grey clay	900	ZC	M	5	6.6	0.15
1000	End of hole at investigation depth						

M=Moist, D=Dry, W=Wet *1= highly dispersive (slakes, complete dispersion), 2= moderately dispersive (slakes, some dispersion), 3= slightly dispersive (slakes, some dispersion after remoulding), 4= non-dispersive (slakes, carbonate or gypsum present), 5= non-dispersive (slakes, dispersion in shaken suspension) 6= non-dispersive (slakes, flocculates in shaken suspension), 7= non-dispersive (no slaking, swells in water), 8= non-dispersive (no slaking, does not swell in water).

Site feature	Assessment	Limitation
Depth to bedrock	Greater than 1,000mm in recommended application area (600mm below application base recommended)	Minor
Depth to high water table	Greater than 1,000mm in recommended application area (600mm below application base recommended)	Minor
Coarse fragments	Gravels identified throughout the soil profile	Minor
Bulk density	Good (estimated)	Minor
pH	Satisfactory (4.5-8.5 optimum range)	Minor
Salinity	Non-saline (<4.0 dS/m desirable threshold)	Minor
Phosphorus sorption capacity (SCA, 2012)	6,500 kg/ha estimated	Minor
Nutrient balance	Water is not expected to move off site, nutrients will be utilised by the vegetation and stored in the soil. The subsoil is a moderately drained silty clay that will immobilise moderate quantities of nitrogen (in ammonium and organic forms) as derived from primary treatment systems.	Minor
Cation exchange capacity	Moderate (estimated). Will provide adequate retention of nutrients for plant growth.	Minor
Dispersiveness (Emerson aggregate test)	Slightly dispersive silty clay to non-dispersive silty clay loam topsoil over a non-dispersive silty clay subsoil. Regular application of gypsum is recommended at the rate of 1kg per square meter of application area.	Minor
Soil structure	Strongly structured	Minor
Soil texture and permeability category	Clay loam CL (100mm) Light clay LC (600mm)	Minor

7. System selection

7.1 Estimation of land application areas from hydraulic loadings

Rainfall water balance and land application area calculations are presented in Appendix 3 and are summarised in the following table. Design flow rates for the dwelling are 600L/day based on the use of water saving features. Wet weather storage areas included in the water balance utilise the storage capacity of the soil. The design application rate was determined from Tables L1, M1, N1 in AS1547 using the permeability classification of the subsoil.

Factors Affecting Design Loading and Sizing		Design application rate (AS1547) (mm/day)	Size required for effluent application
Hydraulic loading for different application systems - Surface/sub-surface irrigation - Absorption/ Evapotranspiration trench		3 8	488m ² 63m ²
Notes	The proposed loading will provide for leaching of salts out of the root zone and prevent the soil from becoming sodic. The proposed infiltration rates will protect the catchment against off-site nutrient movement.		

7.2 Centralised sewerage systems

Consideration of connection to a centralised sewerage system Approximate distance to nearest feasible connection: Potential for future connection to centralised sewerage: Potential for future connection to reticulated water:	>500m high / medium / low / already connected high / medium / low / already connected
---	---

7.3 Suitability of application systems

Application system	Treatment system	Site limitations of the application system	Modifications to mitigate constraints	Suitability
Absorption system	Septic tank	Moderately drained subsoil Surface rock and rock outcrops	Nil	No
Evapotranspiration system	Septic tank	Moderately drained subsoil Surface rock and rock outcrops	Nil	No
Surface irrigation	Secondary	Slightly dispersive topsoil Surface rock and rock outcrops	Regular application of gypsum Ensure wastewater is applied to the soil	Yes
Sub-surface irrigation	Secondary	Slightly dispersive topsoil Surface rock and rock outcrops	Regular application of gypsum Ensure wastewater is applied to the soil	Yes

7.4 System recommendation

Type of land application and treatment systems considered best suited to the site	The recommended system is <ul style="list-style-type: none"> Surface irrigation with an irrigation area of 488 square metres. Gypsum should be applied to the application area during construction. Secondary wastewater treatment system accredited by NSW Health.
Location	The location of the effluent application area is identified in Appendix 1.

Notes	<p>Construction of the treatment and application systems should be according to AS1547 and Sydney Catchment Authority guidelines, Designing and Installing On-site Wastewater Systems (2019).</p> <p>Gypsum should be applied to the application area during construction and annually to maintain permeability.</p> <p>Secondary treatment systems require regular maintenance to ensure effective operation. Maintenance scheduling should be undertaken in accordance with manufacturers and NSW Health guidelines.</p> <p>The water balance is calculated using full water saving devices such as dual flush toilets (6/3litre water closets), water reduction cycles on dishwashers, aerator faucets fitted to taps, front loader washing machines and water reducing shower heads.</p> <p>A maintained grass sward is the recommended vegetation over the irrigation area. Appendix 4 is a checklist of do's and don'ts to ensure correct operation of the wastewater system. Gypsum should be applied every two years to maintain permeability.</p>
-------	--


8. General comments

Are there any specific environmental constraints?	Wastewater should be evenly applied over the application area.
Are there any specific health constraints?	Restrict access to people and stock as recommended in AS1547 and summarised in Appendix 4.
Any other comments?	The topsoil is capable of supporting plant growth that will optimise evapotranspiration and wastewater usage.

9. Report limitations and intellectual property

This report has been prepared for the use of the client to achieve the objectives given the clients requirements. The Australian Standard 1547, *On-site domestic wastewater management*, and the Environment and Health Protection Guidelines, *On-site sewage management for single households* (1998) Department of Urban Affairs and Planning, have been used as guidelines in this report. Where system limitations or uncertainties are known, they are identified in the report. No liability can be accepted for failure to identify conditions or issues which arise in the future and which could not reasonably have been predicted using the scope of the investigation and the information obtained. No guarantee can be made that the wastewater system will achieve all performance criteria because of operational factors and the inherent variable and unpredictable nature of the soil. All components of the wastewater system have a limited life.

This report including data contained, its findings and conclusions remain the intellectual property of Envirowest Consulting Pty Ltd. A licence to use the report for the specific purpose identified is granted after full payment for the services involved in preparation of the report. This report should not be used by persons or for purposes other than those stated, and not reproduced without the permission of Envirowest Consulting Pty Ltd.

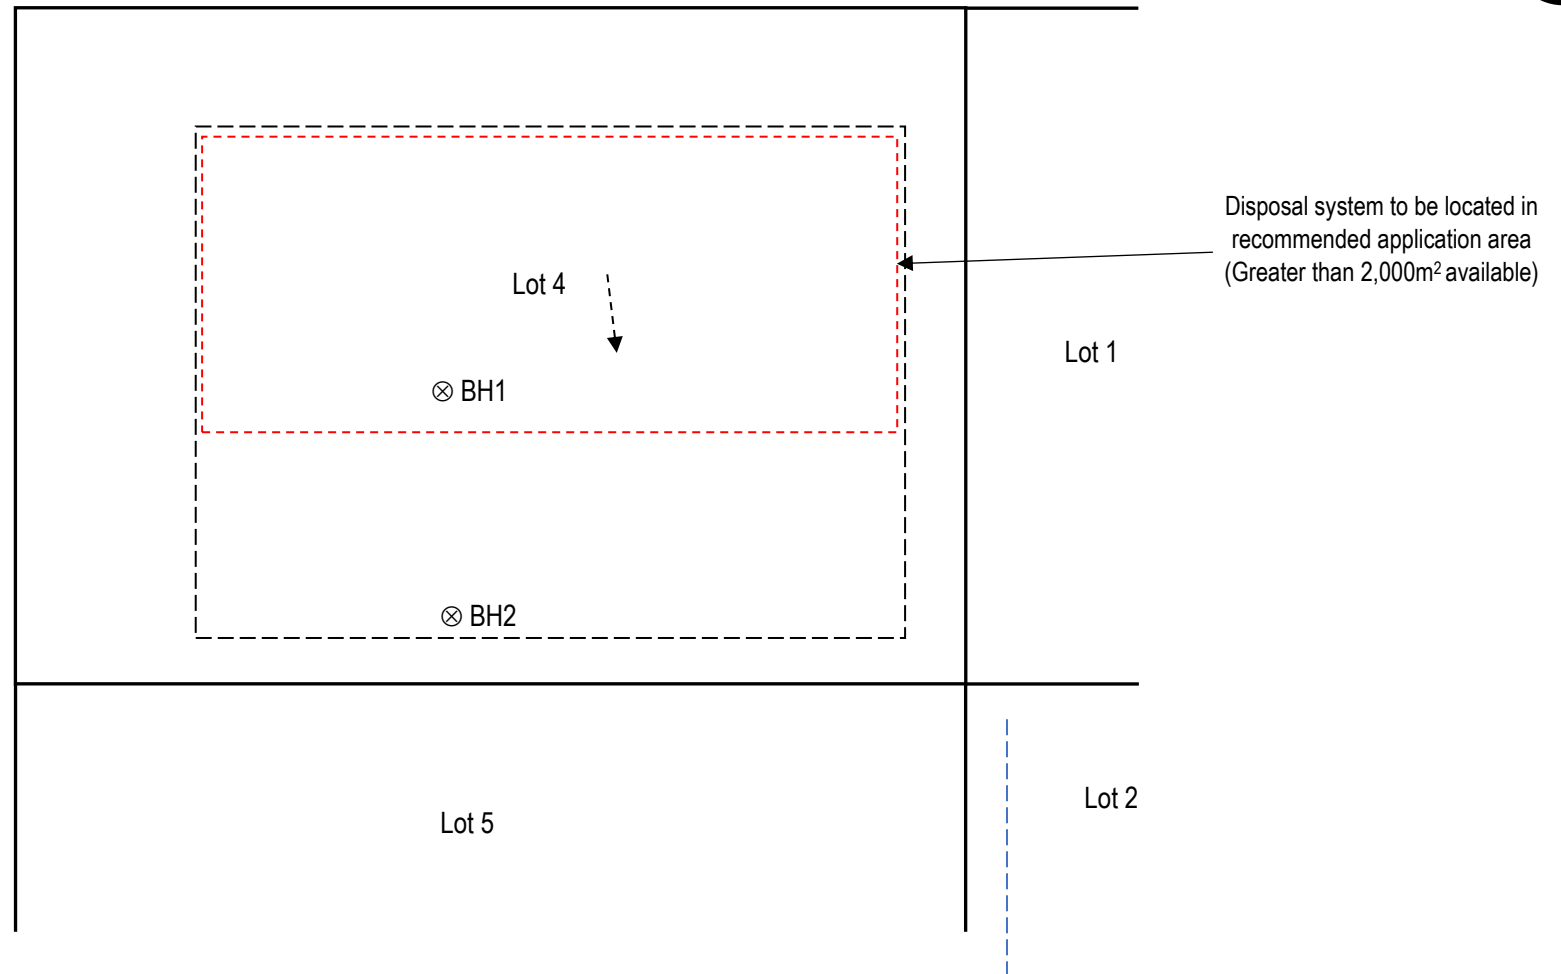

Legend

- | | | | |
|---|--------------|-------|---|
| ⊗ | Borehole | [] | Proposed building envelope |
| → | Slope | [] | Recommended application area (greater than 2,000m ² available) |
| — | Lot boundary | - - - | Drainage line |

Approximate Scale 1: 1300



Appendix 1. Aerial image and borehole location

Lot 4 in the proposed subdivision of 172 Spring Hill Road
Spring Hill NSW



Envirowest Consulting Pty Ltd

Job: R14501e4

Drawn by: TS

Date: 27/06/2022

Appendix 2. Photograph of the recommended application area



Looking north over the recommended application area

Appendix 3a. Monthly water balance to determine the wastewater application area required for Irrigation systems

Design wastewater flow	Q	L/day	600	120	L/person/day	5	persons
Design percolation rate	R	mm/wk	21	3	mm/day		
Land area	L	m ²	130				
Effective precipitation	EP		0.9	(10% runoff)			

Parameter	Symbol	Formula	Units	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	total
days in month	D		days	31	28	31	30	31	30	31	31	30	31	30	31	365
Precipitation	P		mm/month	61.3	86.4	45.9	36.2	47.7	79.7	76.3	86	76.2	81.9	83.6	70.6	832.2
Evaporation	E		mm/month	216	157	137	94	51	41	38	51	81	114	152	203	1335
Crop factor	C		-	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	10.8
Inputs																
Effective Precipitation	EP		mm/month	55.17	77.76	41.31	32.58	42.93	71.73	68.67	77.4	68.58	73.71	75.24	63.54	749
Effluent irrigation	W	QXD/L	mm/month	143.1	129.2	143.1	138.5	143.1	138.5	143.1	143.1	138.5	143.1	138.5	143.1	1685
Inputs		P+W	mm/month	198.2	207.0	184.4	171.0	186.0	210.2	211.7	220.5	207.0	216.8	213.7	206.6	2433
Outputs																
Evapotranspiration	ET	ExC	mm/month	194.4	141.3	123.3	84.6	45.9	36.9	34.2	45.9	72.9	102.6	136.8	182.7	1202
Percolation	B	R/7xD	mm/month	93.0	84.0	93.0	90.0	93.0	90.0	93.0	93.0	90.0	93.0	90.0	93.0	1095
Outputs		ET+B	mm/month	287.4	225.3	216.3	174.6	138.9	126.9	127.2	138.9	162.9	195.6	226.8	275.7	2297
Storage	S	(EP+W)-(ET+B)	mm/month	-89.2	-18.3	-31.9	-3.6	47.1	83.3	84.5	81.6	44.1	21.2	-13.1	-69.1	
Cumulative storage	M		mm	0.0	0.0	0.0	0.0	47.1	130.4	214.9	296.5	340.7	361.9	348.8	279.7	
Storage																
	V	largest M	mm	361.9												
		Soil storage	mm	372.0												
		Storage required	mm	-10.1												
		VxL/1000	m ³	-1.3												
Irrigation area			m ²	130												

	water holding capacity	depth (mm)	Totals(mm)
Topsoil	34%	200	68
Subsoil	38%	800	304
			372

Appendix 3b. Estimation area requirement from organic matter and nutrient balances
(Irrigation systems)

Estimated effluent flow	(Q)	600	L/day
Soil depth		1	m

Organic matter balance

BOD (C)	20	mg/L
		L/da
treated wastewater flow rate (Q)	600	y
	300	
critical loading rate of BOD (Lx)	0	mg/m ² /day
land area required (A)	4.0	m²

Nitrogen balance

nutrient concentration	37	mg/L
treated wastewater flow		L/da
rate	600	y
critical loading rate of nutrient	50	mg/m ² /day
land area required (A)	444	m²

Determination of nitrogen critical loading rate

Nitrogen load (kg/year)	8.1	kg/year		
Loss 20% denitrification	6.5	kg/year		
Load to soil	146.0	kg/ha/year	assumed irr.	44
Vegetation usage	200.0	kg/ha/year	area	4 m ²
Residual (potential leaching)	-54.0	kg/ha/year	from table	

Typical nitrogen uptake (Myers et al. 1984)

Pastures	300 kg/ha/year	82 mg/m ² /day
Pine	350 kg/ha/year	96 mg/m ² /day
Eucalypts	180 kg/ha/year	49 mg/m ² /day

Phosphorus balance

	6,50	
Phosphorus sorption capacity per metre=	0	kg/ha
	6,50	
Phosphorus sorption capacity of profile=	0	kg/ha
Soil factor	0.33	
	3	
Critical loading=	mg/m ² /day	
P concentration*=	12	mg/L
P adsorbed=	phosphorus sorption capacity x soil factor	
	2145	
	0.2145	kg/m ²
	critical loading x	year
Puptake=	days/year x	50 s
	54750	
	0.0548	kg/m ²
Pgenerated=	total phosphorus concentration x wastewater volume in	50 year s
	131400000	
	131	kg
	Pgenerated / (Padsorbed + Puptake)	
Land area required	488.0	m²

Appendix 4. Checklist for effective management of wastewater systems

Domestic wastewater system

DO

- Check household products for suitability of use with a septic tank or secondary treatment tank.
- Conserve water, prolonged period of high water use can lead to application area failure.
For optimum operation, avoid daily and weekly surges in water flows. Spas are not recommended.
- Scrape cooking dishes and plates prior to washing to reduce solid load.
- Maintain the system with regular servicing as per the manufacturer's instructions.

DON'T

- Dispose of excessive solid material, fats, lint or large water volumes into drains.

Land application area

- Construct and maintain diversion drains around the top-side of the application area to divert surface water.
- The application area should be a grassed area, which is maintained at 10-30cm height.
- The area around the perimeter can be planted with small shrubs to aid transpiration of the wastewater.
- Ensure run-off from the roof or driveway is directed away from the application area.
- Periodic application of gypsum may be necessary to maintain the absorptive capacity of the soil.
- **Do not** erect any structures or paths on the land application area.
- **Do not** graze animals on the land application area.
- **Do not** drive over the land application area.
- **Do not** plant large trees that shade the land application area thereby reducing transpiration of water.
- **Do not** let children or pets play on the land application area.
- **Do not** extract untreated groundwater for potable use.