

On-site effluent management study

Lot 2 in the proposed subdivision of 3660 The Escort Way, Cudal NSW 2864

Ref: R16134e1

Date: 30 November 2023

Envirowest Consulting *Pty Ltd* ABN 18 103 955 246

- 9 Cameron Place, Orange NSW • Tel (02) 6361 4954 •
- 6/72 Corporation Avenue, Bathurst NSW • Tel (02) 4444 3312 •
- Email admin@envirowest.net.au • Web www.envirowest.net.au •

*Environmental
Geotechnical
Asbestos
Services*



Document control					
Client iPlan Projects 91 Heifer Station Lane Orange NSW 2800					
Rev	Report number	Date	Prepared by	Checked by	Revision details/status
0	R16134e1	30/11/2023	Thilak Suresh MEng Geotechnical Engineering	Andrew Ruming BSc Senior Environmental Geologist	

Envirowest Consulting Pty Ltd
9 Cameron Place
PO Box 8158
Orange NSW 2800
T 02 6361 4954

6/72 Corporation Avenue
Bathurst NSW 2795
T 02 4444 3312
E admin@envirowest.net.au
W envirowest.net.au

1. Summary

Proposed development and situation	An industrial lot requires evaluation for suitability of on-site application of effluent from a proposed new industrial building. This report describes the assessment and recommends a suitable effluent treatment and application system.
Investigation	<p>A site assessment and soil assessment were undertaken using the Australian Standard 1547, <i>On-site domestic wastewater management</i>, and the Environment and Health Protection Guidelines, <i>On-site sewage management for single households</i> (1998), Department of Urban Affairs and Planning, as guidelines. Suitable wastewater application systems, sizing and location for the site are recommended.</p> <p>The evaluation is based on an industrial shed utilized by maximum of 4 people.</p>
Type of land application and treatment systems considered best suited to the site	<p>The recommended systems are:</p> <p>Option 1</p> <ul style="list-style-type: none"> • Surface or sub-surface irrigation with an irrigation area of 104 square metres. Gypsum should be applied to the application area during construction and annually to maintain permeability. • Secondary wastewater treatment system accredited by NSW Health. <p>Option 2</p> <ul style="list-style-type: none"> • Absorption or evapotranspiration absorption trench with a length of 36 metres. The recommended trench width is 1.0m, with a maximum depth of 0.4m, covered by 0.15m of topsoil. Effluent water must be evenly distributed across the trench length by use of a distribution box directing water to trench segments not exceeding 20m. The trench segments should be 1m apart. • Additional trench management is required due to moderately dispersive soil properties. A minimum of two bed segments each measuring a maximum of 18m are required to enable one segment to be rested for 2 months during the summer/autumn period to enable trench rejuvenation. • Septic treatment system (AS 1546) with a minimum capacity of 3,000 litres.
Location	The location of the effluent application area is identified in Appendix 1.
Notes	<p>Construction of the treatment and application systems should be according to AS1547 and Sydney Catchment Authority guidelines, <i>Designing and Installing On-site Wastewater Systems</i> (2019).</p> <p>Geotextile shall be laid over the distribution aggregate and arching to prevent ingress by the cover material for trench systems.</p> <p>Gypsum should be applied to the application area during construction and annually to maintain permeability.</p>

	<p>Secondary treatment systems require regular maintenance to ensure effective operation. Maintenance scheduling should be undertaken in accordance with manufacturers and NSW Health guidelines.</p> <p>The water balance is calculated using full water saving devices such as dual flush toilets (6/3 litre water closets), water reduction cycles on dishwashers, aerator faucets fitted to taps, front loader washing machines and water reducing shower heads.</p> <p>A maintained grass sward is the recommended vegetation over the irrigation area. Appendix 4 is a checklist of do's and don'ts to ensure correct operation of the wastewater system.</p>
--	---

2. Introduction

An industrial lot requires evaluation for suitability of on-site application of effluent from a proposed new industrial shed with amenities. A site and soil assessment were undertaken on 4 September 2023 and soil samples analysed. This report describes the site and soil investigation and recommends a suitable effluent treatment and application system.

3. Scope

A site assessment and soil assessment were undertaken using the Australian Standard 1547, *On-site domestic wastewater management*, Sydney Catchment Authority guidelines, *Designing and Installing On-site Wastewater Systems* (2019) and the Environment and Health Protection Guidelines, *On-site sewage management for single households* (1998), Department of Urban Affairs and Planning, as guidelines. Suitable wastewater application systems, sizing and location for the site are recommended.

4. Site information

Address of site	Lot 2 in the proposed subdivision of 3660 The Escort Way, Cudal NSW 2864
Local government	Cabonne Shire Council
Client	iPlan Projects
Size	Approximately 9,000m ²
Location, shape, layout	A plan of the relevant areas of the site and proposed effluent application area is described in Appendix 1.
Photograph(s) attached	Yes
Intended water supply	Rainwater Reticulated water supply Bore/Groundwater
Development	New industrial shed with amenities including toilets, basin and kitchenette
Expected wastewater flows	<p>Number of people – 4</p> <p>Flows per person – 35 litres/person</p> <p>Total expected wastewater flow is 140 litres/day</p> <p>The water balance is calculated using full water saving devices such as dual flush toilets (6/3 litre water closets), water reduction cycles on aerator faucets fitted to taps.</p> <p>Re-calculation of the hydraulic balance and application area is required for different wastewater facilities or increase in workers.</p>
Local experience of on-site management systems nearby	All systems are known to work satisfactorily in the locality providing they are adequately designed and maintained.

Setting	The lot is in an industrial setting where the average dwelling density is less than 1 building per 0.9ha and therefore less than the 1 per 0.4 hectares required for groundwater protection (Geary & Gardner 1996, Land Management for Urban Development, Australian Society of Soil Sciences, Qld).
Current land-use	Vacant/cropping
Climate	Summers are warm to hot and winters are cold with little or no effective evapotranspiration. Rainfall is distributed evenly throughout the year with an average annual rainfall of 644mm and pan evaporation of 1,471mm (Bureau of Meteorology, Cudal NSW).

5. Site assessment

Work undertaken	Details
Date	4 September 2023
Details	Site inspection, borehole construction, soil sampling
Weather on day and preceding week	Fine, <25mm rain in preceding week

Site feature	Assessment	Limitation
Vegetation	Common oat, shepherd's purse and henbit	Minor
Flood potential: 1 in 20 year 1 in 100 year	Low Low	Minor
Exposure Site aspect Shelter belts Topographical feature or structure	High North and south Nil Nil	Minor
Slope	0-1% in the application area	Minor
Landform	Mid-slope	Minor
Run-on and seepage: Comment	Run-on and sub-surface seepage is expected to be low. Diversion bank may not be required to divert surface water from upslope sources.	Minor
Erosion potential: Erodibility and erosion hazard	The topsoil and subsoil have a low erodibility. Erosion hazard is moderate and is reduced with ground cover.	Minor
Site drainage	Moderately drained subsoil from approximately 1100mm as indicated by mottled clays in the soil profile.	Moderate

Fill	Nil	Minor
Groundwater: Level of protection Bores and wells in the area and their purpose	Low No groundwater bores are located within 100m of the recommended application area. Three groundwater bores were identified within 500m of the application area. Bores in the locality are licensed for stock, irrigation and domestic use with a standing water level range from 7m and water bearing zone range from 33m to 33m. No impact on groundwater is expected from the application of effluent to the site.	Minor
Surface water: Permanent waters, streams, lakes (Recommended buffer distance 100m) Other waters, intermittent waterways (Recommended buffer distance 40m)	Boree Creek approximately 230m west Nil	Minor
Buffer distances from recommended application area to: Boundary premises (Recommended buffer distance 3-12m) Swimming pools (Recommended buffer distance 6m) Buildings (Recommended buffer distance 3-12m)	>6m Nil >6m	Minor
Area required for application system(s): Area available (including buffers):	104m ² minimum area required for irrigation systems. 36m ² minimum area required for trench systems. Potential application area of greater than 500m ² available (Appendix 1).	Minor
Surface rocks, rock outcrops	Nil	Minor
Geology/ regolith	The site is located within the Lachlan, Canowindra and Cudal soil landscape. <u>Cudal soil landscape</u> The soil landscape comprises the undulating rises, undulating low hills and dissected plateaux around Cudal, with a small area northeast of Molong and to the south of Cowra. The dominant soils are Euchrozems with non-calcic brown soils on lower slopes. Geological unit comprises tertiary basalt, parent rock is basalt and parent material is in-situ and colluvial deposits of parent rock.	Minor

	<p><u>Canowindra soil landscape</u> This soil landscape covers an extensive area of undulating rises to undulating low hills southwest of Cudal and Canowindra. The main soils are non-calci brown soils, yellow and brown solodic soils and red earth with depositional sands. Geological unit comprises undifferentiated, Canowindra Porphyry, alluvial and Kenyu formation. Parent rock is Quartz feldspar porphyry with sparse garnets, shale, limestone and alluvium. The parent material is in-situ and colluvial-alluvial deposits of above parent rock.</p> <p><u>Lachlan soil landscape</u> The soil landscape comprises the alluvial plains and terraces of Lachlan, Molong, Bell and lower Belubula Rivers as well as the Winburndale Rivulet and other minor streams. The geological unit and parent material is alluvium. The parent rock is alluvium including granite materials, metasediments and Molong geanticline volcanics (eSPADE v2.2).</p>	
<p>Environmental concerns:</p> <p>Native plants intolerant of phosphorous</p> <p>High water table</p> <p>Water way/wetland</p> <p>Community water storage</p>	<p>Nil</p> <p>Nil</p> <p>None nearby</p> <p>Nil</p>	Minor
<p>Site stability:</p> <p>Is expert assessment necessary</p>	<p>No, not expected to affect system performance</p>	Minor

6. Soil assessment

Soil was assessed on site on 4 September 2023 by borehole construction to a depth of 1.5 metres or drill refusal with a Landcruiser mounted eziprobe drill rig with flight auger.

The soil profile was described, and representative samples collected for the determination of physical and chemical properties. Soil physical property measurements undertaken included: dispersion description, texture, colour, pH, and salinity. The laboratory tests for physical properties were undertaken by Envirowest Testing Services and results are presented in the following table.

Depth (mm)	Description	Sampled (mm)	Texture group	Moisture	Emerson aggregate test*	pH (1:5 water)	ECe dS/m
Borehole 1							

0-200	Strong brown silty clay loam with coarse sand	100	ZCL	M	5	6.5	0.34
200-700	Dark reddish brown silty clay with coarse sand and abundant ironstone gravels	600	ZC	M	3	7.4	0.23
700-1100	Strong brown silty clay with trace coarse sand and ironstone gravels	1000	ZC	M	2	8.7	0.68
1100-1500	Greyish brown silty clay with coarse sand and grey mottles	-	ZC	M	-	-	-
1500	End of hole at investigation depth						

M=Moist, D=Dry, W=Wet, *1= highly dispersive (slakes, complete dispersion), 2= moderately dispersive (slakes, some dispersion), 3= slightly dispersive (slakes, some dispersion after remoulding), 4= non-dispersive (slakes, carbonate or gypsum present), 5= non-dispersive (slakes, dispersion in shaken suspension), 6= non-dispersive (slakes, flocculates in shaken suspension), 7= non-dispersive (no slaking, swells in water), 8= non-dispersive (no slaking, does not swell in water).

Site feature	Assessment	Limitation
Depth to bedrock	Greater than 1,500mm in recommended application area (600mm below application base recommended)	Minor
Depth to high water table	Approximately 1,100mm in recommended application area (600mm below application base recommended)	Moderate
Coarse fragments	Coarse sand to fine gravels identified throughout the soil profile	Minor
Bulk density	Good (estimated)	Minor
pH	Satisfactory (4.5-8.5 optimum range)	Minor
Salinity	Non-saline (<4.0 dS/m desirable threshold)	Minor
Phosphorus sorption index (SCA, 2019)	6,500 kg/ha estimated	Minor
Nutrient balance	Water is not expected to move off site as nutrients will be utilised by the vegetation and stored in the soil. The subsoil is a moderately drained silty clay that will immobilise large quantities of nitrogen (in ammonium and organic forms) as derived from primary treatment systems.	Minor
Cation exchange capacity	Moderate (estimated). Will provide adequate retention of nutrients for plant growth.	Minor
Dispersiveness (Emerson aggregate test)	Non-dispersive silty clay loam topsoil over a slightly dispersive to moderately dispersive silty clay subsoil. Regular application of gypsum is recommended at the rate of 1kg per square metre of application area.	Moderate
Soil structure	Strongly structured	Minor
Soil texture (subsoil) Permeability category	Clay Loam (100mm) CL Light Clay (600mm) LC	Minor

7. System selection

7.1 Estimation of land application areas from hydraulic loadings

Rainfall water balance and land application area calculations are presented in Appendix 3 and summarised in the following table. Design flow rates are 140L/day based on the use of water saving features. Wet weather storage areas included in the water balance utilise the storage capacity of the soil. The design loading rate was determined from Tables L1, M1, and N1 in AS1547 using the permeability classification of the subsoil.

Factors Affecting Design Loading and Sizing		Design application rate (AS1547) (mm/day)	Size required for effluent application
Hydraulic loading for different application systems - Surface/subsurface irrigation - Evapotranspiration absorption trench		3 8	104m ² 30m ²
Notes	The proposed loading will provide for leaching of salts out of the root zone and prevent the soil from becoming sodic. The proposed infiltration rates will protect the catchment against off-site nutrient movement.		

7.2 Centralised sewerage systems

Consideration of connection to a centralised sewerage system Approximate distance to nearest feasible connection: Potential for future connection to centralised sewerage: Potential for future connection to reticulated water:	>2km high / medium / low / already connected high / medium / low / already connected
---	--

7.3 Suitability of application systems

Application system	Treatment system	Site limitations of the application system	Modifications to mitigate constraints	Suitability
Absorption system	Septic tank	Moderately dispersive subsoil Moderately drained subsoil approximately 1100mm	Regular application of gypsum Construct trenches 1.0m wide Additional trench length of 20% added totalling 36m Resting of trenches Ensure base of trench is at 400mm	Yes
Evapotranspiration absorption system	Septic tank	Moderately dispersive subsoil Moderately drained subsoil approximately 1100mm	Regular application of gypsum Construct trenches 1.0m wide Additional trench length of 20% added totalling 36m Resting of trenches Ensure base of trench is at 400mm	Yes

Surface irrigation	Secondary	Slightly dispersive topsoil	Regular application of gypsum	Yes
Sub-surface irrigation	Secondary	Slightly dispersive topsoil	Regular application of gypsum	Yes

7.4 System recommendation

<p>Type of land application and treatment systems considered best suited to the site</p>	<p>The recommended systems are:</p> <p>Option 1</p> <ul style="list-style-type: none"> • Surface or sub-surface irrigation with an irrigation area of 104 square metres. Gypsum should be applied to the application area during construction and annually to maintain permeability. • Secondary wastewater treatment system accredited by NSW Health. <p>Option 2</p> <ul style="list-style-type: none"> • Absorption or evapotranspiration absorption trench with a length of 36 metres. The recommended trench width is 1.0m, with a maximum depth of 0.4m, covered by 0.15m of topsoil. Effluent water must be evenly distributed across the trench length by use of a distribution box directing water to trench segments not exceeding 20m. The trench segments should be 1m apart. • Additional trench management is required due to moderately dispersive soil properties. A minimum of two bed segments each measuring a maximum of 18m are required to enable one segment to be rested for 2 months during the summer/autumn period to enable trench rejuvenation. • Septic treatment system (AS 1546) with a minimum capacity of 3,000 litres.
<p>Location</p>	<p>The location of the effluent application area is identified in Appendix 1.</p>
<p>Notes</p>	<p>Construction of the treatment and application systems should be according to AS1547 and Sydney Catchment Authority guidelines, <i>Designing and Installing On-site Wastewater Systems</i> (2019).</p> <p>Geotextile shall be laid over the distribution aggregate and arching to prevent ingress by the cover material for trench systems.</p> <p>Gypsum should be applied to the application area during construction and annually to maintain permeability.</p> <p>Secondary treatment systems require regular maintenance to ensure effective operation. Maintenance scheduling should be undertaken in accordance with manufacturers and NSW Health guidelines.</p> <p>The water balance is calculated using full water saving devices such as dual flush toilets (6/3 litre water closets), water reduction cycles on dishwashers, aerator faucets fitted to taps, front loader washing machines and water reducing shower heads.</p>

	A maintained grass sward is the recommended vegetation over the irrigation area. Appendix 4 is a checklist of do's and don'ts to ensure correct operation of the wastewater system.
--	---



8. General comments

Are there any specific environmental constraints?	Wastewater should be evenly applied over the application area.
Are there any specific health constraints?	Restrict access to people and stock as recommended in AS1547 and summarised in Appendix 1.
Any other comments?	The topsoil is capable of supporting plant growth that will optimise evapotranspiration and wastewater usage.

9. Report limitations and intellectual property

This report has been prepared for the use of the client to achieve the objectives given the clients requirements. The Australian Standard 1547, *On-site domestic wastewater management*, and the Environment and Health Protection Guidelines, *On-site sewage management for single households* (1998) Department of Urban Affairs and Planning, have been used as guidelines in this report. Where system limitations or uncertainties are known, they are identified in the report. No liability can be accepted for failure to identify conditions or issues which arise in the future and which could not reasonably have been predicted using the scope of the investigation and the information obtained. No guarantee can be made that the wastewater system will achieve all performance criteria because of operational factors and the inherent variable and unpredictable nature of the soil. All components of the wastewater system have a limited life.

This report including data contained, its findings and conclusions remain the intellectual property of Envirowest Consulting Pty Ltd. A licence to use the report for the specific purpose identified is granted after full payment for the services involved in preparation of the report. This report should not be used by persons or for purposes other than those stated, and not reproduced without the permission of Envirowest Consulting Pty Ltd.

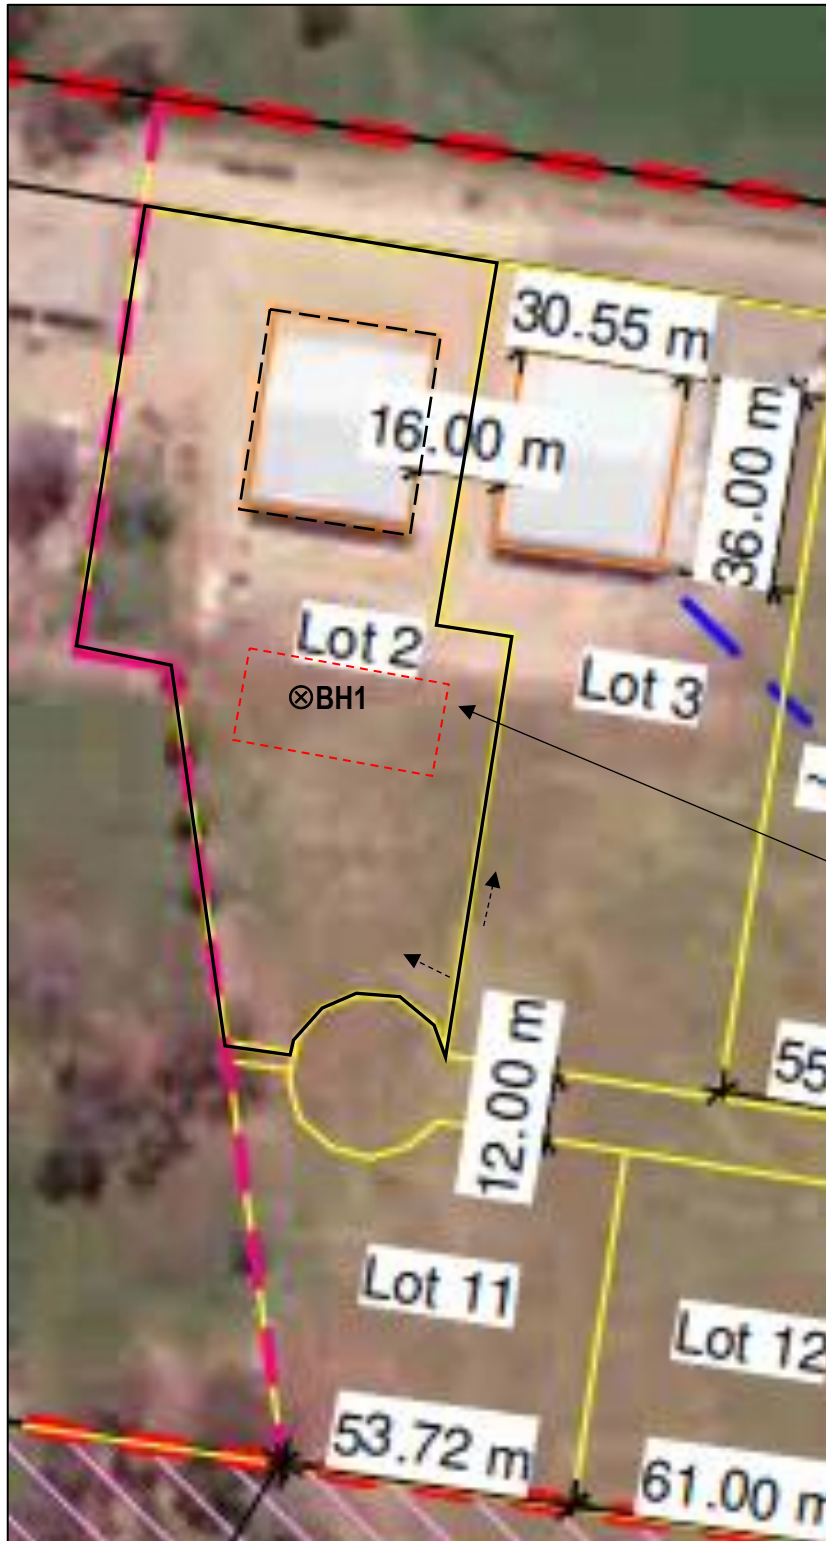

Disposal system to be located in recommended application area (Greater than 500m² available)

Legend

- ⊗ Borehole
- Recommended application area (Greater than 500m² available)
- Slope
- Lot boundary
- Existing shed

Approximate Scale 1:1600



Appendix 1. Aerial image and borehole locations

66 Springvale Lane, Millthorpe NSW



Envirowest Consulting Pty Ltd

Job: R16134e11

Drawn by: TS

Date: 13/11/2023

Appendix 2. Photographs of the site



Looking west over the recommended application area

Appendix 3a. Monthly water balance to determine the wastewater application area required (trench systems)

Design wastewater flow	Q	L/day	140	35	L/person/day	4	persons
Design percolation rate	R	mm/wk	21	3	mm/day		
Land area	L	m ²	30				
Effective precipitation	EP		0.9	(10% runoff)			

Parameter	Symbol	Formula	Units	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	total
days in month	D		days	31	28	31	30	31	30	31	31	30	31	30	31	365
Precipitation	P		mm/month	64	52	52	44	57	53	52	52	48	56	54	60	644
Evaporation	E		mm/month	220	176	152	96	62	42	47	65	93	133	165	220	1471
Crop factor	C		-	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	10.8
Inputs																
Effective Precipitation	EP		mm/month	57.6	46.8	46.8	39.6	51.3	47.7	46.8	46.8	43.2	50.4	48.6	54	579.6
Effluent irrigation	W	QXD/L	mm/month	144.7	130.7	144.7	140.0	144.7	140.0	144.7	144.7	140.0	144.7	140.0	144.7	1703.3
Inputs		P+W	mm/month	202.3	177.5	191.5	179.6	196.0	187.7	191.5	191.5	183.2	195.1	188.6	198.7	2282.9
Outputs																
Evapotranspiration	ET	ExC	mm/month	198	158.4	136.8	86.4	55.8	37.8	42.3	58.5	83.7	119.7	148.5	198.0	1323.9
Percolation	B	R/7xD	mm/month	93.0	84.0	93.0	90.0	93.0	90.0	93.0	93.0	90.0	93.0	90.0	93.0	1095.0
Outputs		ET+B	mm/month	291.0	242.4	229.8	176.4	148.8	127.8	135.3	151.5	173.7	212.7	238.5	291.0	2418.9
Storage	S	(EP+W)-(ET+B)	mm/month	-88.7	-64.9	-38.3	3.2	47.2	59.9	56.2	40.0	9.5	-17.6	-49.9	-92.3	
Cumulative storage	M		mm	0.0	0.0	0.0	3.2	50.4	110.3	166.4	206.4	215.9	198.3	148.4	56.0	
Storage																
	V	largest M	mm	215.9												
		Soil storage	mm	368.0												
				-												
		Storage required	mm	152.1												
		VxL/1000	m ³	-4.6												
Application area			m ²	30												
Trench length																
Trench length			m	30.0												
Trench width			m	1												

	water holding capacity	depth (mm)	Totals(mm)
Topsoil	34%	300	102
Subsoil	38%	700	266
			368

Appendix 3b. Monthly water balance to determine the wastewater application area required (Irrigation systems)

Design wastewater flow	Q	L/day	140	35	L/person/day	4	persons
Design percolation rate	R	mm/wk	21	3	mm/day		
Land area	L	m ²	27				
Effective precipitation	EP		0.9	(10% runoff)			

Parameter	Symbol	Formula	Units	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	total
days in month	D		days	31	28	31	30	31	30	31	31	30	31	30	31	365
Precipitation	P		mm/month	64	52	52	44	57	53	52	52	48	56	54	60	644
Evaporation	E		mm/month	220	176	152	96	62	42	47	65	93	133	165	220	1471
Crop factor	C		-	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	10.8
Inputs																
Effective Precipitation	EP		mm/month	57.6	46.8	46.8	39.6	51.3	47.7	46.8	46.8	43.2	50.4	48.6	54	580
Effluent irrigation	W	QXD/L	mm/month	160.7	145.2	160.7	155.6	160.7	155.6	160.7	160.7	155.6	160.7	155.6	160.7	1893
Inputs		P+W	mm/month	218.3	192.0	207.5	195.2	212.0	203.3	207.5	207.5	198.8	211.1	204.2	214.7	2472
Outputs																
Evapotranspiration	ET	ExC	mm/month	198	158.4	136.8	86.4	55.8	37.8	42.3	58.5	83.7	119.7	148.5	198.0	1324
Percolation	B	R/7xD	mm/month	93.0	84.0	93.0	90.0	93.0	90.0	93.0	93.0	90.0	93.0	90.0	93.0	1095
Outputs		ET+B	mm/month	291.0	242.4	229.8	176.4	148.8	127.8	135.3	151.5	173.7	212.7	238.5	291.0	2419
Storage	S	(EP+W)-(ET+B)	mm/month	-72.7	-50.4	-22.3	18.8	63.2	75.5	72.2	56.0	25.1	-1.6	-34.3	-76.3	
Cumulative storage	M		mm	0.0	0.0	0.0	18.8	82.0	157.5	229.7	285.7	310.8	309.2	274.9	198.6	
Storage																
	V	largest M	mm	310.8												
		Soil storage	mm	372.0												
		Storage required	mm	-61.2												
		VxL/1000	m ³	-1.7												
Irrigation area			m ²	27												

	water holding capacity	depth (mm)	Totals(mm)
Topsoil	34%	200	68
Subsoil	38%	800	304
			372

Appendix 3c. Estimation area requirement from organic matter and nutrient balances (Irrigation systems)

Estimated effluent flow	(Q)	140	L/day
Soil depth		1.5	m

Organic matter balance

BOD (C)	20	mg/L
treated wastewater flow rate (Q)	140	L/day
critical loading rate of BOD (Lx)	3000	mg/m ² /day
land area required (A)	0.9	m²

Nitrogen balance

nutrient concentration	37	mg/L
treated wastewater flow rate	140	L/day
critical loading rate of nutrient	50	mg/m ² /day
land area required (A)	104	m²

Determination of nitrogen critical loading rate

Nitrogen load (kg/year)	1.9	kg/year		
Loss 20% denitrification	1.5	kg/year		
Load to soil	146.0	kg/ha/year	assumed irr. area	104 m ²
Vegetation usage	200.0	kg/ha/year	from table	
Residual (potential leaching)	-54.0	kg/ha/year		

Typical nitrogen uptake (Myers et al. 1984)

Pastures	300 kg/ha/year	82 mg/m ² /day
Pine	350 kg/ha/year	96 mg/m ² /day
Eucalypts	180 kg/ha/year	49 mg/m ² /day

Phosphorus balance

Phosphorus sorption capacity per metre=	6,500	kg/ha
Phosphorus sorption capacity of profile=	9,750	kg/ha
Soil factor	0.33	
Critical loading=	3	mg/m ² /day
P concentration*=	12	mg/L
P adsorbed=	phosphorus sorption capacity x soil factor	
	3217.5	
	0.32175	kg/m ²
	critical loading x days/year	
Puptake=	x	50 years
	54750	
	0.0548	kg/m ²
Pgenerated=	total phosphorus concentration x wastewater volume in	50 years
	30660000	
	31	kg
	Pgenerated / (Padsorbed + Puptake)	
Land area required	81.4	m²

Appendix 4. Checklist for effective management of wastewater systems

Domestic wastewater system

DOs

- Check household products for suitability of use with a septic tank.
- Conserve water, prolonged period of high water use can lead to application area failure. For optimum operation, avoid daily and weekly surges in water flows. Spas are not recommended.
- Scrape cooking dishes and plates prior to washing to reduce solid load.
- Maintain the system with regular servicing as per the manufacturer's instructions.

DON'Ts

- Dispose of excessive solid material, fats, lint, or large water volumes into drains.

Land application area

- Construct and maintain diversion drains around the top-side of the application area to divert surface water.
- The application area should be a grassed area, which is maintained at 10-30cm height.
- The area around the perimeter can be planted with small shrubs to aid transpiration of the wastewater.
- Ensure run-off from the roof or driveway is directed away from the application area.
- Periodic application of gypsum may be necessary to maintain the absorptive capacity of the soil.
- **Do not** erect any structures or paths on the land application area.
- **Do not** graze animals on the land application area.
- **Do not** drive over the land application area.
- **Do not** plant large trees that shade the land application area thereby reducing transpiration of water.
- **Do not** let children or pets play on the land application area.
- **Do not** extract untreated groundwater for potable use.