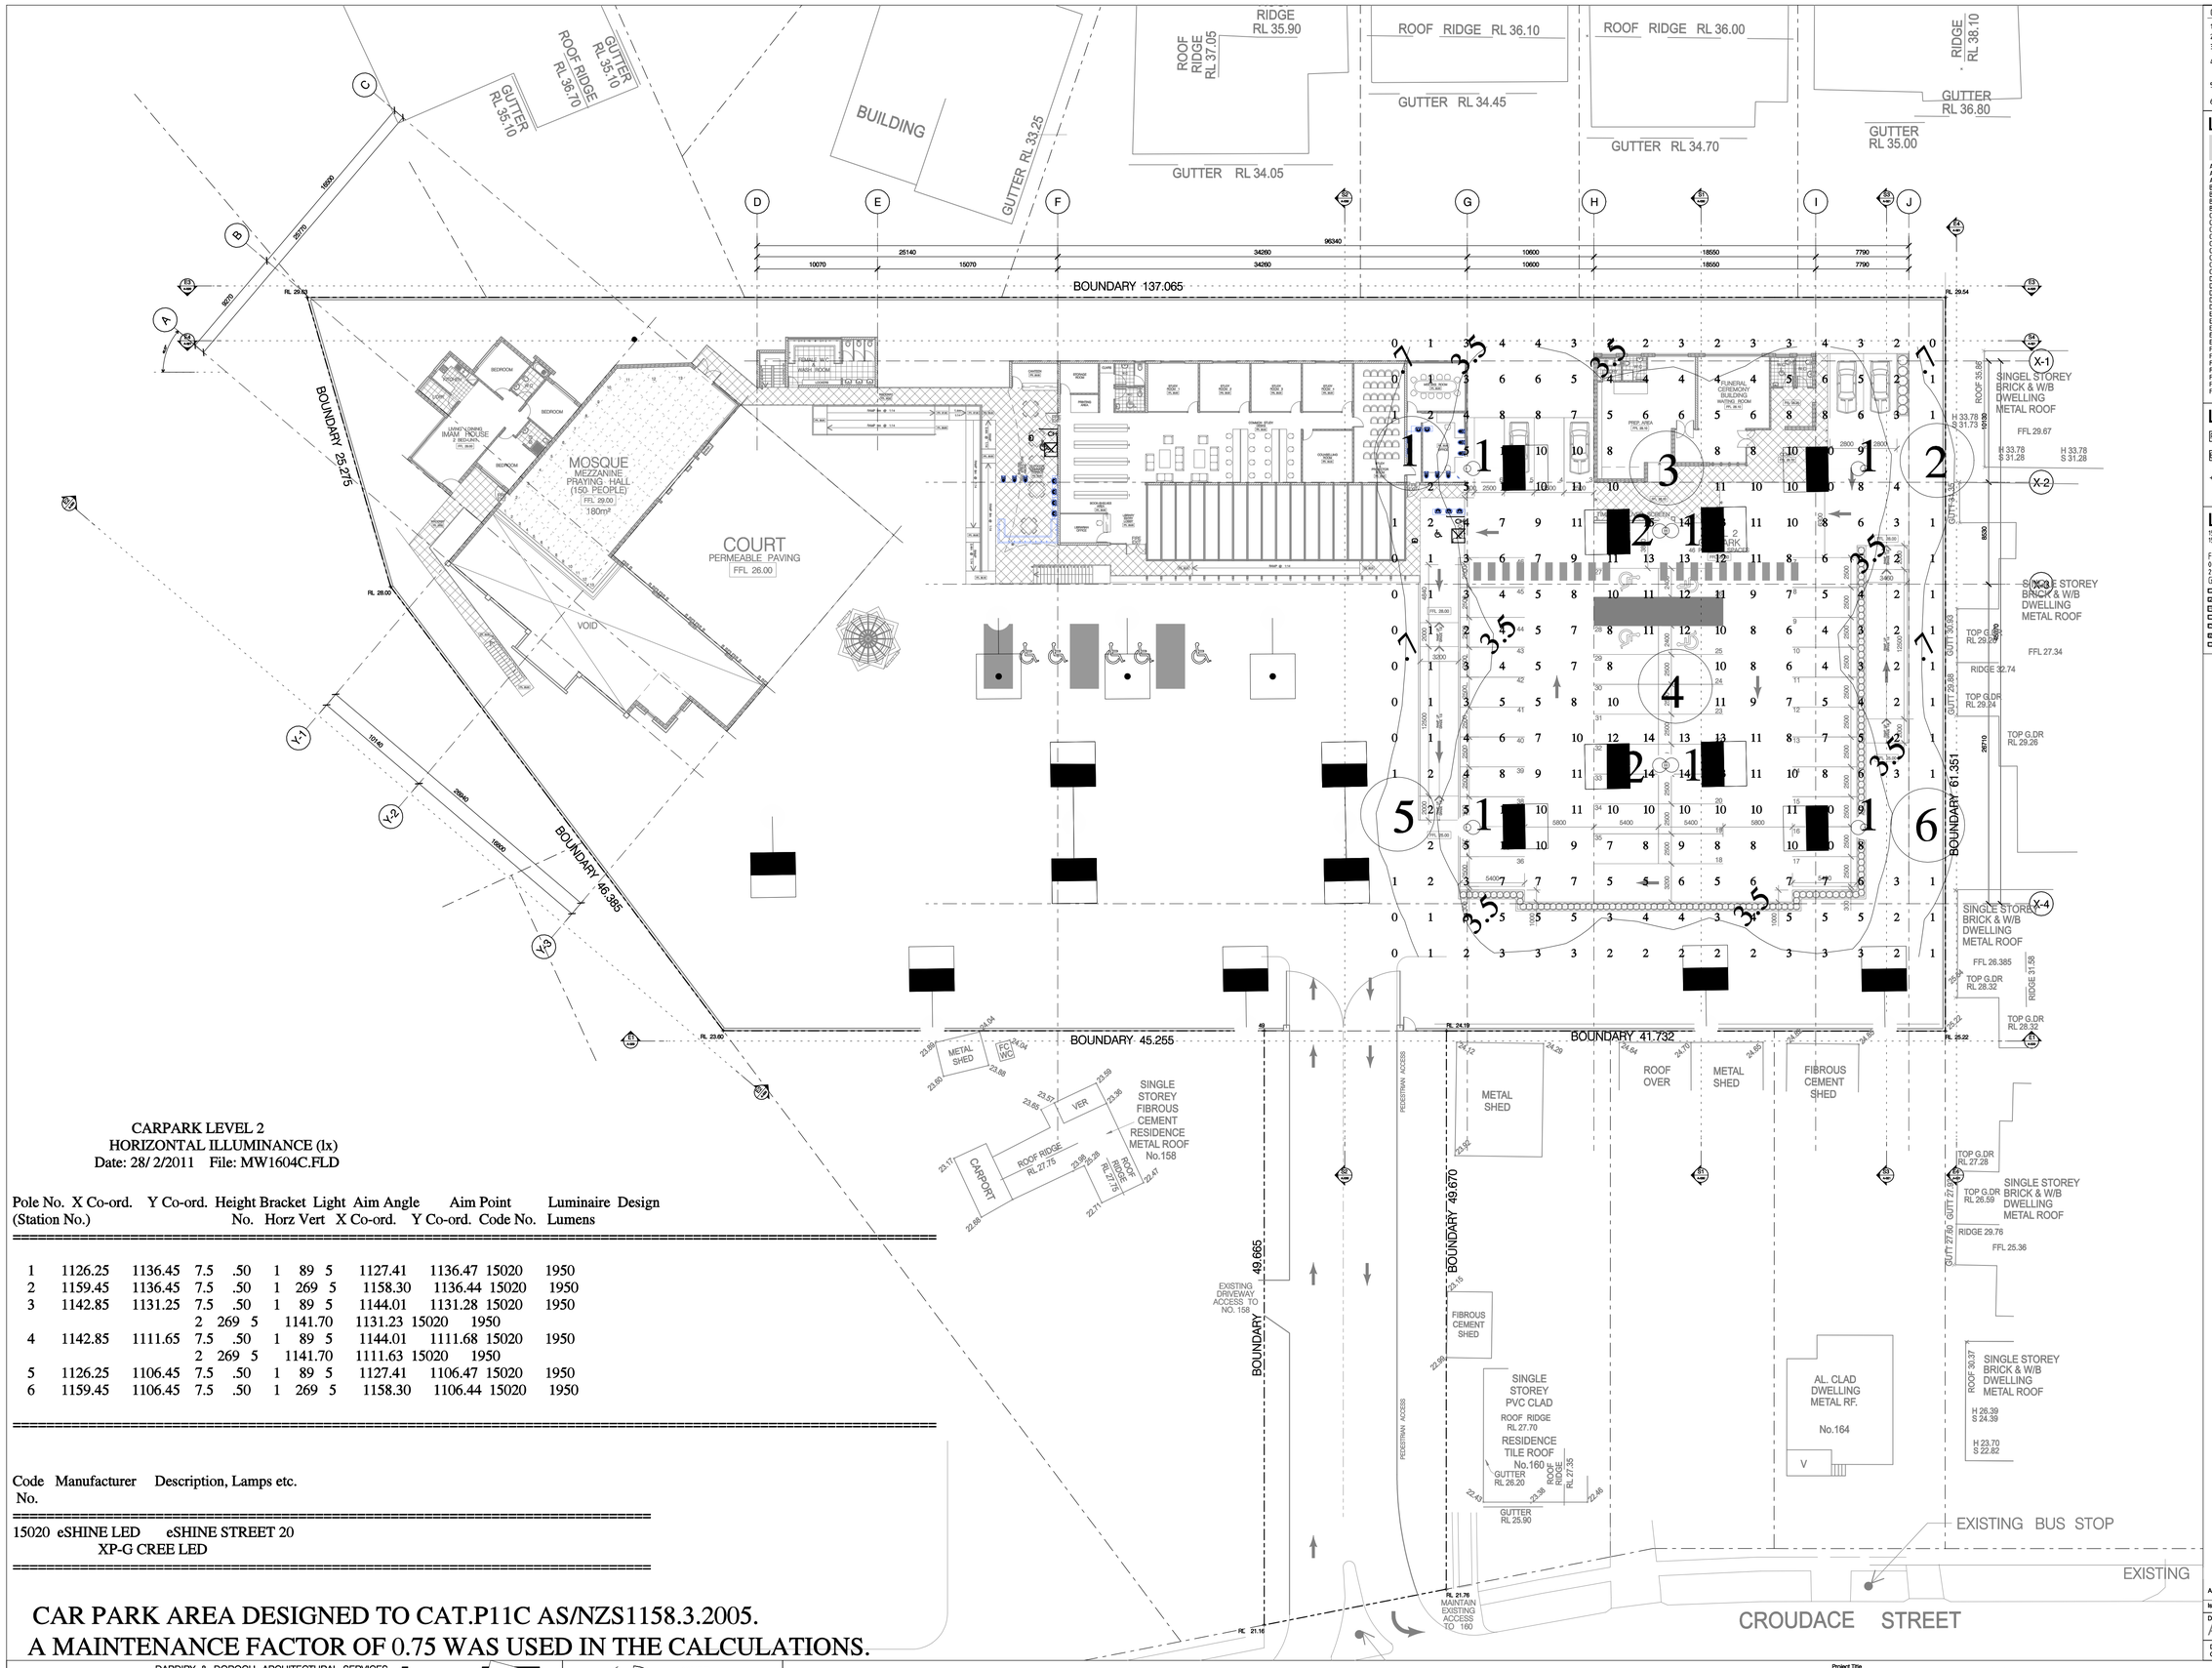

CARPARK LEVEL 2
HORIZONTAL ILLUMINANCE (lx)
Date: 28/ 2/2011 File: MW1604C.FLD

Pole No. (Station No.)	X Co-ord.	Y Co-ord.	Height	Bracket No.	Light Horz	Light Vert	Aim Angle X Co-ord.	Aim Angle Y Co-ord.	Aim Point Code No.	Luminaire Lumens	Design
1	1126.25	1136.45	7.5	.50	1	89	5	1127.41	1136.47	15020	1950
2	1159.45	1136.45	7.5	.50	1	269	5	1158.30	1136.44	15020	1950
3	1142.85	1131.25	7.5	.50	1	89	5	1144.01	1131.28	15020	1950
					2	269	5	1141.70	1131.23	15020	1950
4	1142.85	1111.65	7.5	.50	1	89	5	1144.01	1111.68	15020	1950
					2	269	5	1141.70	1111.63	15020	1950
5	1126.25	1106.45	7.5	.50	1	89	5	1127.41	1106.47	15020	1950
6	1159.45	1106.45	7.5	.50	1	269	5	1158.30	1106.44	15020	1950

Code No.	Manufacturer	Description, Lamps etc.
15020	eSHINE LED	eSHINE STREET 20 XP-G CREE LED

CAR PARK AREA DESIGNED TO CAT.P11C AS/NZS1158.3.2005.
A MAINTENANCE FACTOR OF 0.75 WAS USED IN THE CALCULATIONS.

GENERAL NOTES

1. ALL DIMENSIONS AND SIZES ARE IN MILLIMETRES.
2. DO NOT SCALE DRAWINGS.
3. ALL WALL THICKNESSES DIMENSIONED OR NOTED ARE NOMINAL SIZES ONLY.
4. INFORMATION INDICATED IN THIS DOCUMENT MAY BE CRUCIAL TO THE SAFE AND PROPER FUNCTIONING OF THE PROJECT. DO NOT ALTER ANY ASPECT WITHOUT REFERENCE TO THE ARCHITECT.
5. READ THIS DRAWING IN CONJUNCTION WITH RELEVANT CONSULTANT DRAWINGS AND SPECIFICATIONS.
6. INFORM THE ARCHITECT OF ANY DISCREPANCIES.

LEGEND - GENERAL

EXISTING AREAS - UNALTERED

AC	AIR CONDITIONING	FIP	FIRE INDICATOR PANEL
A/L	AIRLOCK	FNC	PREF METAL POOL FENCE
AP	ACCESS PANEL	FW	FLOOR WASTE
BCT	BABY CHANGE TABLE	GL	GLAZING
BFW	BUCKET TRAP FLOOR WASTE	GMS	GALVANISED MILD STEEL
BOL	BOLLARD	HWU	HOT WATER UNIT
BTM	BITUMIN / KOTMIX TOPPING	KE	KITCHEN EXHAUST
CFC	COMPRESSED FIBRE CEMENT	MAT	PEDIMAT
CG	CORNER GUARD	MD	METAL DECK ROOF
CJ	CONTROL JOINT	MJ	MOVEMENT JOINT
CON	CONCRETE FINISH	PAV	PAVING
COS	CONFIRM ON SITE	PC	POWDERCOAT
CPT	CARPET	PLT	PLANTER / SOFT LANDSCAPE
CRW	COOL ROOM WALL	PR	PROTECTION RAIL
CTH	CANVAS / SAILCLOTH	RWH	RAIN WATER HEAD
CWM	CHAIN WIRE MESH	SC	STEEL COLUMN
DG	DRAINAGE OUTLET	SFL	STRUCTURAL FLOOR LEVEL
DP	DOWN PIPE	SFW	SEALED FLOOR WASTE
DPC	DAMP PROOF COURSE	SH	SECURITY SHUTTERS
DPS	DOWN PIPE AND SUMP	SS	STAINLESS STEEL
DWE	DISHWASHER EXHAUST	SSG	STAINLESS STEEL GRATE
EDP	EXISTING DOWNPIPE	SSHR	STAINLESS STEEL HANDRAIL
EFL	EXISTING FLOOR LEVEL	TD	TUNDISH
EJ	EXPANSION JOINT	TE	TOILET EXHAUST
ESC	EXISTING STEEL COLUMN	TL	TILING
EXP	EPOXY FINISH	TBR	TIMBER BUFFER RAIL
FC	FIBRE CEMENT	TMB	TIMBER
FCL	FINISHED CEILING LEVEL	TWI	TACTILE WARNING INDICATOR
FD	FIRE DOOR	U/SR	UNDERSIDE OF ROOF
FFL	FINISHED FLOOR LEVEL	VP	VENT PIPE
FH	FIRE HYDRANT	WPM	WATERPROOF MEM
FHR	FIRE HOSE REEL	W	WHEEL STOP
FE	FIRE EXTINGUISHERS	WS	WALL STIFFENER

LEGEND

RL 6.840	NEW LEVEL
ERL 6.840	EXISTING LEVEL
RL 6.840	NEW SPOT LEVELS
ERL 6.840	EXISTING SPOT LEVELS

LEGEND - WALL CODES

15.2 MASONRY TYPE AS FOLLOWS:
15 NOMINAL WIDTH IN CENTIMETRES
2 MASONRY FRL

FRL CODES

0	0/0/0				
1	60/60/60	1½	90/90/90		
2	120/120/120	3	180/180/180		

GRAPHICS

BLK	BLOCKWORK	GL	GLAZED WALL
BRK	BRICKWORK		EXISTING WALLS
RC	REINFORCED CONCRETE		EXISTING WALLS DEMOLISHED
S-W	STUD WALL PAINT FINISH		
ECRW	EXIST COOLROOM PANEL		ELEMENTS OVER
CRW	COOLROOM PANELS	ATM	AIR-TIGHT MASONRY
CPI	COOLROOM PANEL WALL	FH	FULL HEIGHT

Issue	Amendment	Date
A1	ISSUED FOR AUTHORITY APPROVAL	28/07/2010

Drawing Status: AUTHORITY APPROVAL
Designed By:
Checked By: NAME SURNAME

This drawing is protected by copyright. It may only be used for the purpose for which it is issued

DARDIRY & DOROCH ARCHITECTURAL SERVICES
ABN: 44 832 054 816
6 / 22 Swete Street
Lidcombe 2141
Phone: 0406362260
Fax: 02 80605531
email: mail@dardirydoroch.com

hakim hamzah
CONSULTANTS
RAIA
email: hharch@msn.com

CLIENT
NEWCASTLE MUSLIM ASSOCIATION
E-MAIL : –

Project Title: PROPOSED MOSQUE & COMMUNITY FACILITIES
Location: 158A 164 CROUDACE ROAD ELERMORE VALE 2287
Project No: 200901106

Scale: 1:250 @A1, @A3
0 2.5 5 7.5 10 12.5 25m

Drawing Title: LUX CONCEPT PLAN 02
Date Printed: 10/03/2011
Drawing No: A-006
Issue: A1

Printed By: $USER$ File: $FILEABBREV$