

## **Strong Property Development**

## **South Street and Burbang Crescent, Rydalmere**

## **Acoustic DA Assessment**

<b>Author</b>	<b>Fu Siong Hie, B.Eng, MAAS Principal Consultant</b>
<b>Document Reference:</b>	<b>SYD2016-1058-R001A</b>
<b>Date</b>	<b>20/06/2016</b>
<b>Comments:</b>	<b>Initial Draft</b>

## Table of Contents

1	Introduction .....	3
2	Noise Criteria .....	4
2.1	Internal Noise Levels .....	4
2.2	Sound Insulation Requirement (Part F5 NCC/BCA) .....	5
2.3	Noise Survey and Project Specific Limits .....	7
3	Assessment and Recommendations .....	8
3.1	Façade Glazing Requirements .....	8
3.2	Building Façade Construction .....	9
3.3	Mechanical Services .....	9
4	Conclusion .....	9
	Appendix A – Acoustic Terminology .....	10
	Appendix B – Architectural Drawings .....	11
	Appendix C – Noise Logger Results .....	12

## Index of Figures

Figure 1 – Site Location, Nearest Residents and Noise Logger Position .....	3
---	---

## Index of Tables


Table 1— Recommended Internal Design Noise Levels (AS/NZS 2107) .....	4
Table 2 - NCC Part F5 Requirements (Class 2 or 3) .....	5
Table 3 – Measured Ambient and Traffic Noise and Levels, dBA .....	7
Table 4— Noise Survey Summary and Project Limits, dBA .....	8
Table 5 – Schedule of Window and Glazing ( $R_w$ ) .....	8
Table 6 – External Façade Construction ( $R_w$ ) .....	9

## 1 Introduction

The following report has been prepared by Acouras Consultancy on behalf of Strong Property Development to assess the potential for noise impact associated with the residential development at 14-16 Burbang Crescent and 47-49 South Street, Rydalmere. The residential development will include:

- Single basement carpark.
- Residential apartment on ground to level 2.

The proposed residential development is surrounded by existing residential buildings to the north, east and west. There is a commercial zone located to the south opposite South Street. Traffic noise along the South Street contributes to the surrounding ambient noise levels. The site location is shown in Figure 1.

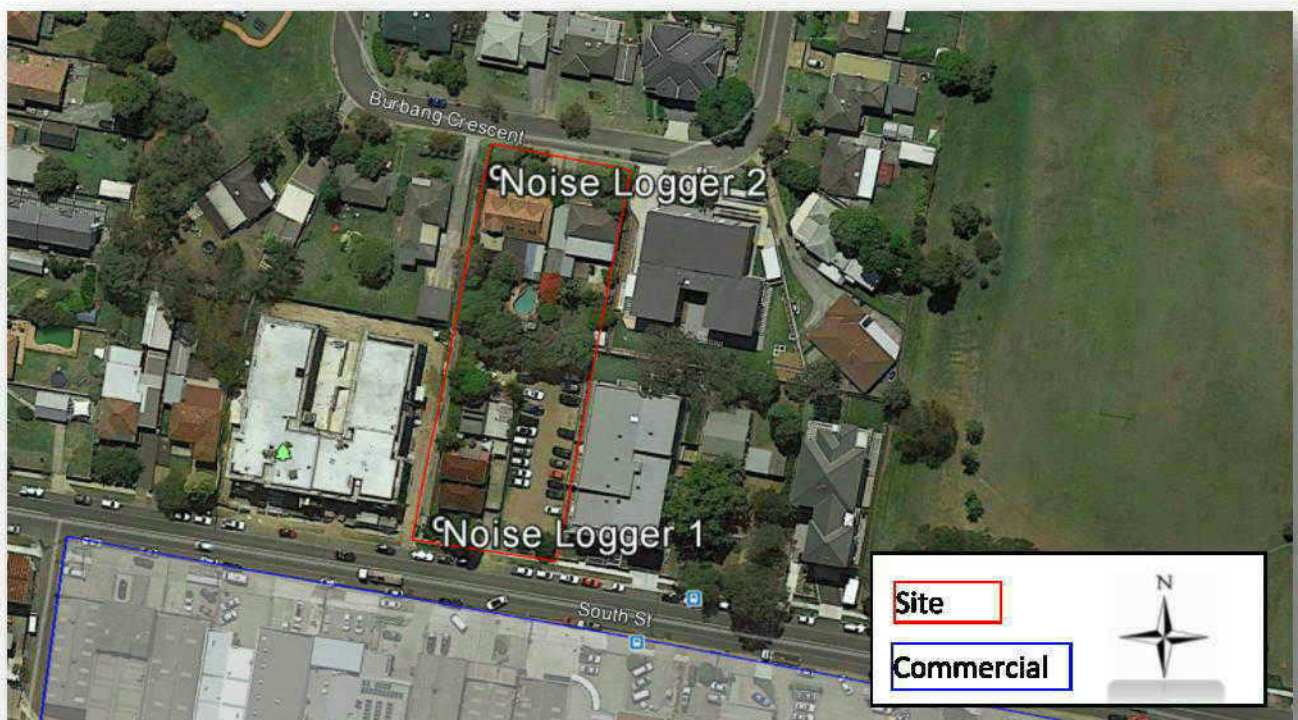

**Figure 1 – Site Location, Nearest Residents and Noise Logger Position**



## 2 Noise Criteria

The following standards and guidelines are applicable to this project:

- Parramatta Development Control Plan (DCP 2011) and Conditions.
- NSW Department of Planning "Development Near Rail Corridors and Busy Roads".
- NCC/BCA Part F5.
- NSW EPA "Noise Guide for Local Government" (NGLG).
- Australian standard AS/NZS 2107-2000: Acoustics – Recommended design sound levels and reverberation times for building interiors.
- Australian standard AS 1055.1-1997: Acoustics – Description and measurement of environmental noise - General procedures.

### 2.1 Internal Noise Levels

Section 3.3.4 of the Parramatta DCP 2011 states that for a residential development:

*C.1 Internal habitable rooms of dwellings affected by high levels of external noise are to be designed to achieve internal noise levels of no greater than 50dBA.*

*NOTE: A busy road is defined as carrying an annual average daily traffic volume of more than 40,000 vehicles (based on the traffic volume data available on the Road and Traffic Authority's website).*

In addition to this, Council require the development meet the following condition:

*As the development is located opposite a no-residential zone uses (on South Street) an acoustic report is required to be provided. The report shall outline the measure that will be taken to ensure that the following LAeq levels are not exceed:*

- (a) In any bedroom in the building is 35dB(A) at any time between 10pm and 7am.*
- (b) Anywhere else in the building (other than a garage, kitchen, bathroom or hallway) is 40dBA at any time.*

The AS/NZS 2107–2000 outlines the acceptable internal noise levels such that a satisfactory acoustic environment within non-residential spaces in new and existing buildings can be achieved. Table 1 presents the recommended internal design noise levels.

**Table 1— Recommended Internal Design Noise Levels (AS/NZS 2107)**

Type of occupancy/activity	Recommended design sound level, Leq in dB(A)	
	Satisfactory	Maximum
Enclosed Carparks	55	65

## 2.2 Sound Insulation Requirement (Part F5 NCC/BCA)

For sound transmission and insulation between sole occupancy units (SOU) within the same development, walls and floors to be constructed in accordance with requirements of Part F5 of the Building Code of Australia (BCA). Sound insulation requirements are summarised in Table 2.

**Table 2 - NCC Part F5 Requirements (Class 2 or 3)**

Building Element	Minimum NCC Part F5 Requirements
<b>Sound Insulation Rating of Walls (Class 2 or 3)</b>	
Walls between separate sole occupancy units.	Rw + Ctr 50 (airborne)
Walls between wet areas (bathrooms, sanitary compartment, laundry or kitchen) and a habitable room (other than kitchen) in adjoining apartments.	Rw + Ctr 50 (airborne) & of discontinuous construction
Walls between sole occupancy unit and stairway, public corridors, public lobby or the like or parts of a different classification.	Rw 50 (airborne)
Walls between a plant room or lift shaft and a sole occupancy unit.	Rw 50 (airborne) & of discontinuous construction
<b>Sound Insulation Rating of Floors (Class 2 or 3)</b>	
Floors between sole occupancy units or between a sole occupancy unit and plant room, lift shaft, stairway, public corridor, public lobby or the like.	Rw + Ctr 50 (airborne) & Ln,w + CI < 62 (impact)
<b>Apartment Entry Doors (Class 2 or 3)</b>	
A door incorporated in a wall that separates a sole-occupancy unit from a stairway, public corridor, public lobby or the like.	Rw 30 (airborne)
<b>Services (Class 2, 3 or 9c)</b>	
If a storm water pipe, a duct, soil, waste or water supply pipe including a duct or pipe that is located in a wall or floor cavity serves or passes through more than one sole occupancy unit must be separated:	
if the adjacent room is a habitable room (other than a kitchen); or	Rw + Ctr 40
if the room is a kitchen or non-habitable room	Rw + Ctr 25



---

**Construction Deemed to Satisfy**

The forms of construction must be installed as follows:

(a) **Masonry**—Units must be laid with all joints filled solid, including those between the masonry and any adjoining construction.

(b) **Concrete slabs**—Joints between concrete slabs or panels and any adjoining construction must be filled solid.

(c) **Sheeting materials**—

(i) if one layer is required on both sides of a wall, it must be fastened to the studs with joints staggered on opposite sides; and

(ii) if two layers are required, the second layer must be fastened over the first layer so that the joints do not coincide with those of the first layer; and

(iii) joints between sheets or between sheets and any adjoining construction must be taped and filled solid.

(d) **Timber or steel-framed construction**—perimeter framing members must be securely fixed to the adjoining structure and—

(i) bedded in resilient compound; or

(ii) the joints must be caulked so that there are no voids between the framing members and the adjoining structure.

(e) **Services**—

(i) Services must not be chased into concrete or masonry elements.

(ii) A door or panel required to have a certain  $R_w + C_{tr}$  that provides access to a duct, pipe or other service must—

(A) not open into any habitable room (other than a kitchen); and

(B) be firmly fixed so as to overlap the frame or rebate of the frame by not less than 10 mm, be fitted with a sealing gasket along all edges and be constructed of—

(aa) wood, particleboard or blockboard not less than 33 mm thick; or

(bb) compressed fibre reinforced cement sheeting not less than 9 mm thick;  
or

(cc) other suitable material with a mass per unit area not less than 24.4 kg/m<sup>2</sup>

(iii) A water supply pipe must—

(A) only be installed in the cavity of discontinuous construction; and

(B) in the case of a pipe that serves only one sole-occupancy unit, not be fixed to the wall leaf on the side adjoining any other sole-occupancy unit and have a clearance not less than 10 mm to the other wall leaf.

(iv) Electrical outlets must be offset from each other—

(A) in masonry walling, not less than 100 mm; and

(B) in timber or steel framed walling, not less than 300 mm.

## 2.3 Noise Survey and Project Specific Limits

An unattended noise survey was carried out at the site to measure the background and ambient noise levels. Noise monitoring was conducted between Thursday 9<sup>th</sup> to Wednesday 15<sup>th</sup> June 2016. The monitor was positioned (as shown in Figure 1) at the following locations:

- Location 1 – 47 South Street, Rydalmere.
- Location 2 – 14 Burbang Crescent, Rydalmere.

Measurements were conducted using the following equipment:

- SVAN 977 Type 1 Real time Analyser/Noise Logger. Serial No. 34135.
- SVAN SV30A Type 1 Sound Level Calibrator. Serial No. 31830.

Noise monitoring was conducted in general accordance with Australian standard AS 1055.1-1997: Acoustics-Description and measurement of environmental noise-General procedures.

The noise analyser was calibrated immediately before and after measurements were taken with no discernible differences between these two recorded levels. The sound analyser is Type 1 and complies with Australian standard AS1259.2: 1990.

Table 3 presents a summary of the measured ambient noise level and traffic noise impacting the development.

**Table 3 – Measured Ambient and Traffic Noise and Levels, dBA**

Location	Period	Average $L_{eq}$	Highest $L_{eq}$ 1hr
South Street	Day (07:00-22:00)	56	61
	Night (22:00-07:00)	50	56

The DCP does not have any specific guide for controlling noise emission from the operation of mechanical equipment associated with the development. However, the EPA Noise Guide for Local Government (NGLG) does provides a guide into considering intrusive impact to nearby receivers from this residential development. The assessment of intrusive noise levels has been conducted in general accordance with the procedures as set out in the NSW Industrial Noise Policy, which defines intrusive noise as 5 decibels above the background noise level. For the purpose of the assessment, the background noise level has been determined using the RBL. In addition to the intrusive noise criteria, noise from this equipment must not be able to be heard in a habitable room in a neighbouring residence during the restricted hours. Table 4 presents a summary of the measured background noise level and the allowable intrusive noise limit for this project.



**Table 4—Noise Survey Summary and Project Limits, dBA**

Location	Time Period	Existing Noise Levels		NGLG Noise Limits, Leq, dBA
		Leq (period)	RBL	
1	Day (07:00-18:00)	56	42	47
	Evening (18:00-22:00)	54	41	46
	Night (22:07:00)	50	39	44
2	Day (07:00-18:00)	54	43	48
	Evening (18:00-22:00)	52	45	50
	Night (22:07:00)	48	41	46

During detailed design stage, the design and selection of the mechanical equipment required to service the proposed development will be required to achieve the noise limits as presented in the table above. During the monitoring period any adverse weather condition have been excluded. The noise logger results are presented in Appendix C.

### 3 Assessment and Recommendations

#### 3.1 Façade Glazing Requirements

Acoustic glazing for the apartments are given in Table 5 are required to reduce noise impact on the internal occupants and should result in noise levels within such units in accordance with the Department of Planning Noise Guidelines and AS/NZS 2107:2000.

**Table 5 – Schedule of Window and Glazing (R<sub>w</sub>)**

Level	Apart. No.	Space	Glazing Thickness	Minimum R <sub>w</sub> (Glazing+Frame)
G	A01	Living	6.38mm laminated	30
		Bed 1	10.38mm laminated	32
	All other	Living & Bedrooms	6.38mm laminated	30
1	A06	Living	6.38mm laminated	30
		Bed 1 & 2	10.38mm laminated	32
	All other	Living & Bedrooms	6.38mm laminated	30
2	A12	Living	6.38mm laminated	30
		Bed 1 & 2	10.38mm laminated	32
	All other	Living & Bedrooms	6.38mm laminated	30



All other non-habitable spaces, such as bathrooms and laundries require minimum 6mm monolithic glass (Rw 28).

All Windows/doors should be well sealed (air tight) when closed with good acoustic seals around the top and bottom sliders. Mohair seals are not considered to be acoustic seals.

### 3.2 Building Façade Construction

To provide sufficient acoustic attention of noise, the general external construction of the proposed building would need to be constructed as detailed in Table 6.

**Table 6 – External Façade Construction (R<sub>w</sub>)**

Building Element	Proposed Construction	Minimum R <sub>w</sub>
External Wall	Masonry or cavity brick	45
Roof and ceiling	Concrete with a plasterboard cavity ceiling	45

### 3.3 Mechanical Services

At the DA stage, the design and selection of mechanical equipment has not been finalised. Following the DA approval of the proposed development, during the Construction Certification Stage a detail assessment of all mechanical plant and equipment will be conducted to ensure compliance with the EPA and DCP noise criteria. Typical acoustic measures may include the construction of acoustic barriers, enclosures, attenuators and/or acoustic louvres.

## 4 Conclusion

An acoustic assessment of the proposed development has been carried out in accordance with the requirements of Parramatta Development Control Plan (DCP 2011).

An environmental noise survey of the site has been conducted and the noise limiting criteria for mechanical plant/equipment noise emission has been determined based on the EPA NGLG. The limits are presented in **Error! Reference source not found.**

Construction for glazing, external walls and the roof/ceiling systems have been provided to achieve the internal noise criteria and are detailed in Section 3.1 and Section 3.2 based on the impact of road, rail and aircraft noise.

Providing the recommendations in this report are implemented, the noise from the proposed development is predicted to comply with acoustic requirements of the Parramatta DCP, BCA Part F5 and relevant Australian standards.

## Appendix A – Acoustic Terminology

**Decibel, dB:** A dimensionless unit which denotes the ratio between two quantities that are proportional to power, energy or intensity. One of these quantities is a designated reference by which all other quantities of identical units are divided. The sound pressure level in decibels is equal to 10 times the logarithm (to the base 10) of the ratio between the pressure squared divided by the reference pressure squared. The reference pressure used in acoustics is 20 micro Pascals.

**A-WEIGHTING:** A measure of sound pressure level designed to reflect the response of the human ear, which does not respond equally to all frequencies. To describe sound in a manner representative of the human ear's response it is necessary to reduce the effects of the low and high frequencies with respect to medium frequencies. The resultant sound level is said to be A-weighted, and the units are in decibels (dBA). The A-weighted sound level is also called the noise level.

**Sound Pressure Level,  $L_p$  (dB), of a sound:** 20 times the logarithm to the base 10 of the ratio of the r.m.s. sound pressure to the reference sound pressure of 20 micro Pascals. Sound pressure level is measured using a microphone and a sound level meter, and varies with distance from the source and the environment.

**Ambient Noise/Sound:** All noise level present in a given environment, usually being a composite of sounds from many sources far and near. Traffic, HVAC, masking sound or even low-level background music can contribute to ambient level of noise or sound.

**Percentile Level -  $L_{90}$ ,  $L_{10}$ , etc:** A statistical measurement giving the sound pressure level which is exceeded for the given percentile of an observation period, e.g.  $L_{90}$  is the level which is exceeded for 90% of a measurement period.  $L_{90}$  is commonly referred to as the "background" sound level.

**Background Noise ( $L_{90}$ ):** The sum total of all unwanted residual noise generated from all direct and reflected sound sources in a space that can represent an interface to, or interfere with good listening and speech intelligibility.

**Rating Background Level – RBL:** Method for determining the existing background noise level which involves calculating the tenth percentile from the  $L_{A90}$  measurements. This value gives the Assessment Background Noise Level (ABL). Rating Background Level is the median of the overall ABL.

**$L_{AEQ,T}$ :** Equivalent continuous A-weighted sound pressure level. The value of the A-weighted sound pressure level of a continuous steady sound that, within a measurement time interval T, has the same A-weighted sound energy as the actual time-varying sound.






---

## Appendix B – Architectural Drawings

This assessment was based on the following architectural drawings provided by Architex.

Drawing	Issue	Date	Description
DA03	A	07-04-16	Basement Level
DA04	A	07-04-16	Ground Floor Level
DA05	A	07-04-16	Level 1 Floor Level
DA06	A	07-04-16	Level 2 Floor Level

## Appendix C – Noise Logger Results

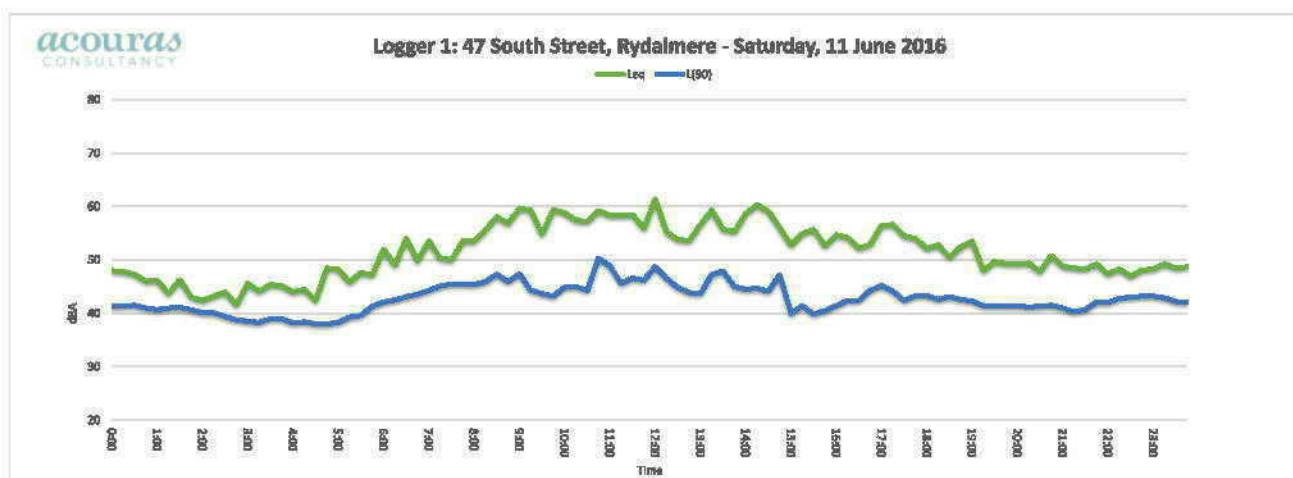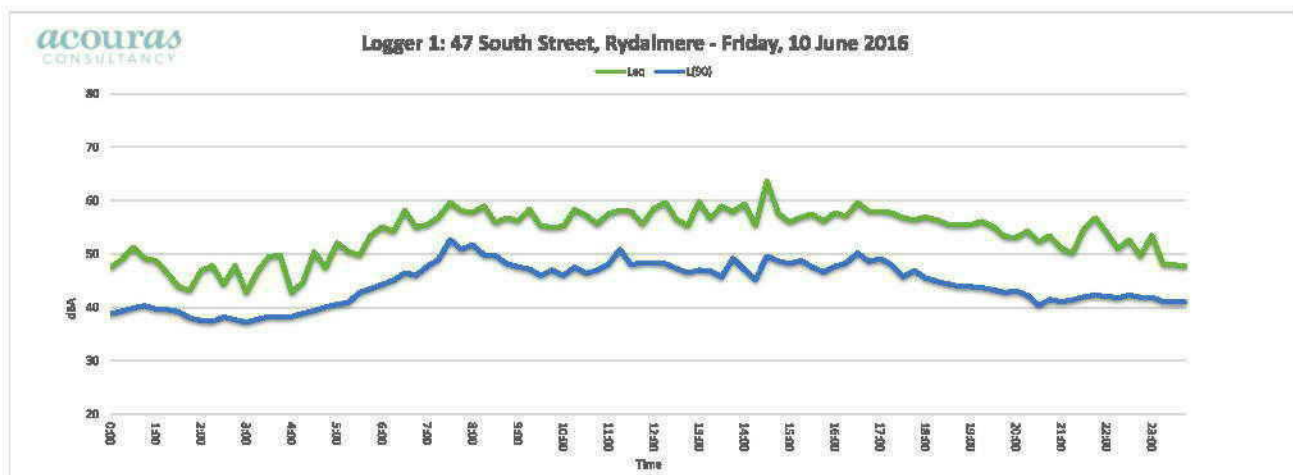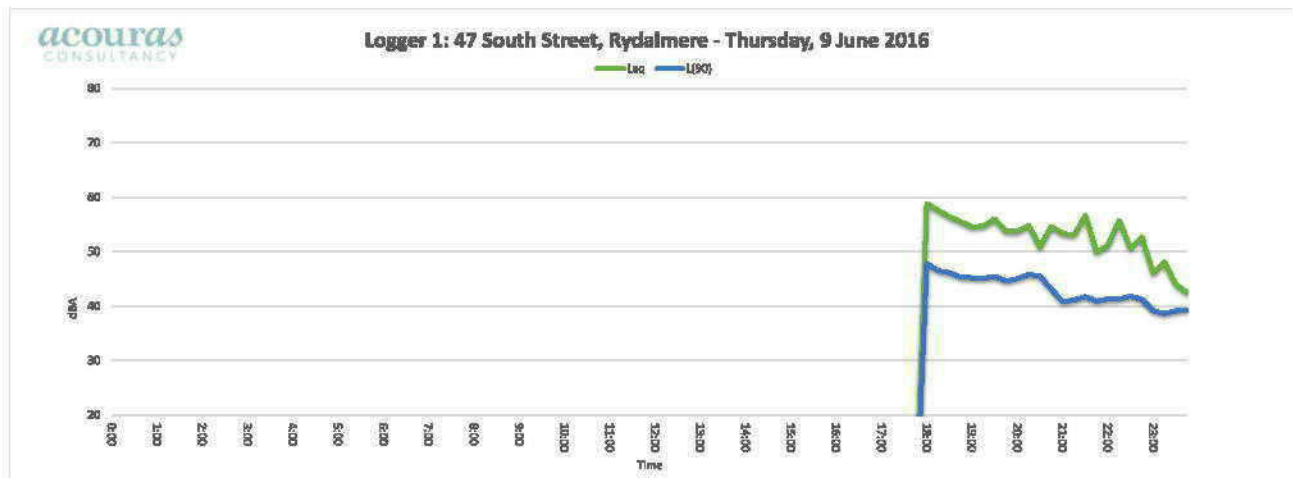






# STRONG PROPERTY DEVELOPMENT

## SOUTH STREET AND BURBANG CRESCENT, RYDALMERE - ACOUSTIC DA ASSESSMENT

SYD2016-1058-R001A

20/06/2016

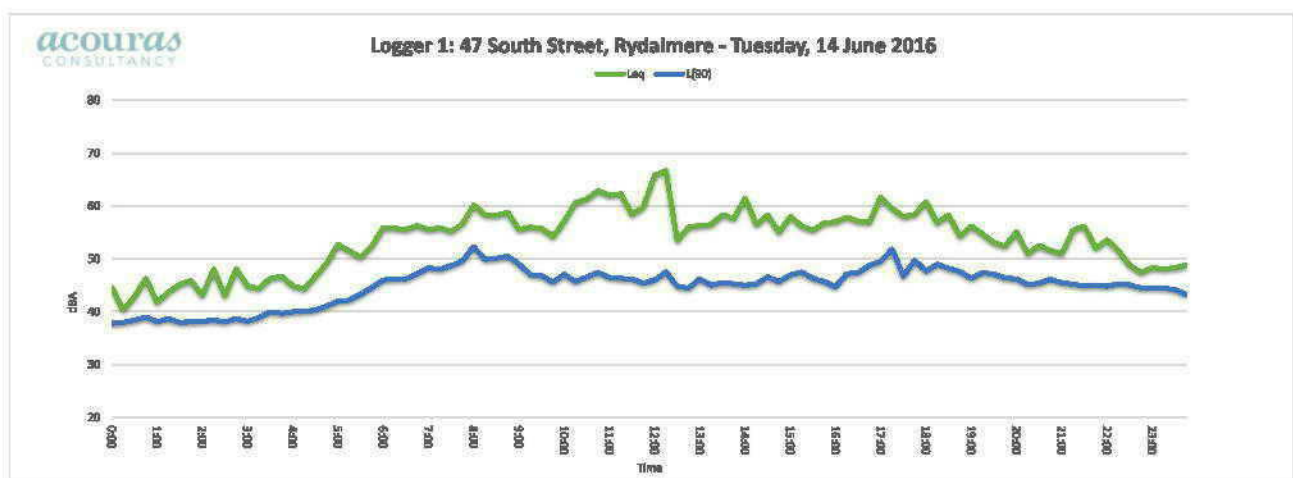
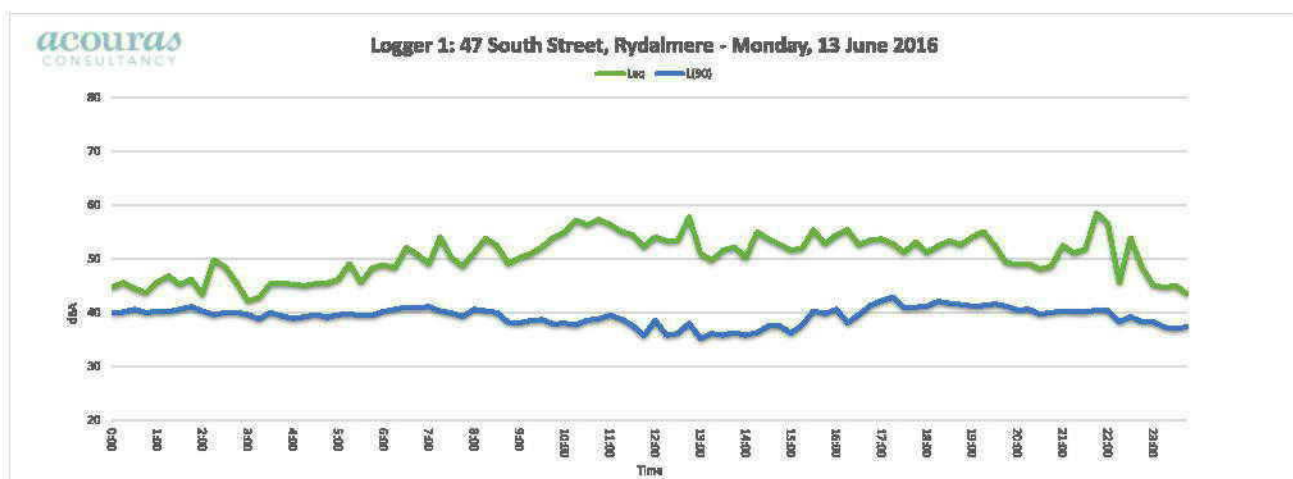
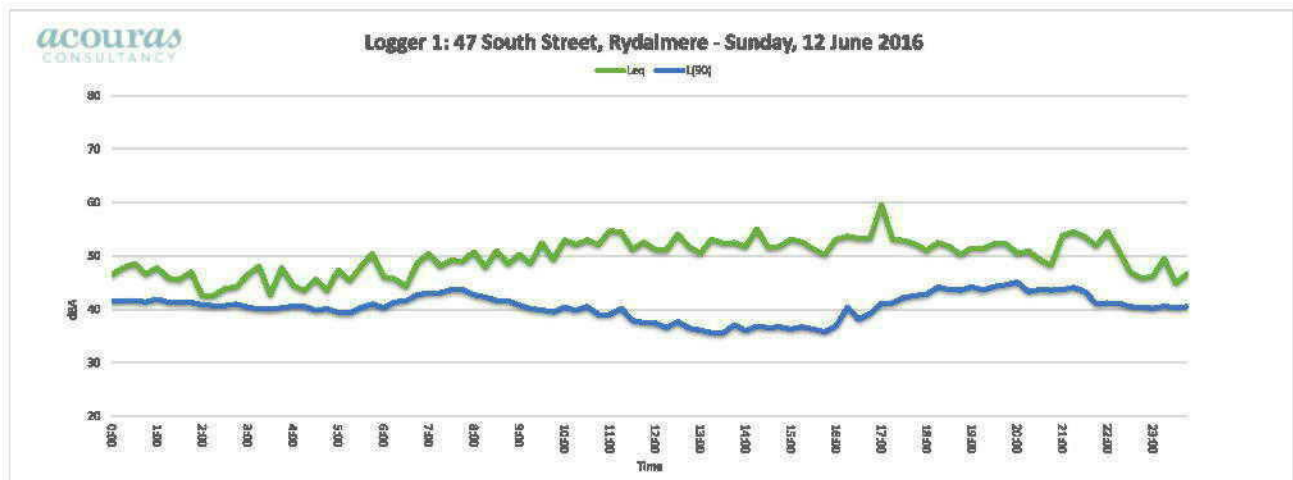


# STRONG PROPERTY DEVELOPMENT

## SOUTH STREET AND BURBANG CRESCENT, RYDALMERE - ACOUSTIC DA ASSESSMENT

SYD2016-1058-R001A

20/06/2016

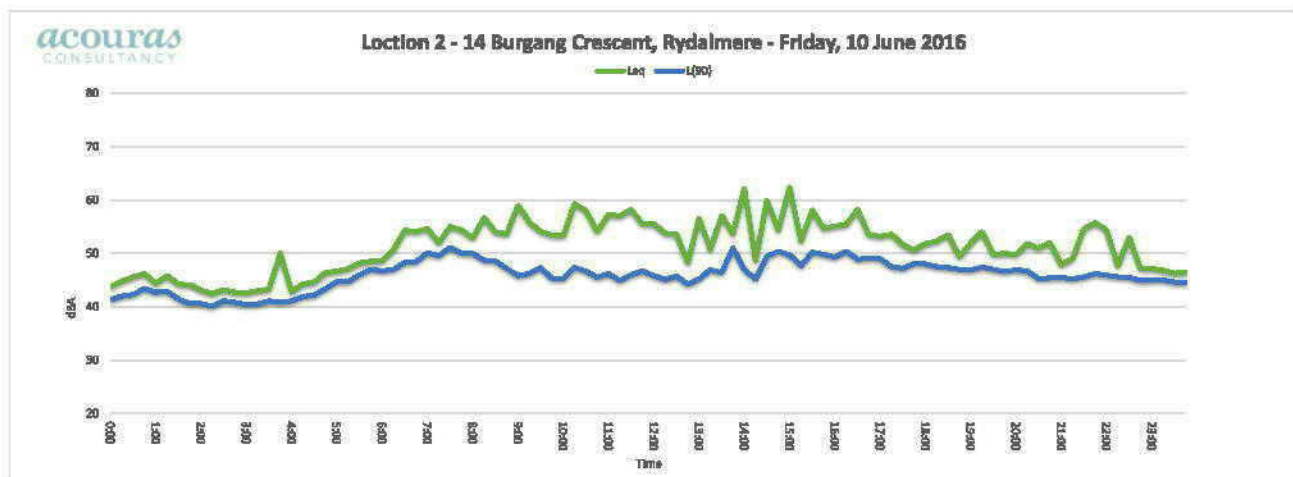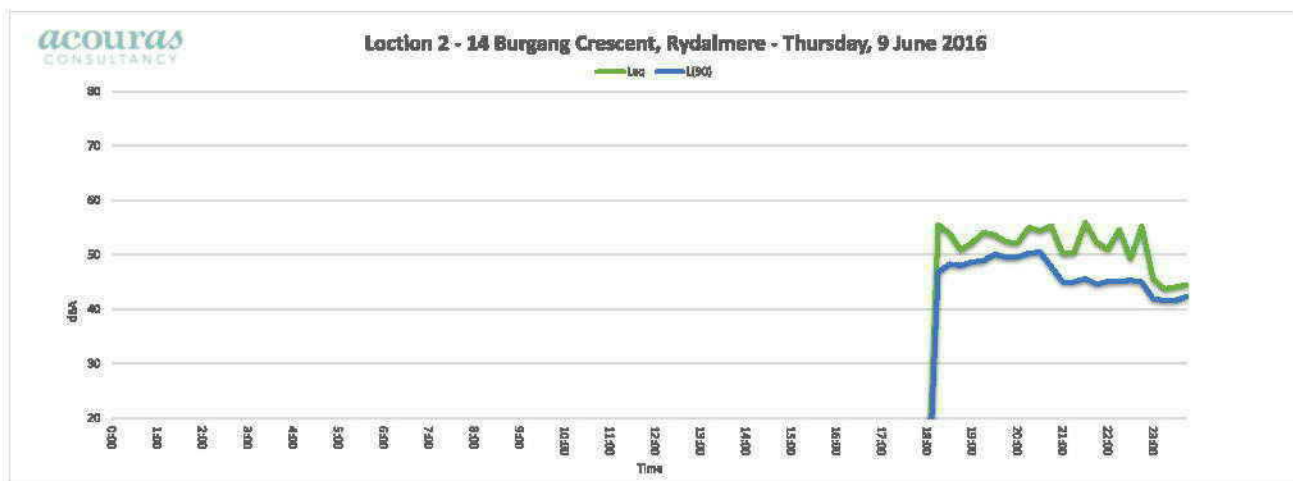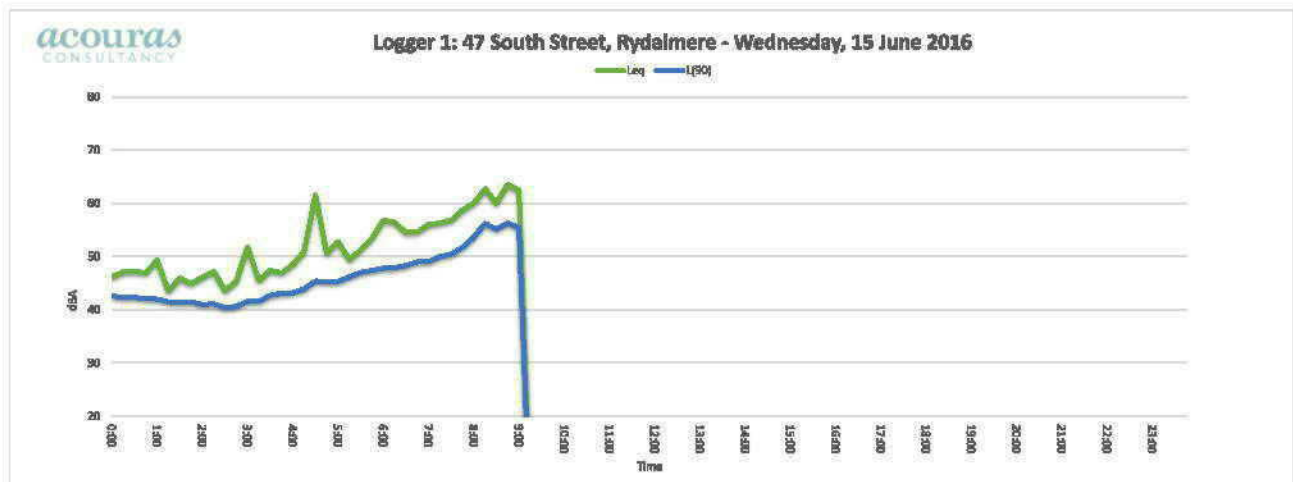






## STRONG PROPERTY DEVELOPMENT

### SOUTH STREET AND BURBANG CRESCENT, RYDALMERE - ACOUSTIC DA ASSESSMENT

SYD2016-1058-R001A

20/06/2016

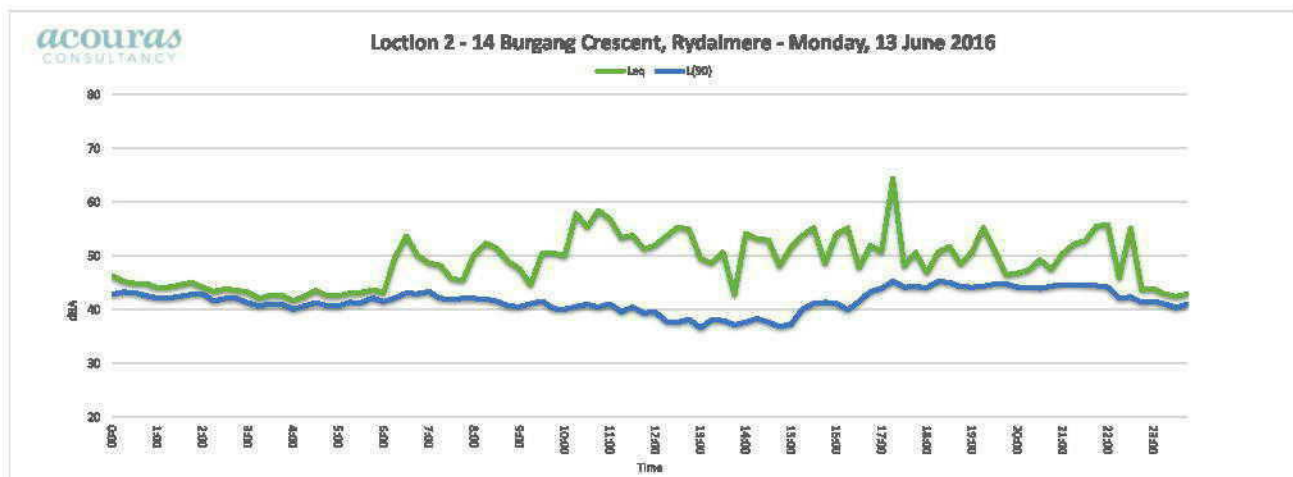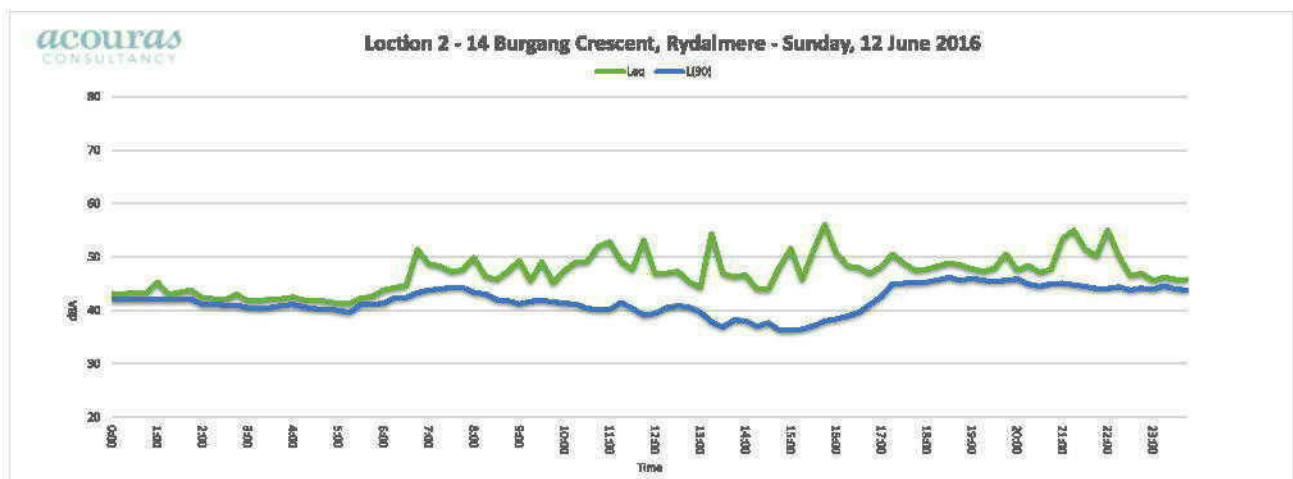
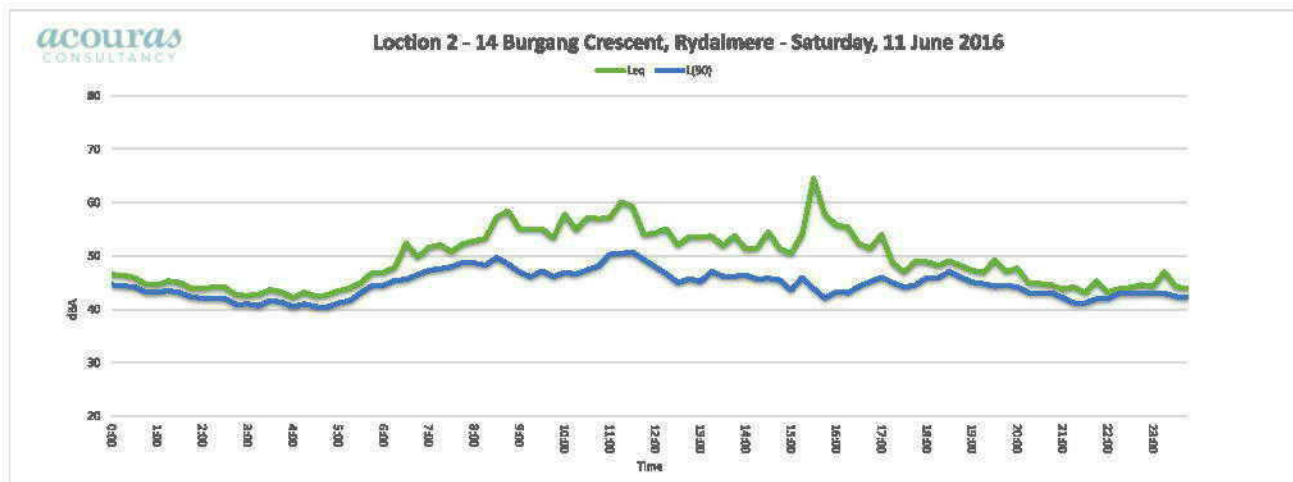


STRONG PROPERTY DEVELOPMENT

SOUTH STREET AND BURBANG CRESCENT, RYDALMERE - ACOUSTIC DA ASSESSMENT

SYD2016-1058-R001A

20/06/2016

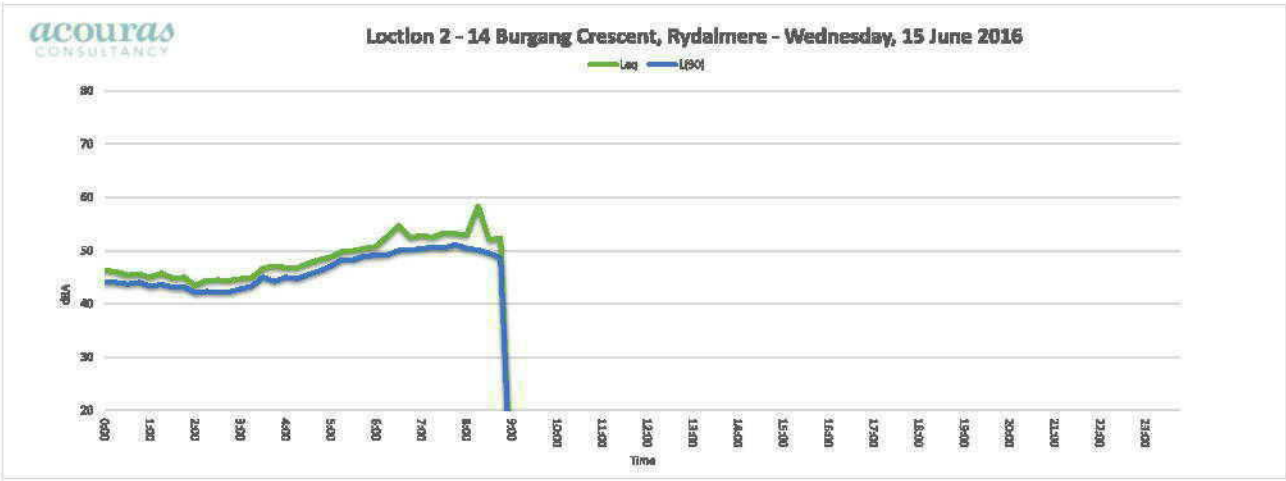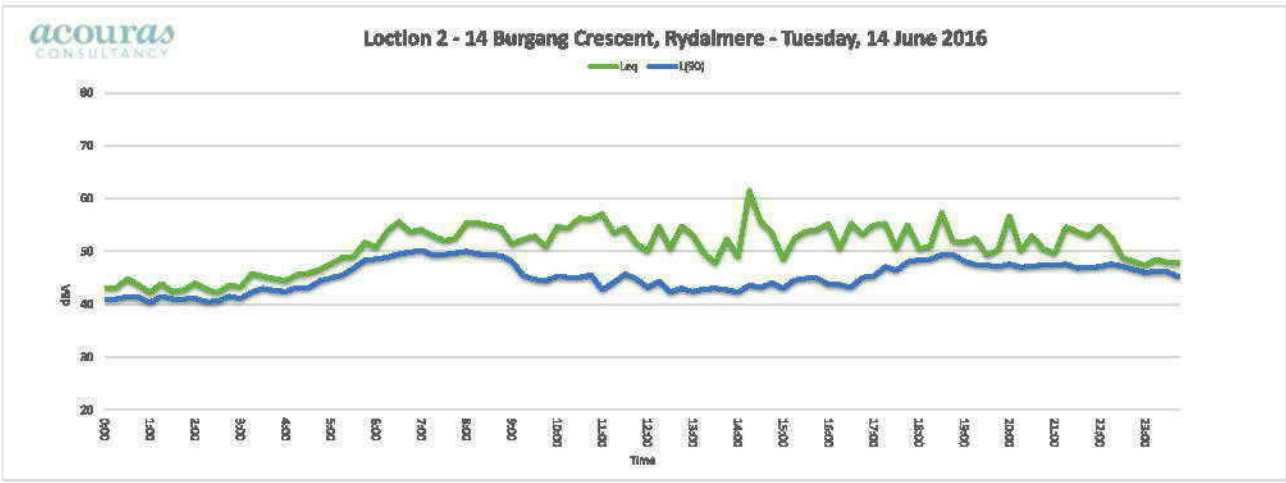





C1 ROOF FASCIA & GUTTER FINISH  
COLORBOND Citi



P1 PAINT FINISH 1  
Dulux Simone Weil PG1A4



P2 PAINT FINISH 2  
Dulux Oolong PG2G8



P3 PAINT FINISH 3  
Dulux Thomas Tallis PW1B9



P4 PAINT FINISH 4  
Dulux Ducal PO5E8



P5 PAINT FINISH 5  
Dulux Orangeade PO8F8



PC1 Dulux Powdercoat  
Citi Pearl 88471



PC2 Metalart Powdercoat  
Timeless Timber - Bush Cherry



STS1 Decor Stacked Stone Russet



## Schedule of Finishes: Proposed Residential Units (Block B - Burbang Crescent)

14-16 Burbang Crescent & 47-49 South Street, Rydalmere

**architex**

architects and planners



C1 ROOF FASCIA & GUTTER FINISH  
COLORBOND Citi



P1 PAINT FINISH 1  
Dulux Simone Weil PG1A4



P2 PAINT FINISH 2  
Dulux Oolong PG2G8



P3 PAINT FINISH 3  
Dulux Thomas Tallis PW1B9



P4 PAINT FINISH 4  
Dulux Ducal PO5E8



P5 PAINT FINISH 5  
Dulux Orangeade PO8F8



PC1 Dulux Powdercoat  
Citi Pearl 88471



PC2 Metalart Powdercoat  
Timeless Timber - Bush Cherry



STS1 Decor Stacked Stone Russet



## Schedule of Finishes: Proposed Residential Units (Block A - South Street)

14-16 Burbang Crescent & 47-49 South Street, Rydalmere

**architex**

architects and planners