

'Section J REPORT

Building Code of Australia
'Deemed-To-Satisfy' Compliance
Section J Report

Proposed Mixed Use Development
Comprising Retail Suites and a
Boarding House

At:
77-79 Waldron Road
CHESTER HILL

Prepared for
Brandon Zhu

July, 2017

Prepared by

MAX BRIGHTWELL

Authors:

Bob Jones	Qualified Building Surveyor
Max Brightwell	Accredited ABSA Assessor

TABLE OF CONTENTS

1	EXECUTIVE SUMMARY	5
2	PURPOSE OF REPORT	5
3	PROPERTY	5
4	BASIS OF ASSESSMENT	5
5	ASSESSMENT	5
5.1	Building Class & Climate Zone	5
5.2	Definitions Pursuant to Part A1 of the BCA	6
5.3	Description of Development	6
6	PART J1 – BUILDING FABRIC FOR CONDITIONED AREAS	7
6.1	J1.2 Thermal Construction General	7
6.2	Subclause J1.2 (a) - Integrity of the Insulation	7
6.3	Subclause J1.2 (b) - Reflective Insulation	8
6.4	Subclause J1.2 (c) - Bulk Insulation	8
6.5	Specification J1.2	9
6.6	Roof & Ceiling Construction part J1.3	10
6.6.1	Application of Part J1.3	10
6.6.2	Assessment of Construction (Roof & Ceiling)	10
6.6.3	Opinion	10
6.6.4	Roof and Ceiling Construction – To The Front Part of Each Retail Ceiling Under the 1 st Floor Landscape Area & the Level 3 Ceiling	10
6.6.5	Compliance for Roof and Ceiling (To The Front Part of Each Retail Ceiling Under the 1 st Floor Landscape Area & the Level 3 Ceiling)	10
6.7	Roof Lights J1.4	11
6.8	Walls Part J1.5	11
6.8.1	Application	11
6.8.2	Assessment for Construction for External and Internal Walls to the Conditioned Areas	11
6.8.3	Opinion	11
6.8.4	Wall Description – Spec. J1.5 (External Concrete A.F.S. Walls to Conditioned Areas	12
6.8.5	Compliance for External Concrete A.F.S. Walls To Conditioned Areas	12
6.8.6	Wall Description – Spec. J1.5 (Internal A.F.S. Walls Separating the Conditioned Areas From the Non-Conditioned Areas at Ground Level)	12
6.8.7	Compliance for Internal Stud Walls Separating Conditioned Areas From Non-Conditioned Areas at Ground Level	12
6.9	Floors Part J1.6	13
6.9.1	Application	13
6.9.2	Assessment for Construction For Floors	13
6.9.3	Opinion	13

6.9.4	Floor Description – Spec. J1.6 (Concrete Floor to the Entire Floor of Level 1 Except that Part Above the 2 Retail Suites, the Communal Room and the Building Manager’s Suite)	13
6.9.5	Compliance for Concrete Floor to the Entire Floor of Level 1 Except that Part Above the 2 Retail Suites, the Communal Room and the Building Manager’s Suite	13
7	EXTERNAL GLAZING PART J2.0	14
7.1	External Glazing	14
7.1.1	Application.....	14
7.1.2	Assessment of Construction.....	14
7.1.3	Opinion	14
7.1.4	Compliance	14
8	BUILDING SEALING PART J3.0	15
8.1	Building Sealing.....	15
8.1.1	Application of Part J3.1	15
8.1.2	Assessment of Construction [Building Sealing]	15
8.1.3	Opinion and Compliance	15
9	AIR MOVEMENT PART J4.....	16
10	AIR-CONDITIONING AND VENTILATION SYSTEM – PART J5	17
10.1	J5.2 Air-Conditioning Systems.....	17
11	ARTIFICIAL LIGHTING & POWER – PART J6	19
11.1	Artificial Lighting & Power.....	19
11.1.1	J6.2 Artificial Lighting.....	19
11.1.2	J6.3 Interior Artificial Lighting & Power Control	19
11.1.3	J6.5	19
11.1.4	Specification J6.3 – Time Switch	20
11.1.5	Specification J6.4 – Motion Detectors.....	20
11.1.6	Specification J6.5 - Daylight sensor and dynamic lighting control device	20
12	HEATED WATER SUPPLY – PART J7.....	22
13	FACILITIES FOR ENERGY MONITORING - PART J8	22
13.1	Facilities for Energy Monitoring – J8.3	22
13.1.1	J8.3(a).....	22
13.1.2	J8.3(b)	22
14	CONCLUSION.....	23
15	ANNEXURE 1 – Window Schedule	25
16	ANNEXURE 2 - Power Density for Specific Areas	32

1 EXECUTIVE SUMMARY

This Report has been prepared by suitably qualified and experienced personnel and shows compliance with the Building Code of Australia (BCA) Volume 1, 'Deemed to Satisfy' (DTS) Provisions for Section J.

The Report further describes and refers to parts of the BCA which leads to the conclusion that the subject building if constructed with the recommendations contained in this report will meet the DTS Provisions of Section J of the BCA.

2 PURPOSE OF REPORT

The purpose of this report is to:

- A. Complete a DTS compliance assessment in reference to Section J of the BCA in respect of the subject building.
- B. Advise of any areas of non-compliance of the building in respect to the DTS provisions of Section J of the BCA.
- C. Provide a Report covering compliance of the building with the relevant provisions of the BCA in respect to the DTS provisions contained in Section J.

3 PROPERTY

The premises, the subject to this Report is known as 77-79 Waldron Road, Chester Hill.

4 BASIS OF ASSESSMENT

The assessment has been carried out using:

- A. Drawing Nos: DA04 to 06, 0.8 to 10 Rev.A, dated 28th August, 2017 drawn by P.T.I. Architecture P/L.
- B. The Building Code of Australia 2017 and the NSW Appendices where applicable.

The referenced plans indicate that the Conditioned spaces are the two (2) retail suites, communal room & WC as well as the Building Manager's suite at ground level and all of levels 1, 2 & 3, with the exception of the balconies.

NOTE: Mechanical air conditioning systems are proposed to be installed on the north-facing and south-facing apartments on site, and the condensers are proposed to be placed on the balconies. Ceiling fans are proposed to be installed for the West-facing and East-facing apartments.

5 ASSESSMENT

5.1 Building Class & Climate Zone

The proposed building has a Class 3 & 6 classification as determined by Part A3 of the BCA.

The climate zone designated in Table A1.1 of the BCA is climate Zone 6.

5.2 Definitions Pursuant to Part A1 of the BCA

'*Conditioned Space*' means a space within a building including a ceiling or under floor supply air plenum or return air plenum where the environment is likely by the intended use of the space to have its temperature controlled by air-conditioning.

'Envelope' means the parts of a building's fabric that separate a conditioned space or habitable room from

- a) The exterior of the building, or
- b) A Non-conditioned space including:
 - (i) The floor of a rooftop plant room, lift machine room or the like, and
 - (ii) The floor above a carpark or warehouse, and
 - (iii) The common wall with a carpark, warehouse or the like.

5.3 Description of Development

The proposed development involves the construction of a four (4) storey mixed use development comprising two (2) retail suites, a communal room and WC, Building Manager's suite and undercover parking at ground level with three (3) levels of boarding house suites above.

The materials of construction are concrete A.F.S. walls for the external walls while the floors and roof will be concrete.

6 PART J1 – BUILDING FABRIC FOR CONDITIONED AREAS

6.1 J1.2 Thermal Construction General

This clause contains a broad range of general requirements that apply to the building fabric. An important aspect of J1.2 is the testing needed to ensure the validity of the insulation products. Information received by the ABCB indicates that some insulation products may not have been tested in accordance with AS/NZS 4859.1 and the stated insulation levels on some manufacturer's literature may not be achievable. In most jurisdictions, the approval of insulation performance ultimately resides with the Building Control Authority, and this discretionary power should be exercised with care.

In order to ensure the performance of materials is correctly validated, test reports complying with the appropriate standard should be provided in accordance with part A2 of the BCA and this documentation forms an integral part of the building approval.

The 2002 edition of AS/NZS 4859.1 did not contain standard assumptions for calculating the R-Value benefit of reflective insulation so suppliers may use different criteria. For example, the assumption may be that the surface is free of dust while in practice it may be used in a dusty environment under a tiled roof. In the absence of a standard set of assumptions, the Building Control Authority may need to review each certificate for relevance to the application.

6.2 Subclause J1.2 (a) - Integrity of the Insulation

Subclause J1.2 (a) requires any insulation, when installed in a building, to form a consistent and continuous barrier with ceilings, walls bulkheads and floors. This is important as any gaps within the barrier will allow heat in or out, which will undermine the effectiveness of the overall energy efficiency measures.

However, it is recognised that certain gaps are essential, especially adjoining services and light fittings where the close proximity of insulation may create a fire hazard.

A key aspect of this Clause is the recognition that certain structural elements of the building (e.g. framing) contribute to achieving the required levels of thermal efficiency. For this reason, it is acceptable that wall insulation closely fit within a wall frame to achieve the desired overall level of performance for the wall. The wall elements, in conjunction with the insulation, are deemed to achieve the required level of performance.

Another part of this Clause worth noting is the reference to AS/NZS 4859.1. This Standard specifies the testing criteria for insulation including both reflective and bulk insulation. In broad terms, the Standard requires the manufacturer to provide a data sheet, which explains the thermal performance and the installation requirements of the product.

The manufacturer's data sheet should be utilised by both building designers and building surveyors as documentary evidence of the performance of the insulation and may be required to form part of the building approval documentation.

6.3 Subclause J1.2 (b) - Reflective Insulation

Insulating performance is achieved by the ability of the reflective insulation to "reflect" heat at one surface and not transmit it at another, combined with the insulating qualities of the thin air films adjacent to the reflective insulation. Some reflective insulation is also bonded to bulk or board insulation providing enhanced performance.

Accordingly, the reflectivity value and the presence of an airspace are critical, because without this airspace the reflection will not occur.

The other issue to consider is that generally, reflective insulation has a dull or anti-glare (painted side) and a shiny silver side. Both sides will achieve a degree of reflectivity. However, the shiny side is the most effective.

From an Occupational Health and Safety point of view, the dull coloured side is installed facing outwards to prevent eye injury, which could occur if the high reflectivity from the silver side was on the outside.

Note that reflective insulation has an overlap requirement of 50 mm. This is different to the Standard AS 4120 (the standard for the installation of wall wraps) requirements. Standard AS 4120 addresses wall sarking, and requires the achievement of a certain degree of water proofing. However, reflective insulation under Section J of the BCA is not installed -for waterproofing and only requires a small overlap to maintain a reflective capacity.

6.4 Subclause J1.2 (c) - Bulk Insulation

Subclause J1.2 (c) provides a list of requirements for bulk insulation. The term, bulk insulation, includes glass fibre, wool, cellulose fibre, polyester and polystyrene. These materials tend to have a high percentage of air voids that retard heat movement.

The thermal performance of bulk insulation is dependent on the material retaining the depth specified by the manufacturer, in accordance with the required test results. The depth of the insulation is critical because the air pockets within the material trap and retard heat flow. If the insulation is compressed it will lose some of these air pockets as the fibre contact increases, which in turn, will reduce its capacity to achieve the design R-Value.

Design alert: Insulation materials used in a Class 2 to 9 building must also comply with Clause C1.10 of the BCA for fire hazard properties. This may require the insulation used in these building to be of negligible fire hazard by complying with the non-combustibility, flammability, spread of flame and smoke development requirements of the Clause. The performance of the insulation used should be validated by test reports and these reports should form part of the building approval documentation.

6.5 Specification J1.2

This specification provides a list of common construction materials and their associated thermal performance. The values have been developed after extensive consultation with industry experts and reflect agreed values based on the latest scientific test information.

Other values for materials may be acceptable. However, these should be validated by supporting information as prescribed in A2.2. In other instances, references from reputable engineering texts such as those published by ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers) and AIRAH (Australian Institute of Refrigeration, Air-Conditioning and Heating) would also be reliable and suitable as evidence for compliance with the BCA.

6.6 **Roof & Ceiling Construction part J1.3**

6.6.1 **Application of Part J1.3**

Clause J1.3 specifies that for a roof and ceiling that is part of the envelope, must achieve the Total R-Value specified in Table J1.3 for the direction of heat flow.

Table J1.3(a) states that for climate Zone 6, insulation generally, must achieve a minimum Total R-Value of R3.2 for a roof and ceiling notwithstanding the roof upper surface solar absorptance value of the roof.

The direction of heat flow indicated in the BCA is downward.

6.6.2 **Assessment of Construction (Roof & Ceiling)**

Drawings indicate that the front part of each retail tenancy ceiling under the landscape gardens and the entire Level 3 ceiling require compliance with J1.3. In each case the ceiling is a concrete slab and will require insulation to comply with J1.3.

No downlights are shown on plan.

6.6.3 **Opinion**

Table J1.3(a) shows DTS options for roof and ceiling construction under the provisions of the BCA. Compliance with the requirements of J1.3 (a), is obtained by materials complying with relevant standards as noted in Specification J1.3 as well as methods used during construction and installation.

6.6.4 **Roof and Ceiling Construction – To The Front Part of Each Retail Ceiling Under the 1st Floor Landscape Area & the Level 3 Ceiling**

Roof construction description:	Item	Item description	R- Value
	1	Outdoor air film (7m/s)	0.04
	2	Concrete slab	0.14
	3	Roof air space (100 mm to 300 mm, non-reflective)	0.22
	4	Plasterboard, gypsum (10 mm, 880 kg/m ³)	0.06
	5	Indoor air film (still air)	0.16
Total R- Value			0.62

6.6.5 **Compliance for Roof and Ceiling (To The Front Part of Each Retail Ceiling Under the 1st Floor Landscape Area & the Level 3 Ceiling)**

Insulation of minimum R2.58 within the ceiling void of the above areas will allow compliance with Part J1.3.

6.7 Roof Lights J1.4

No roof lights are shown within the conditioned areas on the Architectural plans.

J1.4 is not applicable to this development.

6.8 Walls Part J1.5

6.8.1 Application

The construction of walls that are part of the envelope is a major contributing factor in the overall thermal performance of the building.

Each part of an external wall that is part of the envelope must satisfy one of the requirements outlined in Table J1.5(a) except opaque non-glazed openings in external walls such as doors, vents, penetrations, shutters or glazing..

Table J1.5(a) for external walls require a total R-Value of R2.8 however, Table J1.5(a) allows the Total R-value of the external wall to be reduced in the following circumstances:

- (i) For a wall with a surface density of not less than 220kg/m² by R0.5.
- (ii) For a wall that has a south orientation as described in figure J2.3 by R0.5, or
- (iii) Shaded with a projection shade angle in accordance with Figure J1.5 of:
 - (a) 30° to not more than 60° by R0.5, or
 - (b) more than 60° by R1.0.

The internal walls at the ground floor level require an R-Value of R1.8 as required by Table J1.5(b)(b).

6.8.2 Assessment for Construction for External and Internal Walls to the Conditioned Areas


The external walls to the conditioned areas are concrete A.F.S. walls while the internal walls separating the conditioned areas from the non-conditioned areas at ground level will also be 190mm A.F.S. walls. The external and internal walls on their own will not achieve the required R-Value and will require insulation while the concrete external walls qualify for a reduction due to density and both the external and internal walls qualify for a reduction as per Spec. J1.5.

6.8.3 Opinion

Table J1.5(a) and Table J1.5(b) shows DTS options for external and internal wall construction under the provisions of the BCA.

Compliance with Table J1.5(a) and Table J1.5(b) for climate Zone 6 is obtained by materials complying with relevant standards as noted in Specification J1.5 as well as methods used during construction and installation.


6.8.4 **Wall Description – Spec. J1.5 (External Concrete A.F.S. Walls to Conditioned Areas)**

External wall construction description	Item	Item Description	R-Value
	1	Outdoor air film (7m/s)	0.04
	2	Concrete A.F.S. 190mm Walls	0.13
	3	Airspace (nonreflective and unventilated)	0.17
	4	Plasterboard, gypsum (10mm, 880 kg/m ³)	0.06
	5	Indoor air film (still air)	0.12
Total R-Value			0.52

6.8.5 **Compliance for External Concrete A.F.S. Walls To Conditioned Areas**

Allowing for a R0.52 reduction for Spec. J1.5 and a R0.5 reduction for density, insulation within the A.F.S. walls surrounding the conditioned areas of minimum R1.78 will allow compliance with J1.5.

6.8.6 **Wall Description – Spec. J1.5 (Internal A.F.S. Walls Separating the Conditioned Areas From the Non-Conditioned Areas at Ground Level)**

Internal wall construction description	Item	Item Description	R-Value
	1	Indoor air film (7m/s)	0.12
	2	Concrete A.F.S. 190mm Walls	0.13
	3	Airspace (nonreflective and unventilated)	0.17
	4	Plasterboard, gypsum (10mm, 880 kg/m ³)	0.06
	5	Indoor air film (still air)	0.12
Total R-Value			0.60

NOTE: Indoor air film replaces outdoor air film.

6.8.7 **Compliance for Internal Stud Walls Separating Conditioned Areas From Non-Conditioned Areas at Ground Level**

Allowing for a R0.60 reduction for Spec. J1.5, the internal walls separating the conditioned areas from the non-conditioned areas require insulation of minimum R1.20 to comply with Part J1.5.

6.9 Floors Part J1.6

6.9.1 Application

A floor that is part of the envelope of a building including a floor above or below a carpark must achieve the total R-Value specified in J1.6.

In Climate Zone 6 the total R-Value of Table J1.6 may be reduced by R0.5 provided R0.75 is added to the total R-Value required for the ceiling.

Table J1.6(a) allows a slab on ground to have a NIL rating.

Table J1.6(b) requires a suspended floor slab without an in-slab heating or cooling system where the non-conditioned space is enclosed and where mechanically ventilated by not more than 1.5 air changes/hour to have an R-Value of R1.0 however if it cannot meet (b) above J1.6(d) requires the floor to have an R-Value of R2.0.

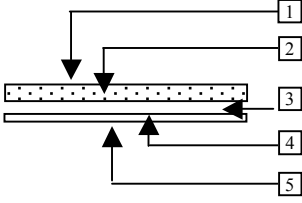
6.9.2 Assessment for Construction For Floors

Drawings indicate that all of the floors of Level 1 except that part of the floor above the 2 retail suites, the communal room and the Building Manager's suite require an R-Value of R2.0 in accordance with J1.6(d).

6.9.3 Opinion

Compliance with Table J1.6(d) for Climate Zone 6 is obtained by materials complying with the relevant standards as noted in Spec. J1.6 as well as methods used during construction and installation.

6.9.4 Floor Description – Spec. J1.6 (Concrete Floor to the Entire Floor of Level 1 Except that Part Above the 2 Retail Suites, the Communal Room and the Building Manager's Suite)

Floor Construction description	Item	Item Description	R-Value Unventilated
	1	Indoor air film	0.16
	2	Solid concrete	0.18
	3	Air Gap	0.22
	4	Villaboard or similar	0.03
	5	outdoor air fill	0.04
		Total R- Value	0.63

6.9.5 Compliance for Concrete Floor to the Entire Floor of Level 1 Except that Part Above the 2 Retail Suites, the Communal Room and the Building Manager's Suite

The concrete floor mentioned above receives an R0.63 reduction.

Insulation of minimum R1.37 to the floor void of the areas mentioned above will allow compliance with J1.6.

7 EXTERNAL GLAZING PART J2.0

7.1 External Glazing

7.1.1 Application

The DTS Provisions of the BCA are covered in J2.1 which applies to elements forming the envelope of a building.

7.1.2 Assessment of Construction

J2.4 Glazing – Method 2 states that glazing must be assessed separately for each storey and for each orientation of the subject building.

Assessment (Method 2 – DTS) is facilitated under the BCA to determine compliance with DTS using the BCA 'Glazing Calculator' developed by the Australian Building codes Board (ABCB) and provided on the ABCB website. This is the form of a Microsoft Excel spreadsheet.

7.1.3 Opinion

A Glazing system that achieves the minimum specifications as outlined in Annexure 1 of this Report will achieve compliance.

These generic window values for the total U-Value and Solar Heat Gain Co-efficient (SHGC) are from the National Fenestration Rating Council (NFRC) and can be supplied by most window manufacturers in Australia.

7.1.4 Compliance

The glazing for the conditioned areas will comply with Part J2.0 of the BCA if it meets the total U-Value and SHGC figures as depicted in Annexure 1.

8 BUILDING SEALING PART J3.0

8.1 Building Sealing

8.1.1 Application of Part J3.1

The DTS Provisions of the BCA are covered in J3.1 and apply to elements forming the envelope of a Class 2 to 9 building, other than:

- a) a building in climate zones 1, 2, 3 and 5 where the only means of air-conditioning is by using an evaporative cooler; or
- b) a permanent building ventilation opening, in a space where a gas appliance is located, that is necessary for the safe operation of a gas appliance; or
- c) a building or space where the mechanical ventilation required by Part F4 provides sufficient pressurization to prevent infiltration.

8.1.2 Assessment of Construction [Building Sealing]

The proposed development is located in Climate Zone 6 as per table A1.1 '*Climate Zones for Thermal Design*' and is required to comply with Part J3.0.

8.1.3 Opinion and Compliance

The building is required to comply with the provisions of the BCA J3.0 for parts J3.2, J3.4, J3.5, J3.6 and J3.7 inclusive,

- J3.2 No chimneys or flues to conditioned spaces are indicated on the referenced drawing set for the new work, therefore compliance is not required for the subject building.
- J3.4(a) A seal to restrict air infiltration must be fitted to each edge of a door, openable window or the like forming part of the envelope of a conditioned space.
- J3.4(b) These requirements do not apply to a window complying with AS.2047, or a fire or smoke door or a roller shutter door, roller shutter grille or other security door or device installed only for out of hours security.
- J3.4(c) A seal required by (a) above for the bottom edge of an external swing door must be a draft protection device and for the other edges of an external door or the edges of an openable window the seal may be a foam or rubber compression strip, fibrous seal or the like.
- J3.4(d) The main entry door to each retail suite shall be a self-closing door.
- J3.5 A miscellaneous exhaust fan such as a bathroom exhaust fan must be fitted with a sealing device such as a self-closing damper or the like when serving a conditioned space.

- J3.6 Roofs, walls, floors and any opening such as a window, door or the like within the conditioned areas must be constructed to minimize air-leakage when forming part of the envelope of the external fabric of a conditioned space.
- Construction as required by J3.6 must be either by enclosure of internal lining systems that are close fitting at ceiling, wall and floor junctions or sealed by caulking skirting, architraves, cornices or the like.
- J3.7 An evaporative cooler must be fitted with a self-closing damper or the like when serving a heated space or an habitable room in a public area of a building.

9 AIR MOVEMENT PART J4

Part J4 is not applicable to this building.

10 AIR-CONDITIONING AND VENTILATION SYSTEM – PART J5

10.1 J5.2 Air-Conditioning Systems

(a) **Control:**

- (i) An air-conditioning system
 - (A) must be capable of being deactivated when the building or part of a building served by that system is not occupied; and
 - (B) when serving more than one air-conditioning zone or area with different heating or cooling needs, must:
 - (aa) thermostatically control the temperature of each zone or area; and
 - (bb) not control the temperature by mixing actively heated air and actively cooled air; and
 - (cc) limit reheating to not more than:
 - (AA) for a fixed supply air rate, a 7.5 K rise in temperature; and
 - (BB) for a variable supply air rate, a 7.5 K rise in temperature at the nominal supply air rate but increased or decreased at the same rate that the supply air rate is respectively decreased or increased; and
 - (C) which provides the required mechanical ventilation, other than in process- related applications where humidity control is needed, must have an outdoor air economy cycle:
 - (aa) in Climate Zones 2 or 3, when the air-conditioning system capacity is more than 50 kW_r; or
 - (bb) in Climate Zones 4, 5, 6, 7 or 8, when the air-conditioning system capacity is more than 35 kW_r; and
 - (D) which contains more than one water heater, chiller or coil, must be capable of stopping the flow of water to those not operating; and
 - (E) except for a packaged air-conditioning system, must have a variable speed fan when its supply air quantity is capable of being varied; and
 - (F) when serving a sole occupancy unit in a Class 3 building, must not operate when any external door of the sole occupancy unit that opens to a balcony or the like, is open for more than one minute.
- (ii) When an air-conditioning system is deactivated, any motorised outside air and return dampers must close.
- (iii) Compliance with (i) must not adversely affect
 - (A) smoke hazard management measures required by Part E2, and
 - (B) ventilation required by Part E3 and Part F14.

(b) **Fans** Fans of an air-conditioning system must comply with Specification J5.2a.

(c) **Pumps**

- (i) An air-conditioning system, where water is circulated by pumping at more than 2 L/s, must be designed so that the maximum pump power to the pump complies with Table J5.2.
- (ii) An air-conditioning system pump that is rated at more than 3 kW of pump power and circulates water at more than 2 L/s must be capable of varying its speed in response to varying load.
- (iii) A spray water pump of an air-conditioning system's closed circuit cooler or evaporative condenser must not use more than 150 W of pump power for each L/s of spray water circulated.

Table J5.2 MAXIMUM PUMP POWER

Cooling or heating load (W/m ² of the floor area of the conditioned space)	Maximum pump power (W/m ² of the floor area of the conditioned space)		
	Chilled water	Condenser water	Heating water
Up to 100	1.3	0.9	1.0
101 to 150	1.9	1.2	1.3
151 to 200	2.2	2.2	1.7
201 to 300	4.3	3.0	2.5
301 to 400	5.0	3.6	3.2
More than 400	5.6	5.6	3.6
Note: Values do not include any motor losses.			

- (d) **Insulation**
- (i) The ductwork of an air-conditioning system must be insulated and sealed in accordance with Specification J5.2b.
 - (ii) Piping, vessels, heat exchangers and tanks containing heating or cooling fluid that are part of an air-conditioning system, other than those with insulation levels covered by MEPS, must be insulated in accordance with Specification J5.2c.
- (e) **Space heating** - A heater used for air-conditioning or as part of an air-conditioning system must comply with Specification J5.2d.
- (f) **Energy efficiency ratios**
- (i) Refrigerant chillers used as part of an air-conditioning system; and
 - (ii) Packaged air-conditioning equipment, must comply with Specification J5.2e.
- (g) **Time switches**
- (i) A time switch complying with Specification J6 must be provided to control
 - (A) an air-conditioning system of more than 10 kW; and
 - (B) a heater of more than 10 kW heating used for air-conditioning
 - (ii) The requirements of (i) do not apply to:
 - (A) an air-conditioning system that serves
 - (aa) only one sole occupancy unit in a Class 2 or 3 building; or
 - (bb) Class 4 part of a building; or
 - (cc) only one sole occupancy unit in a Class 9c building; or
 - (B) a building where air-conditioning is needed for 24 hour occupancy.

11 ARTIFICIAL LIGHTING & POWER – PART J6

11.1 Artificial Lighting & Power

11.1.1 J6.2 Artificial Lighting

In a Class 3 building, for artificial lighting, the aggregate design illumination power load must not exceed the sum of the allowances obtained by multiplying the area of each space by the illumination power density in Table J6.2(a) and the aggregate design illumination power load is the sum of the design illumination power loads in each of the spaces served. (See Annexure 2 for Table J6.2(a) showing the max. illumination power density requirement for the different areas).

In determining the design illumination power load the following must be used:

- (i) Where there are multiple lighting systems serving the same space;
 - A. the total illumination power load of all systems; or
 - B. for a control system that permits only one system to operate at a time, the design illumination power load is;
 - a. based on the highest illumination power load; or
 - b. determined by the formula:
$$[H \times T/2 + P \times (100 - T/2)] / 100$$
Where:
 - H = the highest illumination power load; and
 - T = the time for which the maximum illumination power load will occur, expressed as a percentage; and
 - P = the predominant illumination power load.
- (ii) The requirements above do not apply to emergency lighting or lighting of a specialist process nature such as in an operating theatre, fume cupboard or clean workstation.

11.1.2 J6.3 Interior Artificial Lighting & Power Control

- (i) Artificial lighting of a room or space must be individually operated by a switch or other control device.
- (ii) An artificial lighting switch or other control device in (i) above must:
 - A. If an artificial lighting switch, be located in a visible position;
 - a. In the room or space being switched; or
 - b. In an adjacent room or space from where the lighting being switched is visible.

The requirements of (i) and (ii) above do not apply to Emergency lighting in accordance with Part E4.

11.1.3 J6.5

Artificial lighting around the perimeter of a building must be

- (i) Controlled by either a daylight sensor or a time switch that is capable of switching on and off electric power to the system at variable pre-programmed times and on variable pre-programmed days, and
- (ii) when the total perimeter lighting load exceeds 100w.
 - A. have an average light source efficacy of not less than 60 lumens/w, or
 - B. be controlled by a motion detector in accordance with Spec J6, and
 - C. when used for decorative purposes such as façade lighting or signage lighting have a separate time switch in accordance with Spec. J6.
- (iii) The requirements of (ii)(A) and (B) do not apply to Emergency lighting in accordance with Part E4.

11.1.4 Specification J6.3 – Time Switch

A time switch must be capable of:-

- (i) Switching on and off electric power to systems:
 - A. at variable pre-programmed times and on variable pre-programmed days, and
 - B. limiting the period the system is switching on to 2 hours beyond the time for which the building is occupied; and
- (ii) Being overridden by a manual switch for a period of up to 2 hours, after which the time switch must resume control.

11.1.5 Specification J6.4 – Motion Detectors

In a Class 5, 6, 7, 8, 9a or 9b building, a motion detector must:-

- (i) Be capable of sensing movement such as by infra-red, ultrasonic or microwave detection or by a combination of these means; and
- (ii) Be capable of detecting a person before they have entered 1 m into the space, and movement of 500mm within the useable part of the space; and
- (iii) Not control more than, in other than a carpark, an area of 500m² with a single sensor or group of parallel sensors and 75% of the lights in spaces using high intensity discharge; and
- (iv) Be capable of maintaining the artificial lighting when activated for a minimum of 5 minutes and a maximum of 30 minutes unless it is reset, and without interruption if the motion detector is reset by movement; and
- (v) Have a manual override switch which enable the lighting to that area, or a greater area, to be turned off, and is not capable of switching the lights permanently on.

11.1.6 Specification J6.5 - Daylight sensor and dynamic lighting control device

A daylight sensor and dynamic lighting control device for artificial lighting must -

- (i) For switching on and off:-
 - A. Be capable of having the switching level set point adjusted between 50 and 1000 lux; and
 - B. Have a delay of more than 2 minutes and a differential of more than 100 lux for a sensor controlling high pressure discharge lighting and 50 lux for a sensor controlling other than high pressure discharge lighting.

Have a manual override switch which enables the lighting in an area to be turned off but is not able to switch the lights permanently on or bypass the lighting controls

12 HEATED WATER SUPPLY – PART J7

Any heated water supply for food preparation and sanitary purposes must be designed and installed in accordance with Part B2 of NCC Volume 3 – Plumbing Code of Australia.

13 FACILITIES FOR ENERGY MONITORING - PART J8

13.1 Facilities for Energy Monitoring – J8.3

13.1.1 J8.3(a)

The building must have the facility to record the consumption of gas and electricity.

13.1.2 J8.3(b)

As the building is less than 2500sq metres in area J8.3 is not applicable.

14 **CONCLUSION**

This report provides an assessment of the Deemed-To-Satisfy requirements of Section J of the Building Code of Australia.

Should the recommendations contained in this report be adopted into the building during construction, the development will comply with the Deemed-To-Satisfy requirements of Section J.

NOTE: Summary of Recommendations

1. J1.2(a) Any insulation must be installed so that it abuts or overlaps adjoining insulation, forms a continuous barrier with ceilings, walls, bulkheads, floors or the like and does not affect the safe or effective operation of a service or fitting.
2. J1.2(b) Reflective insulation must be installed to achieve the required R-Value between a reflective side of the reflective insulation and a building lining or cladding. It must be closely fitted against any penetration, door or window opening, adequately supported and overlapped not less than 50mm or taped together.
3. J1.2(c) Bulk insulation must be installed so that it maintains its position and thickness and in a ceiling where there is no bulk or reflective insulation in the wall beneath, it overlaps the wall by not less than 50mm.
4. Provide a minimum R2.58 insulation to the ceilings of the front part of each retail suite under the 1st floor landscape area and all of Level 3.
5. Provide insulation of minimum R1.78 to all external concrete A.F.S. walls to the conditioned areas.
6. Provide insulation of minimum R1.20 to all internal A.F.S. walls separating the conditioned areas from the non-conditioned areas at ground level.
7. Provide insulation of minimum R1.37 to the floor of the entire Level 1 floor except that part above the 2 retail suites, the communal room and the Building Manager's Suite.
8. Provide glazing to all windows and glass doors of the conditioned areas that have the U-Value and SHGC values as nominated in Annexure 1 of this report.
9. Provide seals to any openable windows and doors within the conditioned areas as mentioned in 8.1.3 of this report.
10. The main entry door to each ground floor retail suite shall be a self-closing door and if not a fire door shall have a draft protection device attached to the underside of the door.
11. Any miscellaneous exhaust fan such as a bathroom exhaust fan must be fitted with a sealing device such as a self-closing damper or the like when serving a conditioned area.
12. Any evaporative cooler must be fitted with a self-closing damper or the like when serving a heated space or an habitable room or a public area of the conditioned areas.
13. All internal linings to the conditioned areas shall be close fitting at the junction of ceiling wall and floors or sealed by caulking skirting, architraves cornices or the like.

14. Any air-conditioning system to the conditioned areas must comply with the requirements outlined in Heading 10.0.
15. Lighting and Power to the building shall comply with the requirements outlined in Heading 11 and Annexure 2.
16. Any heated water supply for food preparation and sanitary purposes must be designed and installed in accordance with Part B2 of NCC Volume 3 – Plumbing Code of Australia.
17. The building must have the facility to record the consumption of gas and electricity.



MAX BRIGHTWELL

15 ANNEXURE 1 – Window Schedule

Ground Floor

printed 24/07/2017

Report from Waldron Rd - 77-79

NCC VOLUME ONE GLAZING CALCULATOR (first issued with NCC 2014)

Building name/description

77-79 Waldron Rd, Chester Hill NSW.

Application

other

Climate zone

6

Storey

G

Facade areas

	N	NE	E	SE	S	SW	W	NW	Internal
Option A	66m ²	10m ²	13.5m ²				60m ²	10m ²	
Option B									n/a
Glazing area (A)	27.1m ²	4.37m ²	7.34m ²				7.34m ²	4.37m ²	

Number of rows preferred in table below

14 (as currently displayed)

GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE and PERFORMANCE CHARACTERISTICS									
Glazing element		Facing sector			Size			Performance	
ID	Description (optional)	Option A facades	Option B facades		Height (m)	Width (m)	Area (m ²)	Total System U-Value (AFRC)	Total System SHGC (AFRC)
1	Retail	N			2.40	4.73		7.0	0.44
2	Retail	N			2.40	0.91		7.0	0.44
3	Retail	NE			2.40	0.91		7.0	0.50
4	Retail	NE			2.40	0.91		7.0	0.50
5	WG02	E			2.40	1.06		2.9	0.20
6	DG01	E			2.40	1.00		2.9	0.20
7	WG03	E			2.40	1.00		2.9	0.20
8	WG04	W			2.40	1.00		7.0	0.70
9	DG02	W			2.40	1.00		7.0	0.70
10	WG05	W			2.40	1.06		7.0	0.70
11	Retail	NW			2.40	0.91		4.4	0.40
12	Retail	NW			2.40	0.91		4.4	0.40
13	Retail	N			2.40	0.91		7.0	0.44
14	Retail	N			2.40	4.73		7.0	0.44

IMPORTANT NOTICE AND DISCLAIMER IN RESPECT OF THE GLAZING CALCULATOR

The Glazing Calculator has been developed by the ABCB to assist in developing a better understanding of glazing energy efficiency parameters. While the ABCB believes that the Glazing Calculator, if used correctly, will produce accurate results, it is provided 'as is' and without any representation or warranty of any kind, including that it is fit for any purpose or of merchantable quality, or functions as intended or at all. Your use of the Glazing Calculator is entirely at your own risk and the ABCB accepts no liability of any kind.

Copyright © 2014 – Australian Government, State and Territory Governments of Australia. All Rights Reserved

if inputs are valid



page 1 of 1

1st Floor (Page 1 of 2)

printed 24/07/2017

Report from Waldron Rd - 77-79 (CLASS 3 LEVEL 1)

NCC VOLUME ONE GLAZING CALCULATOR (first issued with NCC 2014)

Building name/description
77-79 Waldron Rd, Chester Hill NSW.

Storey
1

Application
Class 3

Climate zone
6

Facade areas

	N	NE	E	SE	S	SW	W	NW	Internal
Option A	70m ²		100m ²		70m ²		100m ²		
Option B									n/a
Glazing area (A)	30.2m ²	15.1m ²	29.4m ²	9.03m ²		

Number of rows preferred in table below **18** (as currently displayed)


GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE AND PERFORMANCE CHARACTERISTICS										SHADING							CALCULATED OUTCOMES OK (if inputs are valid)				
Glazing element		Facing sector		Size			Performance			P&H or device		Shading		Multipliers		Size		Outcomes			
ID	Description (optional)	Option A facades	Option B facades	Height (m)	Width (m)	Area (m²)	Total System U-Value (AFRC)	Total System SHGC (AFRC)	P	H	P/H	G	Heating (S _h)	Cooling (S _c)	Area used (m²)	Element share of % of allowance used					
1 D107		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
2 D108		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
3 D109		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
4 D110		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
5 D111		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
6 D112		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
7 D132		W		2.10	1.00		7.0	0.70	1.000	2.800	0.36	0.70	0.97	0.95	2.10	24% of 68%					
8 W105		W		0.90	2.10		7.0	0.70	1.000	1.600	0.63	0.70	0.91	0.86	1.89	21% of 68%					
9 D133		W		2.40	2.10		7.0	0.70	1.000	2.800	0.36	0.40	0.92	0.87	5.04	55% of 68%					
10 D126		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
11 D127		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
12 D128		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
13 D129		S		2.00	2.10		3.6	0.70	1.000	2.800	0.36	0.80	0.97	0.95	4.20	13% of 100%					
14 D130		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
15 D131		S		2.40	2.10		3.6	0.60	1.000	2.800	0.36	0.40	0.94	0.90	5.04	20% of 100%					
16 D134		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%					
17 D135		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%					
18 D136		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%					

page 1 of 2

1st Floor (Page 2 of 2)

printed 24/07/2017

Report from Waldron Rd - 77-79 (CLASS 3 LEVEL 1)

GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE and PERFORMANCE CHARACTERISTICS										SHADING			CALCULATED OUTCOMES OK (if inputs are valid)			
Glazing element		Facing sector		Size			Performance			P&H or device		Shading	Multipliers		Size	Outcomes
ID	Description (optional)	Option A facades	Option B facades	Height (m)	Width (m)	Area (m ²)	Total System U-Value (AFRC)	Total System SHGC (AFRC)	P (m)	H (m)	PIH	G (m)	Heating (S _H)	Cooling (S _C)	Area used (m ²)	Element share of % of allowance used
IMPORTANT NOTICE AND DISCLAIMER IN RESPECT OF THE GLAZING CALCULATOR																
The Glazing Calculator has been developed by the ABCB to assist in developing a better understanding of glazing energy efficiency parameters.																
While the ABCB believes that the Glazing Calculator, if used correctly, will produce accurate results, it is provided 'as is' and without any representation or warranty of any kind, including that it is fit for any purpose or of merchantable quality, or functions as intended or at all.																
Your use of the Glazing Calculator is entirely at your own risk and the ABCB accepts no liability of any kind.																
if inputs are valid																
																

Copyright © 2014 – Australian Government, State and Territory Governments of Australia. All Rights Reserved

page 2 of 2

2nd Floor (Page 1 of 2)

printed 24/07/2017

Report from Waldron Rd - 77-79 (CLASS 3 LEVEL 2)

NCC VOLUME ONE GLAZING CALCULATOR (first issued with NCC 2014)

Building name/description
77-79 Waldron Rd, Chester Hill NSW.

Storey
2

Application
Class 3

Climate zone
6

Facade areas

	N	NE	E	SE	S	SW	W	NW	Internal
Option A	70m ²		100m ²		70m ²		100m ²		
Option B									n/a
Glazing area (A)	30.2m ²	15.1m ²	29.4m ²	9.03m ²		

Number of rows preferred in table below
18 (as currently displayed)

GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE AND PERFORMANCE CHARACTERISTICS										SHADING		CALCULATED OUTCOMES OK (if inputs are valid)					
Glazing element		Facing sector		Size			Performance			P&H or device		Shading	Multipliers		Size	Outcomes	
ID	Description (optional)	Option A facades	Option B facades	Height (m)	Width (m)	Area (m²)	Total System U-Value (AFRC)	Total System SHGC (AFRC)	P	H	P/H	G (m)	Heating (S _h)	Cooling (S _c)	Area used (m²)	Element share of % of allowance used	
1 D220		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%	
2 D221		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%	
3 D222		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%	
4 D223		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%	
5 D224		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%	
6 D225		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%	
7 D232		W		2.10	1.00		7.0	0.70	1.000	2.800	0.36	0.70	0.97	0.95	2.10	24% of 68%	
8 W205		W		0.90	2.10		7.0	0.70	1.000	1.600	0.63	0.70	0.91	0.86	1.89	21% of 68%	
9 D233		W		2.40	2.10		7.0	0.70	1.000	2.800	0.36	0.40	0.92	0.87	5.04	55% of 68%	
10 D226		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%	
11 D227		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%	
12 D228		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%	
13 D229		S		2.00	2.10		3.6	0.70	1.000	2.800	0.36	0.80	0.97	0.95	4.20	13% of 100%	
14 D230		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%	
15 D31		S		2.40	2.10		3.6	0.60	1.000	2.800	0.36	0.40	0.94	0.90	5.04	20% of 100%	
16 D234		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%	
17 D235		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%	
18 D236		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%	

page 1 of 2

2nd Floor (Page 2 of 2)

Report from Waldron Rd - 77-79 (CLASS 3 LEVEL 2)

printed 24/07/2017

GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE AND PERFORMANCE CHARACTERISTICS										CALCULATED OUTCOMES OK (if inputs are valid)							
Glazing element		Facing sector		Size			Performance			SHADING		P&H or device		Shading	Multipliers	Size	Outcomes
ID	Description (optional)	Option A facades	Option B facades	Height (m)	Width (m)	Area (m ²)	Total System U-value (AFRC)	Total System SHGC (AFRC)	P	H	G	P/H	Cooling (S _c)	Heating (S _h)	Area used (m ²)	Element share of % of allowance used	
if inputs are valid																	

IMPORTANT NOTICE AND DISCLAIMER IN RESPECT OF THE GLAZING CALCULATOR

The Glazing Calculator has been developed by the ABCB to assist in developing a better understanding of glazing energy efficiency parameters. While the ABCB believes that the Glazing Calculator, if used correctly, will produce accurate results, it is provided "as is" and without any representation or warranty of any kind, including that it is fit for any purpose or of merchantable quality, or functions as intended or at all. Your use of the Glazing Calculator is entirely at your own risk and the ABCB accepts no liability of any kind.

3rd Floor (Page 1 of 2)

printed 24/07/2017

Report from Waldron Rd - 77-79 (CLASS 3 LEVEL 3)

NCC VOLUME ONE GLAZING CALCULATOR (first issued with NCC 2014)

Building name/description
77-79 Waldron Rd, Chester Hill NSW.

Storey
3

Application
Class 3

Climate zone
6

Facade areas


	N	NE	E	SE	S	SW	W	NW	Internal
Option A	70m ²		100m ²		70m ²		100m ²		
Option B									n/a
Glazing area (A)	30.2m ²	15.1m ²	29.4m ²	9.03m ²					

Number of rows preferred in table below **18** (as currently displayed)

GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE and PERFORMANCE CHARACTERISTICS										SHADING							CALCULATED OUTCOMES OK (if inputs are valid)				
Glazing element		Facing sector		Size			Performance			P&H or device		Shading		Multipliers		Size		Outcomes			
ID	Description (optional)	Option A facades	Option B facades	Height (m)	Width (m)	Area (m²)	Total System U-Value (AFRC)	Total System SHGC (AFRC)	P	H	P/H	G	Heating (S _h)	Cooling (S _c)	Area used (m²)	Element share of % of allowance used					
1 D325		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
2 D326		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
3 D327		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
4 D328		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
5 D329		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
6 D330		N		2.40	2.10		6.2	0.30	1.000	2.800	0.36	0.40	0.97	0.82	5.04	17% of 100%					
7 D331		W		2.10	1.00		7.0	0.70	1.000	2.800	0.36	0.70	0.97	0.95	2.10	24% of 68%					
8 W305		W		0.90	2.10		7.0	0.70	1.000	1.600	0.63	0.70	0.91	0.86	1.89	21% of 68%					
9 D332		W		2.40	2.10		7.0	0.70	1.000	2.800	0.36	0.40	0.92	0.87	5.04	55% of 68%					
10 D319		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
11 D320		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
12 D321		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
13 D322		S		2.00	2.10		3.6	0.70	1.000	2.800	0.36	0.80	0.97	0.95	4.20	13% of 100%					
14 D323		S		2.40	2.10		3.6	0.70	1.000	2.800	0.36	0.40	0.94	0.90	5.04	17% of 100%					
15 D324		S		2.40	2.10		3.6	0.60	1.000	2.800	0.36	0.40	0.94	0.90	5.04	20% of 100%					
16 D335		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%					
17 D334		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%					
18 D333		E		2.40	2.10		5.0	0.62	1.000	2.800	0.36	0.40	0.93	0.88	5.04	33% of 96%					

page 1 of 2

Report from Waldron Rd - 77-79 (CLASS 3 LEVEL 3)

GLAZING ELEMENTS, ORIENTATION SECTOR, SIZE AND PERFORMANCE CHARACTERISTICS										CALCULATED OUTCOMES OK (if inputs are valid)							
Glazing element	Facing sector		Size			Performance		SHADING		Shading	Multipliers	Size	Outcomes				
	Description (optional)	Option A facades	Option B facades	Height (m)	Width (m)	Area (m²)	Total System U-Value (AFRC)	Total System SHGC (AFRC)	P (m)					H (m)	P/H (m)	G (m)	Heating (S _H)
ID																	
IMPORTANT NOTICE AND DISCLAIMER IN RESPECT OF THE GLAZING CALCULATOR																	if inputs are valid
The Glazing Calculator has been developed by the ABCB to assist in developing a better understanding of glazing energy efficiency parameters.																	
While the ABCB believes that the Glazing Calculator, if used correctly, will produce accurate results, it is provided "as is" and without any representation or warranty of any kind, including that it is fit for any purpose or of merchantable quality, or functions as intended or at all.																	
Your use of the Glazing Calculator is entirely at your own risk and the ABCB accepts no liability of any kind.																	
																	

Copyright © 2014 – Australian Government, State and Territory Governments of Australia. All Rights Reserved

16 ANNEXURE 2 - Power Density for Specific Areas

Table J6.2a MAXIMUM ILLUMINATION POWER DENSITY	
Space	Maximum illumination power density(W/m²)
Auditorium, church and public hall	10
Board room and conference room	10
Carpark – general	6
Carpark - entry zone (first 20 m of travel)	25
Common rooms, spaces and corridors in a Class 2 building	8
Control room, switch room, and the like	9
Corridors	8
Courtroom	12
Dormitory of a Class 3 building used for sleeping only	6
Dormitory of a Class 3 building used for sleeping and study	9
Entry lobby from outside the building	15
Health-care - children's ward	10
Health-care - examination room	10
Health-care - patient ward	7
Health-care - all patient care areas including corridors where cyanosis lamps are used	13
Kitchen and food preparation area	8
Laboratory - artificially lit to an ambient level of 400 lx or more	12
Library = stack and shelving area	12
Library - reading room and general areas	10
Lounge area for communal use in a Class 3 building or Class 9c aged care building	10
Museum and gallery - circulation, cleaning and service lighting	8
Office – artificially lit to an ambient level of 200 lx or more	9
Office – artificially lit to an ambient level of less than 200 lx	7
Plant room	5
Restaurant, café bar, hotel lounge and a space for the serving and consumption of food or drinks	18
Retail space including a museum and gallery whose purpose is the sale of objects	22
School - general purpose learning areas and tutorial rooms	8
Sole-occupancy unit of a Class 3 building	5
Sole-occupancy unit of a Class 9c aged care building	7
Storage with shelving no higher than 75% of the height of the aisle lighting	8
Storage with shelving higher than 75% of the of the aisle lighting	10
Service area, cleaner's room and the like	5
Toilet, locker room, staff room, rest room and the like	6
Wholesale storage and display area	10

Notes:

1. In areas not listed above, the maximum illumination power density is:
 - (a) For an illuminance of not more than 80 lx, 7.5 W/m²
 - (b) For an illuminance of more than 80 lx and not more than 160 lx, 9 W/m²
 - (c) For an illuminance of more than 160 lx and not more than 240 lx, 10 W/m²
 - (d) For an illuminance of more than 240 lx and not more than 320 lx, 11 W/m²
 - (e) For an illuminance of more than 320 lx and not more than 400 lx, 12 W/m²
 - (f) For an illuminance of more than 400 lx and not more than 480 lx, 13 W/m²
 - (g) For an illuminance of more than 480 lx and not more than 540 lx, 14 W/m²
 - (h) For an illuminance of more than 540 lx and not more than 620 lx, 15 W/m².
2. For illuminance levels greater than 620 lx, the average light source efficacy must not be less than 80 Lumens/W.