

MANAGING DIRECTORS

MATTHEW PALAVIDIS
VICTOR FATTORETTO

DIRECTORS

MATTHEW SHIELDS
BEN WHITE



St Basil's, 62-82 Harrow Road, Bexley

Section 96 Environmental Noise Impact Assessment

SYDNEY
A: 9 Sarah St
MASCOT 2020
T: (02) 8339 8000

SYDNEY MELBOURNE BRISBANE CANBERRA
LONDON DUBAI SINGAPORE GREECE

www.acousticlogic.com.au
ABN: 11 068 954 343

The information in this document is the property of Acoustic Logic Consultancy Pty Ltd ABN 11 068 954 343 and shall be returned on demand. It is issued on the condition that, except with our written permission, it must not be reproduced, copied or communicated to any other party nor be used for any purpose other than that stated in particular enquiry, order or contract with which it is issued.

DOCUMENT CONTROL REGISTER

Project Number	20131222.4
Project Name	St Basil's, 62-82 Harrow Road, Bexley
Document Title	Section 96 Environmental Noise Impact Assessment
Document Reference	20131222.4/0811A/R1/HC
Issue Type	Email
Attention To	St Basil's Homes

Revision	Date	Document Reference	Prepared By	Checked By	Approved By
0	8/11/2017	20131222.4/0811A/R0/HC	HC		GW
1	8/11/2017	20131222.4/0811A/R1/HC	HC		GW

TABLE OF CONTENTS

1	INTRODUCTION	3
2	SITE DESCRIPTION	4
3	SURROUNDING NOISE SOURCES	1
3.1	TOPOGRAPHY	1
3.2	ENVIRONMENTAL NOISE LEVELS	1
3.3	TRAFFIC NOISE LEVELS	2
3.3.1	Measurement Location	2
3.3.2	Attended Measurement Equipment	2
3.3.3	Unattended Noise Monitoring Equipment	2
3.3.4	Results of Traffic Noise Level Measurements	2
3.4	BACKGROUND NOISE LEVELS	1
3.4.1	Monitoring Period	1
	Monitoring Equipment	1
3.4.2	Monitoring Locations	1
3.4.3	Noise Monitoring Results	1
3.4.4	Existing Background Noise Levels	1
4	NOISE IMPACTS	2
4.1	PROJECT TRAFFIC ACOUSTIC OBJECTIVES	2
4.1.1	Australian Standard AS2107:2000 Criteria	2
5	ASSESSMENT OF AIRCRAFT NOISE	3
5.1	SITE EVALUATION	3
5.2	INTERNAL NOISE CRITERIA FOR RESIDENTIAL LEVELS	3
5.3	EXTERNAL AIRCRAFT NOISE LEVELS	4
5.4	DISCUSSION	4
6	EVALUATION OF NOISE INTRUSION	4
6.1	RECOMMENDED GLAZING	5
6.1.1	External Walls	5
6.1.1.1	Concrete Walls	5
6.2	ROOF/ CEILING CONSTRUCTIONS	6
6.2.1	External Doors	6
6.3	VENTILATION	6
7	NOISE EMISSIONS FROM THE SITE	7
7.1	ACOUSTIC OBJECTIVES	7
7.1.1	Intrusiveness Criterion	7
7.1.2	Amenity Criterion	8
7.1.3	Proposed Noise Objectives	8
7.1.4	Plant Noise Emissions	9
8	CONCLUSION	10

1 INTRODUCTION

This report presents our acoustic assessment for the proposed Section 96 for the proposed development at 62-82 Harrow Road, Bexley.

Attended and unattended noise monitoring has been conducted in order to determine the existing environmental noise levels surrounding the site including traffic and aircraft noise levels around the perimeter of the site. Additionally, unattended noise monitoring was conducted in order to determine background noise levels in the area.

This study will set noise levels criteria applicable to the project based on Council and other relevant statutory/regulatory requirements for services associated with the development. The project is an aged care development with a Class 9C Classification.

This assessment has been based on architectural drawings dated 18/09/18, prepared by PTW Architects, Project no. PA016906.01.

2 SITE DESCRIPTION

Figure 1 is an illustration of the existing development. The existing environmental noise sources affecting the site are as follows:

- Traffic noise from surrounding roadways;
- Aircraft noise impact from Sydney Airport.

It is anticipated that the future acoustic environment impacting the proposed development will not be altered significantly from those conditions currently experienced at the site.



Proposed 62-82 Harrow Road, Bexley site

●	UNATTENDED NOISE MONITORING
—	SITE BOUNDARY
+	ATTENDED NOISE MEASUREMENT

Figure 1 – Site Description

3 SURROUNDING NOISE SOURCES

Environment noise impacting the site includes traffic noise from surrounding street, aircraft noise from Sydney Airport as well as the potential of noise impact generated from the operation of the electrical substation neighbouring the site to the north east.

Traffic noise from Harrow Road will be the main source of traffic noise from the surrounding perimeter roadways impacting upon the proposed development. The surrounding roadways carry medium to low traffic volumes.

3.1 TOPOGRAPHY

The topography of the site and surrounding land of the proposed development is generally flat and the acoustic assessment has taken this into account.

3.2 ENVIRONMENTAL NOISE LEVELS

Environmental noise constantly varies in level, due to fluctuations in local noise sources including road traffic. Accordingly, a 15 minute measurement interval is normally utilised. Over this period, noise levels are monitored on a continuous basis and statistical and integrating techniques are used to determine noise description parameters.

In the case of environmental noise three principle measurement parameters are used, namely L_{10} , L_{90} and L_{eq} .

The L_{10} and L_{90} measurement parameters are statistical levels that represent the average maximum and average minimum noise levels respectively, over the measurement intervals.

The L_{10} parameter is commonly used to measure noise produced by a particular intrusive noise source since it represents the average of the loudest noise levels produced by the source.

Conversely, the L_{90} level (which is commonly referred to as the background noise level) represents the noise level heard in the quieter periods during a measurement interval. The L_{90} parameter is used to set the allowable noise level for new, potentially intrusive noise sources since the disturbance caused by the new source depends on how audible it is above the pre-existing noise environment, particularly during quiet periods, as represented by the L_{90} level.

The L_{eq} parameter represents the average noise energy during a measurement period. This parameter is derived by integrating the noise levels measured over the measurement period. L_{eq} is important in the assessment of traffic noise impact as it closely corresponds with human perception of a changing noise environment; such is the character of industrial noise.

3.3 TRAFFIC NOISE LEVELS

As part of this investigation, traffic noise from the surrounding perimeter roadways has been measured. The results of this measurement will be used to determine the treatments required to reduce noise levels to within the project acoustic objectives.

Measurements included attended and unattended noise levels measurements conducted at the locations as detailed in Figure 1 above.

3.3.1 Measurement Location

Traffic noise measurement locations are detailed above in figure 1. Measurements were conducted between 9:30am to 10:30am on the 21st September, 2017.

3.3.2 Attended Measurement Equipment

Measurements were taken using a Norsonic-140 precision sound level analyser, set to A-weighted fast response. The sound level meter was calibrated before and after the measurements using a RION NC73 precision sound calibrator, and no significant drift was recorded.

3.3.3 Unattended Noise Monitoring Equipment

Unattended noise measurements were obtained using an Acoustic Research Laboratories Pty Ltd noise logger. The logger was programmed to store 15-minute statistical noise levels throughout the monitoring period. The noises monitors were calibrated at the beginning and the end of the measurement using a Rion NC-73 calibrator. No significant drift was detected. All measurements were taken on A-weighted fast response mode. There were no significant periods of adverse weather conditions during the measurement period.

3.3.4 Results of Traffic Noise Level Measurements

The results of measured traffic noise levels at the locations around the site as detailed in Figure 1 above are detailed in the table below.

Table 1 – Measured Traffic Noise Levels

Location	Traffic Noise Level, L_{Aeq} (15 min) dB(A)
Harrow Road	60
Bowlers Avenue	71
Frederick Street	61

3.4 BACKGROUND NOISE LEVELS

Existing background noise levels have been measured at a representative location on the site as indicated in Figure 1 of this report, in order to characterise the existing background noise levels within and surrounding the proposed development.

3.4.1 Monitoring Period

Unattended noise monitoring was conducted during the period of 21st September to 3rd October 2013 in order to measure the existing background noise levels. Noise monitoring data is provided in Appendix B below.

Monitoring Equipment

Unattended noise measurements were obtained using an Acoustic Research Laboratories Pty Ltd noise logger. The logger was programmed to store 15-minute statistical noise levels throughout the monitoring period. The noises monitors were calibrated at the beginning and the end of the measurement using a Rion NC-73 calibrator. No significant drift was detected. All measurements were taken on A-weighted fast response mode. There were no significant periods of adverse weather conditions during the measurement period.

3.4.2 Monitoring Locations

Figure 1 in Section 1 of this document presents an illustration of the site, including unmanned and manned noise monitoring positions.

3.4.3 Noise Monitoring Results

Unattended monitoring was undertaken within the site in order to determine the existing acoustic environment. The unattended monitor results will be used to determine the variation between day, evening and night time noise levels. Monitoring locations are indicated in Figure 1 in Section 1 of this document.

3.4.4 Existing Background Noise Levels

Background noise levels during day time are dominated by general vehicular traffic movements. The EPA NSW Industrial Noise Policy details specific steps in determining the background noise level for assessment of the day, evening and night time periods. Table 2 summarises the background determined at the monitoring location, based on the guidelines set out in the EPA NSW Industrial Noise Policy and the results of unattended noise monitoring.

Table 2 - Measured Background Noise Levels

Description	Day Noise Level 7am to 6pm (dB(A))	Evening Noise Level 6pm to 10pm (dB(A))	Night Noise Level 10pm to 7am (dB(A))
Minimum Repeatable Background $L_{90,15min}$	48	46	32

4 NOISE IMPACTS

4.1 PROJECT TRAFFIC ACOUSTIC OBJECTIVES

The determination of an acceptable level of traffic noise within the residential spaces requires consideration of the activities carried out within the space and the degree to which noise will interfere with those activities

As sleep is the activity most affected by traffic noise, bedrooms are the most sensitive rooms. Higher levels of noise are acceptable in living areas without interfering with activities such as reading, listening to television, etc. Noise levels in utility spaces such as kitchens, bathrooms, laundries, etc can be higher.

4.1.1 Australian Standard AS2107:2000 Criteria

The Australian Standard AS2107-2000 “Recommended Design Sound Levels and Reverberation Times for Building Interiors” recommends maximum design sound levels for different areas of occupancy in the residential development while AS 3671 -1989 “Road Traffic Noise Intrusion - Building Siting and Construction” recommends that an appropriate L_{eq} or L_{10} traffic noise descriptor be used for the occupancy being assessed. Traffic noise criteria for AS2107-2000 is presented in the table below, based on developments near major roadways.

Table 3 – Australian Standards Traffic Noise Criteria

Space/Activity Type	Internal Noise Level Criteria
Living Areas	45 dB(A) L_{eq} (24 hour)
Bedrooms	40 dB(A) L_{eq} (9 hour, 10pm to 7am)
Common Areas	55 dB(A) L_{eq} (24 hour)

This assessment shall be conducted in accordance with AS2107-2000 “Recommended Design Sound Levels and Reverberation Times for Building Interiors”.

Based on AS2107-2000 the following assessment criteria would apply to the proposed development.

Table 4 - Internal Traffic Noise Criteria

Space/Activity Type	Noise Level dB(A) L_{eq}
Living Areas	40 dB(A) L_{eq} (1 hour)
Bedrooms	40 dB(A) L_{eq} (1 hour)
Common Areas	55 dB(A) L_{eq} (24 hour)

5 ASSESSMENT OF AIRCRAFT NOISE

5.1 SITE EVALUATION

Assessing the acceptability of aircraft noise exposure is done so using Australian Standard AS 2021-2000 "Aircraft Noise Intrusion – Building Siting and Construction". The standard sets the criteria for the allowable levels of aircraft noise exposure dependant on the situation and use of the development.

The acceptability of a site in terms of aircraft noise exposure is assessed using the Australian Noise Exposure Forecast System (ANEF). ANEF was produced to provide a rating system that reflects actual human response to different aspects of aircraft noise, allowing the noise exposure of a particular location to be readily assessed. The three fundamental factors that influence the perception of aircraft noise are as follows; the frequency of aircraft movements overhead, the noise level and duration of individual aircraft movements and the time of the day in which they occur.

The proposed site is located between ANEF 25 and 30 contours, based on the Sydney Airport 2033 ANEF plan. For any sites located on or near the 20 ANEF contour, it is recommended that the proposed site be assessed to ensure that internal noise levels are limited to those recommended in AS2021.

5.2 INTERNAL NOISE CRITERIA FOR RESIDENTIAL LEVELS

Due to the proposed site being located between ANEF 25 and 30 contours, AS2021 states that a full evaluation of internal noise levels is carried out. This evaluation requires an examination of the likely levels of internal noise from aircraft flyovers.

AS2021 stipulates the internal noise levels listed in Table 1 for residential buildings. These levels will be used to assess aircraft noise intrusion into the residential levels of the development.

Table 5 – Indoor Design Sound Levels for Aircraft Noise Reduction Assessment

ACTIVITY	INDOOR DESIGN SOUND LEVEL FROM AIRCRAFT FLYOVER, dB (A)_{L_{max}}
Sleeping areas, dedicated lounges	50 dB (A)
Other habitable spaces	55 dB (A)
Bathrooms, toilets, laundries	60 dB (A)
Private offices, conference rooms	55 dB (A)
Shops, supermarkets, showrooms	75 dB (A)

5.3 EXTERNAL AIRCRAFT NOISE LEVELS

Aircraft noise levels at the site were determined using AS 2021. The Standard gives aircraft noise levels for various aircraft landing and taking off for locations near airports. The location of the runways was obtained from Sydney Airport 2033 ANEF.

Based on the distance from the site to the runways and an assessment of all the aircraft listed in AS 2021, the Standard predicts that the highest typical aircraft movement will be from A330 landing to the Third Runway. The noise level at the site as indicated by the standard is 83dB(A). This noise level will be used to predict the resultant internal noise levels.

5.4 DISCUSSION

All internal noise levels within the development will be less than the required criteria within the Australian Standards and will result in an acceptable acoustic amenity for future tenants.

It is noted that many multi story residential buildings within the Sydney region have included suitable acoustic treatments to ensure internal noise levels comply with the relevant council and Australian standards.

Additionally treatments to the external balconies or gardens of residential buildings with exposure to environmental noise sources, greater than that of the proposed development, are not required to comply with the relevant standards.

6 EVALUATION OF NOISE INTRUSION

Noise intrusion into the apartments was assessed using the measured levels in the sections above and the internal noise level criteria which is compliant with Council requirement, AS2021:2015 and AS2107:2016 criteria as detailed in the section above.

Calculations were performed taking into account the orientation of windows, barrier effects (where applicable), roof, the total area of glazing, facade transmission loss and room sound absorption characteristics. In this way the likely interior noise levels can be predicted.

Aircraft, traffic and substation noise intrusion into the proposed development is assessed using the measured external noise levels reported above as a basis. Internal noise levels will primarily be as a result of noise transfer through the windows and doors as these are relatively light building elements that offer less resistance to the transmission of sound. Noise transfer through the masonry elements will not be significant and need not be considered further.

In all cases, the selected glazing type (refer below) reduces internal noise levels to within the nominated criteria for the various space types.

6.1 RECOMMENDED GLAZING

The glazing thicknesses recommended are those needed to satisfy acoustic requirements and do not take into account other requirements such as structural, safety or other considerations. These additional considerations may require the glazing thickness to be increased beyond the acoustic requirement. It is noted that no skylights are nominated on the drawings. Where windows are not nominated they shall be standard glazing without acoustic seals.

A preliminary review of traffic, aircraft and substation noise intrusion has revealed that upgraded single glazing with acoustic seals will be required to comply with design noise levels as detailed within AS/NZS 2107:2016. Experience with similar projects indicates that single upgraded glazing will ensure internal noise levels are achieved and are both possible and practical.

The recommended glazing types can be seen in Appendix A which will ensure internal noise levels assemblies for this project.

In addition to meeting the minimum glazing thickness requirements given, the design of the window mullions, perimeter seals and the installation of the windows/doors in the building openings shall not reduce the STC rating of the glazing assembly below the values nominated in Table 7 below. Note that mohair type seals will not be acceptable for the windows requiring acoustic seals.

Table 6 - Minimum STC of Glazing

Glazing Assembly	Acoustic Seals	Minimum STC/Rw of Installed Window
12.38mm laminated	Yes	37
10.38mm laminated	Yes	35
10mm float	Yes	33

6.1.1 External Walls

6.1.1.1 Concrete Walls


Any proposed concrete external wall construction will be acoustically acceptable and will not require any additional treatment.

There should not be vents on the internal skin of external walls. All penetrations in the internal skin of external walls should be acoustically sealed with a flexible sealant.

6.2 ROOF/ CEILING CONSTRUCTIONS

External roof constructs with concrete slab is acoustically acceptable. Penetrations in ceilings (such as for light fittings etc.) must be sealed gap free with a flexible sealant. Any ventilation openings in the ceilings would need to be acoustically treated to maintain the acoustic performance of the ceiling construction.

External roof of metal deck construction should be as follows:

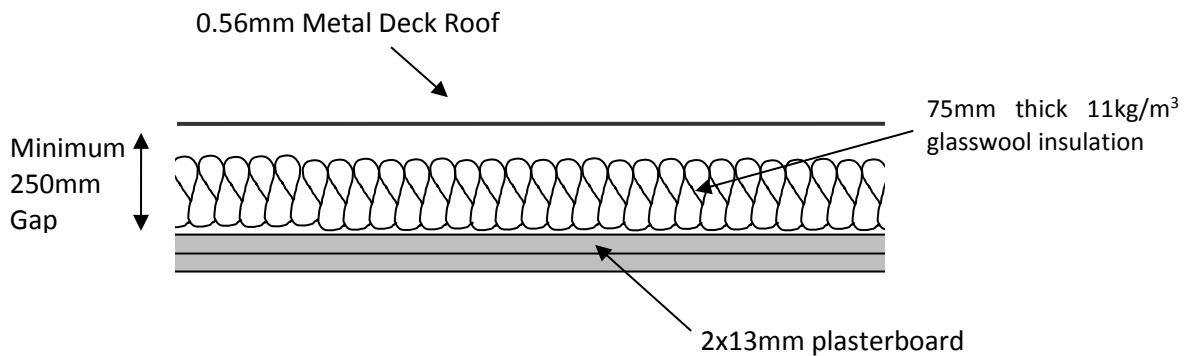

6.2.1 External Doors

Any glass doors should be constructed using glazing thickness set out in markup attached. Full perimeter acoustic seals around the doors are required. The proposed western red cedar hardwood framing is acoustically acceptable.

Any timber external doors shall be a minimum 40mm solid core timber with Raven RP10 to the top and sides and Raven RP38 to the underside of the door.

6.3 VENTILATION

As the recommended internal noise levels cannot be achieved with windows open, an alternative outside air supply system or air conditioning system will be required to be installed in accordance with AS2021:2015 requirements for aircraft noise.

The alternative ventilation system that is installed should be acoustically designed to ensure that the acoustic performance of the recommended constructions is not reduced and provide ventilation complying with the BCA with windows closed.

7 NOISE EMISSIONS FROM THE SITE

As detailed plant selections are not available at this stage it is not possible to carry out a detailed examination of the ameliorative measures that may be required to achieve the noise targets.

Plant will be acoustically treated to prevent noise emissions from adversely impacting the surrounding properties. This may include selecting the quietest plant practicable, or treating the plant with enclosures, barriers, duct lining and silencers, etc as required to comply with the sound level requirements of local council. A detailed assessment of noise emissions associated with services within the building will be conducted at CC stage of the development.

Experience with similar projects indicates that it would be possible to achieve Council requirements with appropriate treatment of the plant. This treatment would be determined at the Construction Certificate stage.

7.1 ACOUSTIC OBJECTIVES

The external noise emission from the project site shall be assessed to the requirements of the EPA guidelines. The recommended assessment objectives vary depending on the potentially affected receivers, the time of day, and the type of noise source. The EPA Industrial Noise Policy has two requirements which both have to be complied with, namely an amenity criterion and an intrusiveness criterion.

7.1.1 Intrusiveness Criterion

The guideline is intended to limit the audibility of noise emissions at residential receivers and requires that noise emissions measured using the L_{eq} descriptor not exceed the background noise level by more than 5dB(A). Where applicable, the intrusive noise level should be penalised (increased) to account for any annoying characteristics such as tonality.

Background noise levels adopted are presented in Section 3.5. Noise emissions from the site should comply with the noise levels presented below when measured at nearby property boundary.

7.1.2 Amenity Criterion

The guideline is intended to limit the absolute noise level from all noise sources to a level that is consistent with the general environment.

The EPA's Industrial noise policy sets out acceptable noise levels for various localities. Table 2.1 on page 16 of the policy indicates 4 categories to distinguish different residential areas. They are rural, suburban, urban and urban/industrial interface. This site is categorised by all nearby receivers as suburban.

For the purposes of this condition:

- Day is defined as the period from 7am to 6pm Monday to Saturday and 8am to 6pm Sundays and Public Holidays;
- Evening is defined as the period from 6pm to 10pm.
- Night is defined as the period from 10pm to 7am Monday to Saturday and 10pm to 8am Sunday and public holidays.

7.1.3 Proposed Noise Objectives

Noise emissions to all receivers are to be assessed using the Industrial Noise Policy Amenity and Intrusiveness criteria, as set out below.

Table 7 - Noise Emission Requirements – All Receivers

Receiver Type	Time of Day	Measured Background Noise level dB(A) L ₉₀	Resulting Intrusiveness Noise Objective dB(A)L _{eq}	Amenity Noise Objective dB(A)L _{eq}
Suburban	Day	48	53	55
	Evening	46	51	45
	Night	32	37	40
Commercial	All times of the day, evening and night	65	65	65

7.1.4 Plant Noise Emissions

A detailed review of all external mechanical plant has not been undertaken at present due to plant selection not currently being available. A fully detailed assessment of treatments will be conducted once plant selections are finalised.

Acoustic treatments should be determined in order for plant noise emissions to comply with requirements outlined in the INP as detailed in this report. Where required, it is envisaged that acoustic treatments could include acoustic barriers, lined ducting and attenuators on any intake or discharge louvers or openings.

Experience with similar projects indicates that compliance with the nominated criteria is both possible and practical using standard practices.

8 CONCLUSION

This report provides the results of Environmental Noise Study for the proposed development located at St Basil's, 62-82 Harrow Road, Bexley. Noise at the site has been measured and noise goals have been set in accordance with the requirements of the local council and relevant statutory/regulatory authorities.


Determination of noise assessment criteria based on the EPA's Industrial Noise Policy have been determined based on both manned and unmanned noise monitoring conducted at the proposed development and Australian standards.

Traffic noise has been measured, and Aircraft noise has been calculated, and assessment of this is provided in Section 5 & 6 of this report. Noise emissions from the site will need to comply with acoustic criteria presented in Section 7.

Internal noise isolation criteria have been setup in Section 8 of this report based on requirements of BCA Part F5.

We trust this information is satisfactory. Please contact us should you have any further queries.


Yours faithfully,

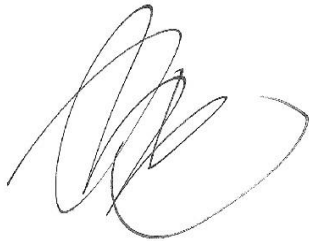A handwritten signature in black ink, appearing to be 'Hugh Cao', written in a cursive style.

Acoustic Logic Consultancy Pty Ltd
Hugh Cao

Appendix A: Glazing Mark-up

- Glazing Mark - up**
- 10mm
 - 10.38mm laminated
 - 12.38mm laminated

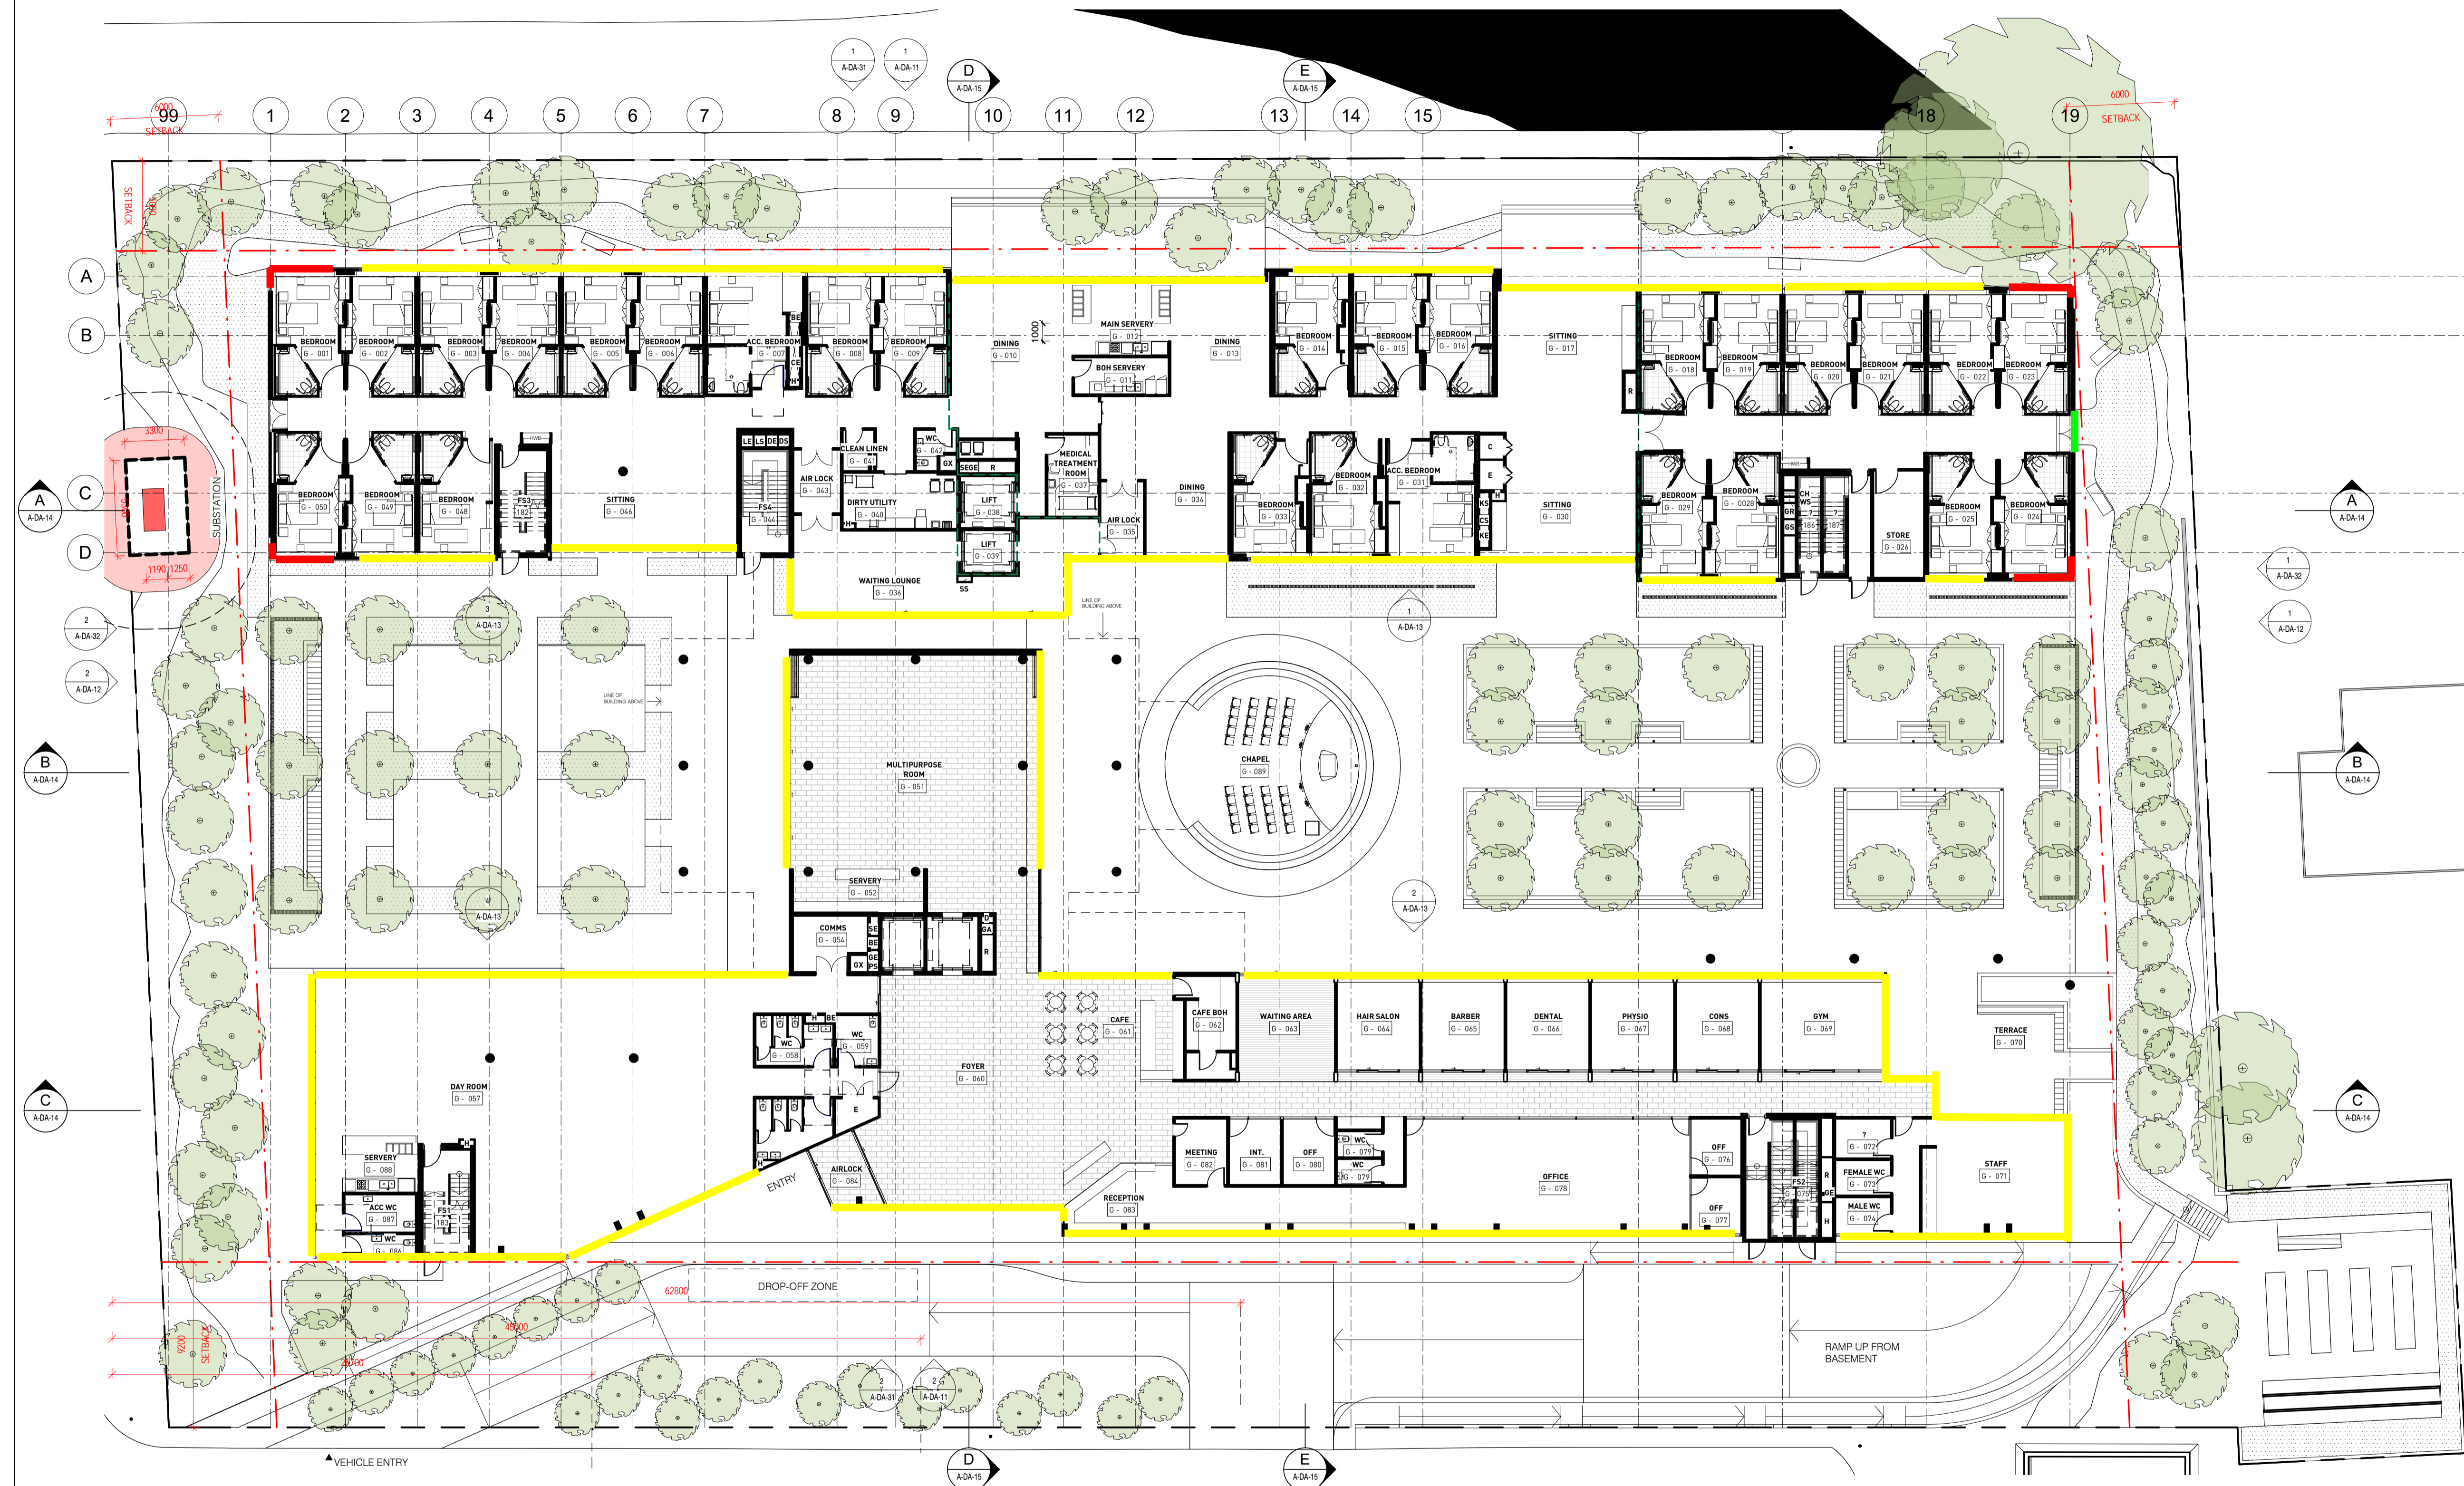

1 GROUND FLOOR PLAN
1 : 200

Key Plan:

Drawing Disclaimer:
Do not scale from drawings. Verify all dimensions on site before commencing work. Copying or reproduction of this drawing is strictly prohibited without the consent of PTW Architects

Section 4.55 SCOPE OF WORK

Substation moved to western street boundary.

Southern wing redesigned to provide greater sense of openness, community facilities that open out to the courtyard.

Chapel is a freestanding sculptural element in the courtyard.

Multipurpose room is located under the soffit of north-south wing to create greater activation of the courtyard.

Lifts are all bed-size cars.

Exhaust risers incorporated within internal fabric.

LEGEND

- SMOKE WALL
- FIRE WALL

01	SECTION 4.55 ISSUE	PTW	18/09/18
Rv	Amendment	By Ck	Date

Client
St Basils Homes
130 Croydon Street, Lakemba
02 9784 3200

Architect
PTW Architects
Level 11, 88 Phillip Street
Sydney NSW 2000 Australia
T +61 2 9232 5877
ptw.com.au


Project PA016906.01
St Basils Bexley
62 - 82 HARROW ROAD, BEXLEY, NSW
2207

Title
GROUND FLOOR PLAN
RL 33.720

0 5 10 15m

Drawing Number A-DA-06
Revision 01

Status
SECTION 4.55

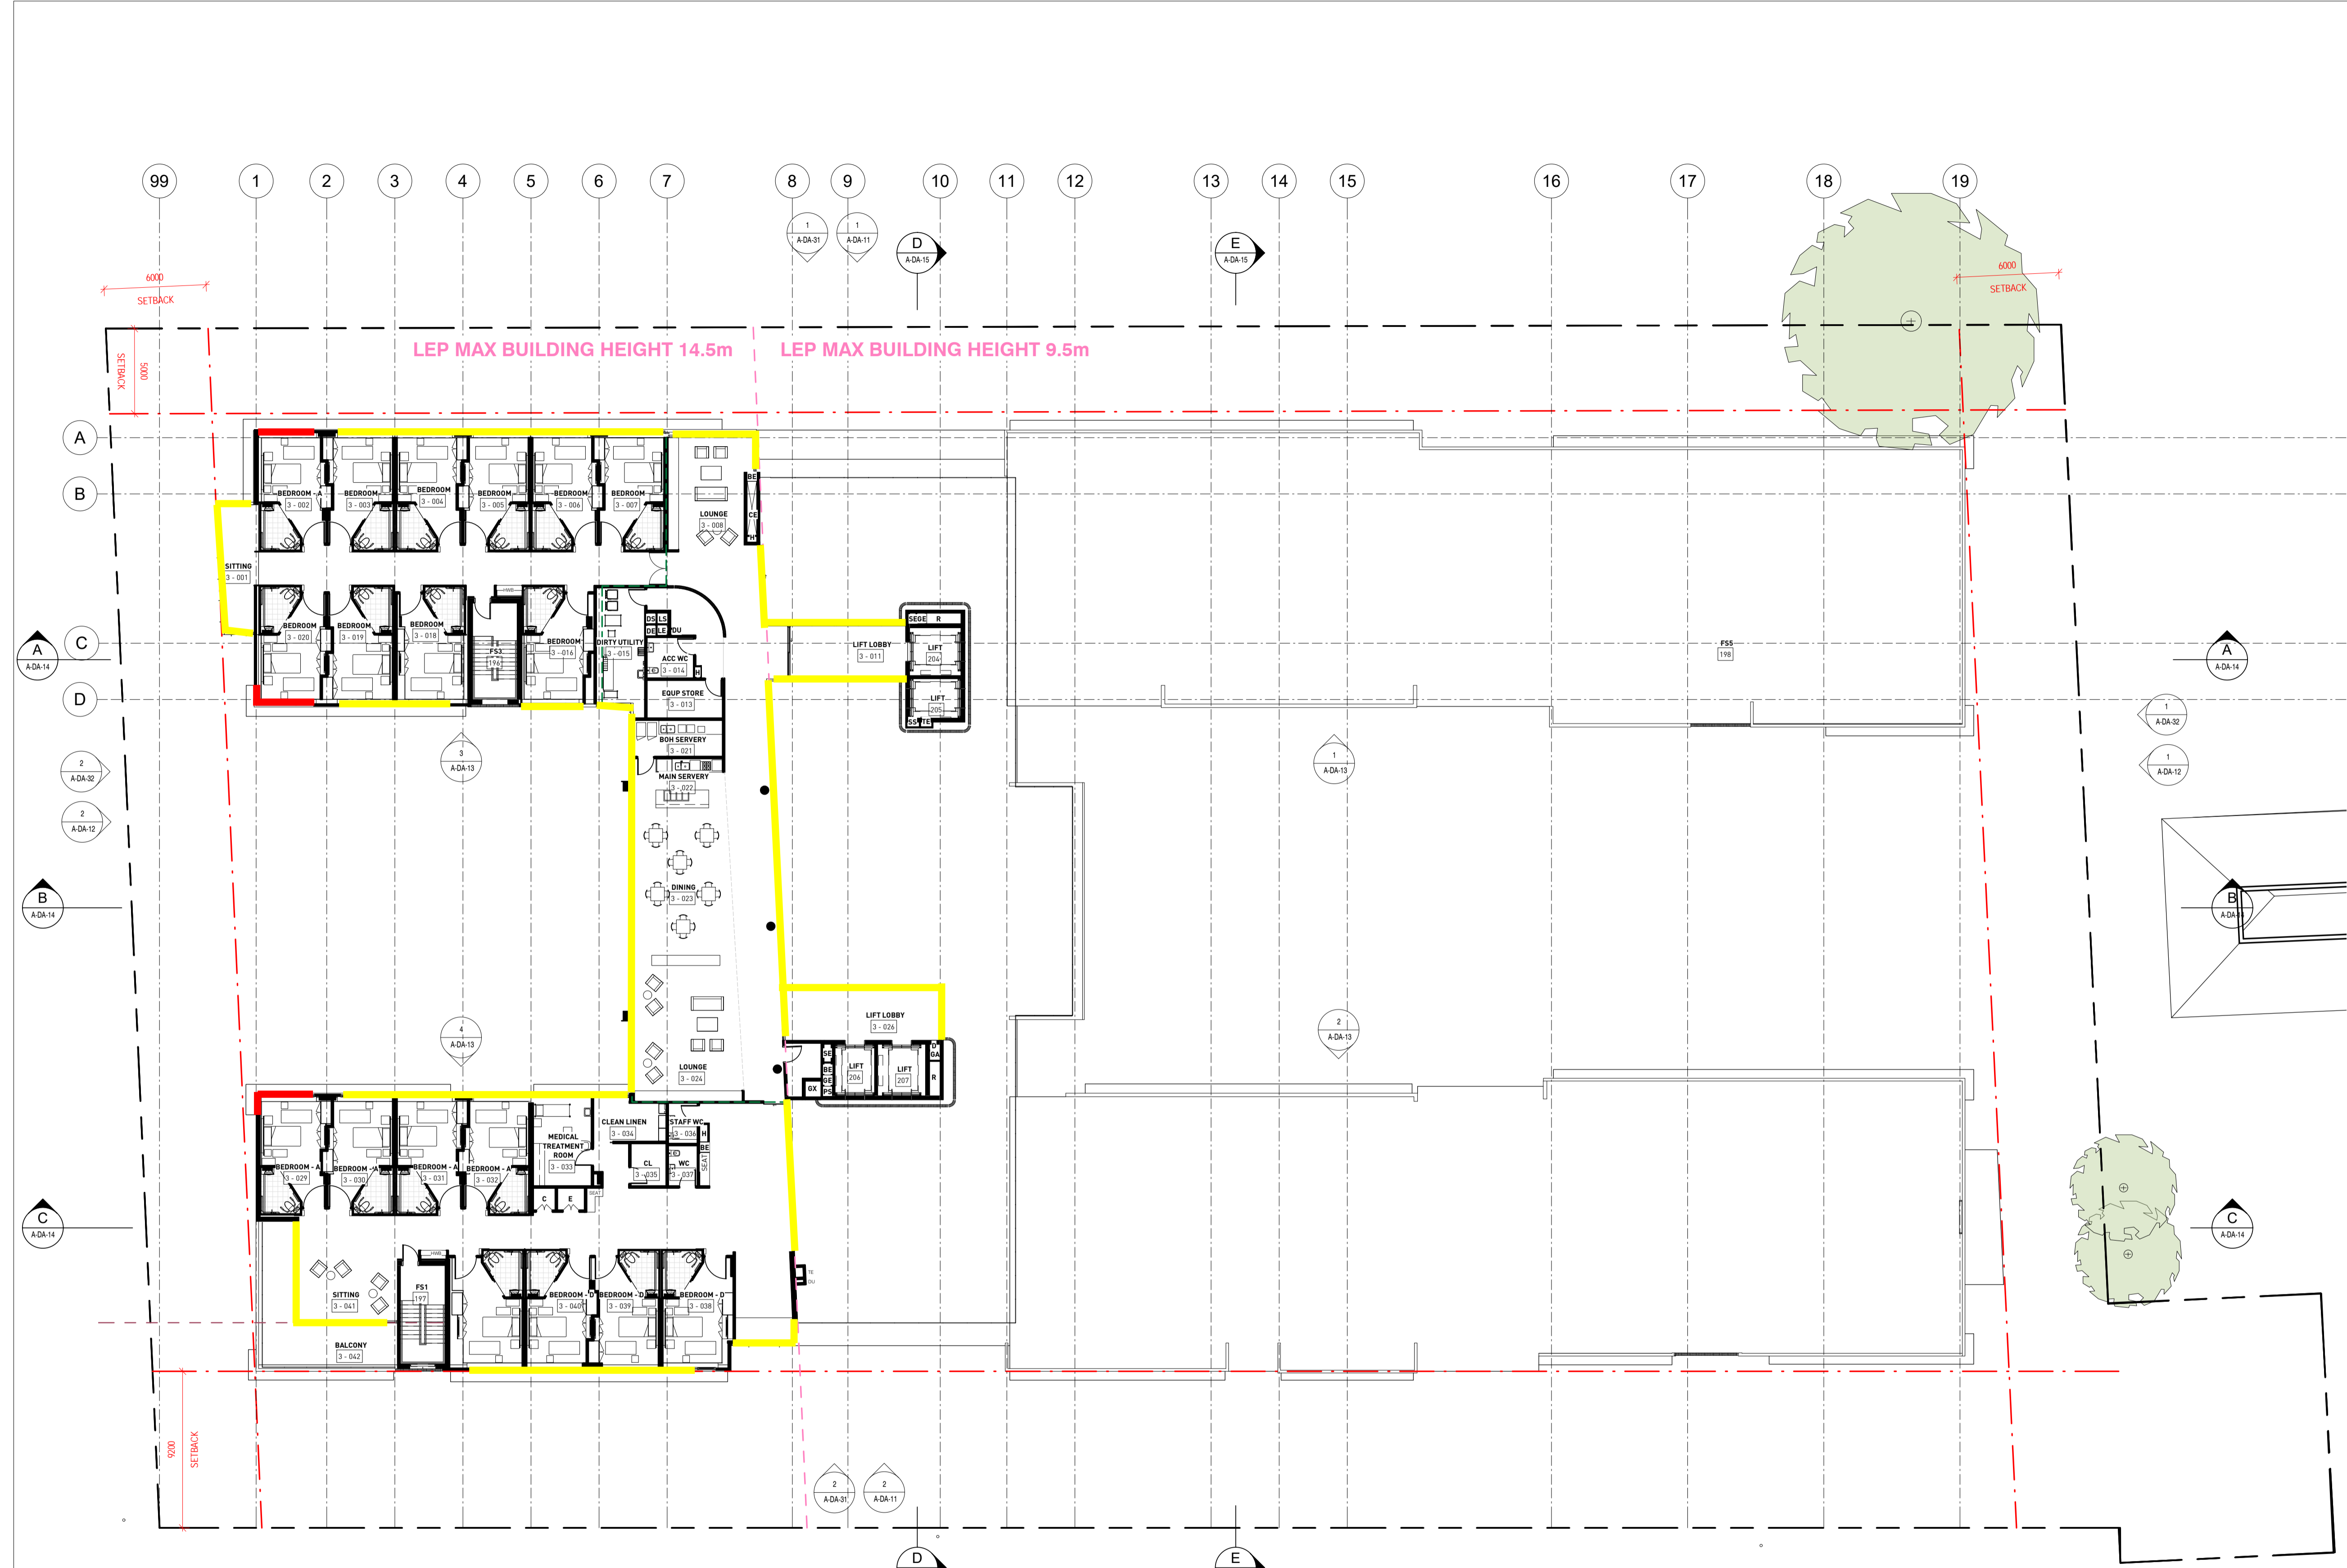

1 LEVEL 3 FLOOR PLAN
1 : 200 @ A1

Key Plan:

Drawing Disclaimer:
Do not scale from drawings. Verify all dimensions on site before commencing work. Copying or reproduction of this drawing is strictly prohibited without the consent of PTW Architects

Section 4.55 SCOPE OF WORK
Internal layout of wings amended to give greater amenity and access to natural light.

LEGEND
--- SMOKE WALL
--- FIRE WALL

Rev	Description	By	Ck	Date
01	SECTION 4.55 ISSUE	PTW		18/09/18
	Amendment			

Client
St Basils Homes
130 Croydon Street, Lakemba
02 9784 3200



Architect
PTW Architects
Level 11, 88 Phillip Street
Sydney NSW 2000 Australia
T +61 2 9232 5877
ptw.com.au


Peddie Thorp & Walker P/L
ABN 23 000 454 424
trading as PTW Architects

NSW Nominated Architects
S Parsons Architect No.6098
D Jones Architect No.4778




Project PA016906.01
St Basils Bexley
62 - 82 HARROW ROAD, BEXLEY, NSW
2207

Title
LEVEL 3 FLOOR PLAN



Drawing Number A-DA-09
Revision 01

Status
SECTION 4.55

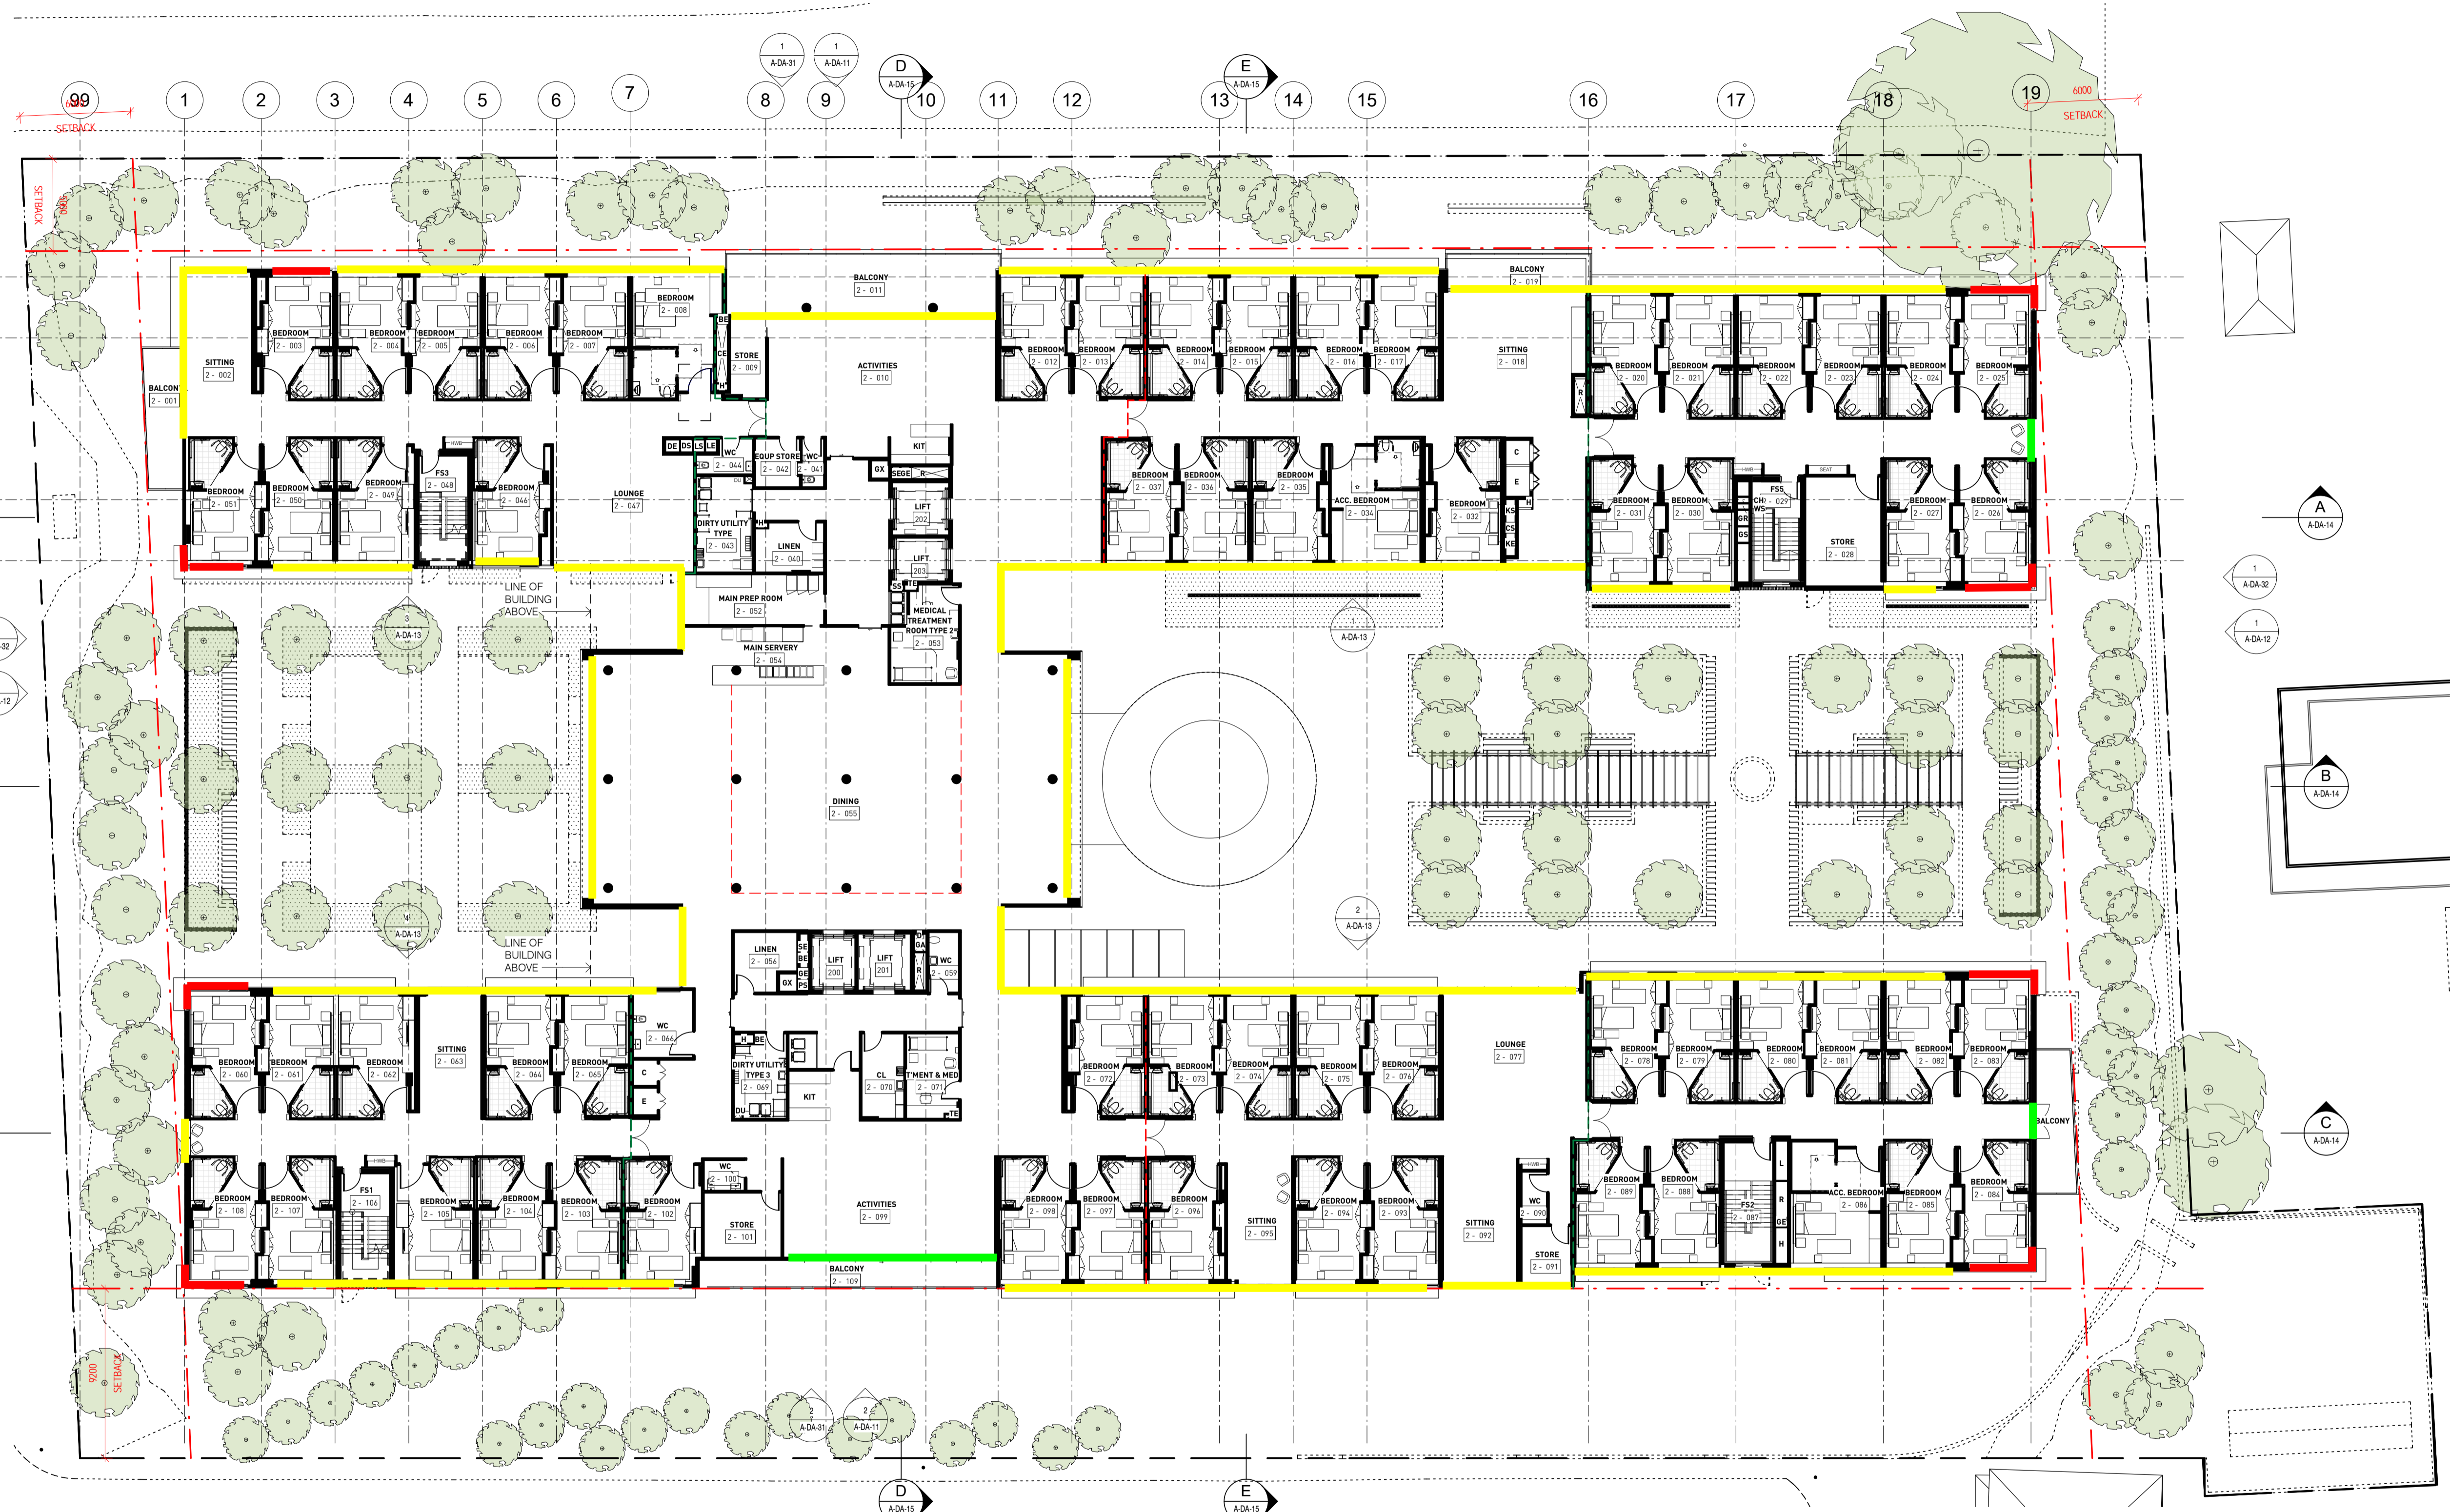

1 LEVEL 2 FLOOR PLAN
1 : 200

Key Plan:

Drawing Disclaimer:
Do not scale from drawings. Verify all dimensions on site before commencing work. Copying or reproduction of this drawing is strictly prohibited without the consent of PTW Architects

Section 4.55 SCOPE OF WORK
Internal layout of wings amended to give greater amenity and access to natural light.

LEGEND
--- SMOKE WALL
--- FIRE WALL

01	SECTION 4.55 ISSUE	PTW	18/09/18
Rv	Amendment	By Ck	Date

Consultant

Client
St Basils Homes
130 Croydon Street, Lakemba
02 9784 3200


Architect
PTW Architects
Level 11, 88 Phillip Street
Sydney NSW 2000 Australia
T +61 2 9232 5877
ptw.com.au

Peddie Thorp & Walker P/L
ABN 23 000 454 424
trading as PTW Architects

NSW Nominated Architects
S Parsons Architect No.6098
D Jones Architect No.4778


Project PA016906.01
St Basils Bexley
62 - 82 HARROW ROAD, BEXLEY, NSW
2207

Title
LEVEL 2 FLOOR PLAN
RL 40.835



Drawing Number A-DA-08
Revision 01

Status
SECTION 4.55

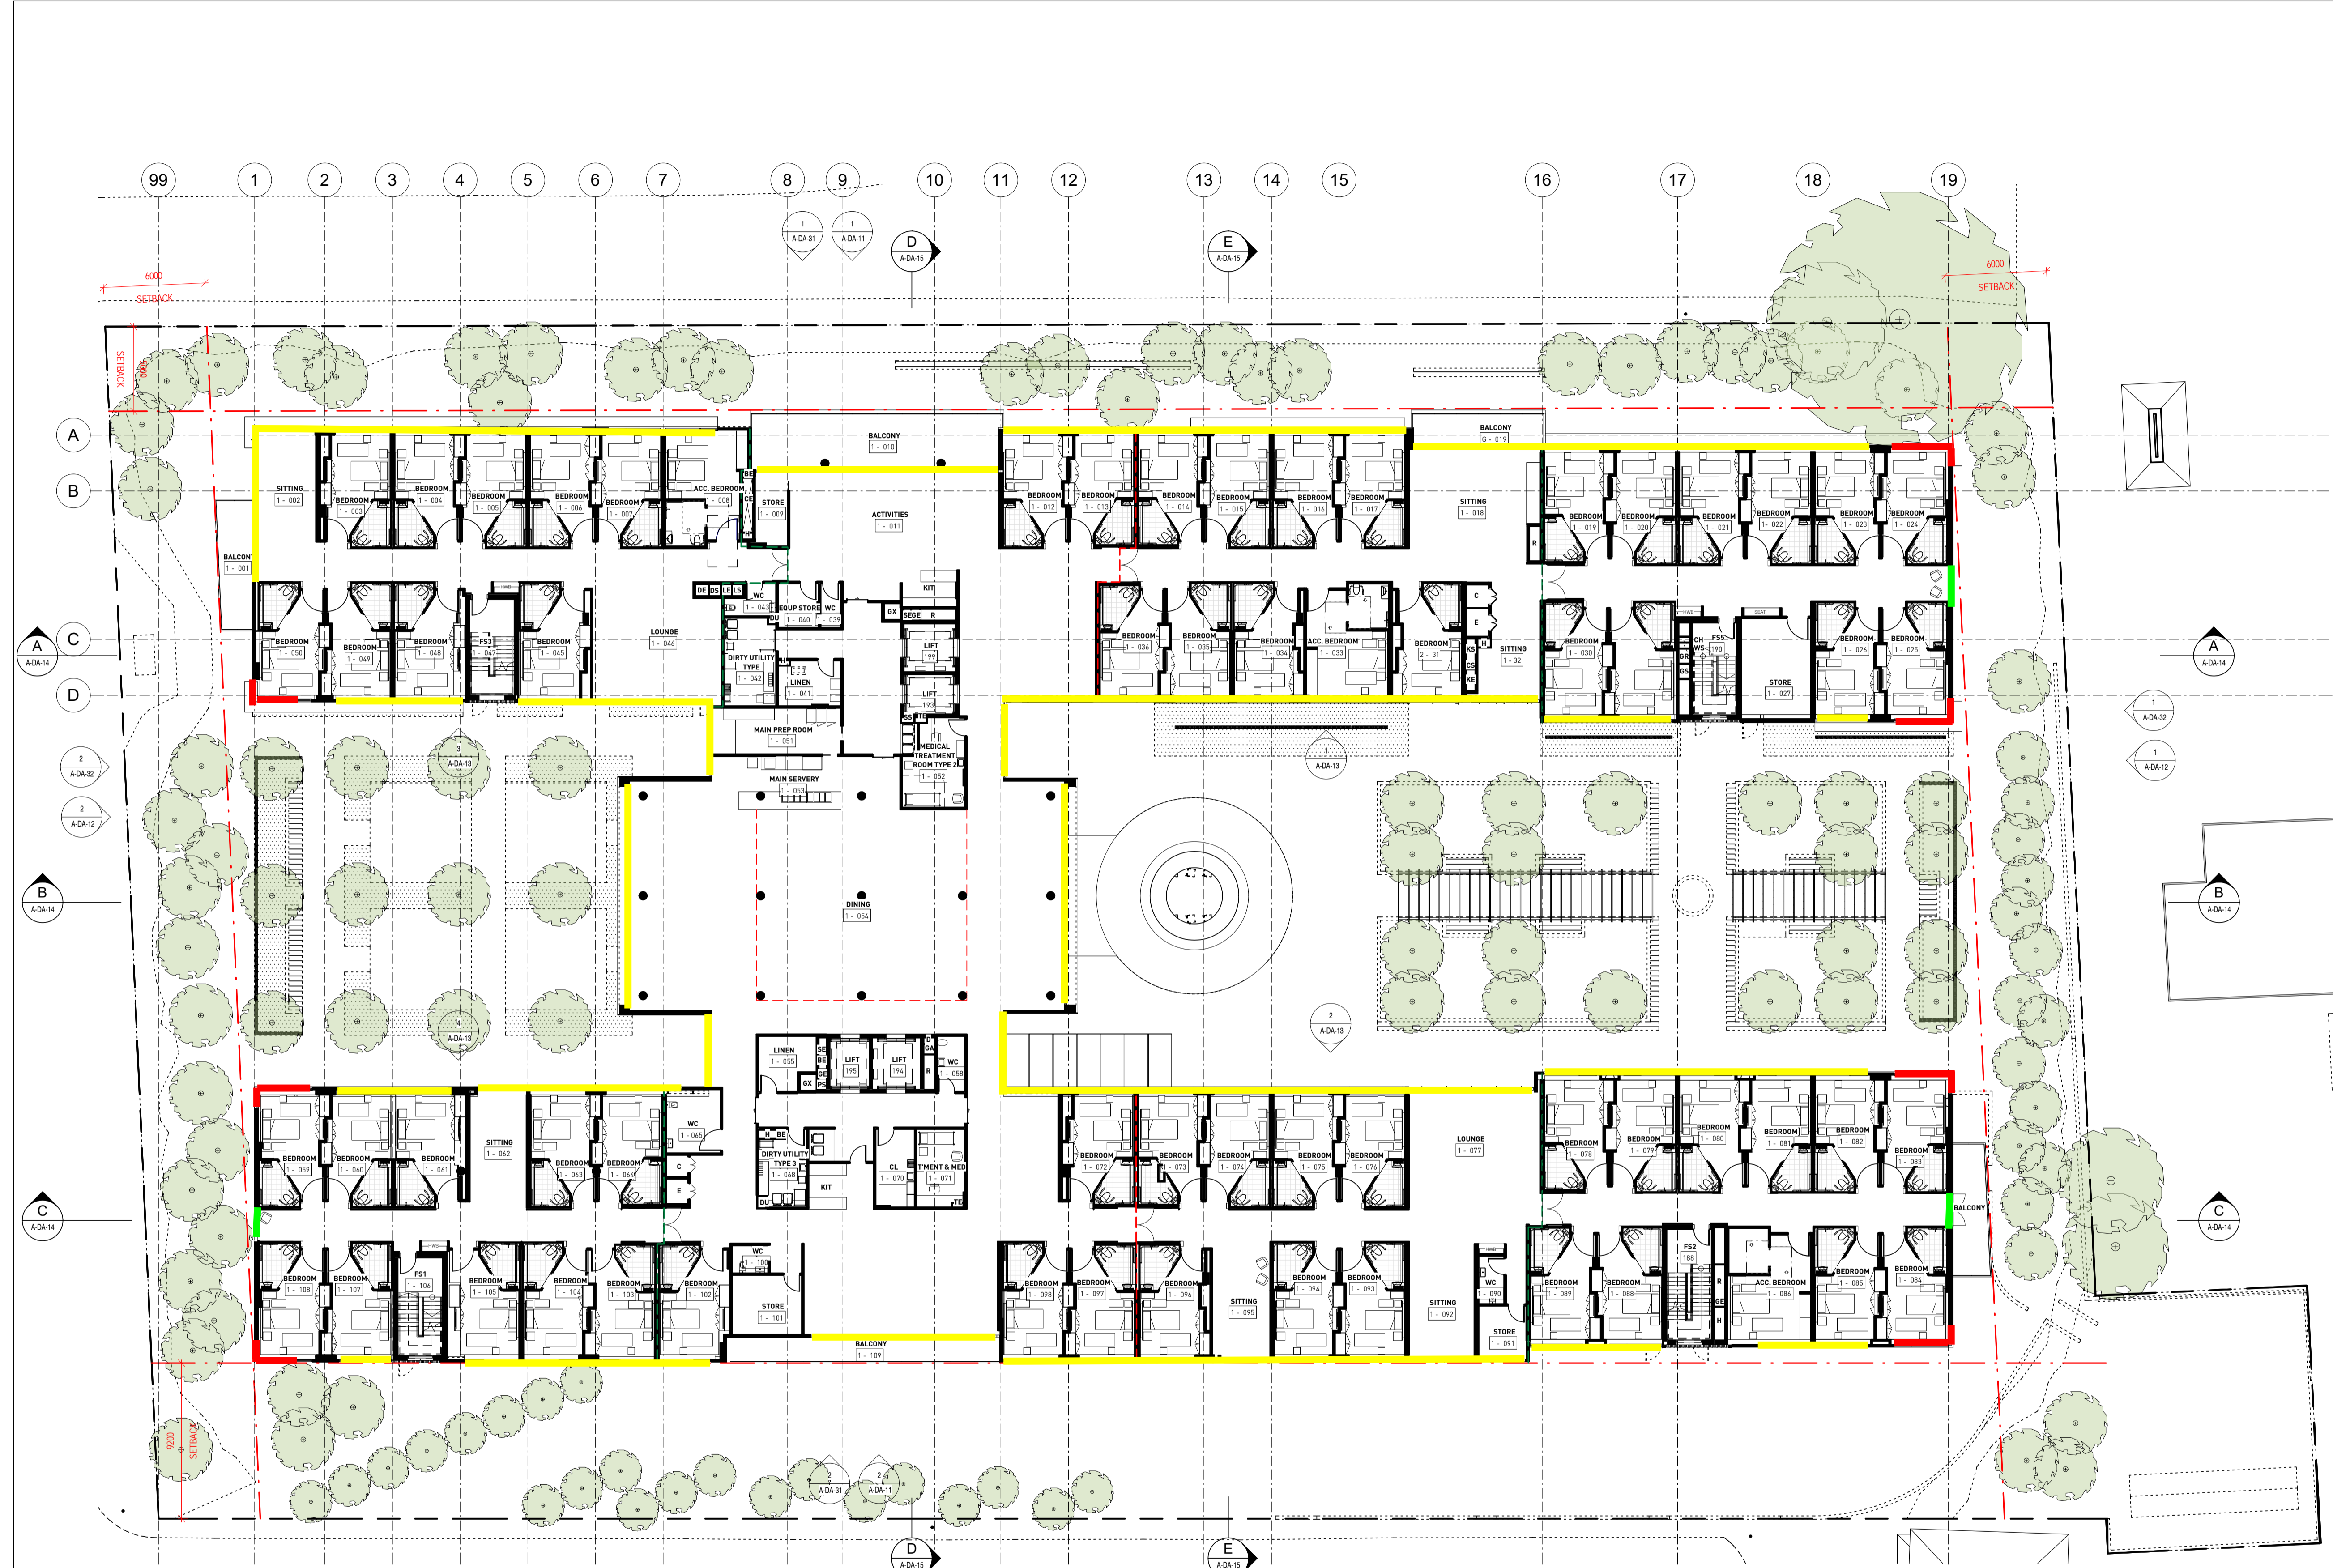

1 LEVEL 1 FLOOR PLAN
1 : 200

Key Plan:

Drawing Disclaimer:
Do not scale from drawings. Verify all dimensions on site before commencing work. Copying or reproduction of this drawing is strictly prohibited without the consent of PTW Architects

Section 4.55 SCOPE OF WORK
Internal layout of wings amended to give greater amenity and access to natural light.

LEGEND
--- SMOKE WALL
--- FIRE WALL

01	SECTION 4.55 ISSUE	PTW	18/09/18
Rv	Amendment	By Ck	Date

Consultant

Client
St Basils Homes
130 Croydon Street, Lakemba
02 9784 3200


Architect
PTW Architects
Level 11, 88 Phillip Street
Sydney NSW 2000 Australia
T +61 2 9232 5877
ptw.com.au

Peddie Thorp & Walker P/L
ABN 23 000 454 424
trading as PTW Architects

NSW Nominated Architects
S Parsons Architect No.6098
D Jones Architect No.4778

Project PA016906.01
St Basils Bexley
62 - 82 HARROW ROAD, BEXLEY, NSW
2207

Title
LEVEL 1 FLOOR PLAN
RL 37.492




Drawing Number A-DA-07
Revision 01

Status
SECTION 4.55

Appendix B: Unattended measurement data




bexley: Thursday 21 September, 2017

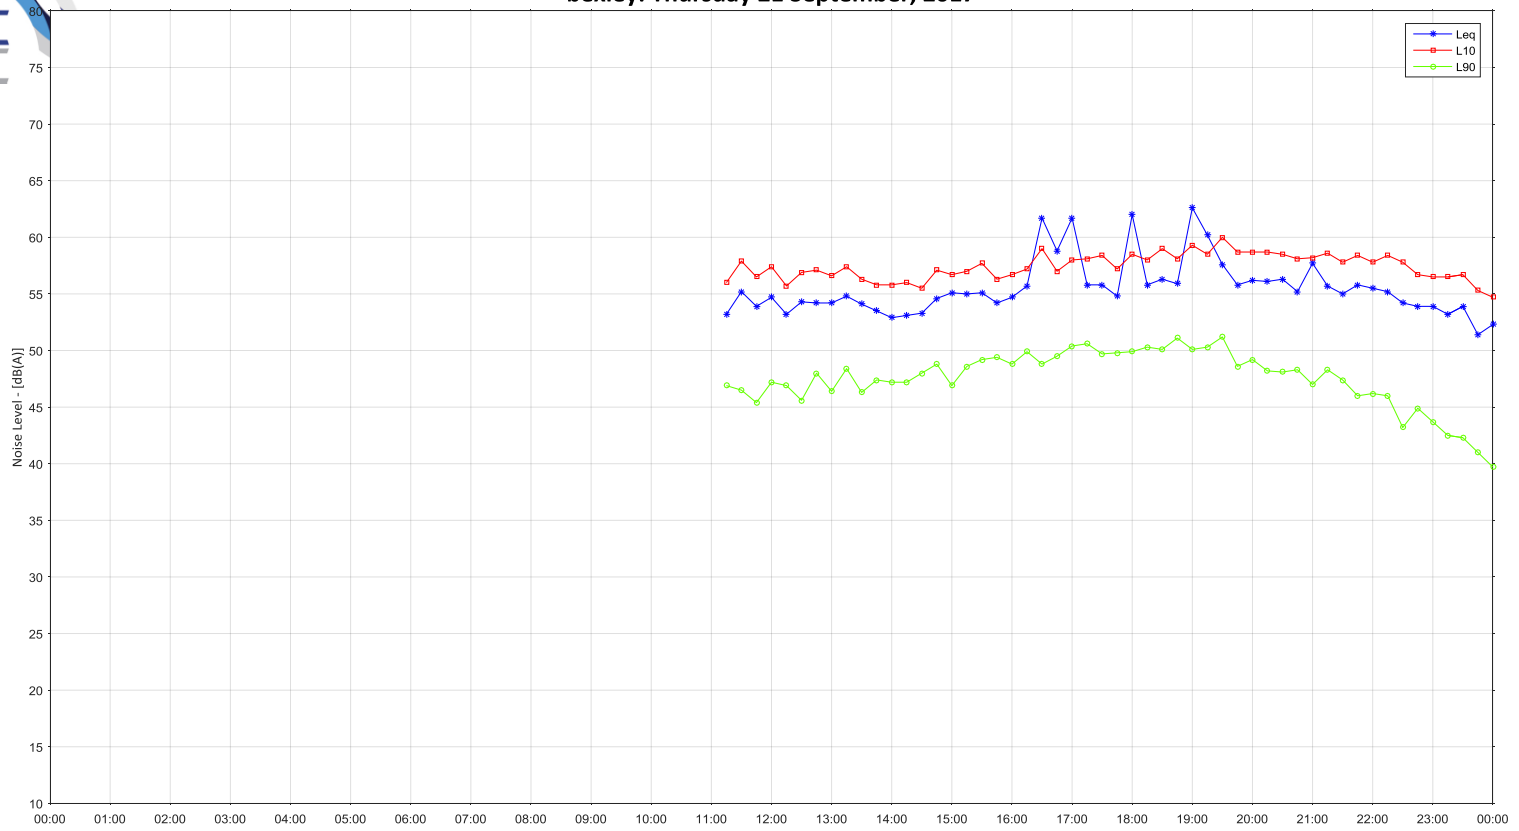




bexley: Friday 22 September, 2017

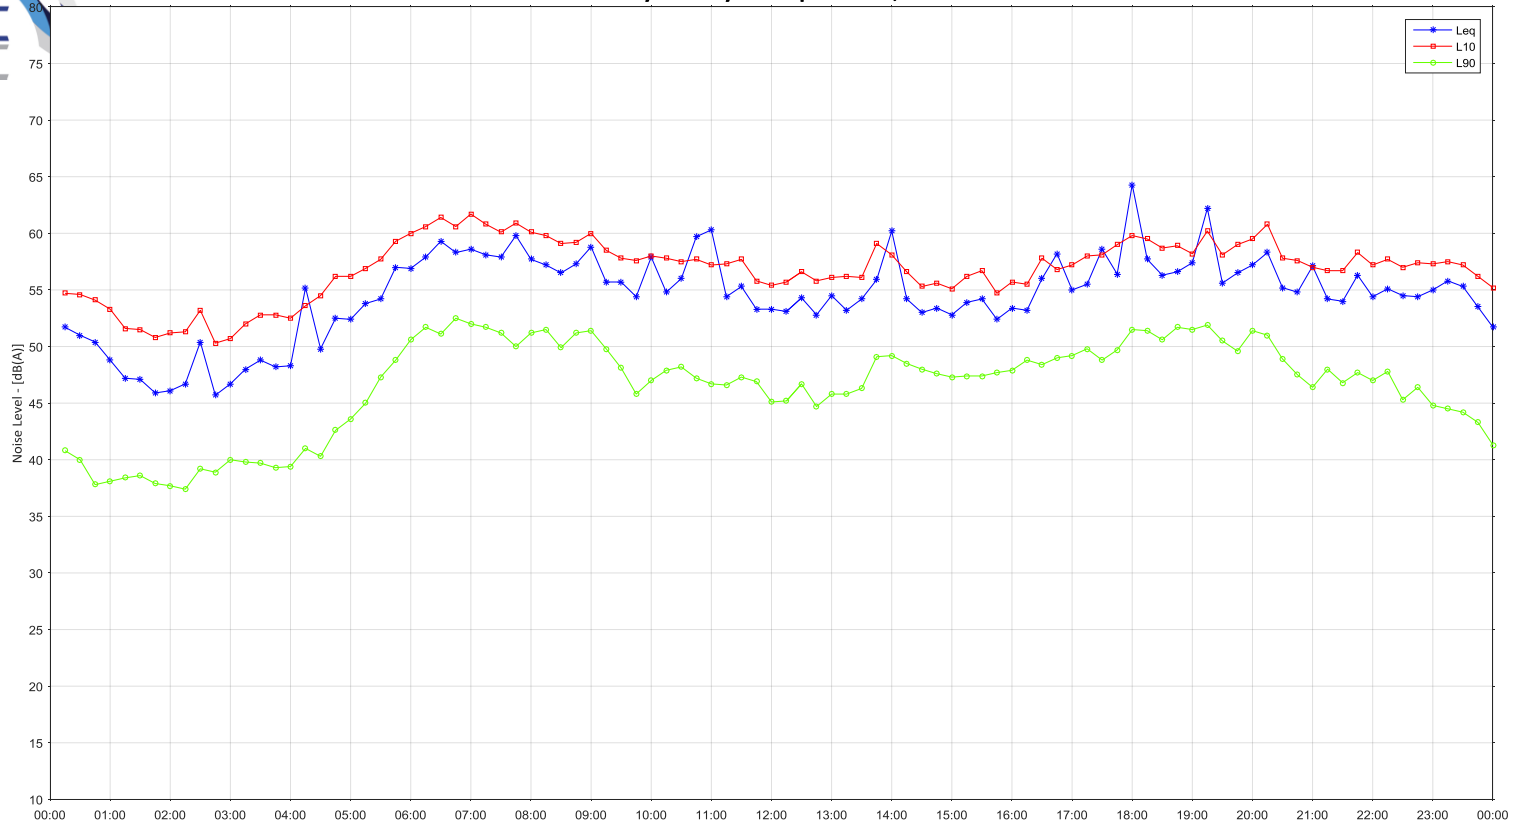




bexley: Saturday 23 September, 2017

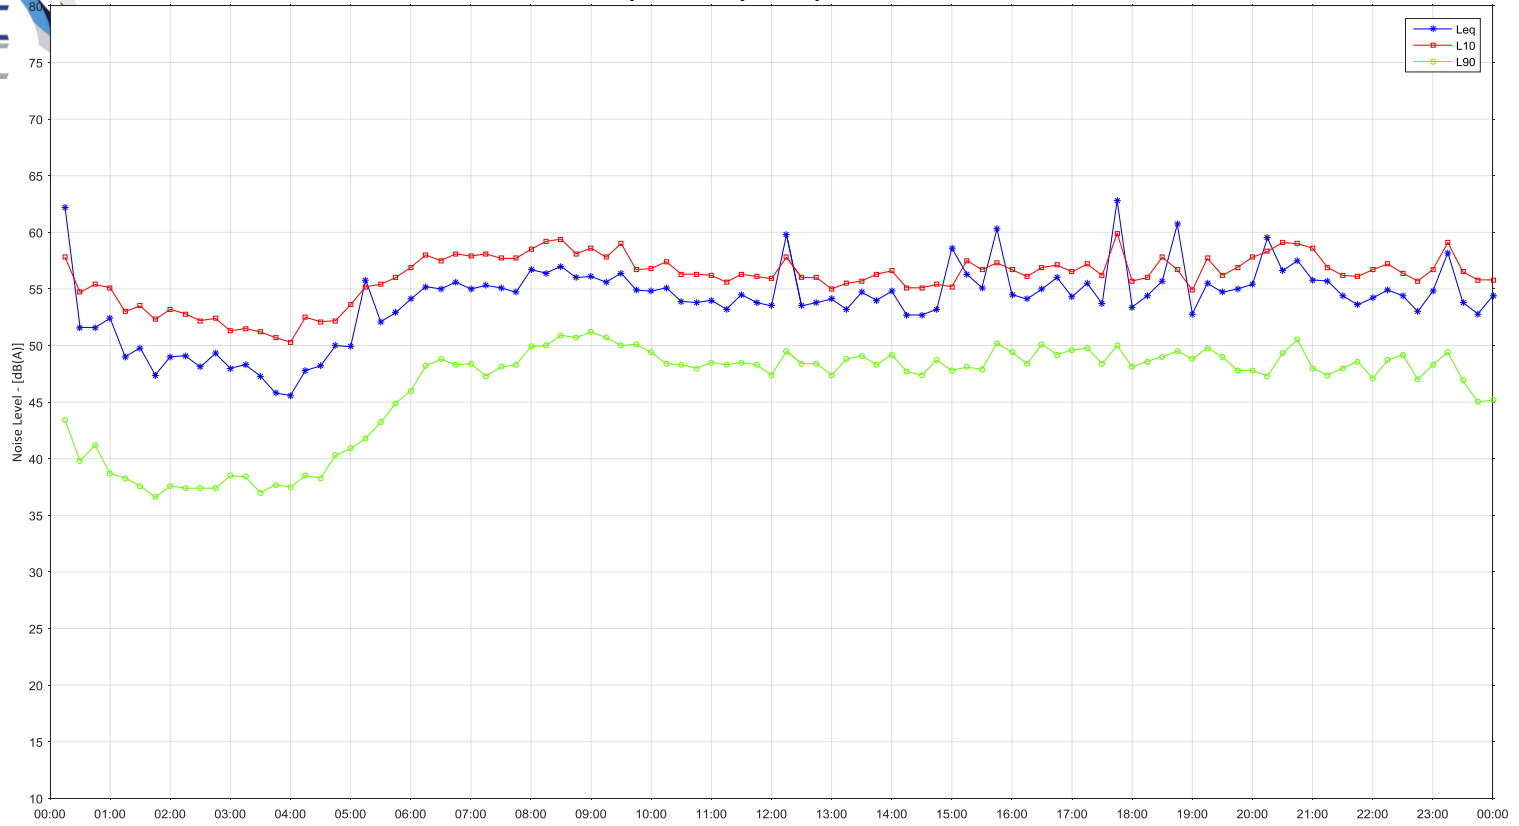




bexley: Sunday 24 September, 2017

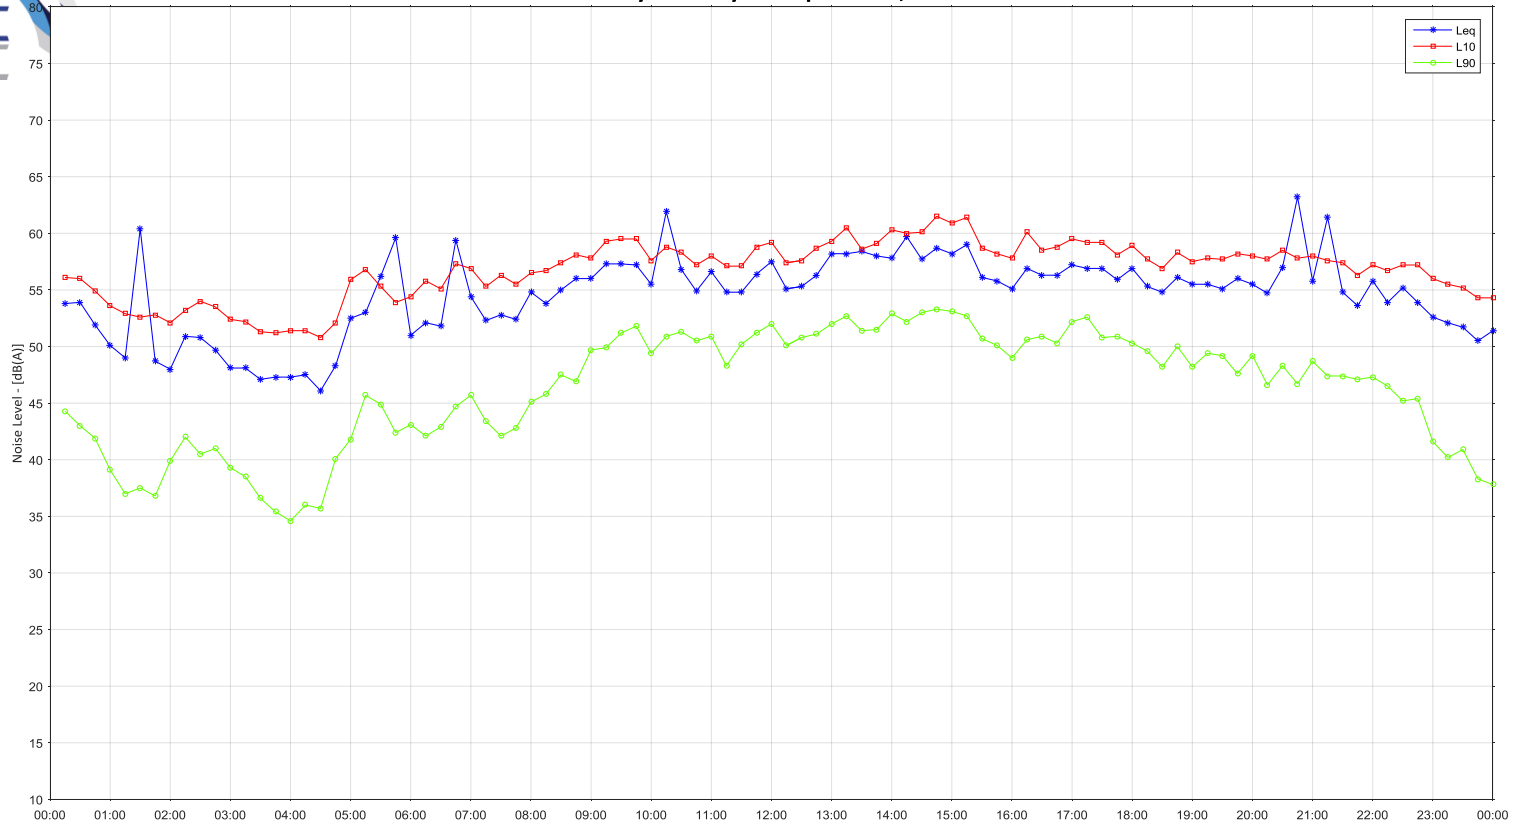




bexley: Monday 25 September, 2017

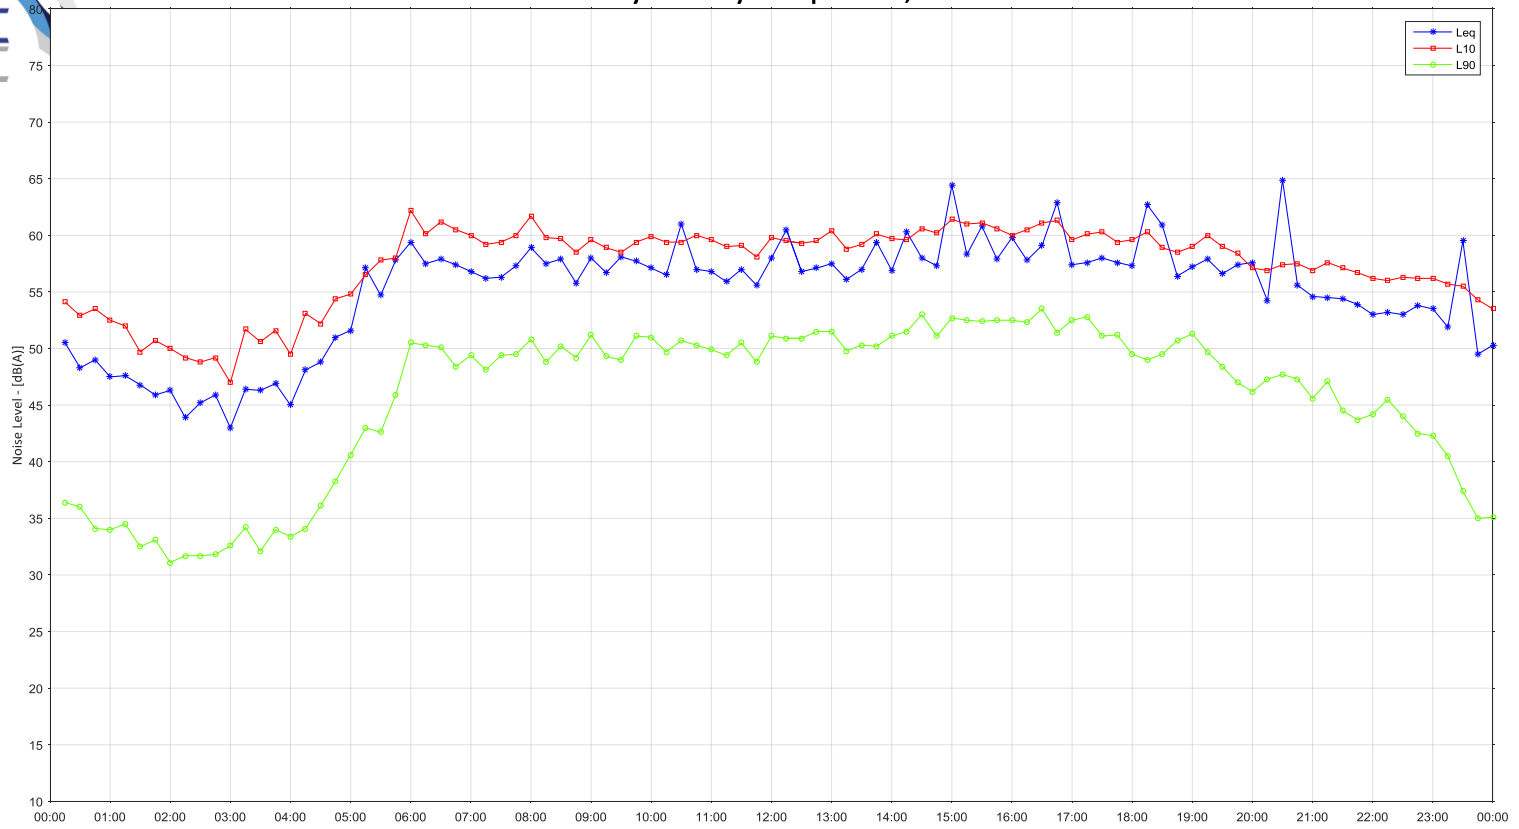




bexley: Tuesday 26 September, 2017

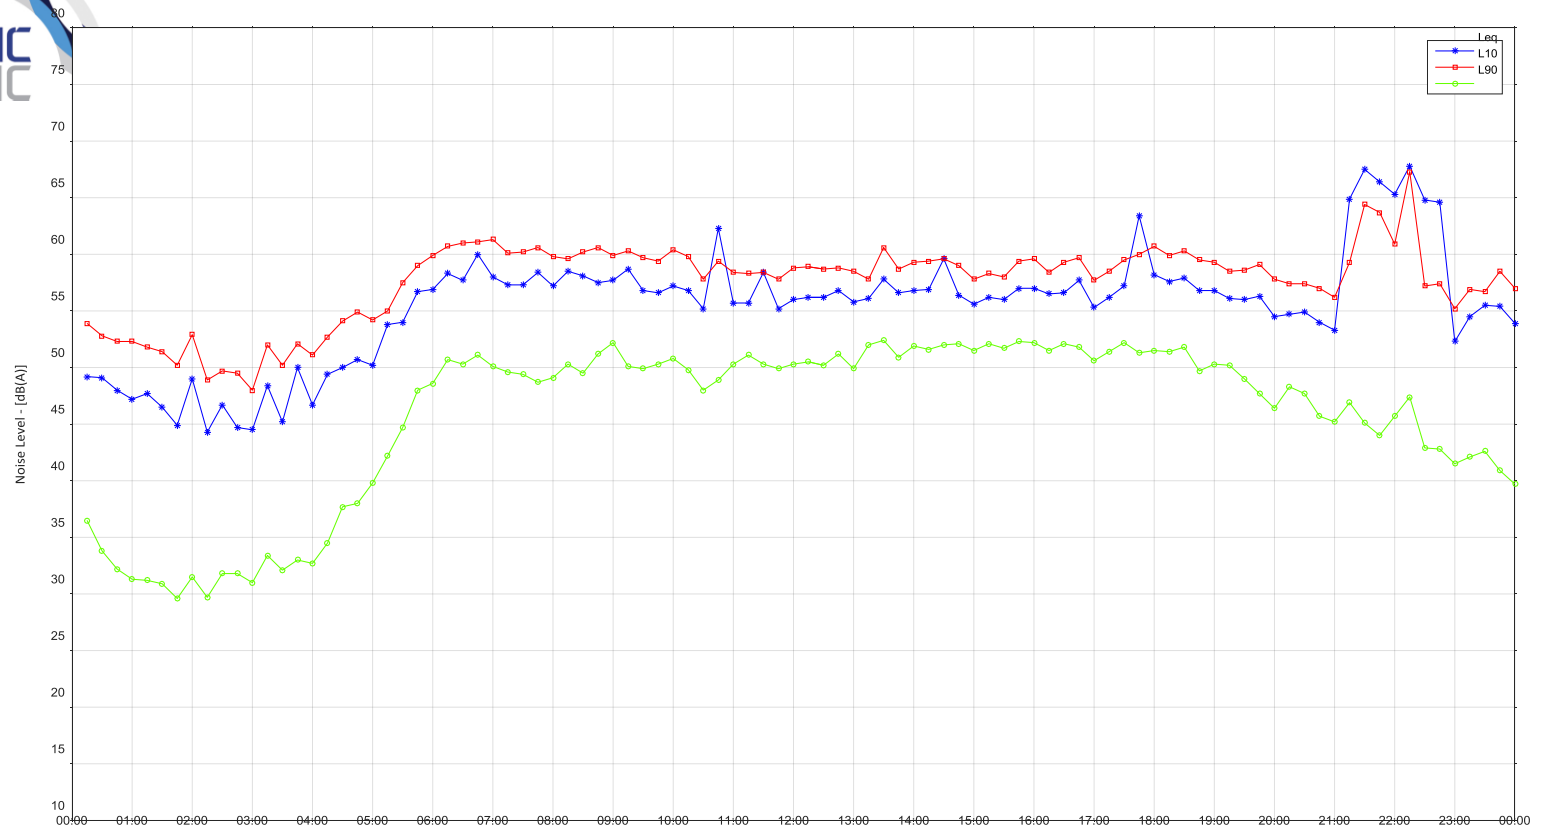




bexley: Wednesday 27 September, 2017

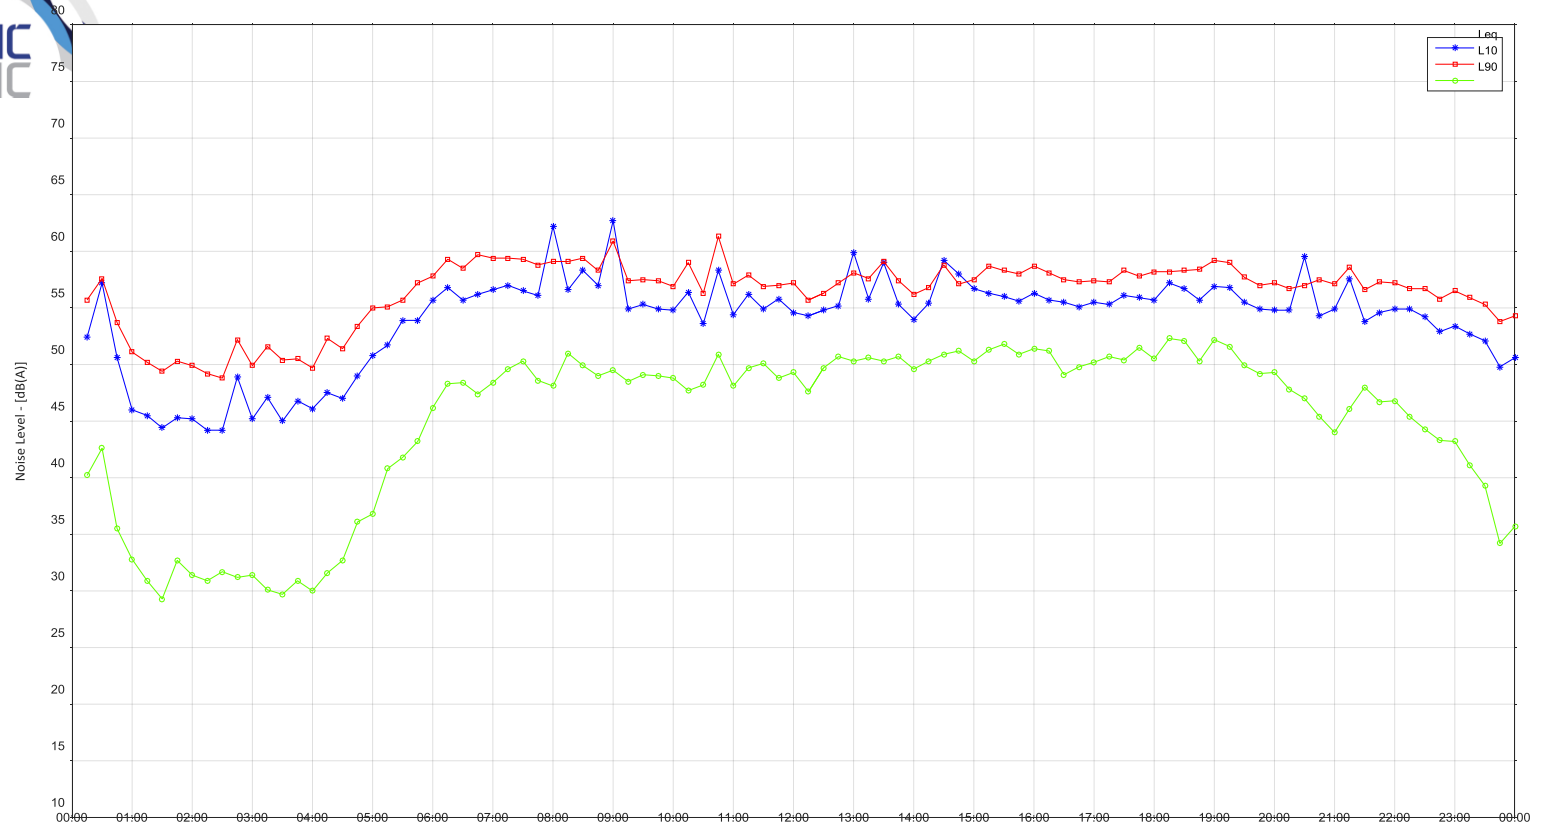




bexley: Thursday 28 September, 2017

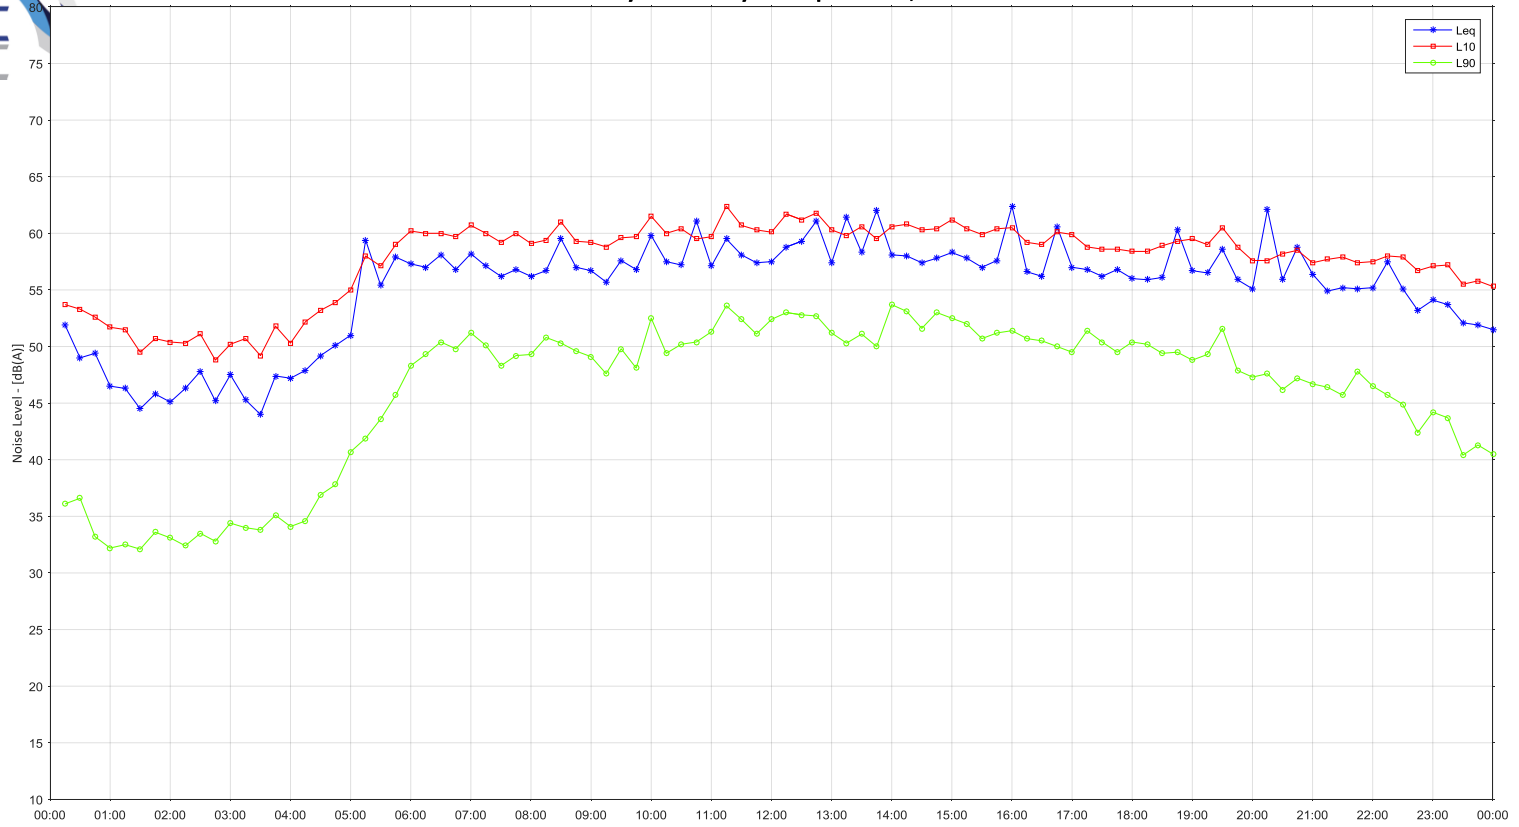




bexley: Friday 29 September, 2017

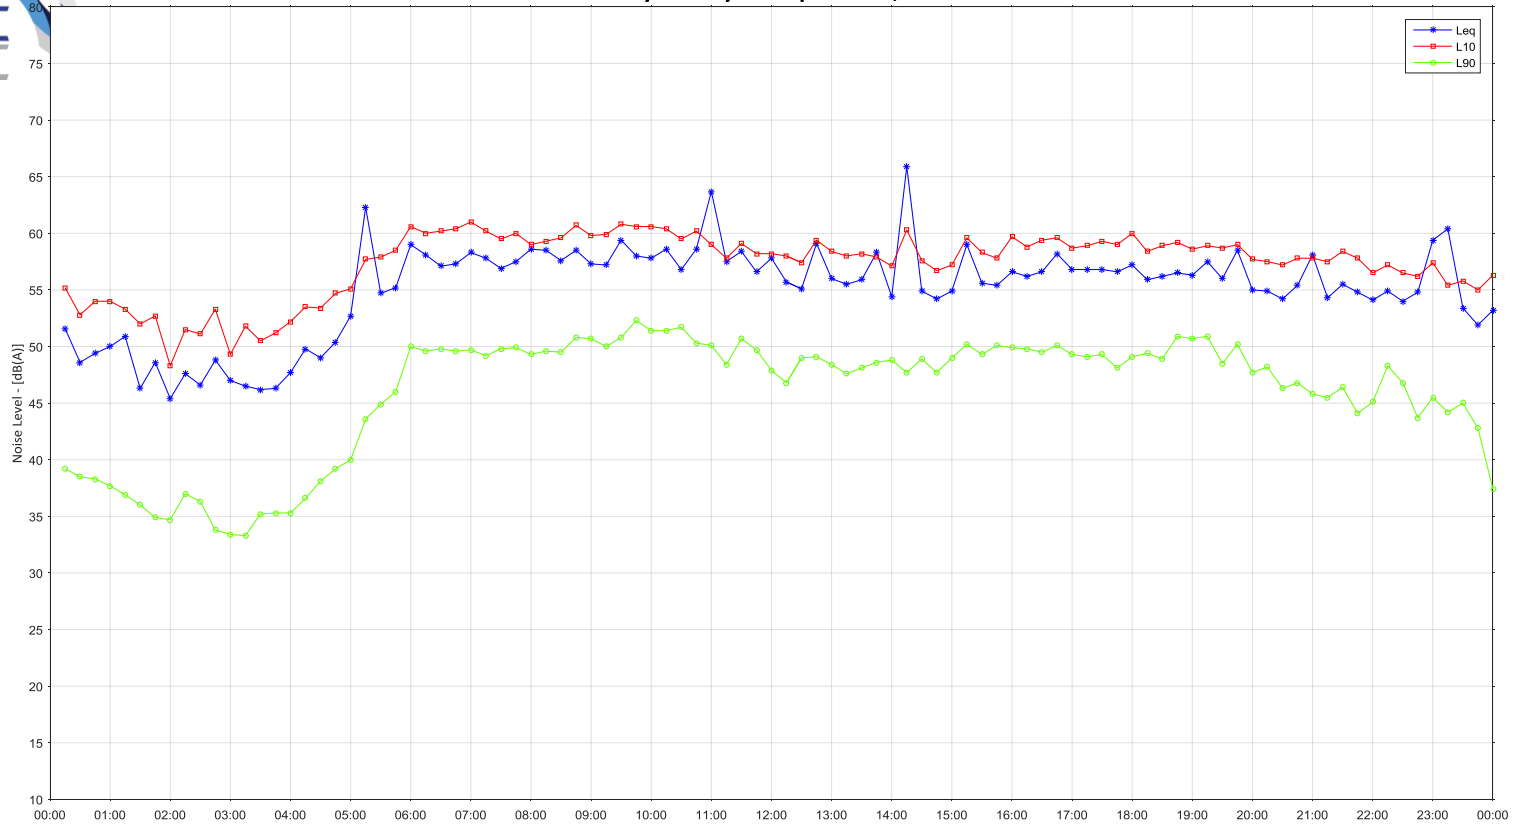




bexley: Saturday 30 September, 2017

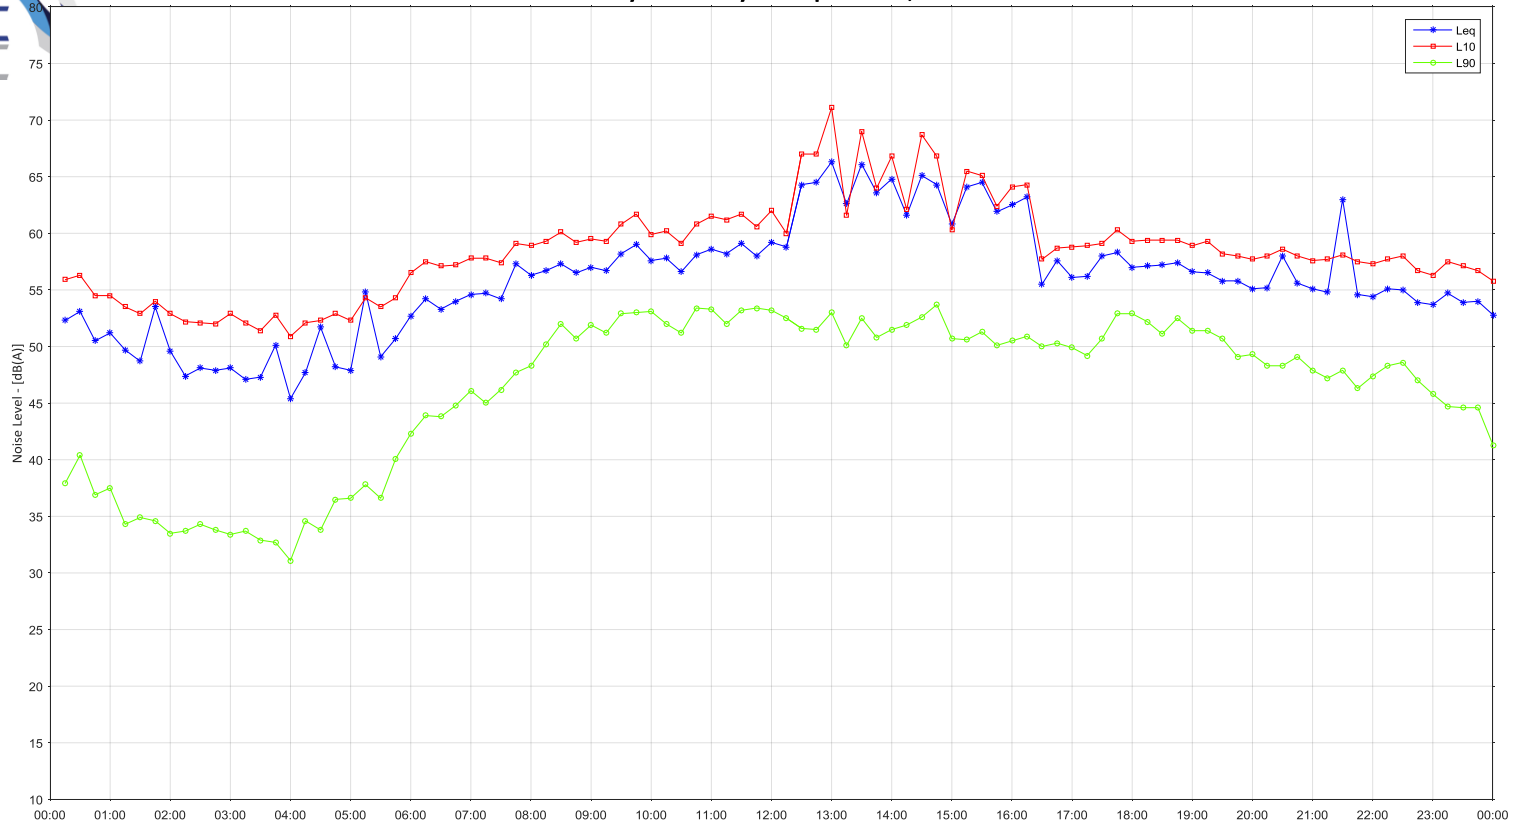




bexley: Sunday 01 October, 2017

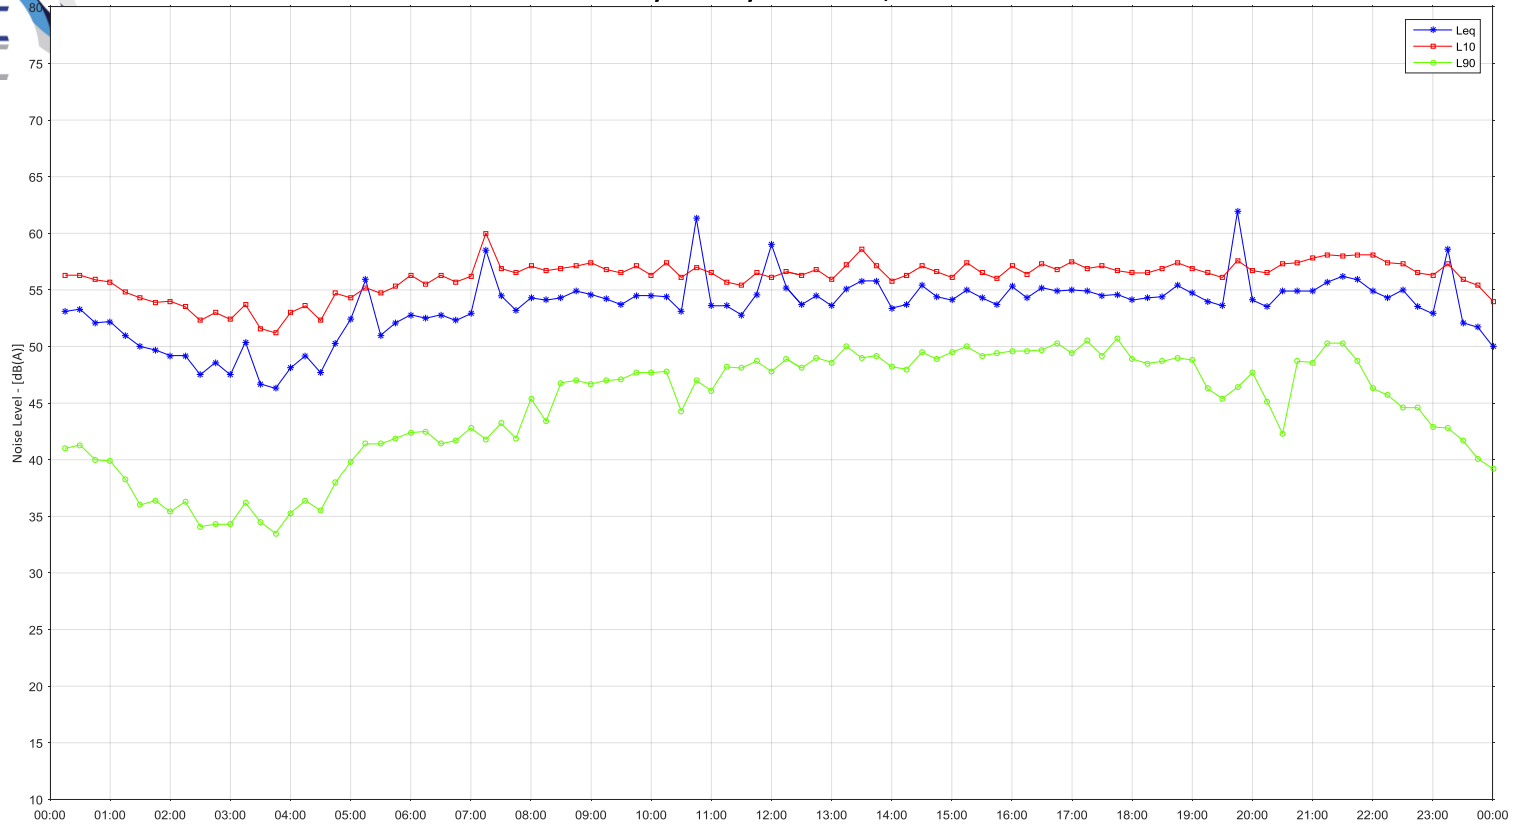



bexley: Monday 02 October, 2017

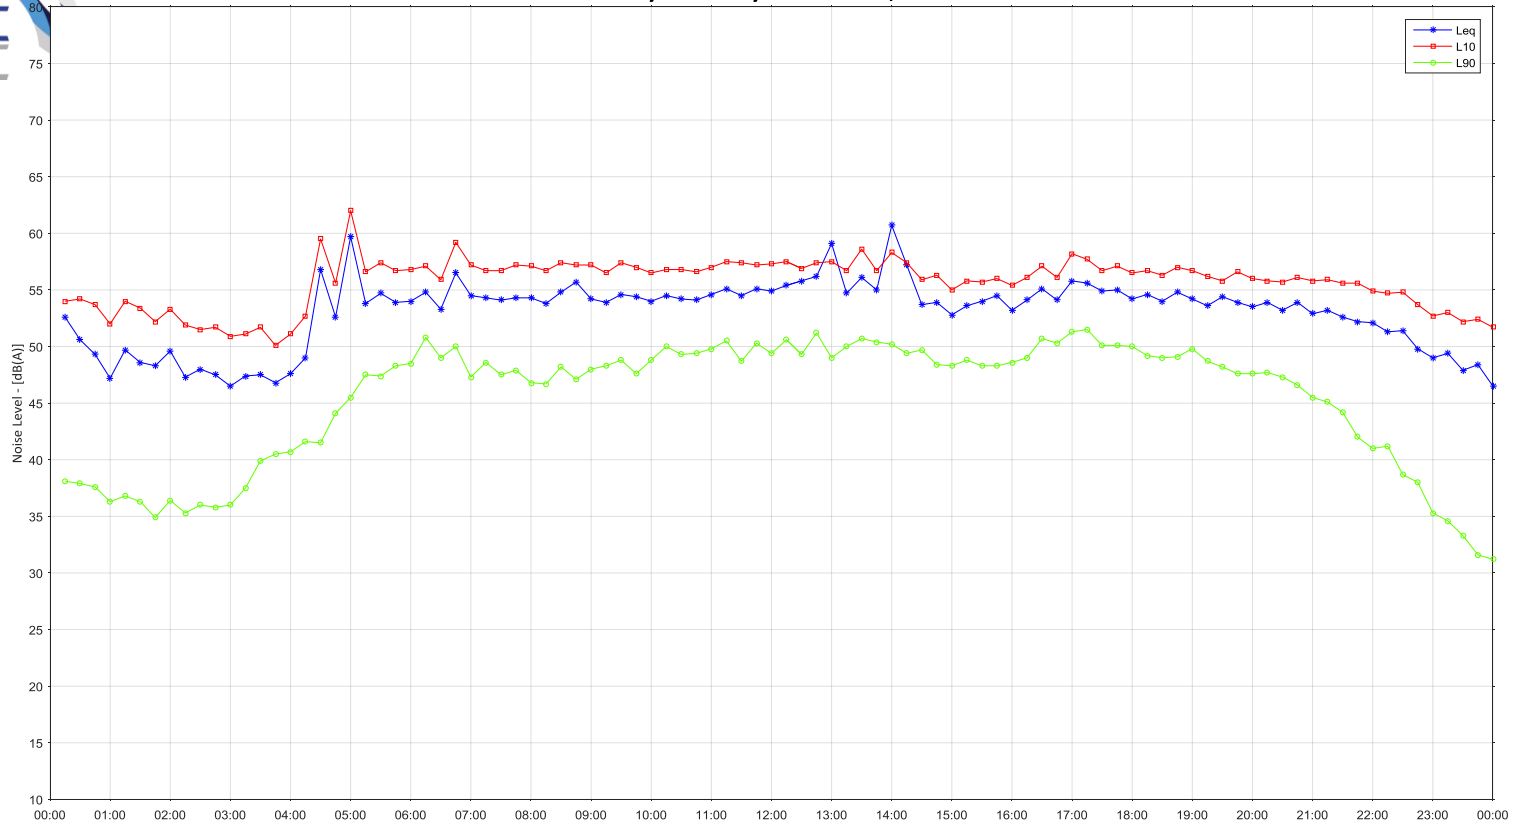



bexley: Tuesday 03 October, 2017

