

EVACUATION DIAGRAM

GUILDFORD MOSQUE

64 MOUNTFORD AVE., GUILDFORD, NSW 2162

LOWER BASEMENT

IN CASE OF FIRE

- R**EMOVE PEOPLE
- From immediate danger (if safe to do so)
- A**LERT OTHERS
- Dial 000 to notify the Fire Brigade
- C**ONFINE FIRE & SMOKE
- Close doors and windows (if safe to do so)
- E**VACUATE
- The building via the nearest designated or safe exit

EVACUATION PROCEDURES



- On activation of the smoke alarm system or when directed by a member of the Emergency Control Organization:
- Evacuate the building via the designated exit or nearest safe exit.
- Proceed to the nominated Assembly Area and remain there until otherwise directed by a member of the Emergency Control Organization or Emergency Services.

000
EMERGENCY

In a life threatening emergency dial 000

DRAWN:	DBM	DWG No:	CEP -ED-LB01
CHECKED:	ML	REVISION:	0
DATE OF ISSUE:	11/01/2019		
DATE OF VALIDATION:	11/01/2024		

ASSEMBLY AREA

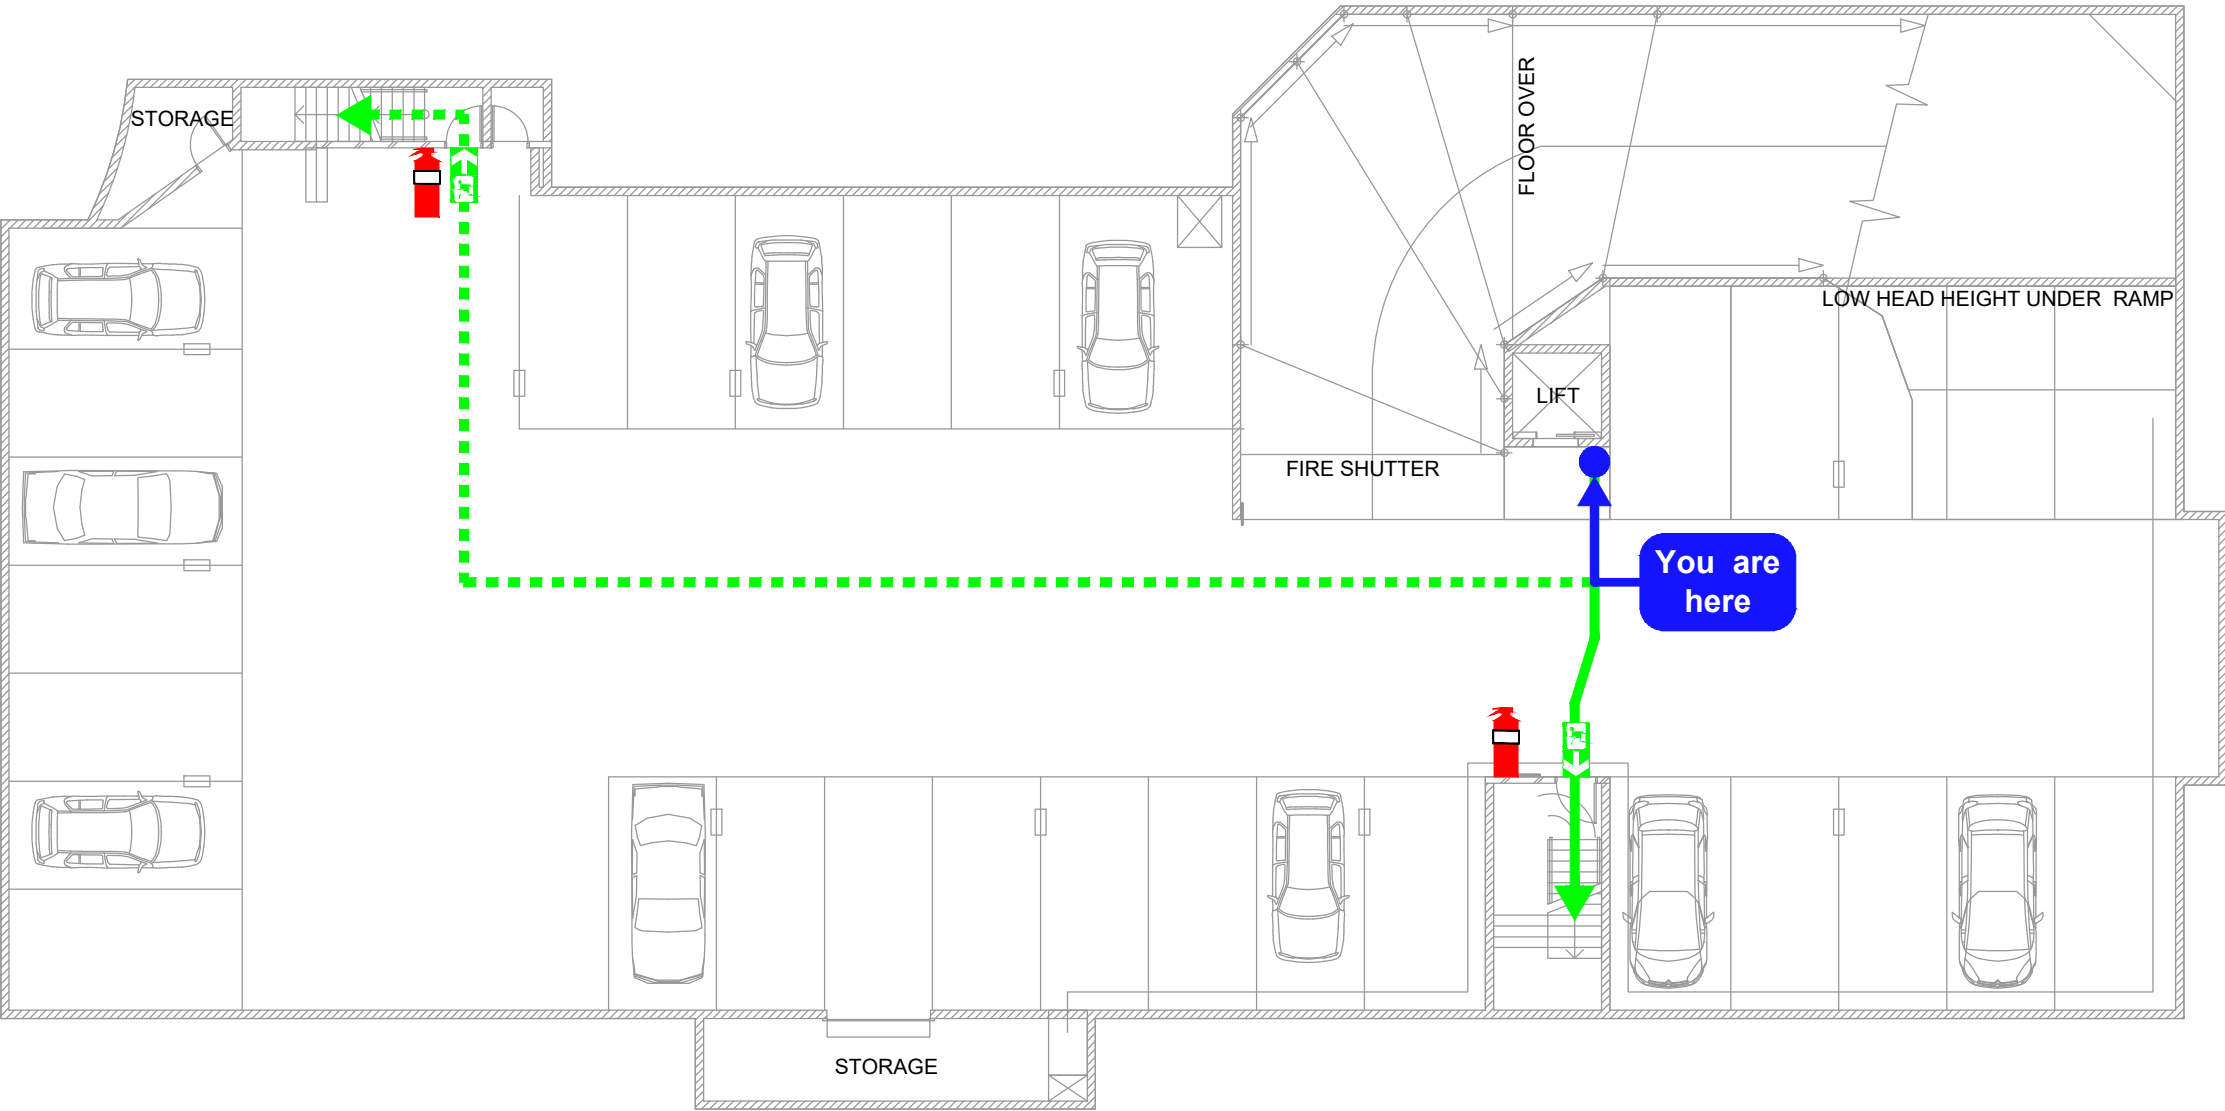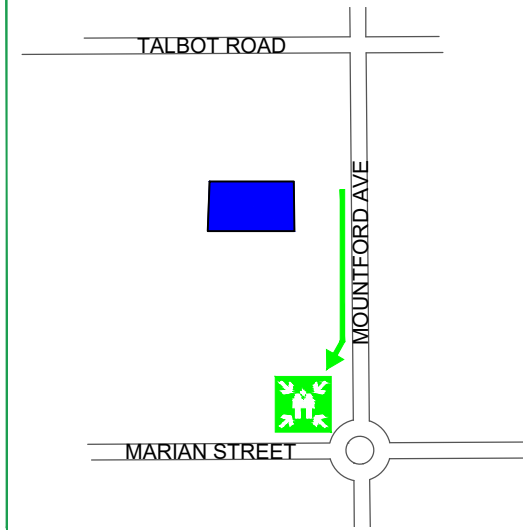

LEGEND

- Emergency Exit
- Exit Path
- Extinguisher - Dry Chemical
- Assembly Area
- Alternate Exit Path

EVACUATION DIAGRAM

GUILDFORD MOSQUE

64 MOUNTFORD AVE., GUILDFORD, NSW 2162

UPPER BASEMENT

IN CASE OF FIRE

- R**EMOVE PEOPLE
 - From immediate danger (if safe to do so)
- A**LERT OTHERS
 - Dial 000 to notify the Fire Brigade
- C**ONFINE FIRE & SMOKE
 - Close doors and windows (if safe to do so)
- E**VACUATE
 - The building via the nearest designated or safe exit

EVACUATION PROCEDURES

- On activation of the smoke alarm system or when directed by a member of the Emergency Control Organization:
- Evacuate the building via the designated exit or nearest safe exit.
 - Proceed to the nominated Assembly Area and remain there until otherwise directed by a member of the Emergency Control Organization or Emergency Services.




000
EMERGENCY

In a life threatening emergency dial 000





POLICE
NSW



DRAWN:	DBM	DWG No:	CEP-ED-UB01
CHECKED:	ML	REVISION:	0
DATE OF ISSUE:	11/01/2019		
DATE OF VALIDATION:	11/01/2024		

ASSEMBLY AREA

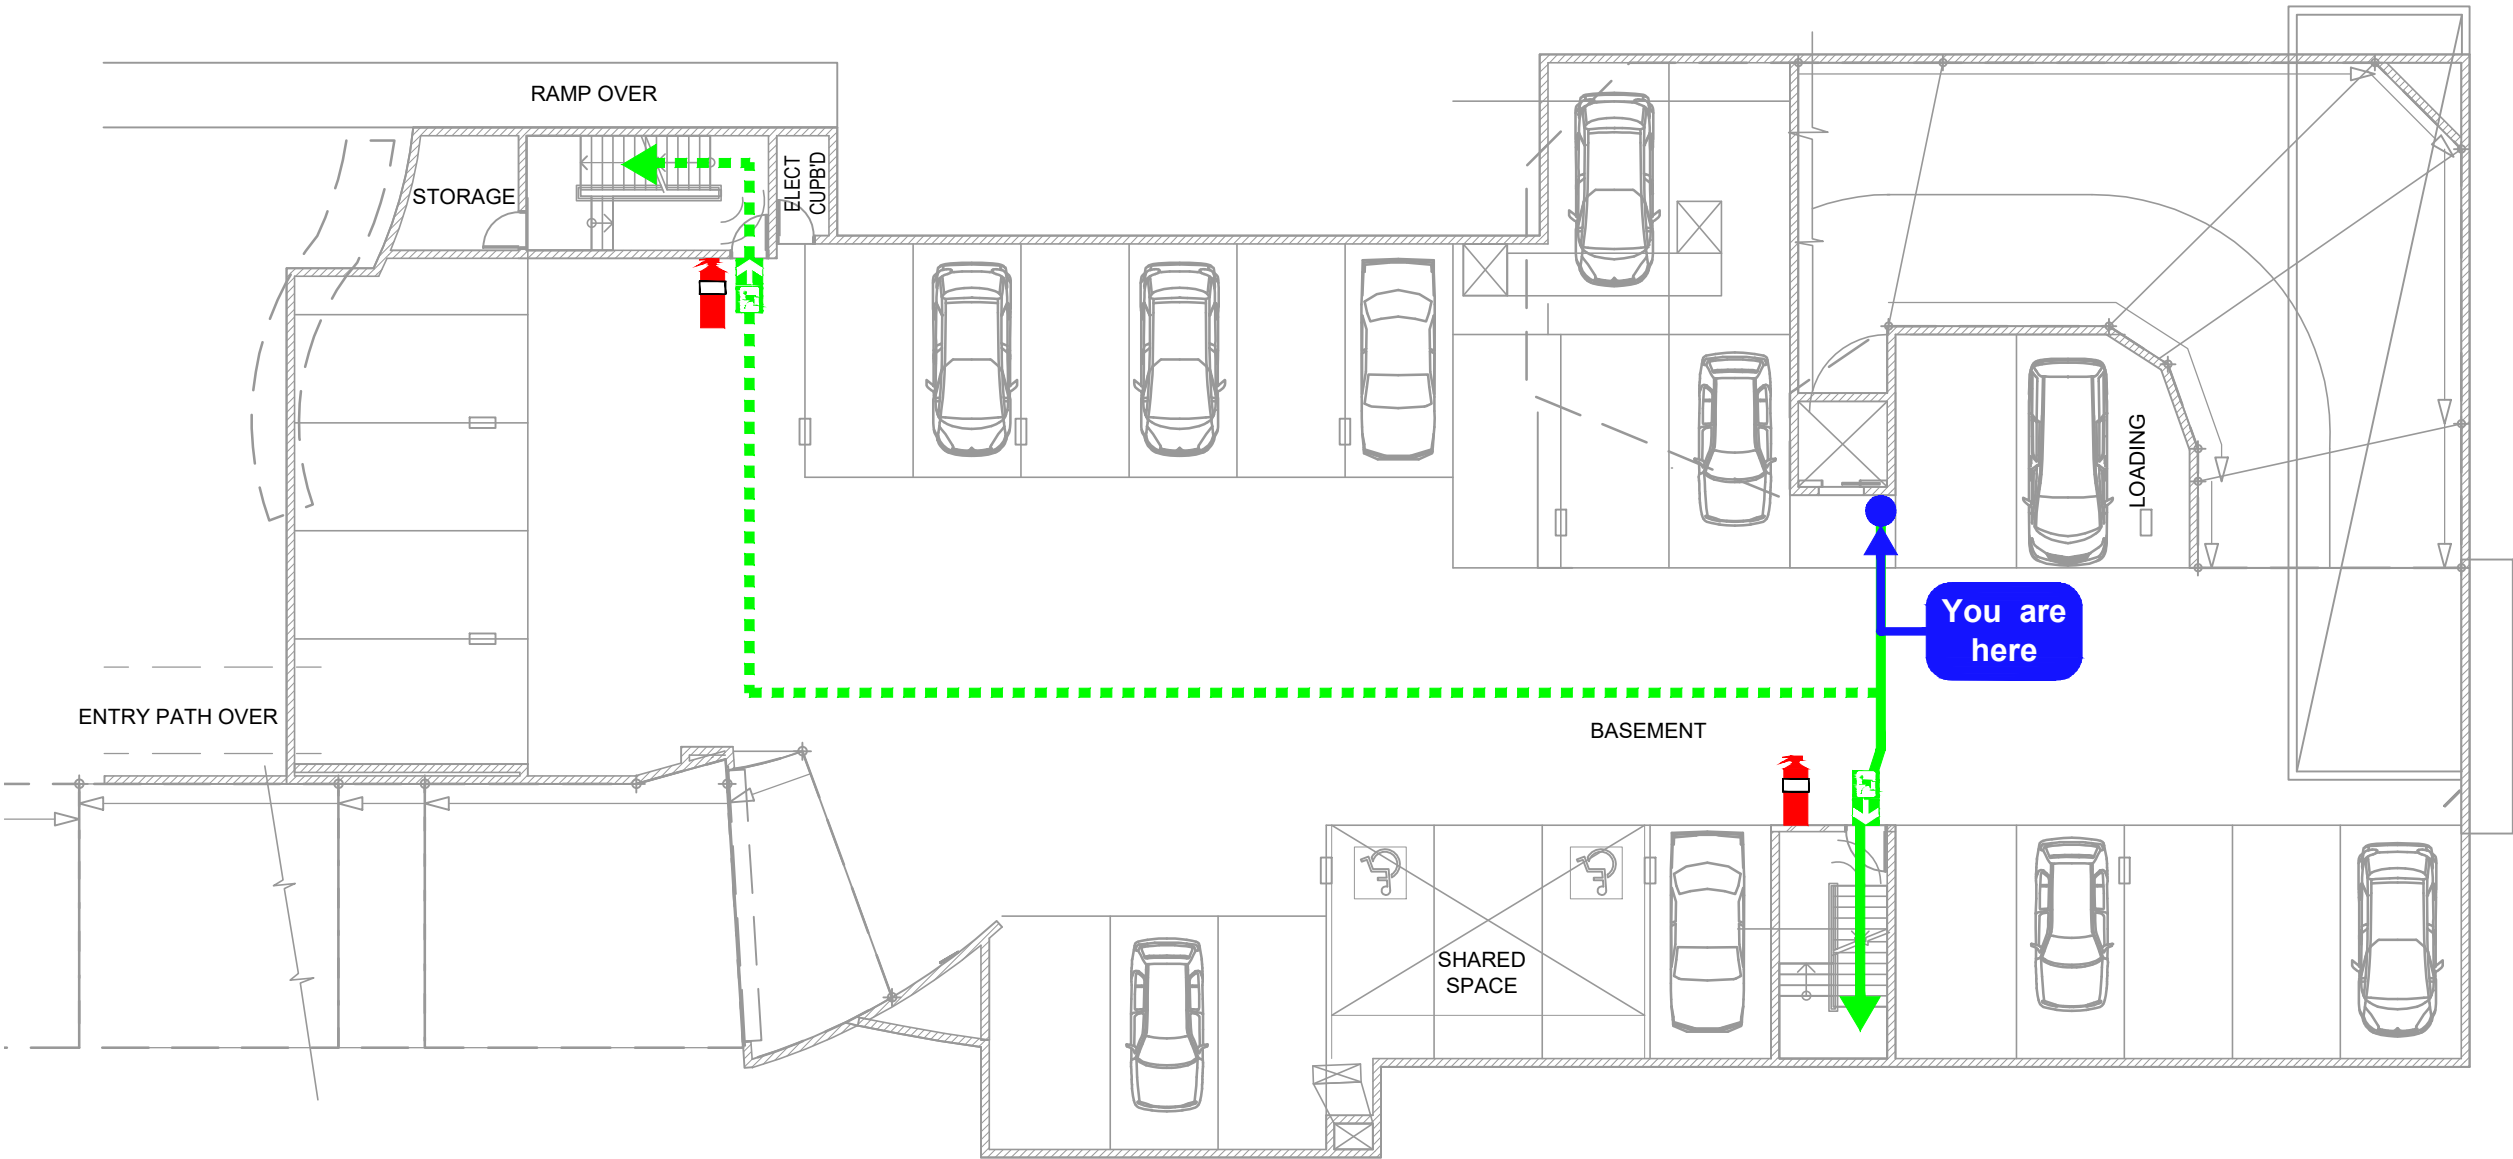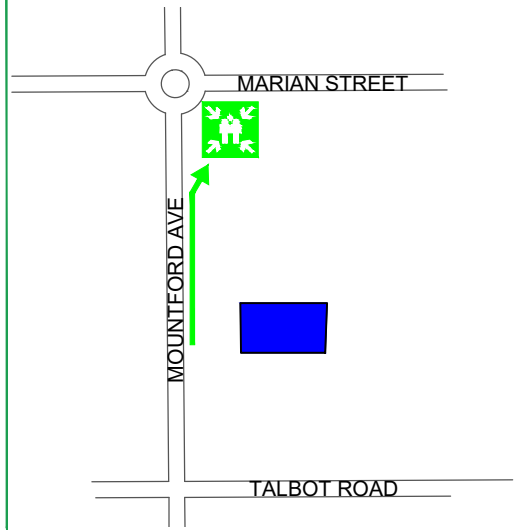

LEGEND

-  Emergency Exit
-  Exit Path
-  Extinguisher - Dry Chemical
-  Assembly Area
-  Alternate Exit Path

EVACUATION DIAGRAM

GUILDFORD MOSQUE

64 MOUNTFORD AVE., GUILDFORD, NSW 2162

LEVEL 1

IN CASE OF FIRE

- R**EMOVE PEOPLE
- From immediate danger (if safe to do so)
- A**LERT OTHERS
- Dial 000 to notify the Fire Brigade
- C**ONFINE FIRE & SMOKE
- Close doors and windows (if safe to do so)
- E**VACUATE
- The building via the nearest designated or safe exit


EVACUATION PROCEDURES

- On activation of the smoke alarm system or when directed by a member of the Emergency Control Organization:
- Evacuate the building via the designated exit or nearest safe exit.
- Proceed to the nominated Assembly Area and remain there until otherwise directed by a member of the Emergency Control Organization or Emergency Services.




000
EMERGENCY

In a life threatening emergency dial 000





POLICE
NSW



DRAWN:	DBM	DWG No:	CEP-ED-L101
CHECKED:	ML	REVISION:	0
DATE OF ISSUE:	11/01/2019		
DATE OF VALIDATION:	11/01/2024		

ASSEMBLY AREA

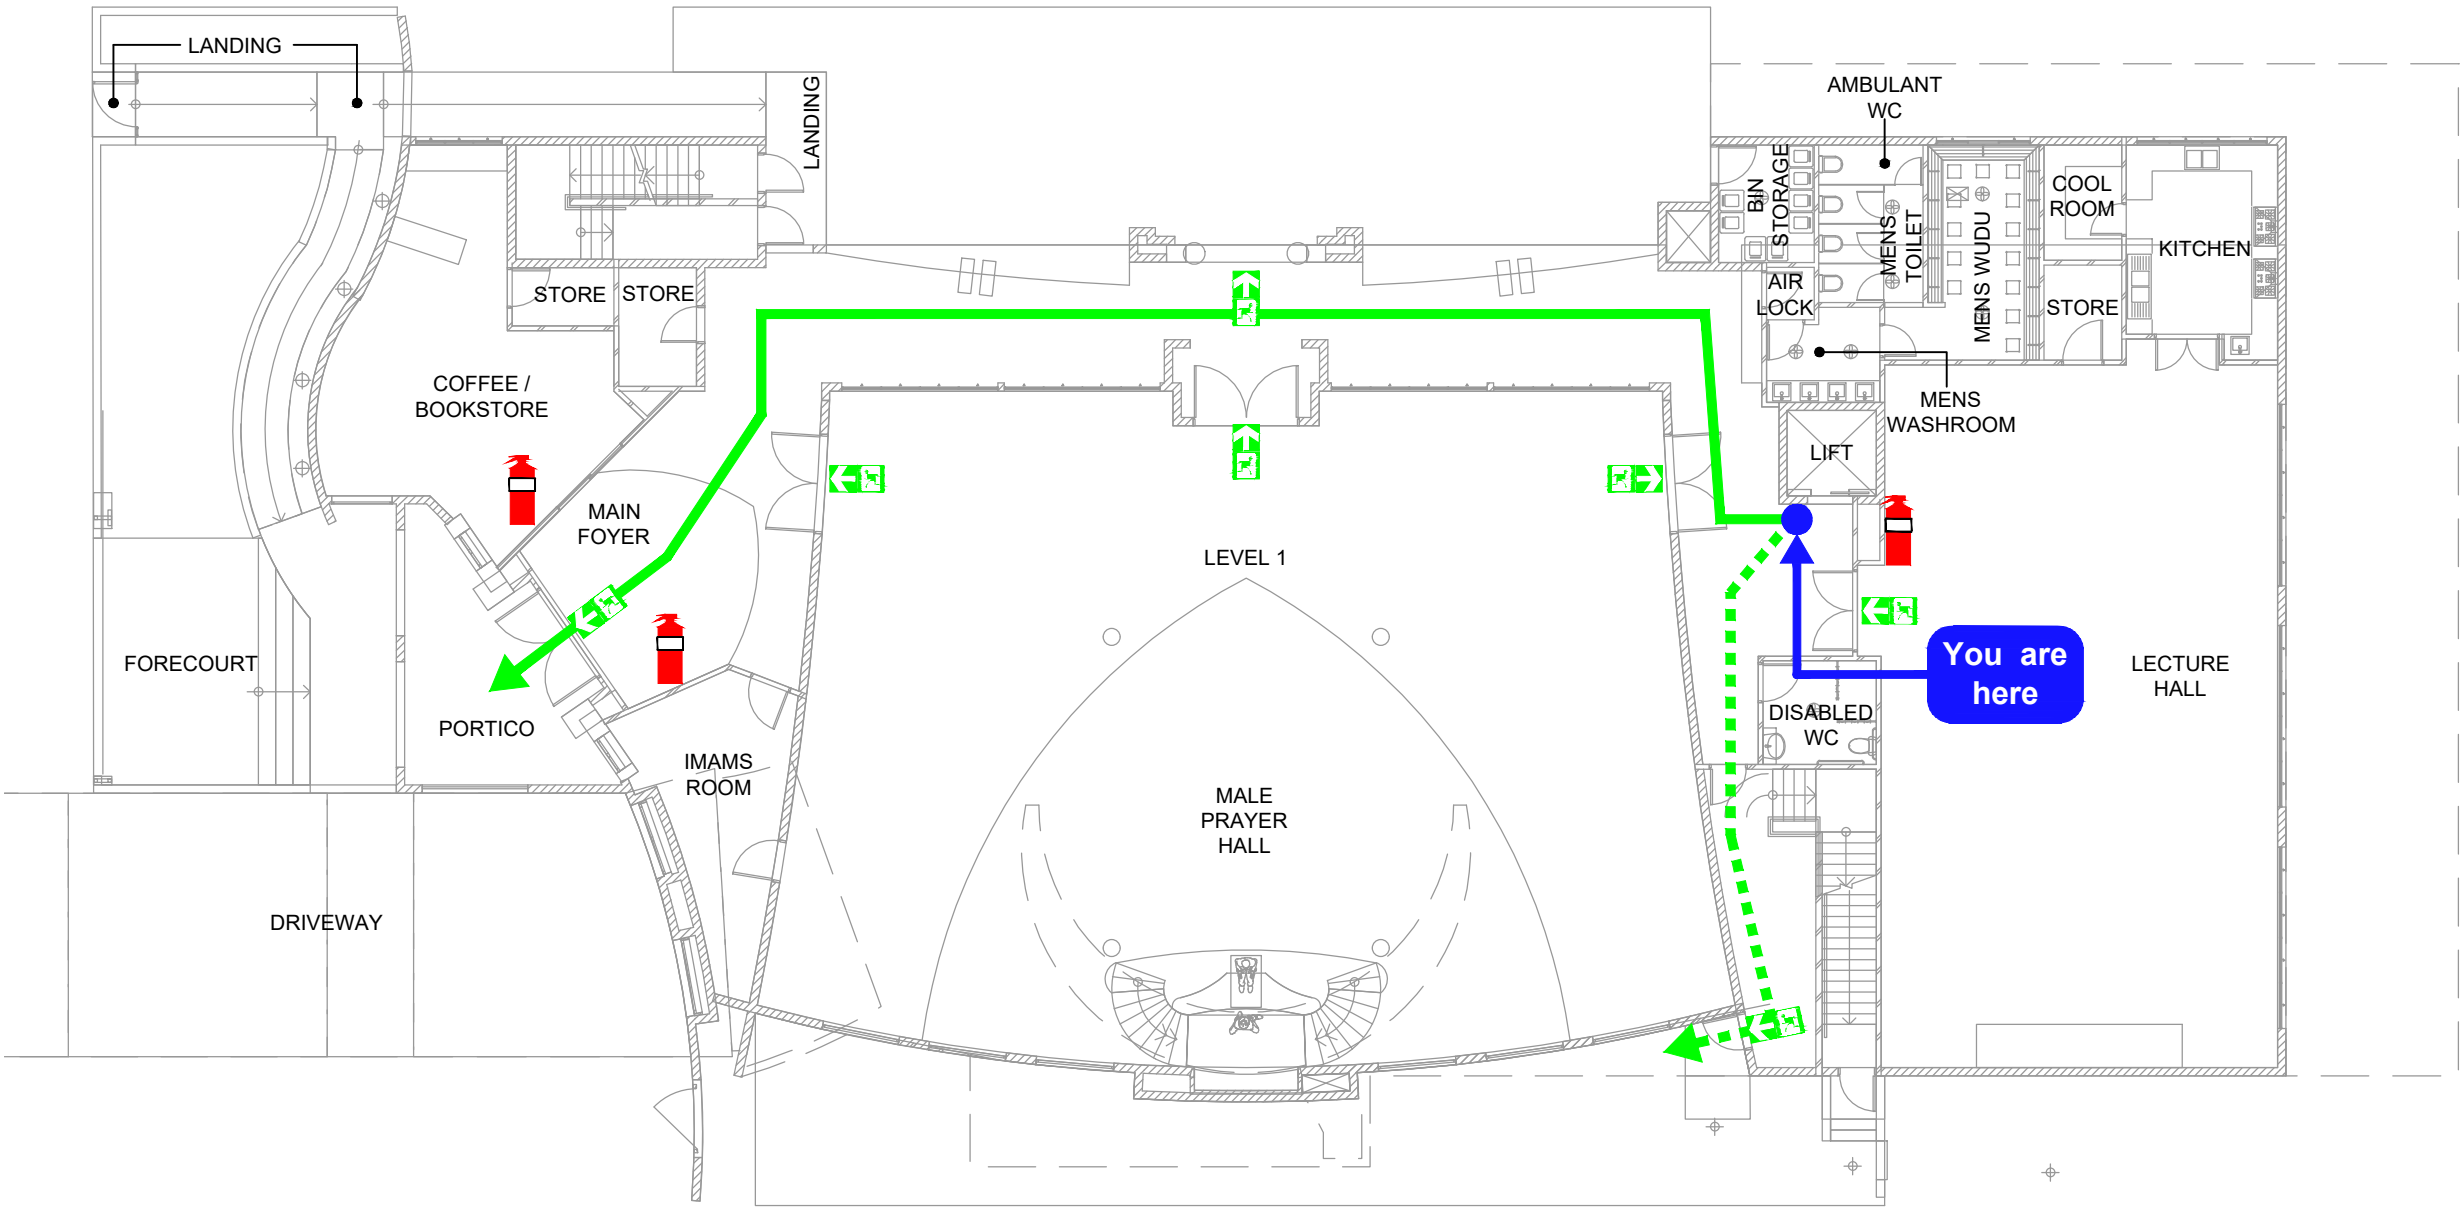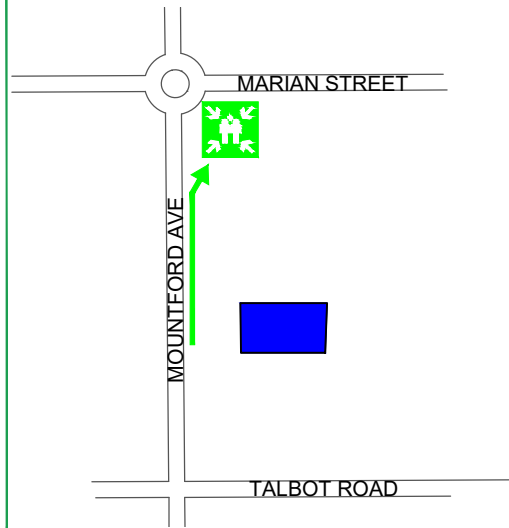

LEGEND

 Emergency Exit

 Exit Path

 Extinguisher - Dry Chemical

 Assembly Area

 Alternate Exit Path

EVACUATION DIAGRAM

GUILDFORD MOSQUE

64 MOUNTFORD AVE., GUILDFORD, NSW 2162

LEVEL 2


IN CASE OF FIRE

- R**EMOVE PEOPLE
 - From immediate danger (if safe to do so)
- A**LERT OTHERS
 - Dial 000 to notify the Fire Brigade
- C**ONFINE FIRE & SMOKE
 - Close doors and windows (if safe to do so)
- E**VACUATE
 - The building via the nearest designated or safe exit

EVACUATION PROCEDURES



On activation of the smoke alarm system or when directed by a member of the Emergency Control Organization:

- Evacuate the building via the designated exit or nearest safe exit.
- Proceed to the nominated **Assembly Area** and remain there until otherwise directed by a member of the Emergency Control Organization or Emergency Services.



DRAWN:	DBM	DWG No:	CEP-ED-L102
CHECKED:	ML	REVISION:	0
DATE OF ISSUE:	11/01/2019		
DATE OF VALIDATION:	11/01/2024		

ASSEMBLY AREA

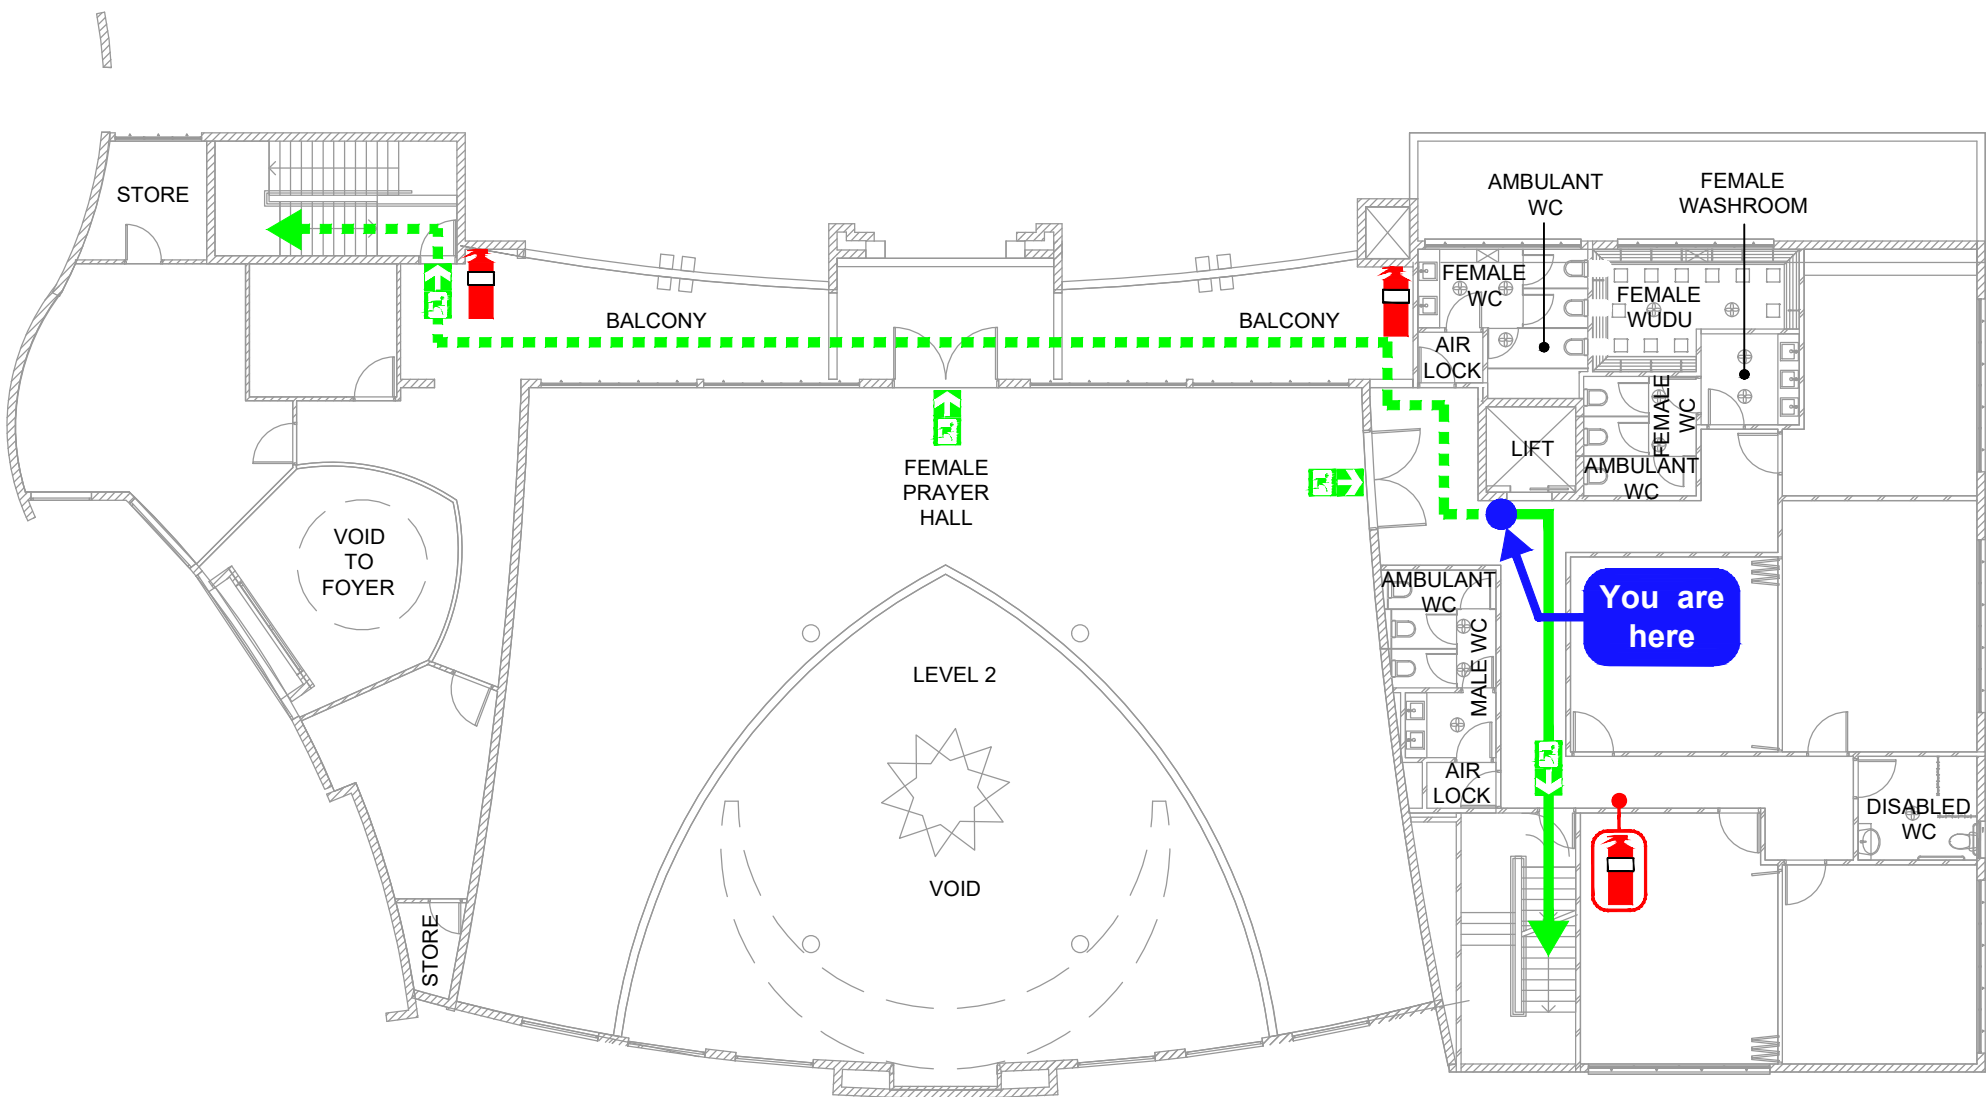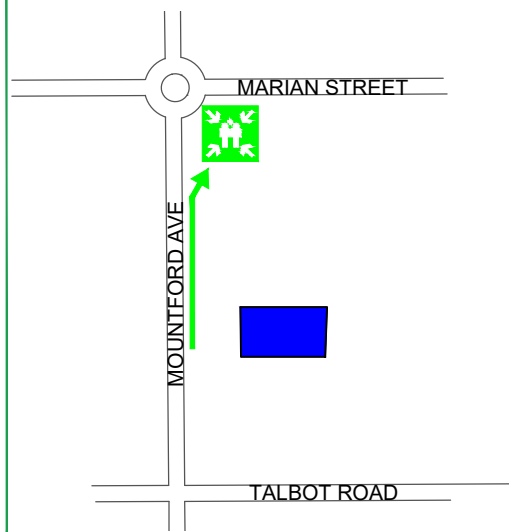

LEGEND



Emergency Exit



Exit Path



Assembly Area



Alternate Exit Path



Extinguisher - Dry Chemical

EVACUATION DIAGRAM


GUILDFORD MOSQUE
64 MOUNTFORD AVE., GUILDFORD, NSW 2162
LEVEL 3

IN CASE OF FIRE

- R**EMOVE PEOPLE
 - From immediate danger (if safe to do so)
- A**LERT OTHERS
 - Dial 000 to notify the Fire Brigade
- C**ONFINE FIRE & SMOKE
 - Close doors and windows (if safe to do so)
- E**VACUATE
 - The building via the nearest designated or safe exit



EVACUATION PROCEDURES

- On activation of the smoke alarm system or when directed by a member of the Emergency Control Organization:
- Evacuate the building via the designated exit or nearest safe exit.
 - Proceed to the nominated Assembly Area and remain there until otherwise directed by a member of the Emergency Control Organization or Emergency Services.



DRAWN:	DBM	DWG No:	CEP -ED-L103
CHECKED:	ML	REVISION:	0
DATE OF ISSUE:	11/01/2019		
DATE OF VALIDATION:	11/01/2024		

ASSEMBLY AREA

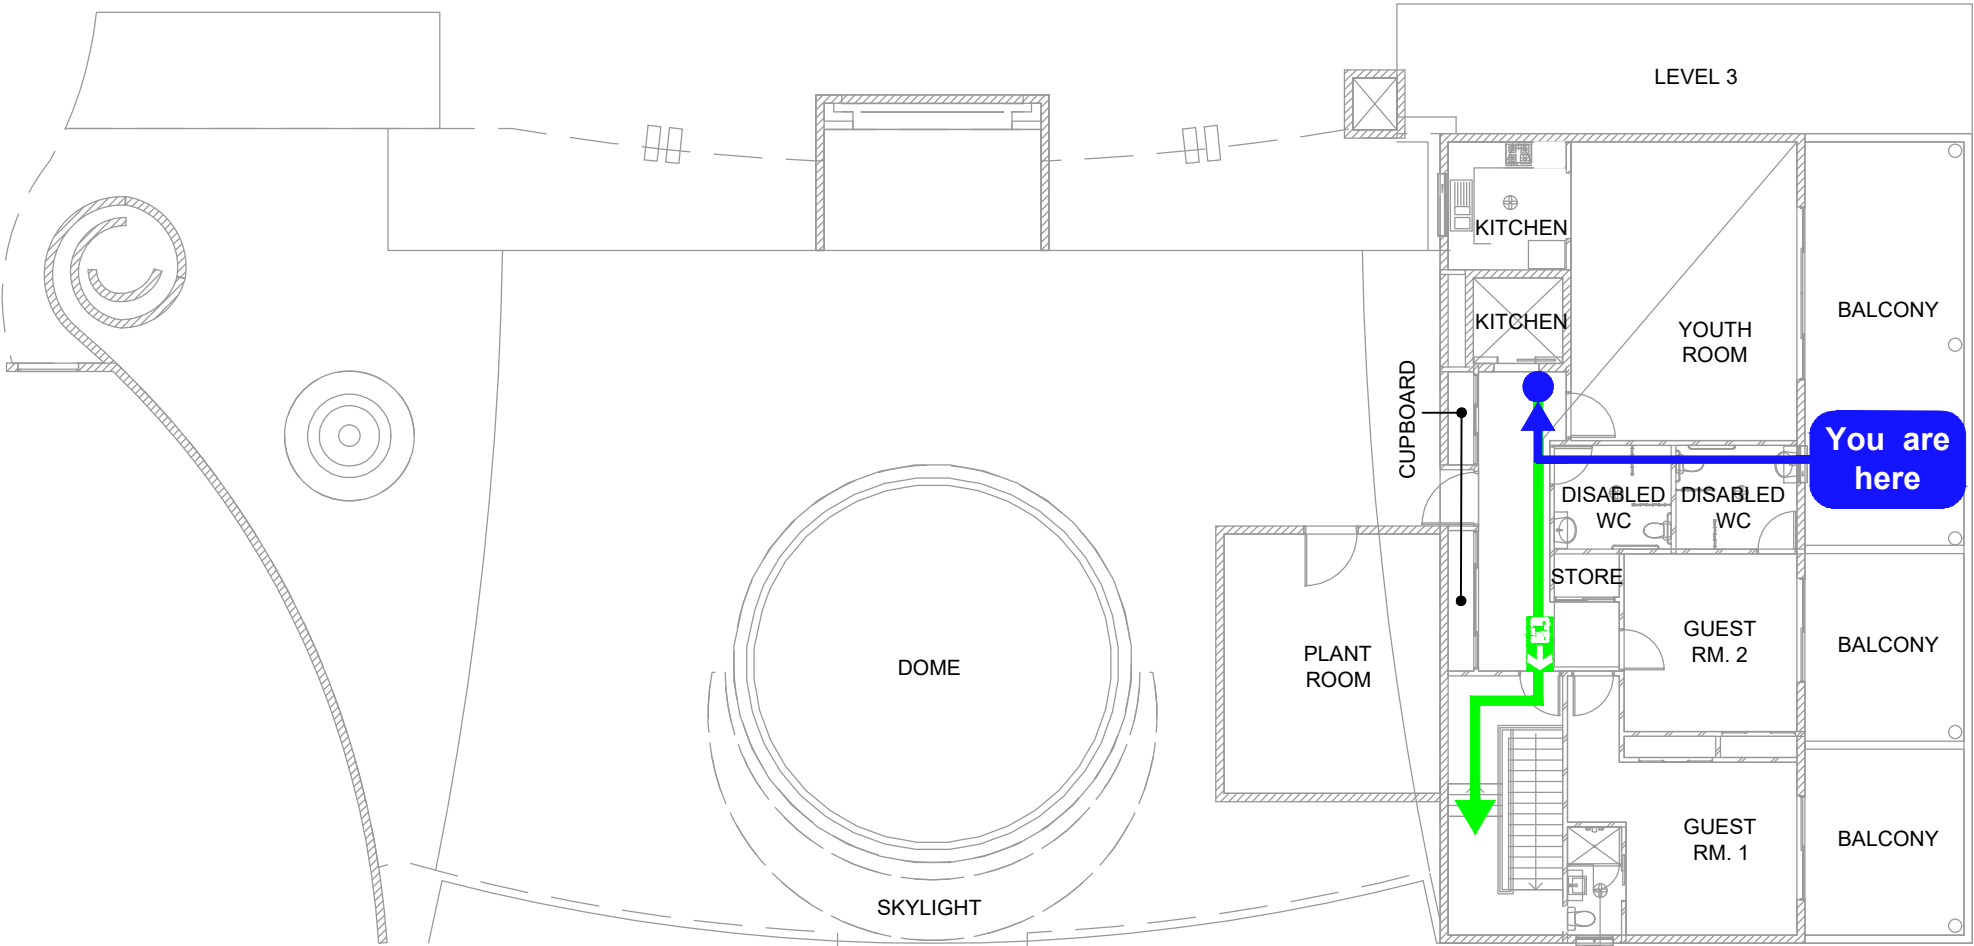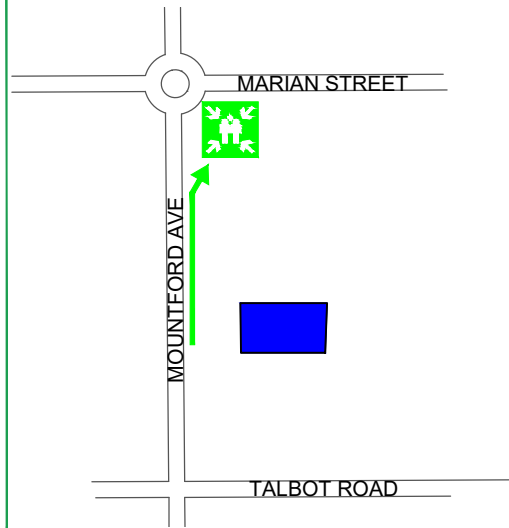

LEGEND

 Emergency Exit

 Exit Path

 Assembly Area