

11 March 2024

Attention: Brendan Price

The Dott Developments Pty Ltd
Level 6 161 London Circuit
Canberra ACT 2601
brendan@thepricegroup.com.au

BY EMAIL

Dear Brendan

Re: Land Capability Assessment – 37 Annie Pyers Drive Gundagai NSW 2722

I refer to the written request by yourself to conduct a Land Capability Assessment (LCA) for a proposed commercial development at 37 Annie Pyers Drive, Gundagai NSW 2722, the site. The intended recipient of this report is yourself for use in the design of a wastewater management system. It is assumed that designers, installers, and regulators will rely on this report for guidance, however DM McMahon Pty Ltd is required to be consulted when designs are being prepared to confirm site conditions in relation to the site-specific development.

Objective and scope

The objective of this LCA is to adopt the approaches outlined in AS 1547 (2012) On-site Domestic Wastewater Management and the NSW Department of Environment and Conservation (DEC 2004) Use of Effluent by Irrigation, to achieve sustainable and effective wastewater management and to protect public health and the environment. AS 1547 (2012) and DEC (2004) have been adopted to provide a clear and consistent approach to conducting LCAs and has been used in preference to other guidelines owing to its relevance and state wide acceptance. Our role is designated as a site evaluator and assessor to evaluate the capacity of a site and its soil for accepting treated wastewater and to provide recommendations for alternate management methods if required.

The agreed scope of works include:

- Where available, review plans and other general related documents provided to us to gain a comprehensive understanding of the site.
- Undertake a site and soil check of the proposed land application area as instructed on by yourself to collate relevant site information and environmental factors.
- Conduct a site and soil assessment to examine and record the soil profile and soil features within the proposed application area.
- Detail the results of the assessment of the area for environmental factors (setbacks and constraints) which are likely to impinge on the siting and design of a land application system; and evaluate the site and soil characteristics to determine feasible options for designing and sizing a land application system and alternate management methods if required.

Location and description of the project site and its history

The site is a 2.7ha (approx.) land parcel with a real property description of Lot 2 DP 160191 and Lot 529B DP 203601 and is located on the western side of Annie Pyers Drive off the Hume Highway approximately 8km north of Gundagai. Location maps and a plan of the proposed development can be seen in **Attachment A**.

From a historical search and review of the available historical aerial imagery, Annie Pyers established a kiosk/retail outlet on site in 1933 (the Dog on the Tuckerbox). The current kiosk/retail outlet and disused service station building, were built sometime in the 1960s and 1970s with the older buildings mostly removed.

Annie Pyers Drive is not connected to municipal sewer, so on-site wastewater management is required. Water is supplied from bore water and rainwater currently, but we understand that Council is currently undertaking or will be undertaking works in the near future to connect the site to a reticulated town water supply. Currently the site is occupied by a 300m² kiosk/retail outlet with toilet facilities and a disused service station building. Wastewater is currently disposed of on site by a trench system.

Description of the regional and local environment

The site lies on a north east trending very gently inclined footslope of Silurian sedimentary rocks and Quaternary alluvium at elevation of around 262 to 257 mAHD.

The site lies within a local Five Mile Creek catchment with the Five Mile Creek, a third order intermittent, located around 90m down gradient of the site boundary and an unnamed third order ephemeral drainage located around 40m upgradient of the site boundary. These drainages have integrated and convergent channel networks with the confluence with the Murrumbidgee River being around 2km downgradient of the site.

There are no registered bores on site but there are four bores on neighbouring properties. Two bores at a similar elevation to the site are constructed to around 10m deep into the underlying alluvium with groundwater intersected at around 7m, while the two upgradient bores are 22m and 30m deep and the construction is unknown but assumed to be into the underlying fractured sedimentary rock. These four bores are registered for stock and domestic use. Interflow and throughflow will occur in the surficial soil after periods of extended wet weather. Anecdotally, we understand that there have been concerns in the past with potential contamination of interflow and groundwater during periods of high rainfall resulting from a wastewater management system on a nearby site.

The climate for Gundagai is characterised as having hot dry summers and cool winters. The average annual rainfall for the site is around 700mm per annum with wetter than average months being from June through to October. The annual pan evaporation for the site is around 1400mm with rainfall exceeding evaporation in the cooler months from May to August.

Records of fieldwork, including methods and results

McMahon conducted a site and soil assessment and found that soils on site have a strong relationship with the slope sequence, which are characterised by deep reddish clayey residual soil on the high elevations, deep brownish clay loam colluvial and residual soil on the mid elevations, and deep dark brown clay loam alluvial soil on the low elevations. A map of the investigation locations can be seen in **Attachment B** and the log sheets with soil descriptions and field test results can be seen in **Attachment C**.

Laboratory results

Bulk grab samples were taken from the topsoil and subsoil within the proposed land application area. These samples were laboratory tested for the chemical parameters pH (CaCl₂), electrical conductivity, and exchangeable cations. The results found a slightly acid, non-saline, non-sodic topsoil overlying a slightly acid, non-saline, non-sodic subsoil. The chemical analysis results can be seen in **Attachment D**.

Summary of results

There are no major setbacks and limitations to note regarding siting a land application system, by reference to AS 1547 (2012), see **Attachment A**. Vertical and horizontal setback distances have been considered in line with Council guidelines and Australian Standards when locating the wastewater management system. Specific to the site, setbacks around the placement of the wastewater management system have considered:

- Potential access/egress and distance to overhead powerline easements.
- Existing and proposed future on-site developments.
- Allowance for wind-carried spray from spray irrigation systems when determining final horizontal setback distances to boundaries, dwellings, and food crops.
- Minimum horizontal setback distance of 100m from surface water features including Five Mile Creek.
- Minimum horizontal setback distances of 50m from downslope and 25m for upslope bores.

The chemical analysis and physical testing conducted characterises the site as having nil or slight limitations compared to the DEC (2004) guidelines (**Attachment E**), except for moderate limitations for cation exchange capacity in the topsoil that is inherent to the soil chemistry and texture; and pH, which may be ameliorated with the application of lime. As noted above, we also understand that there have been issues in the past on a nearby site.

In making the following recommendations, the plans prepared by SN Architects, dated 11 December 2023 have been referred to (**Attachment A**). The volume of wastewater produced from the proposed development is estimated to be 6,382 litres per day. The volume of wastewater produced from the proposed development has been estimated based on the total floor area per development sub-type and associated average water demand per unit area (Sydney Water, see **Attachment F**). The following table provides a breakdown of the estimated total wastewater volume based on the floor area.

Table 1: Estimated total volume of generated wastewater

Building	Floor area (m²)	Average demand per development sub-type (L/m²/day)	Calculated wastewater (L/day)
B01 – Future food and drink premises	316	2.48	784
B02 – Future retail premises	278	2.48	689
B03 – Future food and drink premises	300	2.48	744
B04 – Future retail premises	329	2.48	816
B05 – Future retail premises	329	2.48	816
B06/B07 – Future pub premises	672	3.77	2533
Total			6382

Two options are considered for wastewater management being a pump out system and/or on-site disposal by irrigation.

1. A pump out system is recommended for wastewater management as the site is not connected to the sewer and the size of an on-site wastewater management system could hinder future development. The collection tank size should be based on the weekly wastewater volume and whether there is a standby pump incorporated into the design. It is also recommended that appropriate infrastructure is incorporated into the design to allow for the efficient monitoring and operation of the pump out system. Treatment for odour control should also be considered. The pump out system future proofs the site in the case of it being connected to the municipal sewer.

2. An Aerated Wastewater Treatment Systems (AWTS) could be considered as an option for wastewater treatment with land application via drip or low-pressure spray irrigation. The AWTS is preferred over conventional septic tanks and trench disposal as:

- The AWTS offers the highest level of treatment compared to conventional septic tanks.
- The irrigated drip or spray also offers a low application risk owing to the comparatively large irrigation area compared to trenches or beds, meaning nutrients and bacteria are not concentrated.
- Based on such the following land application system sizing using the design irrigation rate for weakly structured clay loam soil as presented in AS 1547 (2012):
 - The minimum land application area is calculated at 3,047m² therefore the 3,223m² effluent disposal area shown on the plan is suitable (**Attachment A**).
 - The maximum application rate is 3.5mm/day over the available suitable land application area.
 - The water balance calculations can be seen in **Attachment G**.

In the case of the subject site and noting the anecdotal evidence of previous contamination issues resulting from an AWTS and the potential for future development as informed by the adopted masterplan, we recommend that the pump out system be pursued. The area of the site which would be required to be designated to the drip or low-pressure spray irrigation would be significant and would hinder the future development potential at the site. We recommend a pump out system with at least 44,674 litres capacity be pursued but is to be confirmed by a hydraulic engineer.

If you have any queries about the contents of the letter format report, please contact the undersigned.

Yours sincerely

A handwritten signature in dark ink, appearing to read 'i. McMahon', with a long horizontal stroke extending to the right.

David McMahon CEnvP SC

BAppSc SA

GradDip WRM

MEnvMgmt

MALGA MEIANZ MSSA

Disclaimer

The information contained in this report has been extracted from sources believed to be reliable and accurate. DM McMahon Pty Ltd will not assume any responsibility for the misinterpretation of information supplied in this report. The accuracy and reliability of recommendations identified in this report need to be evaluated with due care according to individual circumstances. The results of the assessment undertaken are an overall representation of the conditions encountered. It should be noted that the recommendations and findings in this report are based solely upon the said site location and the ground level conditions at the time of testing. The results of the said investigations undertaken are an overall representation of the conditions encountered. The properties of the soil within the location may change due to variations in ground conditions outside of the tested area. The author has no control or liability over site variability that may warrant further investigation that may lead to significant design changes.

Notice of Copyright

The information contained in this report must not be copied, reproduced, or used for any purpose other than a purpose approved by DM McMahon Pty Ltd, except as permitted under the Copyright Act 1968. Information cannot be stored or recorded electronically in any form without such permission.

© DM McMahon Pty Ltd

Attachments

- A.** Location maps and proposed development plan
- B.** Investigation locations
- C.** Log sheets
- D.** Laboratory results
- E.** Soil characterisation
- F.** Sydney Water average daily water use by property development type
- G.** Water balance



Attachment A : *Location maps and proposed development plan*

37 Annie Pyers Drive Gundagai NSW 2722

Land Capability Assessment
Job No. 9743
Google Earth image 2023

Legend

Boundary




RENO

M31

Gundagai

Tumut River

M31





37 Annie Pyers Drive Gundagai NSW 2722

Land Capability Assessment
Job No. 9743
Google Earth image 2023

Legend


Boundary

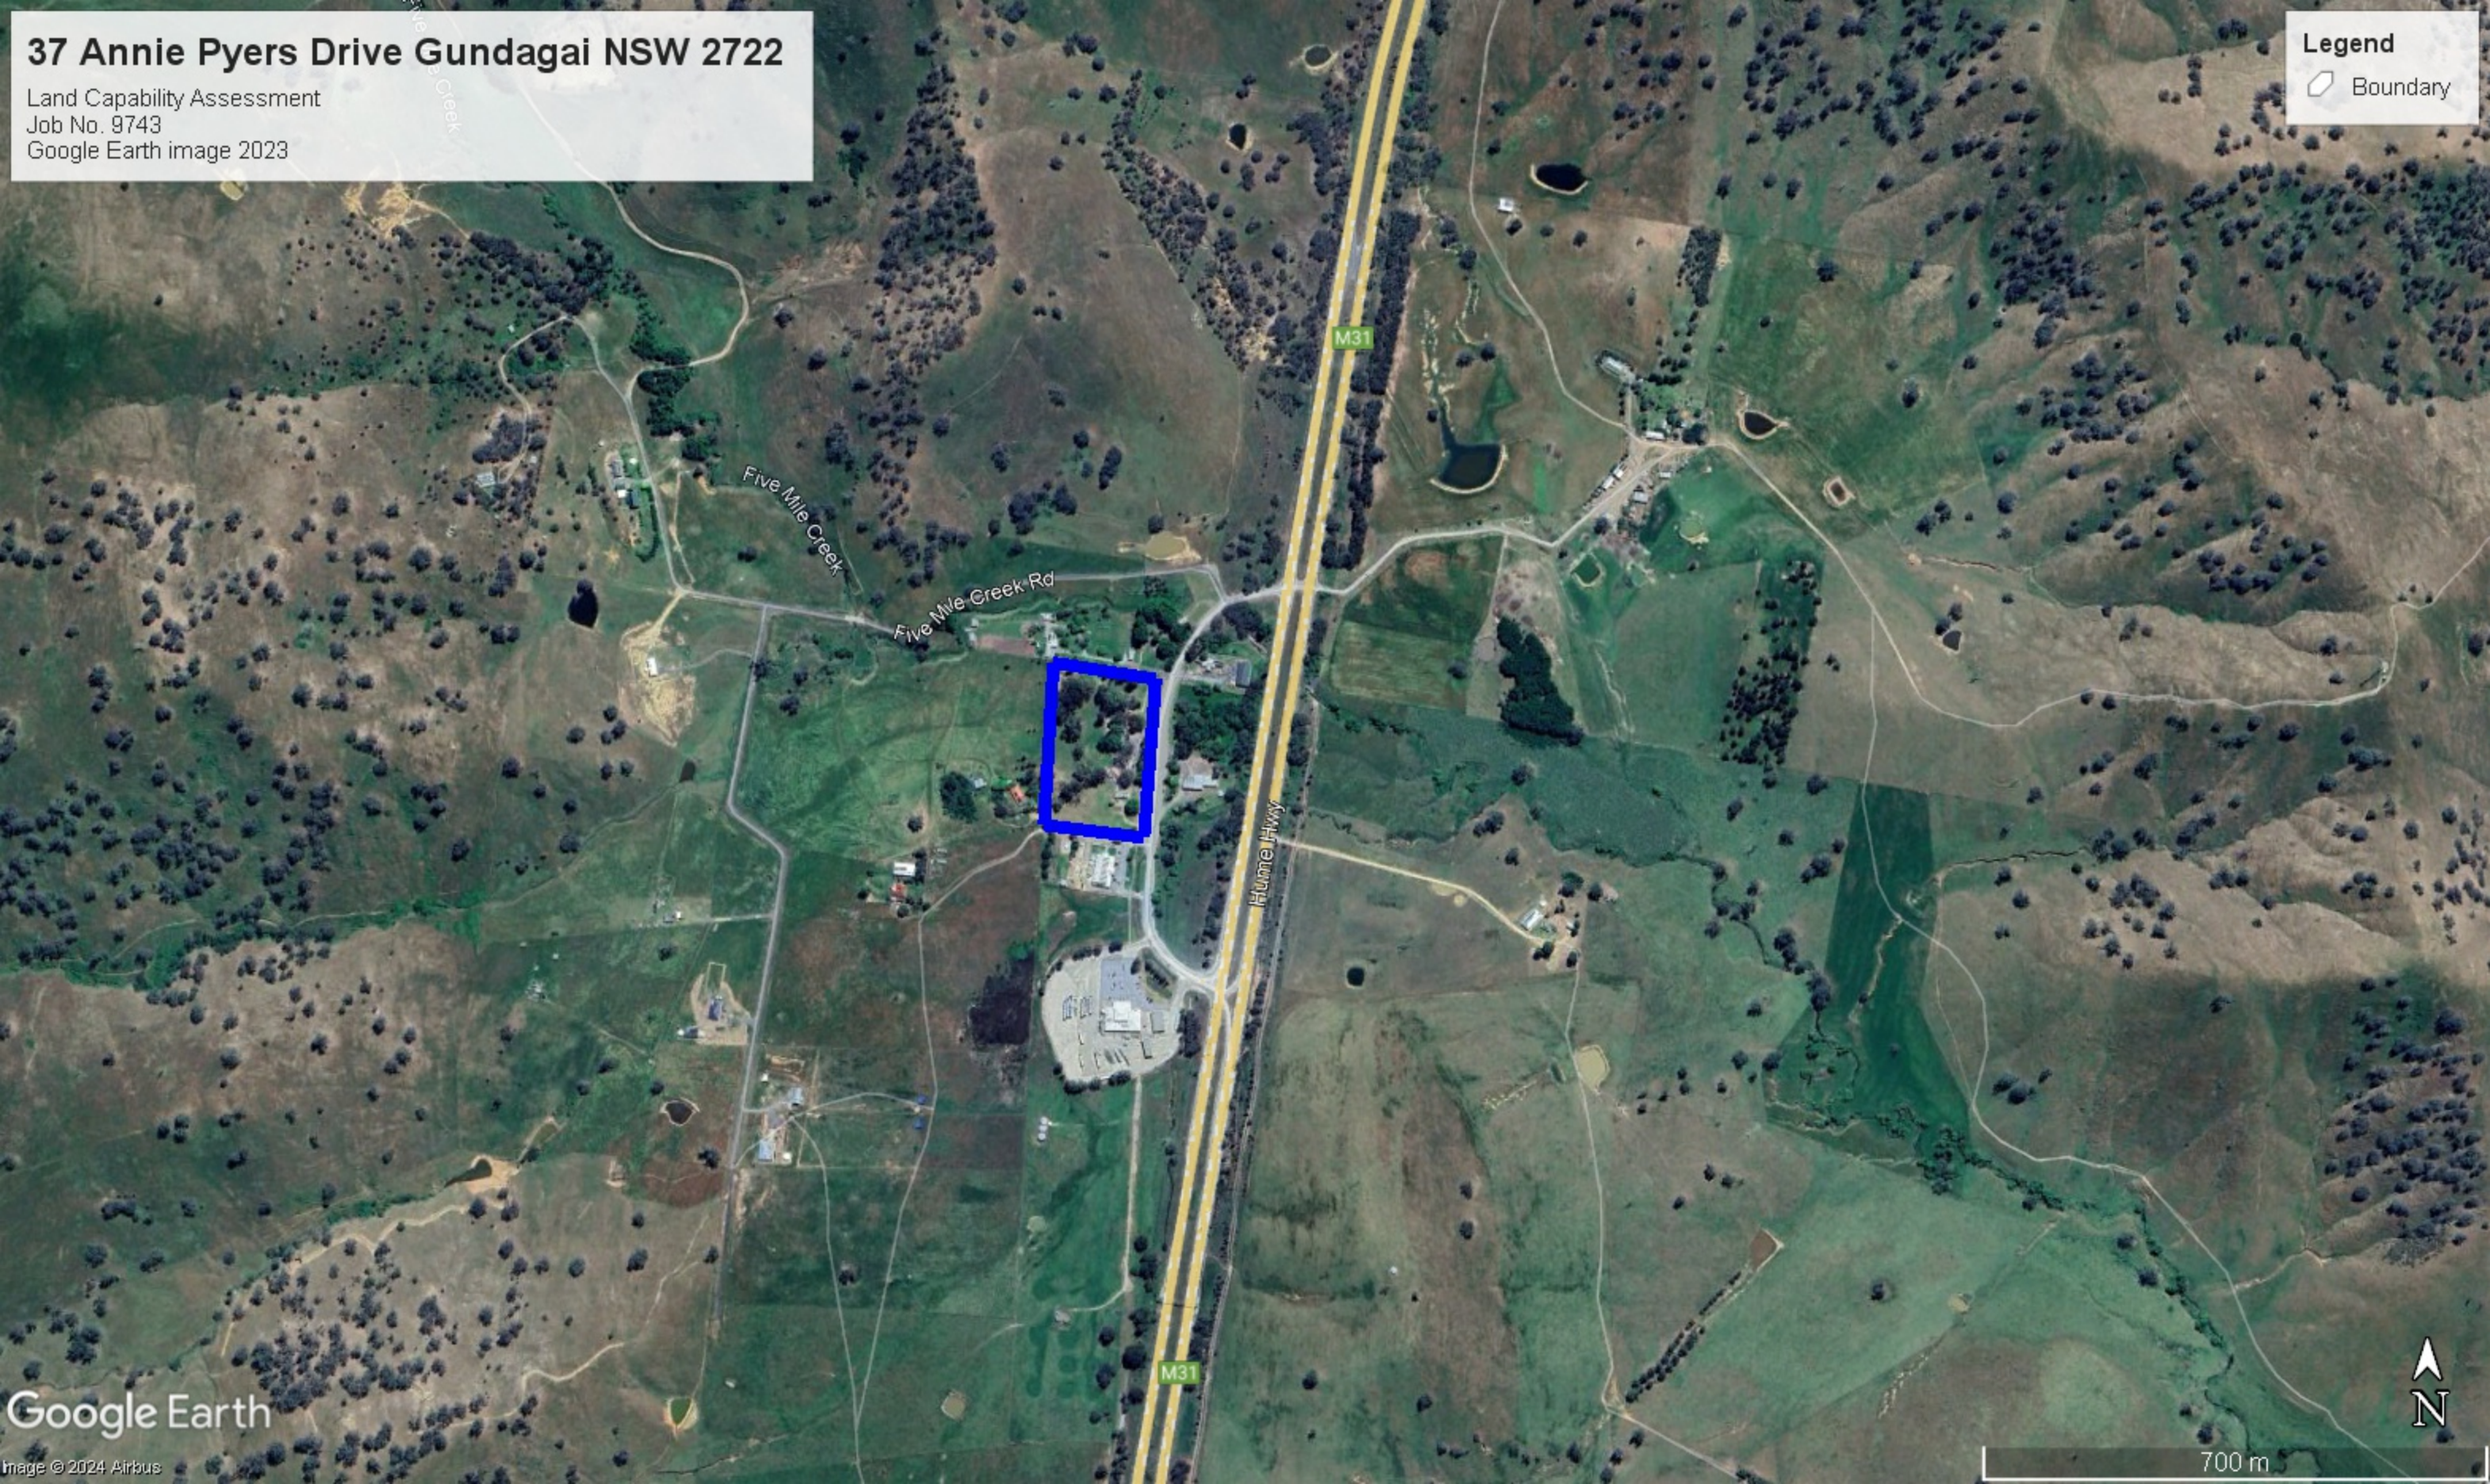

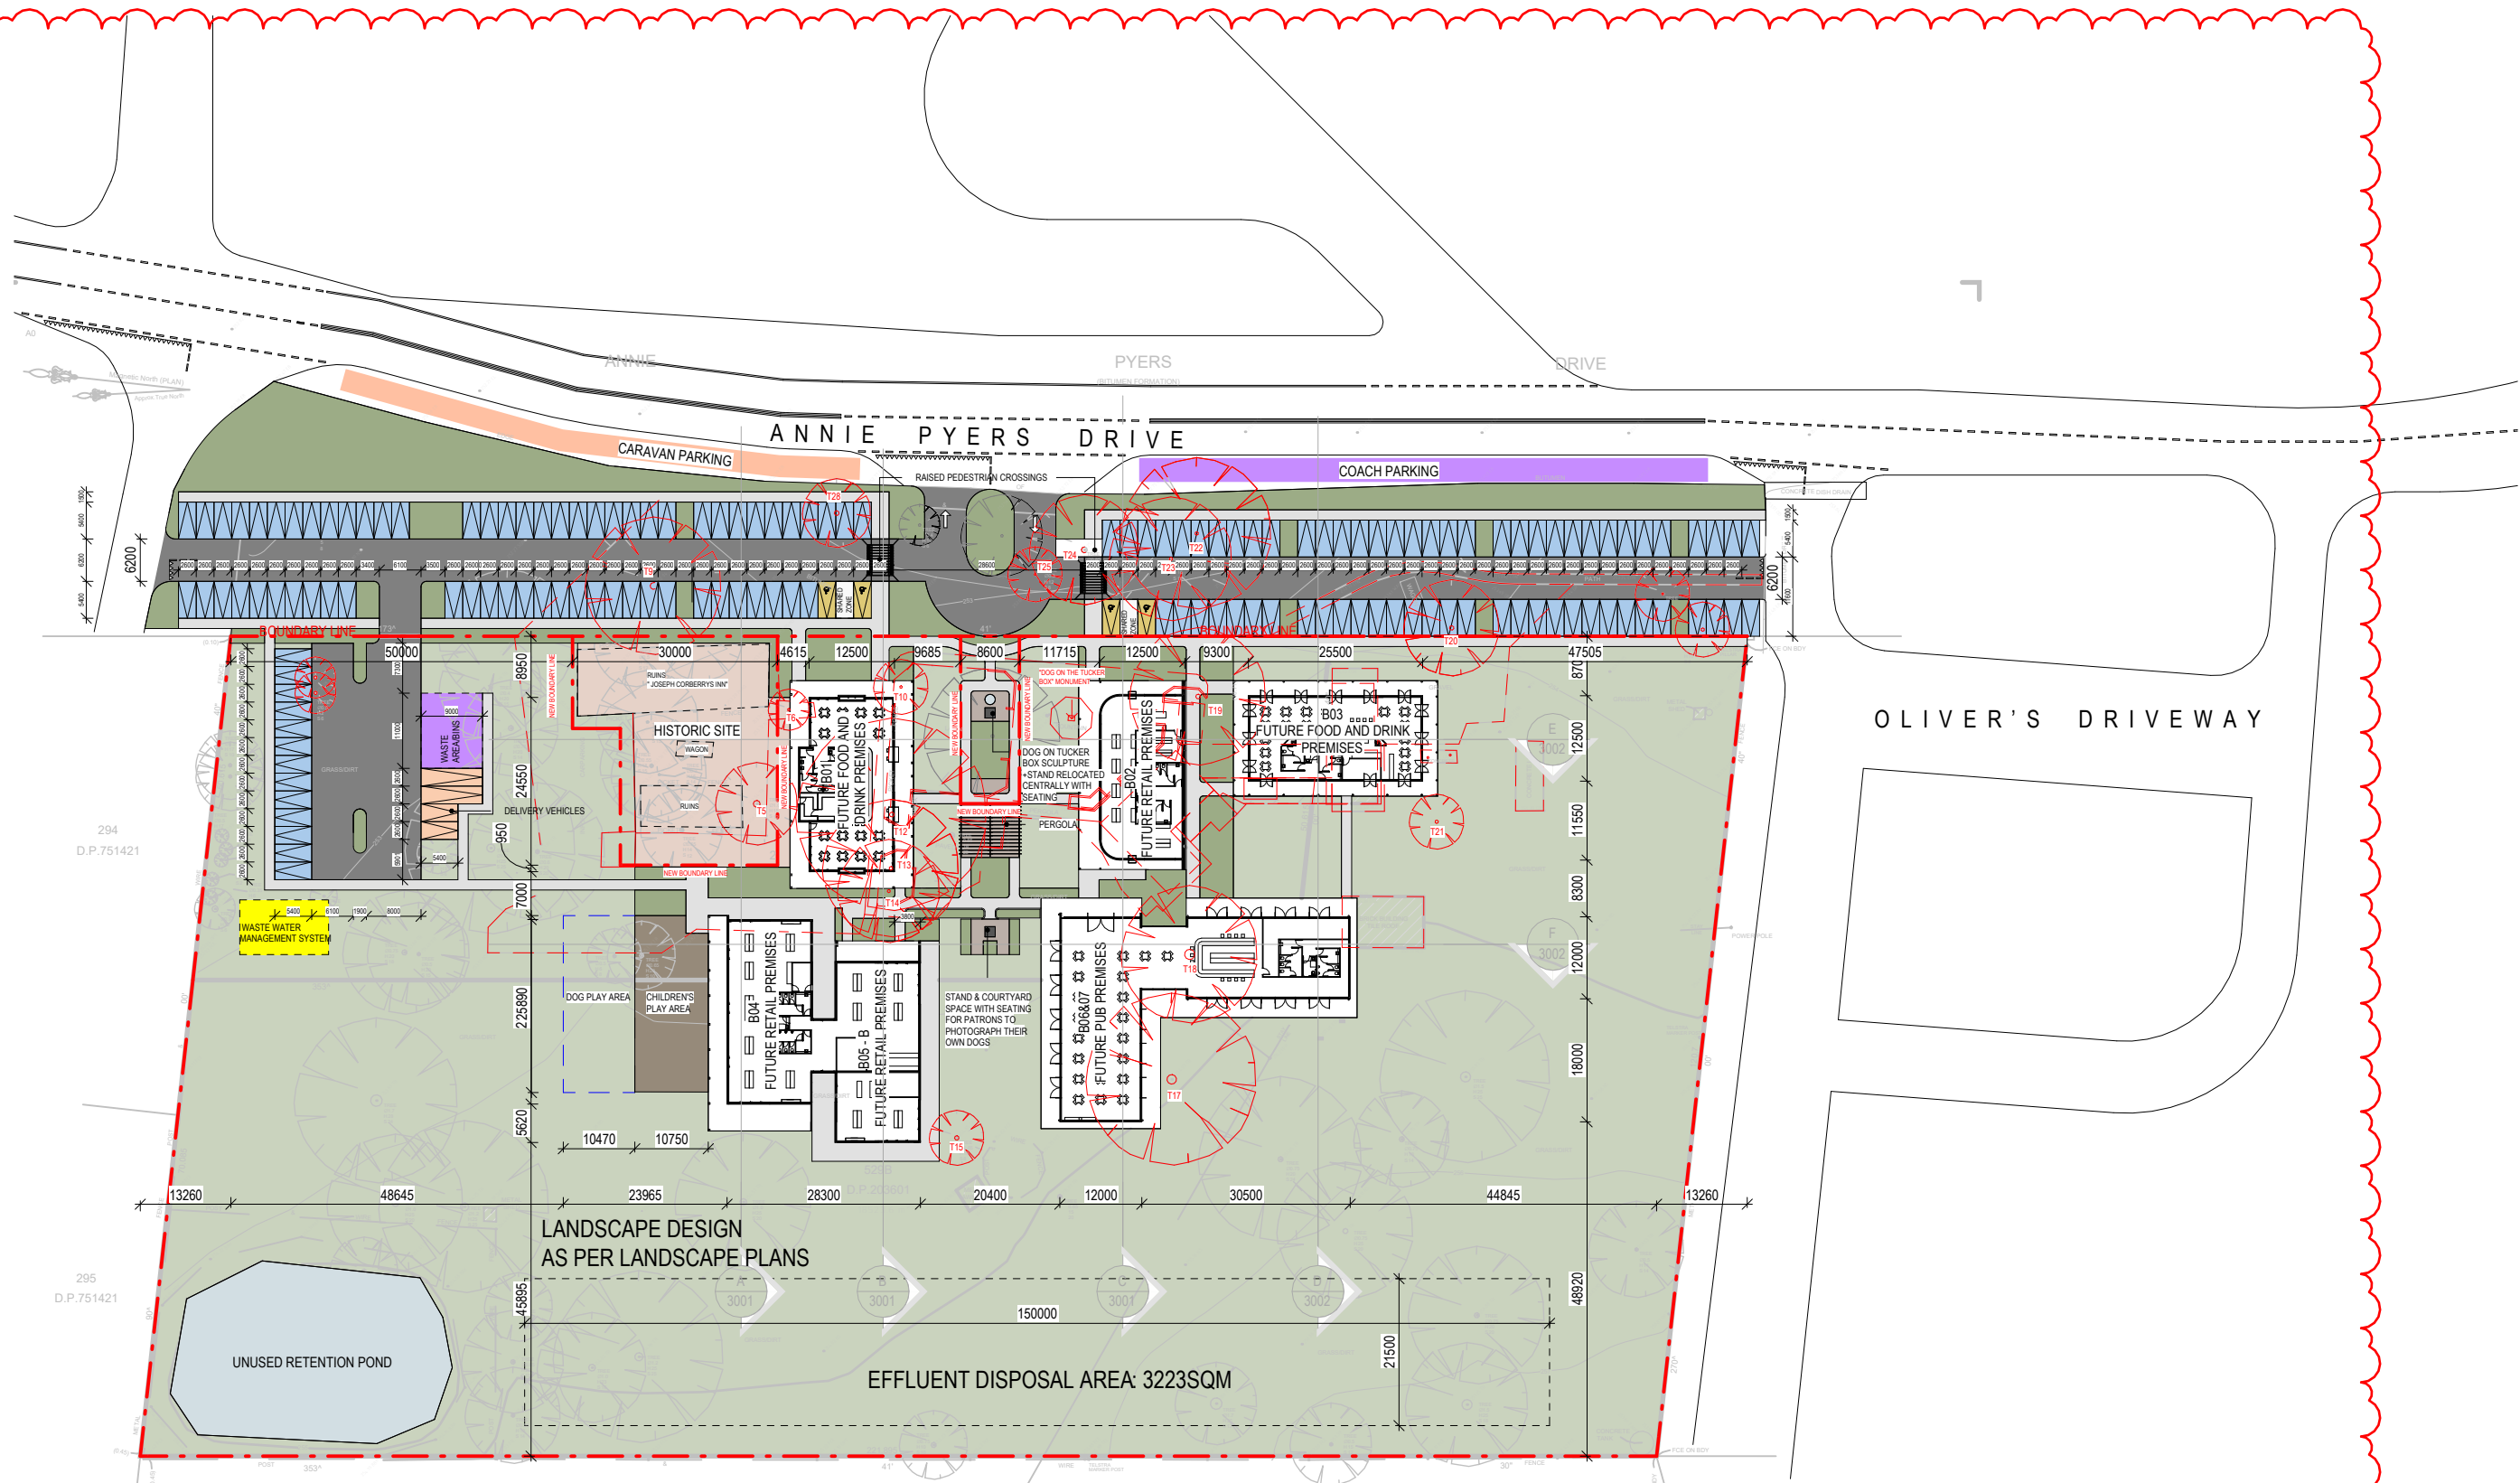

LEGEND

- PROPOSED
TO BE DEMOLISHED



REFERENCES
DRAWINGS TO BE READ IN CONJUNCTION WITH BUT NOT LIMITED TO ALL STRUCTURAL ENGINEERS, STORMWATER ENGINEERS, LANDSCAPE ARCHITECTS, AND OTHER ASSOCIATED PLANS & REPORTS.
REFER TO THE BASIS REPORT FOR ADDITIONAL REQUIREMENTS.
NOTES
ALL DIMENSIONS AND SETOUTS ARE TO BE VERIFIED ON SITE AND ALL OMISSIONS OR ANY DISCREPANCIES TO BE NOTIFIED.
FIGURED DIMENSIONS TO BE USED AT ALL TIMES DO NOT SCALE MEASUREMENTS OFF DRAWINGS.

NOMINATED ARCHITECT: SOROOSH MOSHKAR 1278

DRAWN SM
DESIGNED SM
CHECKED SM
DRAWING SCALE As indicated
SHEET SIZE A3
PROJECT NUMBER 210804


DRAWING NUMBER A 1003
DRAWING TITLE SITE PLAN

PROJECT STAGE DA
PROJECT DETAILS Mixed used Development

DOG ON THE TUCKER BOX
CLIENT DETAILS The DOTT Developments Pty Ltd

B	11.12.23	AMENDMENTS
A	18.08.23	DA SUBMISSION
Rev.	Date	Description

Scale



W www.snarchitects.com.au
E info@snarchitects.com.au
M 0405242821
A 1/98 Allen St, Leichhardt NSW 2040

© COPYRIGHT
REPRODUCTION OF THE WHOLE OR PART OF THE DOCUMENT CONSTITUTES AND INFRINGES COPYRIGHT. THE INFORMATION, IDEAS AND CONCEPTS CONTAINED IN THIS DOCUMENT IS / ARE CONFIDENTIAL. THE RECIPIENT(S) OF THIS DOCUMENT IS / ARE PROHIBITED FROM DISCLOSING SUCH INFORMATION IDEAS AND CONCEPTS TO ANY PERSON WITHOUT PRIOR WRITTEN CONSENT OF THE COPYRIGHT HOLDER.
CONTRACTOR TO CHECK AND VERIFY ALL LEVELS, DATUMS & DIMENSIONS ON SITE AND SHALL REPORT ANY DISCREPANCIES OR OMISSIONS TO THIS OFFICE PRIOR TO START OF WORK & DURING THE CONSTRUCTION PHASE. THIS DRAWING IS TO BE READ AND UNDERSTOOD IN CONJUNCTION WITH STRUCTURAL, MECHANICAL, ELECTRICAL AND OR ANY OTHER CONSULTANTS DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO START OF WORK & ITS DURATION. MEASUREMENT SCALING OF THIS DRAWING SHALL ONLY BE PERMITTED IN ITS DIGITAL FORM.



Attachment B : *Investigation locations*

37 Annie Pyers Drive Gundagai NSW 2722

Land Capability Assessment
Job No. 9743
Google Earth image 2023

Legend

- Boundary
- Investigation location





Attachment C : *Log sheets*

Job No: 9743

Landform: Footslope

Client: The Dott Developments Pty Ltd

Slope: Gently inclined

Site: 37 Annie Pyers Drive Gundagai

Vegetation/Surface: Grass (mown)

Date: 11/05/2023

Logged By: D. McMahon

Sampling Method: ☒ Hand Excavated ☒ Hand Auger ☐ Power Auger ☐ Machine Excavated Other:

Location	Depth (m)	Sample	Description	Comments	Co-ordinates MGA GDA94 z55
1	0-0.2	1/1	A Horizon - grey brown sandy clay loam, weak subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, abundant roots, gradual and smooth boundary to -	Field dispersion 6 (Emerson).	601275E 6126270N 261mAHD
	0.2-0.5	-	A2-Horizon - bleached grey sandy silty loam, weak granular pedality, nil mottling, nil coarse fragments, nil segregations, well drained, many roots, abrupt and smooth boundary to -	-	
	0.5-0.9	1/2	B-Horizon - yellow red medium clay, moderate subangular blocky pedality, nil mottling, few coarse fragments (siltstone) 2-6mm, nil segregations, imperfectly drained, common roots, diffuse boundary to -	Field dispersion 6 (Emerson).	
	0.9-1.2	-	C-Horizon - red yellow silty clay, moderate subangular blocky pedality, nil mottling, many coarse fragments (siltstone) 2-6mm, nil segregations, moderately-well drained, few roots, end of hole at 1.2m.	-	

Job No: 9743

Landform: Footslope

Client: The Dott Developments Pty Ltd

Slope: Very gently inclined

Site: 37 Annie Pyers Drive Gundagai

Vegetation/Surface: Grass (mown)

Date: 11/05/2023

Logged By: David McMahon

Sampling Method: ☒ Hand Excavated ☒ Hand Auger ☐ Power Auger ☐ Machine Excavated Other: _____

Location	Depth (m)	Sample	Description	Comments	Co-ordinates MGA GDA94 z55
2	0-0.15	-	A Horizon - grey brown silty clay loam, weak subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, abundant roots, gradual and smooth boundary to -	-	530386E 6103282N 260mAHD
	0.15-0.3	-	A2 Horizon - bleached (slightly) grey brown fine sandy clay loam, weak subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, common roots, abrupt and smooth boundary to -	-	
	0.3-0.6	-	B1 Horizon - yellow brown fine sandy clay loam, strong subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, moderately-well drained, common roots, abrupt and smooth boundary to -	-	
	0.6-1.2	-	B2-Horizon - yellow red medium clay, moderate subangular blocky pedality, nil mottling, few coarse fragments (siltstone) 2-6mm, nil segregations, imperfectly drained, common roots, end of hole at 1.2m.	-	

Job No: 9743

Landform: Footslope

Client: The Dott Developments Pty Ltd

Slope: Very gently inclined

Site: 37 Annie Pyers Drive Gundagai

Vegetation/Surface: Grass (mown)

Date: 11/05/2023

Logged By: David McMahon

Sampling Method: ☒ Hand Excavated ☒ Hand Auger ☐ Power Auger ☐ Machine Excavated Other:

Location	Depth (m)	Sample	Description	Comments	Co-ordinates MGA GDA94 z55
3	0-0.2	-	A Horizon - grey brown silty clay loam, weak subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, abundant roots, gradual and smooth boundary to -	-	601300E 6126345N 259mAHd
	0.2-0.5	-	A2 Horizon - bleached (slightly) grey brown fine sandy clay loam, weak subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, common roots, abrupt and smooth boundary to -	-	
	0.5-0.8	-	B1 Horizon - yellow brown fine sandy clay loam, strong subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, moderately-well drained, common roots, abrupt and smooth boundary to -	-	
	0.8-1.2	-	B2-Horizon - yellow red medium clay, moderate subangular blocky pedality, nil mottling, few coarse fragments (siltstone) 2-6mm, nil segregations, imperfectly drained, common roots, end of hole at 1.2m.	-	



Job No: 9743

Landform: Flat

Client: The Dott Developments Pty Ltd

Slope: Level

Site: 37 Annie Piers Drive Gundagai

Vegetation/Surface: Grass (mown)

Date: 11/05/2023

Logged By: David McMahon

Sampling Method: ☒ Hand Excavated ☒ Hand Auger ☐ Power Auger ☐ Machine Excavated Other:

Location	Depth (m)	Sample	Description	Comments	Co-ordinates MGA GDA94 z55
4	0-0.5	-	A Horizon - dark brown clay loam, moderate subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, abundant roots, gradual and smooth boundary to -	Organic soil. Field dispersion 5 (Emerson).	601353E 6126383N 257mAHD
	0.5-1.2	-	B/C Horizon - drak grey brown light clay, strong subangular blocky pedality, nil mottling, nil coarse fragments, nil segregations, well drained, abundant roots, end of hole at 1.2m.	Organic soil. Some sand seams at depth. Field dispersion 4 (Emerson).	



Attachment D : *Laboratory results*



98688
DM McMahon Pty Ltd

Lab No		7GS23050	7GS23051	7GS23052	7GS23053
Name		9743 1/1	9743 1/2	9743 4/1	9743 4/2
Code		17/05/23	17/05/23	17/05/23	17/05/23
Customer		DM McMahon Pty Ltd	DM McMahon Pty Ltd	DM McMahon Pty Ltd	DM McMahon Pty Ltd
Depth		0-10	0-10	0-10	0-10
NH4OAc exch Calcium	meq/100g	3.94	10.14	12.60	18.45
NH4OAc exch Magnesium	meq/100g	1.10	5.91	4.52	16.30
NH4OAc exch Potassium	meq/100g	0.59	0.67	1.37	1.13
NH4OAc exch Sodium	meq/100g	0.03	0.16	0.28	3.04
Conductivity	dS/m	0.029	0.027	0.129	0.533
pH Level (CaCl2)		5.5	5.9	5.9	6.6
pH Level (H2O)		6.6	7.2	6.9	7.6
Ca:Mg NH4OAc exch.		3.57	1.71	2.79	1.13
ECEC	meq/100g	5.7	16.9	18.8	38.9
K:Mg NH4OAc exch.		0.53	0.11	0.30	0.07



Attachment E : *Soil characterisation*

37 Annie Pyers Drive Gundagai NSW
Land Capability Assessment Soil Characteristics for Irrigation area

Property	Result	Limitation			Restrictive Feature
		Nil or Slight	Moderate	Severe ¹	
Exchangeable sodium percentage 0-40cm	0.5 – 1.5	0–5	5–10 ²	> 10	Structural degradation and waterlogging
Exchangeable sodium percentage (40-100 cm)	1.0 – 7.8	< 10	>10	–	Structural degradation and waterlogging
Salinity measured as electrical conductivity (ECe) (dS/m at 0-70cm)	0.029 - 0.129	< 2	2–4	> 4 ³	Excess salt may restrict plant growth
Salinity measured as electrical conductivity (ECe) (dS/m at 70-100cm)	0.027 - 0.533	< 4	4–8	> 8 ³	Excess salt may restrict plant growth, potential seasonal groundwater rise
Depth to top of seasonal high water table (metres)	>1.2m	> 3 ⁴	0.5–3 ⁴	< 0.5	Poor aeration, restricts plant growth, risk to groundwater ⁵
Depth to bedrock or hardpan (metres)	>1.2m	> 1	0.5–1	< 0.5	Restricts plant growth, excess runoff, waterlogging
Saturated hydraulic conductivity (Ks, mm/h, 0-100 cm)	20-70	20–80	5–20 ⁶ or >80 ⁶	<5	Excess runoff, waterlogging, poor infiltration
Available water capacity (AWC, mm/m)	120-210	>100	<100 ⁶	-	Little plant-available water in reserve, risk to groundwater
Soil pH CaCl ₂ (surface layer)	5.5 – 5.9	>6-7.5	3.5-6.0	<3.5	Reduces optimum plant growth
Effective cation exchange capacity (ECEC, cmol (+)/kg, average 0–40 cm)	5.7 - 18.8	>15	3-15 ⁸	<3	Unable to hold plant nutrients
Emerson aggregate test (0–100cm)	4, 5 & 6	4, 5, 6, 7, 8	2, 3	1	Poor structure
Phosphorus (P) sorption (kg/ha at total 0–100 cm)	-	high ⁹	moderate ⁹	Low	Unable to immobilise any excess phosphorus

Source: Based on Hardie and Hird (1998), See also NSW Department of Primary Industries (2004).

- Notes:**
1. Sites with these properties are unlikely to be suitable for irrigation of some or all effluent products.
 2. Application of gypsum or lime may be required to maintain long-term site sustainability.
 3. Some high EC soils containing calcium 'salts' are not necessarily considered 'severe'.
 4. Where unable to excavate to 3m, local knowledge and absence of indications of water table to the depth of sampling (1m) should be used.
 5. Criteria are set primarily for assessing site suitability for plant growth. Presence of a shallow soil water table may indicate soil conditions that favour movement of nutrients and contaminants into groundwater. In such cases, careful consideration should be given to quality and potential impacts on groundwater.
 6. Careful irrigation scheduling and good irrigation practices will be required to maintain site sustainability.
 7. Soil pH may need to be increased to improve plant growth. Where effluent is alkaline or lime is available, opportunities exist to raise pH. If acid sulfate soil is present, site-specific specialist advice should be obtained.
 8. Soil may become more sodic with effluent irrigation. In some cases, however, this soil property may be ameliorated with addition of a calcium source.
 9. Soils with medium to high phosphorus sorption capacity can adsorb excess phosphorus not taken up by plants. The effectiveness of this depends not only on the sorption capacity but also, the depth and permeability of the soil.

Attachment F : *Sydney Water average daily water use by property development type*

Average daily water use

By property development type

Water Supply Code of Australia



MWH/PB Flow Study Report



Water usage survey



Development Type	Development Sub-Type	Key Metric	Metric Unit	Average Demand (L/Metric unit/Day)
Residential	Single Lot Torrens	Dwelling	Each dwelling	623.00
	Flats Torrens	Net floor area	Square metre	2.36
	High Rise Units	Net floor area	Square metre	3.34
	Single Lot Community	Dwelling	Each dwelling	623.00
Mixed	Residential / Commercial	Combined floor area	Each dwelling / Square metre	Use separate rates for each component
	Commercial / Industrial	Combined floor area	Square metre	Use separate rates for each component
Commercial	Aged Accom - Self Care	Net floor area	Square metre	2.50
	Aged Accom - Hostel	Bed	Each bed	271.00
	Aged Accom - Full Care	Bed	Each bed	271.00
	Childcare	Net floor area	Square metre	3.60
	Hotel / motel / serviced apartments	Room	Each room	359.94
	Office	Net floor area	Square metre	2.27
	Shopping Centre	Net floor area	Square metre	3.00
	Laundry / Dry Cleaner	Net floor area	Square metre	10.50
	Café / Fast Food / Butcher / Deli	Net floor area	Square metre	2.48
	Retail Units	Net floor area	Square metre	2.48
	Medical / Veterinary	Net floor area	Square metre	2.48
	Mechanical Repair	Net floor area	Square metre	2.48
	Car / Boat Sales	Net floor area	Square metre	2.48
	Car Wash	Net floor area	Square metre	9.40
	Club	Net floor area	Square metre	3.77
Industrial	Heavy Process	As required		
	Chemical Manufacturing	As required		


Special Uses	Printing Manufacturing	As required		
	Beverage Manufacturing	As required		
	Light Factory Unit	Developed floor area	Square metre	2.82
	Warehousing	Developed floor area	Square metre	2.82
	Transport / Bus depot	Site area	Square metre	0.91
	University	Student	Each student	20.00
	School	Student	Each student	20.00
	Hospital	Bed	Each bed	271.00
	Religious assemblies	Developed floor area	Square metre	1.30
	Government depot	Site area	Square metre	0.91
	Community Centre / Library	Floor area	Square metre	1.84
	Sports Fields with amenities	As required		
	Parks & Reserves	As required		
	Services: Police, Ambulance, etc	Floor area	Square metre	1.40

RE: Something else - Ask a question [E-Mail Ref:E-5270263]

Sydney Water <customerservice@sydneywater.com.au>

Sat 9/03/2024 12:20 PM

To: Admin | McMahon Earth Science <admin@dmmcmahon.com.au>

 1 attachments (21 KB)

pastedImage1;

Hi David

Thanks for contacting us.

The document you have attached for average daily water use by property development type is available to download on the Sydney Water website

<https://www.sydneywater.com.au/content/dam/sydneywater/documents/provider-information/constructing-new-pipes/average-daily-water-use-by-property-type.pdf>

To view the documents available on our website please visit - [Search \(sydneywater.com.au\)](https://www.sydneywater.com.au) and change the information type to documents.

Unfortunately it does not provide a date that the document you are enquiring about was produced.

If you need more information, please respond to this email or call us on 13 20 92 weekdays from 8am to 5.30pm.

Kind regards

Lisa

Customer Service Representative

Customer Contact

Original Text

From: admin@dmmcmahon.com.au**To:** customerservice@sydneywater.com.au**CC:****Sent:** 07.03.24 10:58:49**Subject:** Something else - Ask a question

Details of the request from Website

=====

Request Type : Something else - Ask a question

First Name: David

Last Name: McMahon

Phone: 0269310510

Account number or Payment number or Property address: \${accountNumber}

Email: admin@dmmcmahon.com.au

Comments : Hi. I am a wastewater consultant and came across the attached document and just wanted to verify it is an endorsed Sydney Water publication and also how to properly reference it (what year etc...). Thank you David

 [Facebook](#)  [Twitter](#)  [YouTube](#)  [Instagram](#)

NOTICE: This email is confidential. If you are not the nominated recipient, please immediately delete this email, destroy all copies and inform the sender. Sydney Water Corporation (Sydney Water) prohibits the unauthorised copying or distribution of this email. This email does not necessarily express the views of Sydney Water. Sydney Water does not warrant nor guarantee that this email communication is free from errors, virus, interception or interference.



Attachment G : *Water balance*

Water Balance

Irrigation area sizing using Nominated Area Water Balance & Storage Calculations																
Site Address:		37 Annie Pyers Drive Gundagai NSW 2722														
Date:		January 2024				Assessor:		David McMahon								
INPUT DATA																
Design Wastewater Flow	Q	6,382	L/day	Based on assumptions and expected wastewater generation as outlined in report 8903.												
Design Irrigation Rate	DIR	3.5	mm/day	Based on soil texture class/permeability and derived from Table 5.2 of AS 1547:2012												
Nominated Land Application Area	L	3047	m ²	1												
Crop Factor	C	0.8-1.0	unitless	Estimates evapotranspiration as a fraction of pan evaporation; varies with season and crop type ²												
Rainfall Runoff Factor	RF	1	unitless	Proportion of rainfall that remains onsite and infiltrates, allowing for any runoff												
Mean Monthly Rainfall Data	Gundagai Data Drill (-35.00, 148.10)			SILO Data Drill datasets (1889-2023) are constructed from observational records provided by the Bureau of												
Mean Monthly Pan Evaporation Data	Gundagai Data Drill (-35.00, 148.10)			Meteorology. SILO interpolates the raw data, which may contain missing values, to derive datasets which are both spatially and temporally complete.												
Parameter	Symbol	Formula	Units	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Days in month	D		days	31	28	31	30	31	30	31	31	30	31	30	31	365
Rainfall	R		mm/month	54.8	43.7	48.8	51.2	57.4	63.8	71.3	69.3	62.3	69.2	58.4	49.3	699.4
Evaporation	E		mm/month	234.4	185.9	152.2	87.2	48.8	31.7	34.7	51.5	78.9	124.9	167.3	216.8	1414.4
Crop Factor	C		unitless	1.00	1.00	0.90	0.90	0.80	0.80	0.80	0.80	0.80	0.90	0.90	1.00	
OUTPUTS																
Evapotranspiration	ET	ExC	mm/month	234	186	137	78	39	25	28	41	63	112	151	217	1312.1
Percolation	B	DIRxD	mm/month	108.5	98	108.5	105.0	108.5	105.0	108.5	108.5	105.0	108.5	105.0	108.5	1277.5
Outputs		ET+B	mm/month	342.9	283.9	245.5	183.4	147.6	130.4	136.2	149.7	168.2	221.0	255.6	325.3	2589.6
INPUTS																
Retained Rainfall	RR	RxRF	mm/month	54.8	43.7	48.8	51.2	57.4	63.8	71.3	69.3	62.3	69.2	58.4	49.3	699.4
Applied Effluent	W	(QxD)/L	mm/month	64.9	58.6	64.9	62.8	64.9	62.8	64.9	64.9	62.8	64.9	62.8	64.9	764.5
Inputs		RR+W	mm/month	119.7	102.3	113.7	114.1	122.3	126.6	136.2	134.2	125.2	134.1	121.2	114.2	1463.9
STORAGE CALCULATION																
Storage remaining from previous month			mm/month	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Storage for the month	S	(RR+W)-(ET+B)	mm/month	-223.2	-181.6	-131.8	-69.4	-25.2	-3.8	0.0	-15.5	-43.0	-86.8	-134.3	-211.1	
Cumulative Storage	M		mm	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Maximum Storage for Nominated Area	N		mm	0.00												
	V	NxL	L	0												
LAND AREA REQUIRED FOR ZERO STORAGE			m ²	687	744	1006	1448	2194	2874	3047	2461	1809	1304	971	717	
MINIMUM AREA REQUIRED FOR ZERO STORAGE:				3047.0	m ²											