LANDSCAPE WORK SPECIFICATION

1.01 GENERAL

The following general conditions should be considered prior to the commencement of landscape works:

hydraulic plans, service plans and survey prepared for the proposed development. All services including existing drainage should be accurately located prior to the commencement of landscape installation. Any proposed tree planting which falls close to services will be relocated on site under the

The landscape plans should be read in conjunction with the architectural plans, project arborist's assessment

- instruction of the landscape architect. Installation of conduit for required irrigation, electrical and other services shall be completed prior to the
- commencement of hardscape works and hardstand pours All outdoor lighting specified by architect or client to be installed by qualified electrician
- Anomalies that occur in these plans should be brought to our immediate attention. Where an Australian Standard applies for any landscape material testing or installation technique, that

standard shall be followed.

1.02 PROTECTION OF ADJACENT FINISHES The Contractor shall take all precautions to prevent damage to all or any adjacent finishes by providing adequate

protection to these areas / surfaces prior to the commencement of the Works

1.03 PROTECTION OF EXISTING TREES Existing trees identified to be retained shall be done in accordance with (AS)4970-Protection of trees on development

sites as well as in accordance with the tree protection measures prepared by project arborist

Where general works are occurring around such trees, or pruning is required, a qualified Arborist shall be engaged to oversee such works and manage tree health

Existing trees designated on the drawing for retention shall be protected at all times during the construction period. Any soil within the drip-line of existing trees shall be excavated and removed by hand only. No stockpiling shall occur within the root zone of existing trees to be retained.

Any roots larger in diameter than 50mm shall only be severed under instruction by a qualified arborist. Roots smaller than 50mm diameter shall be cut cleanly with a saw.

Temporary fencing shall be installed around the base of all trees to be retained prior to the commencement of landscape works. Where possible this fencing will be located around the drip line of these trees, or a minimum of 3m from the trunk, The fencing shall be maintained for the full construction period.

1.04 EROSION & POLLUTION CONTROL

- Straw bale & geotextile sediment filter.

The Contractor shall take all proper precautions to prevent the erosion of soil from the subject site. The contractor shall install erosion & sediment control barriers and as required by council, and maintain these barriers throughout the construction period. Note that the sediment control measures adopted should reflect the soil type and erosion characteristics of the site.

Erosion & pollution control measures shall incorporate the following:

- Construction of a sediment trap at the vehicle access point to the subject site. - Sediment fencing using a geotextile filter fabric in the location indicated on the erosion control plan or as instructed on
- site by the landscape architect.
- Earth banks to prevent scour of stockpiles - Sandbag kerb sediment traps
- Exposed banks shall be pegged with an approved Jute matting in preparation for mass planting

Refer to "Sitewise Reference Kit" as prepared by DLWC & WSROC (1997) for construction techniques

2.01 MATERIALS

Specified Soil Conditioner (Generally to improve site soil)

The specified soil conditioner for site top-soil improvement shall be an organic mix, equal to "Botany Humus", as supplied by ANL. Note that for sites where soil testing indicates toxins or extremes in pH, or soils that are extremely poor, allow to excavate and supply 300mm of imported soil mix.

New gardens & proposed Planting

New garden and planting areas shall consist of a 50/50 mix of clean site soil (refer d) below) and imported "Organic Garden Mix" as supplied by ANL or approved equal. All mixes are to comply with AS 4419 Soils for landscaping & garden use, & AS 4454 Composts, Soil conditioners & mulches

The specified soil mix for all turf areas shall be a min 75mm layer of imported soil mix consisting of 80% washed river sand (reasonably coarse), and 20% composted organic matter equivalent to mushroom compost or soil conditioner, or other approved lawn top dress.

Site topsoil is to be clean and free of unwanted matter such as gravel, clay lumps, grass, weeds, tree roots, sticks, rubbish and plastics, and any deleterious materials and materials toxic to plants. The topsoil must have a pH of between 5.5 and 7. Use 100% imported soil mix when site when site topsoil runs out

2.02 INSTALLATION (TO GARDEN OUTSIDE OF TREE PROTECTION ZONES OF TREES RECOMMENDED TO BY

Note: No level changes (Cut or Fill), soil ripping within the Tree Protection Zones of trees to be retained

All testing is to be conducted in accordance with AS 1289 Methods for testing soils for engineering purposes. Site soil shall be given a pH test prior to modifying to ensure conditions are appropriate for planting as stated above. Tests shall be taken in several areas where planting is proposed, and the pH shall be adjusted accordingly with sulphur or lime to

Note that a soil test conducted by the "Sydney Soil Lab" or approved equal shall be prepared for all commercial, industrial and multi-unit residential sites. The successful landscape contractor shall implement the recommendations of

b) Set Out of Individual Trees & Mass Planting Areas

All individual tree planting positions and areas designated for mass planting shall be set out with stakes or another form of marking, ready for inspection and approval. Locate all services.

c) Establishing Subgrade Levels outside of tree protection zones of trees to be retained Subgrade levels are defined as the finished base levels prior to the placement of the specified material (i.e. soil

conditioner). The following subgrade levels shall apply: Mass Planting Beds - 300mm below existing levels with specified imported soil mix.

Turf areas - 100mm below finished surface level. Note that all subgrades shall consist of a relatively free draining natural material, consisting of site topsoil placed

previously by the Civil Contractor. No builders waste material shall be acceptable.

d) Subgrade Cultivation

Cultivate all subgrades to a minimum depth of 100mm in all planting beds and all turf areas, ensuring a thorough breakup of the subgrade into a reasonably coarse tilth. Grade subgrades to provide falls to surface and subsurface drains, prior to

e) Drainage Works Install surface and subsurface drainage where required and as detailed on the drawing. Drain subsurface drains to

outlets provided, with a minimum fall of 1:100 to outlets and / or service pits.

f) Placement and Preparation of Specified Soil Conditioner & Mixes. Trees in turf & beds - Holes shall be twice as wide as root ball and minimum 100mm deeper - backfill hole with 50/50 mix of clean site soil and imported "Organic Garden Mix" as supplied by ANL or approved equal.

Mass Planting Beds - Install specified soil conditioner to a compacted depth of 100mm Place the specified soil conditioner to the required compacted depth and use a rotary hoe to thoroughly mix the conditioner into the top 300mm of garden bed soil. Ensure thorough mixing and the preparation of a reasonably fine tilth and good growing medium in preparation for planting.

Turf Areas - Install specified soil mix to a minimum compacted depth of 75mm. Place the specified soil mix to the required compacted depth and grade to required finished soil levels, in preparation for planting and turfing.

PLANTING

3.01 MATERIALS

a) Quality and Size of Plant Material

Below - Ground Assessment

All trees supplied above a 25L container size must be grown and planted in accordance with AS 2303:2018 'TREE STOCK FOR LANDSCAPE USE' Certification that trees have been grown to AS 2303:2018 is to be provided upon request of Council's Tree Management Officer.

Above - Ground Assessment: The following plant quality assessment criteria should be followed:

Plant true to type, Good vigour and health, free from pest & disease, free from injury, self-supporting, good stem taper, has been pruned correctly, is apically dominant, has even crown symmetry, free from included bark & stem junctions, even trunk position in pot, good stem structure

Good root division & direction, rootball occupancy, rootball depth, height of crown, non-suckering For further explanation

and description of these assessment criteria, refer to Ross Clark's book. All Plant material shall be to the type and size specified. No substitutions of plant material shall be permitted without written prior approval by the Landscape Architect. No plant shall be accepted which does not conform to the standards

b) Stakes and Ties

listed above.

Provide min. 3 No. Stakes and ties to all plants identified as trees in the plant schedule. Stakes shall be sound, unpainted, straight hardwood, free of knots and pointed at one end. They shall be 1800mm x 50mm x 50mm Hardwood timber, or as per council specification where is available. Ties shall be 50mm wide hessian webbing material

Fertilisers shall be approved slow release fertilisers suitable for the proposed planting types. Note that for native plants, specifically Proteaceae family plants including Grevillea species, low phosphorus fertilizers shall be used.

d) Mulch Mulch for general planter bed shall be an approved equal to "EUCY" as supplied by ANL. Mulch shall be completely free from any soil, weeds, rubbish or other debris. Mulch for bio-retention/rain garden area where is required shall be non-floatable materials that could include crushed rock, gravel, coarse river sand, scoria or river pebbles. 4-7mm screenings or similar.

Turf for project site shall be soft leaf Buffalo or Zoysia macrantha 'Nana' or equivalent unless stated otherwise), free from any weeds and other grasses, and be in a healthy growing condition. Re-turfing to nature strip where is required shall use species that match existing on street.

3.02 INSTALLATION

a) Setting Out All planting set out shall be in strict accordance with the drawings, or as directed. Note that proposed tree planting located near services should be adjusted at this stage. Notify Landscape Architect for inspection for approval prior to

b) Planting All plant material shall be planted as soon after delivery as possible. Planting holes for trees shall be excavated as detailed and specified. Plant containers shall be removed and discarded, and the outer roots gently teased from the soil mass. Immediately set plant in hole and backfill with specified soil mix, incorporating the approved quantity of fertiliser for each plant type. Ensure that plants are set plumb vertically and root balls set to the consolidated finished grades detailed on the drawings. Compact the backfilled soil and saturate by hand watering to expel any remaining air pockets

c) Staking and Tying

Staking and tying shall be in strict accordance with the drawings and shall occur immediately following plant placement and soil backfilling. All plants identified as "Trees" on the planting schedule shall be staked with a min. 3 stakes.

Mulch for general planter bed shall be an approved equal to "EUCY" as supplied by ANL. Mulch shall be completely free from any soil, weeds, rubbish or other debris. Mulch for bio-retention/rain garden area where is required shall be non-floatable materials that could include crushed rock gravel, scoria or river pebbles, 4-7mm screenings or similar

f) Brick edging

Moisten soil prior to the turf being laid. Turf shall be neatly butt jointed and true to grade to finish flush with adjacent surfaces. Incorporate a lawn fertilizer and thoroughly water in. Keep turf moist until roots have taken and sods/rolls cannot be lifted. Keep all traffic off turf until this has occurred. Allow for top dressing of all turf areas. All turf shall be rolled immediately following installation

Where is required, the Contractor shall install brick edging as detailed on the drawings, to all mass planting beds

adjoining turf or gravel mulched areas, and where required. The resultant edge shall be true to line and flush with adjacent surfaces. However, no edging shall be used within the Structural Root Zone (SRZ) of trees to be retained.

g) Earth retaining structure All walls which form part of drainage works must be built as detailed by the hydraulic engineer. All walls exceeding

800mm shall be of **not** timber construction materials, construction details to be provided by a qualified engineer. Install

4.01 GENERAL

The Contractor shall undertake the installation of all hardscape works as detailed on the drawing, or where not detailed by manufacturers specification.

Paving - refer to typical details provided, and applicable Australian Standards, Permeable paving may be used as a suitable means of satisfying Council permeable surface requirements, while providing a useable, hardwearing, practical surface. In most instances, the client shall nominate the appropriate paving material t

Australian Standards shall be adhered to in relation to all concrete, masonry & metal work. Some details are typical and WHERE TREES may vary on site. All hardscape works shall be setout as per the drawings, and inspected and approved by the Landscape Architect prior to installation. All workmanship shall be of the highest standard. Any queries or problems that arise from hardscape variations should be bought to the attention of the Landscape Architect. Your attention is directed to any obligations or responsibilities under the Dividing Fences Act, 1991 in respect of adjoining property owner/s which may arise from this application. Any enquiries in this regard may be made to the Crown Lands

Division on (02) 8836 5332. **IRRIGATION WORKS**

5.01 GENERAL (PERFORMANCE SPECIFICATION)

wall to suit site levels and to manufacture's specification.

New irrigation systems to planting areas shall be a Commercial Grade Irrigation System conforming to all relevant Australian standards, including AS 3500 & the Electrical Safety Act 2002, Workplace Health & Safety Act 2011, & the latest Sydney Water Code

An automated drip-irrigation system is to be installed to all gardens, planters and lawn areas in accordance with the

This system shall be designed and installed by a qualified and licensed irrigation specialist, to industry standards and to maximise the efficient usage of water.

- The Landscape Contractor nominated Licensed Irrigation Specialist shall provide irrigation drawings for approval upon

engagement.

- The irrigation system shall be installed prior to all planting works. It shall incorporate a commercially available irrigation system, with sub-surface dripper lines to irrigate all gardens, planters and lawn areas. - It shall incorporate a suitable back flow prevention device for the scale of works, an in-line filter, check valves, and suitable high and low density poly hose fittings and PVC piping to achieve flow rates suitable for specified planting.

- The irrigation application rate shall not exceed the infiltration rate of the soil or creates run-off. - The landscape contractor shall check the existing pressure available from the ring mains and size irrigation piping to suit. Supply shall be from local hose cock where available.

- All piping and fittings shall be buried 50mm below the finished soil levels in garden and lawn areas, and secured in position at 500mm centres with galv wire pins. - Size of pipes shall be selected to ensure the working pressure at the end of the line does not decrease by more than

Services Co-ordination - Co-ordination required by Landscape Contractor or Project Manager to provide required conduit, pipe work and penetration through slabs and planter walls for water and power provisions - The Landscape Contractor shall be engaged with the Irrigation Specialist to co-ordinate with the Project Manager to

identify the preferred service and conduit locations. - Project Manager and Landscape Contractor to establish area suitable for irrigation control system with required area, power provision and water supply

Testing & Defects:

Upon completion of installation, the system shall be tested, including: - Main Line Pressure Test: The main line is pressurised to test for leaks. All valves are shut and the pressure is taken over a determined length of time.

- Dripper Pressure Test: Measurement at flushing valves are taken and the pressure gauged to make sure it conforms to the manufacturer recommendations. The inlet pressure is then tested under the same conditions to check it does not exceed 300Kpa. - All components are to be satisfactorily functional and operational prior to approval. Should any defect develop, or the

capacity or efficiency of the system decline during the agreed maintenance system, then these faults shall be immediately rectified.

- A full 12 month warranty shall be included to cover labour and all parts. **Further Documentation:**

- On request, a detailed irrigation performance specification report can be issued.

CONSOLIDATION AND MAINTENANCE

ARCHITEC^{*}

6.01 GENERAL

The consolidation and maintenance period shall be either 6 months beginning from the approved completion of the specified construction work (Practical Completion) as agreed to in the landscape contractors contractual obligations.

or as specified by Council in the Determination. A qualified landscape maintenance contractor shall undertake the required landscape maintenance works. Consolidation and maintenance shall mean the care and maintenance of Contracted works by accepted landscaping or horticultural practices, ensuring that all plants are in optimum growing conditions and appearance at all times, as well as rectifying

any defects that become apparent in the contracted works.

This shall include, but not be limited to, the following items where and as required Watering all planting and lawn areas / irrigation maintenance. • Clearing litter and other debris from landscaped areas.

 Removing weeds, pruning and general plant maintenance. Replacement of damaged, stolen or unhealthy plants. · Make good areas of soil subsidence or erosion.

• Topping up of mulched areas Spray / treatment for Insect and disease control.

Fertilizing with approved fertilizers at correct rates.

superintendent or landscape architect, the responsibility will be signed over to the client.

 Mowing lawns & trimming edges each 14 days in summer or 18 days in winter Adjusting ties to Stakes

 Maintenance of all paving, retaining and hardscape elements. On the completion of the maintenance period, the landscape works shall be inspected and at the satisfaction of the

1. CHAIN WIRE MESH PANELS WITH SHADE CLOTH (IF REQUIRED) ATTACHED, HELD IN PLACE WITH CONCRETE FEET


2. ALTERNATIVE PLYWOOD OR WOODEN PALING FENCE PANELS. THE FENCING MATERIAL ALSO PREVENTS BUILDING MATERIALS OR SOIL ENTERING THE TPZ

3. MULCH INSTALLATION ACROSS SURFACE OF TPZ (AT THE DISCRETION OF THE PROJECT ARBORIST). NO **EXCAVATION, CONSTRUCTION** ACTIVITY, GRADE CHANGES, SURFACE TREATMENT OR STORAGE OF MATERIALS OF ANY KIND IS PERMITTED WITHIN THE TPZ

4. BRACING IS PERMISSIBLE WITHIN THE TPZ. INSTALLATION OF SUPPORTS TO AVOID DAMAGING ROOTS

PROVIDE FENCING AS DETAILED TO ALL TREES PROPOSED TO BE RETAINED ON THE SUBJECT SITE. FENCING TO BE LOCATED TO THE DRIP LINE OF TREES OR AS INDICATED ON PLANS OR DIRECTED ON-SITE BY ARBORIST. NO STOCKPILING WITHIN FENCE PERIMETERS.

TREE PROTECTION ZONE

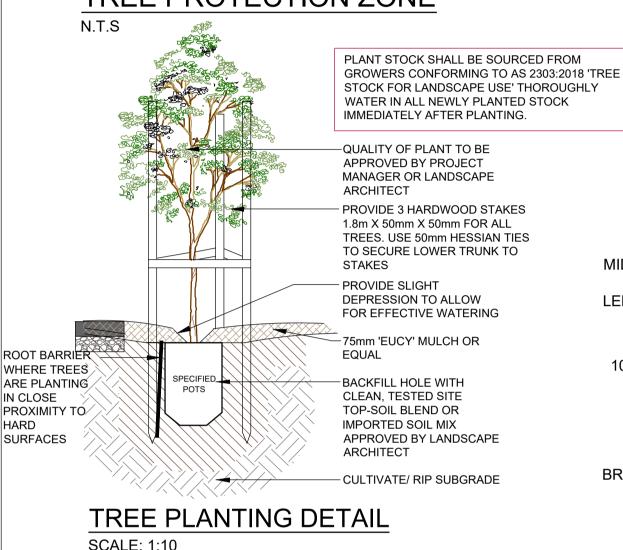

(ONLY APPLICABLE FOR PLANTING AREA OUTSIDE TREE

RIPPING/CULTIVATING OF THE SOIL WITHIN THE TPZ OF

Planting Mix 1:

Pot size:

PLANTING MIX 1 MATRIX

Brachyscome multifida

Casuarina glauca 'Cousin It'

Carpobrotus 'Aussie Rambler

Mature H x S: < .8m

Myoporum parvifolium 'Yareena'

Qty Required: Refer to matrix

Tube stock

ARE TO OCCUR TO EXISTING LEVELS, INCLUDING

TREES TO BE RETAINED ON SITE)

PROTECTION ZONE OF TREES TO BE RETAINED. NO CHANGES

MID & TOP RAILS 50 X 100 MM LENGTH TO SUIT 100MM SQUARE D.A.R T/PINE **TIMBER POST** PRIMED & PAINTED NOMINATED BRIGHT COLOUR

SPECIFIED

PLANTING &

300mm DERTH SOIL MIX BLEND

SUBSOIL CULTIVATED TO 100mm

TYPICAL GARDEN PREPARATION DETAIL

(ONLY APPLICABLE FOR PLANTING AREA OUTSIDE TREE PROTECTION

ZONE OF TREES TO BE RETAINED. NO CHANGES ARE TO OCCUR TO

EXISTING LEVELS, INCLUDING RIPPING/CULTIVATING OF THE SOIL

WITHIN THE TPZ OF TREES TO BE RETAINED ON SITE)

POT SIZE

TYPICAL SETBACK FROM

75mm DEPTH "EUCY" MULCH OR

50% OF STOCKPILED SITE TOPSOIL

AND DELETERIOUS MATERIALS.

MIX OR SOIL CONDITIONER/

SITE TOPSOIL RUNS OUT

FREE FROM ALL BUILDER'S RUBBISH

TOPSOIL TO BE AMELIORATED, MIXED

COMPOSTED ORGANIC MATTER - SEE

USE 100% IMPORTED SOIL MIX WHEN

WITH MINIMUM 50% IMPORTED GARDEN

LAWN/GARDEN EDGE

EQUIVALENT

SOIL MIX:

TIMBER TREE GUARDS

4/3m2

3/3m2

4/3m2

3/3m2

N.T.S

SCALE N.T.S

PLANTING MIX 1

Note: ALL SPECIES IN TUBE STOCK SIZE


Brachyscome multifida

Casuarina glauca 'Cousin It'


Carpobrotus 'Aussie Rambler'

Myoporum parvifolium 'Yareena'

Botanical Name

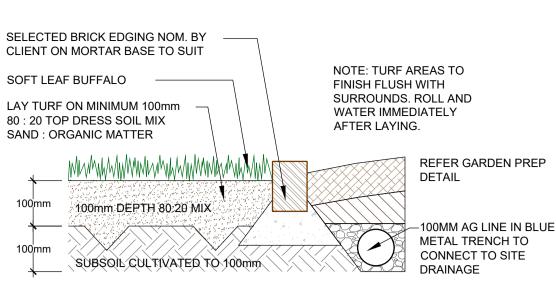

TYPICAL TURF AND BRICK EDGE DETAIL

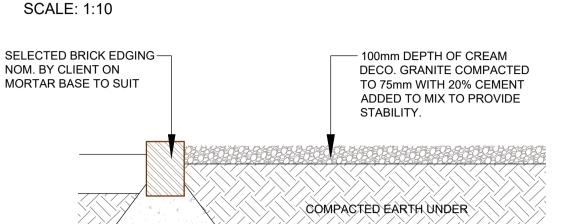

TYPICAL COMPACTED DECO GRANITE DETAIL **SCALE 1:10**


(140mm/190mm SIZE TO SUIT). FACE

BLOCK OR SMOOTH SKIM RENDER

FINISH AND PAINTED COLOR TO

- MULCH & MIN 300mm TOP SOIL FOR

MATCH DEVELOPMENT. 50mm CAPPING

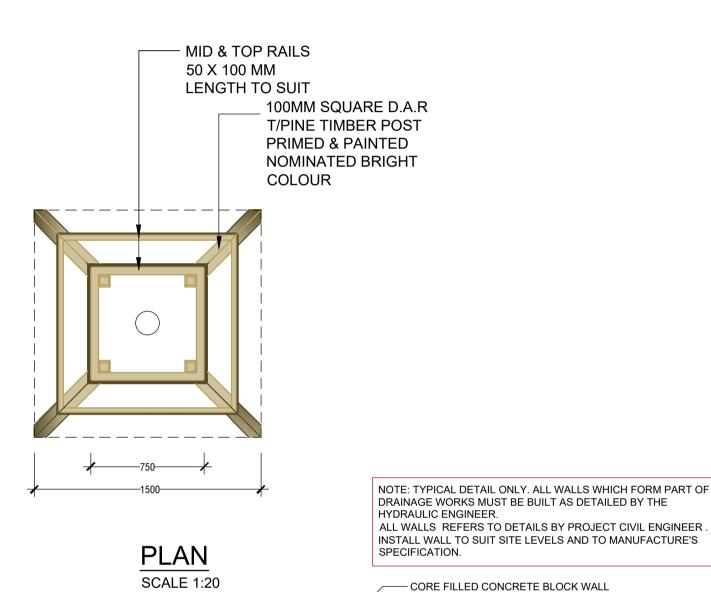

REFERS TO GARDEN PREPARATION DETAIL -STAGGERED PLANTING TO SPECIFIED DENSITIES AS SHOWN PLANTS AS PER SCHEDULE HEIGHT VARIOU MASS PLANTING SETOUT WATERPROOFING TO ALL WALLS: APPLY WELDED WATERPROOF MEMBRANE TO INSIDE OF WALL WITH PROTECTION BOARD (OR CORE FLUTE) OVER. Ø100mm AG LINE TO BASE OF MIN 300mm WIDTH DRAINAGE GRAVEL (NOM. 20mm BLUE METAL OR SIMILAR) TRENCH WITH FILTER FABRIC OVER TO CONNECT TO SITE DRAINAGE. UNDERTAKE WATER TEST PRIOR TO INSTALLING SOIL MIX. ADJACENT SURFACE AS SPEC ALL FOOTINGS TO ENGINEERS DETAILS AND SPECIFICATION

TYPICAL MASONRY BLOCK RETAINING WALL

APPROX 1:10

© Copyright Sulphurcrest Enterprises Pty Ltd Trading as CONZEPT
(ABN: 75 623 405 630) copyright. All rights are reserved. Unless permitted means be reproduced, published, broadcast or transmitted without the prior written permission of the copyright owner. to change, alteration or amendment at the discretion of our office

site. PDP'd plans may vary slightly in Scale for that indicated on plans. Report any whether special, consequential, direct or indirect, suffered by you or any other person as a result of your use of this drawin These plans and associated IP remain the propert Sulphurcrest Enterprises (T/A Conzept) until such time as agreed payments are made in full. We retain the right to withdraw this information from the assessmen payments are not made following the notification period.









LANDSCAPE ARCHITECT:

Mob: 0413 861 351 www.conzept.net.au

enquiries@conzept.net.au

Suit 101, 506 Miller Stree

	COUNCIL	REV	DATE	NOTATION/AMENDMENT	PROJECT:
	COOTAMUNDRA GUNDAGAI	Α	08.08.23	Preliminary DA plans prepared for review	PROPOSED COMMERCIAL
		В	14.08.23	Coordinated with architectural updates	I NOI OOLD COMMINILINGIAL
		С	17.08.23	Coordinated with SW plans	DEVELOPMENT
	CLIENT THE DOTT DEVELOPMENT PTY LTD	D	22.01.24	Coordinated with architectural updates	
		Е	24.01.24	Final submission	THE DOG ON THE TUCKER BOX
		F	16.04.24	Coordinated with architectural updates	37 ANNIE PYERS DR. GUNDAGAI
		G	27.06.24	Coordinated with architectural updates	31 AMME PTERS DR, GUNDAGAI

MY

DEVELOPMENT APPLICATION **DETAILS & SPECIFICATION JUNE 2024** R.F L.Z LPDA 24-24