

Toga High Street, Penrith

Development Application Acoustic Report

SYDNEY
A: 9 Sarah St
MASCOT 2020
T: (02) 8339 8000

SYDNEY MELBOURNE BRISBANE CANBERRA
LONDON DUBAI SINGAPORE GREECE

ABN: 11 068 954 343

The information in this document is the property of Acoustic Logic Consultancy Pty Ltd ABN 11 068 954 343 and shall be returned on demand. It is issued on the condition that, except with our written permission, it must not be reproduced, copied or communicated to any other party nor be used for any purpose other than that stated in particular enquiry, order or contract with which it is issued.

DOCUMENT CONTROL REGISTER

Project Number	20191477.2
Project Name	Toga High Street, Penrith
Document Title	Development Application Acoustic Report
Document Reference	20191477.2/1202A/R0/TA
Issue Type	Email
Attention To	Toga Penrith Developments Pty Ltd Daniel Borkovic

Revision	Date	Document Reference	Prepared By	Checked By	Approved By
0	12/02/2020	20191477.2/1202A/R0/TA	TA		TA

TABLE OF CONTENTS

1	INTRODUCTION	4
2	SITE DESCRIPTION	5
3	NOISE DESCRIPTORS.....	6
4	NOISE INTRUSION ASSESSMENT	7
4.1	PROJECT ACOUSTIC OBJECTIVES	7
4.1.1	State Environmental Planning Policy 2007	7
4.1.2	Australian and New Zealand AS/NZS 2107:2016 ' <i>Recommended design sound levels and reverberation times for building interiors</i> ' (Rail and Traffic Noise Intrusion)	8
4.1.3	Summary of Applicable Criteria	8
4.2	NOISE MEASUREMENTS	9
4.2.1	Glazing Construction	10
4.2.2	External Walls	11
4.2.3	Roof/Ceiling Construction	11
4.2.4	External Doors	11
4.3	MECHANICAL VENTILATION	11
5	NOISE EMISSION ASSESSMENT	13
5.1	BACKGROUND NOISE MONITORING	13
5.2	NOISE EMISSION OBJECTIVES – GENERAL OPERATION AND MECHANICAL PLANT	13
5.2.1	Penrith City Council Development Control Plan 2014	13
5.3	EPA - NOISE POLICY FOR INDUSTRY (NPfI)	13
5.3.1	NPfI - Intrusiveness Noise Goals	13
5.3.2	INP – Project Amenity Goals	14
5.4	SLEEP AROUSAL ASSESSMENT	14
5.5	ASSESSMENT OF NOISE EMISSIONS	16
5.5.1	Mechanical plant	16
5.5.2	Podium Car Park	16
5.5.3	Retail	16
5.5.4	Garbage Collection	16
6	CONCLUSION.....	17

1 INTRODUCTION

This report presents our development application acoustic assessment for the proposed Stage 1 mixed-use development at 634-652 High Street & 87 – 91 Union Road, Penrith.

This report will:

- Conduct an external noise intrusion assessment (primarily traffic noise) and recommend acoustic treatments to ensure that a reasonable level of amenity is achieved for future occupants. Traffic noise at the site have been measured and assessed in accordance with Penrith Council requirements, Australian Standard 2107:2000 and NSW State Environmental Planning Policy (Infrastructure) 2007.
- Conduct background noise monitoring to determine noise emission goals for future use of the development to meet council and NSW EPA acoustic requirements.

The assessment is based on architectural drawings by SJB Architects AR-1-002 to AR-1-1038 dated January 2020.

2 SITE DESCRIPTION

The site is located at 87-91 Union Road / 634-368 High Street in Penrith (Site 1). Toga has another site at 640-652 High Street Penrith (Site 2) which will be progressed in a separate Development Application. Toga's sites are dissected by John Tipping Grove which is a council owned road. This document has been prepared for the Development Application on Site 01, 87-91 Union Road / 634-368 High Street Penrith.

The proposed development comprises of residential buildings, retail and associated parking. Buildings 1 and 2 are joined together by a common ground floor podium, underground basement and podium car parking areas. Thus, both residential buildings are considered to be a united building under a single DA.

The precinct consists of up to 355 apartments and approximately 993 sqm of retail. SJB and Architect Prineas have been appointed as the architectural team through winning the design excellence competition.

The future northern façade faces the High Street which carries medium to high volumes of traffic. The southern boundary of the site abuts Union Road which carries low volumes of traffic. The East of the site is bounded by future and existing residential development and to the west of the site lies the proposed Stage 2 of the project.

Figure 1 shows the site surroundings and measurement locations.



Figure 1: Site Map and Measurement Locations

3 NOISE DESCRIPTORS

Traffic noise constantly varies in level, due to fluctuations in traffic speed, vehicle types, road conditions and traffic densities. Accordingly, it is not possible to accurately determine prevailing traffic noise conditions by measuring a single, instantaneous noise level. To accurately determine the effects of traffic noise a 15-20 minute measurement interval is utilised. Over this period, noise levels are monitored on a continuous basis and statistical and integrating techniques are used to determine noise description parameters. These parameters are used to measure how much annoyance would be caused by a particular noise source.

In the case of environmental noise three principle measurement parameters are used, namely L_{10} , L_{90} and L_{eq} .

The L_{10} and L_{90} measurement parameters are statistical levels that represent the average maximum and average minimum noise levels respectively, over the measurement intervals.

The L_{10} parameter is commonly used to measure noise produced by a particular intrusive noise source since it represents the average of the loudest noise levels produced at the source.

Conversely, the L_{90} level (which is commonly referred to as the background noise level) represents the noise level heard in the quieter periods during a measurement interval. The L_{90} parameter is used to set the allowable noise level for new, potentially intrusive noise sources since the disturbance caused by the new source will depend on how audible it is above the pre-existing noise environment, particularly during quiet periods, as represented by the L_{90} level.

The L_{eq} parameter represents the average noise energy during a measurement period. This parameter is derived by integrating the noise levels measured over the measurement period. L_{eq} is important in the assessment of traffic noise impact as it closely corresponds with human perception of a changing noise environment; such is the character of traffic noise.

Current practice favours the L_{eq} parameter as a means of measuring traffic noise, whereas the L_{10} parameter has been used in the past and is still incorporated in some codes. For the reasons outlined above, the L_{90} parameter is not used to assess traffic noise intrusion.

LA_{max} refers to the maximum noise level occurring during a measurement period, and is used when assessing sleep disturbance impacts.

4 NOISE INTRUSION ASSESSMENT

4.1 PROJECT ACOUSTIC OBJECTIVES

Penrith Council DCP states the following with respect to noise intrusion:

Part C, Section 12.1, Road Traffic Noise

“1) Road traffic noise criteria including sensitive land uses

- a) Council will not grant consent to development, particularly residential development, including subdivisions, unless the impact of traffic noise from freeway, arterial, designated or collector roads complies with the standards and guidelines for road traffic noise prepared by the relevant State Government authorities or agencies, as well as relevant Australian Standards.*
- b) Council will not grant consent to development for sensitive land uses unless it complies with the provisions and standards for road traffic noise prepared by the relevant State Government authorities or agencies, as well as relevant Australian Standards.*
- c) Sensitive land uses subject to road traffic noise criteria referred to in b) above include educational establishments (including schools), places of public worship, hospitals, and passive and active recreation areas.*

Noise Impact Statements - Specific Requirements

- a) Where a site is likely to be affected by unacceptable levels of road traffic noise, the applicant is required to provide a Noise Impact Statement prepared by a qualified acoustic consultant in accordance with the requirements set out in the DA Submission Requirements Appendix of this DCP.*

The Noise Impact Statement should demonstrate acoustic protection measures necessary to achieve an indoor environment meeting residential standards, in accordance with EPA and Department of Planning Criteria, as well as relevant Australian Standards.”

As per the requirements of the Penrith DCP, the assessment of noise intrusion has been conducted in accordance with the NSW State Environmental Planning Policy Infrastructure (2007).

4.1.1 State Environmental Planning Policy 2007

The NSW Department of Planning’s policy, Development Near Rail Corridors And Busy Roads – Interim Guideline, sets out internal noise level criteria adapted from the State Environmental Planning Policy (Infrastructure) 2007 (the ‘Infrastructure SEPP’) for developments with the potential to be impacted by traffic or rail noise and vibration.

The Infrastructure SEPP defines busy roads that are subject to an acoustic assessment as:

“Clause 102: development for any of the following purposes that is on land in or adjacent to a road corridor for a freeway, a tollway or a transit way or any other road with an annual average daily traffic volume of more than 40,000 vehicles (based on the traffic volume data available on the website of the RTA) and that the consent authority considers is likely to be adversely affected by road noise or vibration:

- building for residential use*
- a place of public worship*

- a hospital
- an educational establishment or childcare.”

The Infrastructure SEPP sets out the following criteria for internal noise levels from airborne traffic noise:

“For Clauses 87 (Rail) and 102 (Road):

“If the development is for the purpose of a building for residential use, the consent authority must be satisfied that appropriate measures will be taken to ensure that the following L_{Aeq} levels are not exceeded:

in any bedroom in the building: 35dB(A) at any time 10pm–7am

anywhere else in the building (other than a garage, kitchen, bathroom or hallway): 40dB(A) at any time.”

Internal requirements are for residential spaces and are measured internally with windows closed.

4.1.2 Australian and New Zealand AS/NZS 2107:2016 ‘Recommended design sound levels and reverberation times for building interiors’ (Rail and Traffic Noise Intrusion)

For non-residential spaces (retail / commercial) Australian Standard AS 2107-2016: Recommended design sound levels and reverberation times for building interiors specifies allowable internal noise levels for internal spaces. Table 1, in Section 5 of AS 2107-2016, gives the following maximum internal noise levels for commercial buildings near major roads.

Table 1 – Recommended Design Sound Level

Space /Activity Type	Recommended Maximum Design Sound Level dB(A) L_{eq}
Commercial	45 dB(A) L_{eq}
Retail	50dB(A) L_{eq}

4.1.3 Summary of Applicable Criteria

The governing project criteria are presented in the table below.

Table 2 – Internal Noise Level Criteria

Location	Criteria
	Traffic Noise Intrusion
Bedroom	35 dB(A) $L_{eq(9hr)}$
Living Area	40 dB(A) $L_{eq(15hr)}$
Commercial	45 dB(A) L_{eq} (9 hour, when in use)
Retail	50dB(A) L_{eq} (9 hour, when in use)

Compliance with the criteria in the table above will result in compliance with Council's DCP and SEPP Infrastructure.

4.2 NOISE MEASUREMENTS

Traffic measurements were taken along all future facades the proposed development. Both short term (attended) and long term (unattended) measurements were conducted.

Long term monitors were installed both within the middle of the existing site (between Union and High Street) and within the existing car dealership, facing High Street. The monitor had a full view of the road without any obstructions, as indicated in Figure 1. The long-term noise monitor was conducted from 8 February to 15 February 2018. Supplementary attended measurements were taken at various locations of the site, as shown in Figure 1. The attended measurements were taken on 8 February and 15 February 2018. Supplementary attended measurements were undertaken on the 4 and 7 February 2020 to confirm noise levels.

The long-term monitoring was conducted using an Acoustic Research Laboratories Pty Ltd noise logger. The logger was set to A-weighted fast response and was programmed to store 15-minute statistical noise levels throughout the monitoring period. The monitor was calibrated at the start and end of the monitoring period using a Rion NC-73 calibrator. No significant drift was noted.

Attended measurements were undertaken using a Norsonic 140 sound level analyser, set to A-weighted fast response. The sound level analyser was calibrated before and after the measurements, no significant drift was noted.

The traffic noise levels listed in the table below were determined based on the logging data and attended measurements. In determination of acoustic treatments, the measured level is adjusted for distance and orientation.

Table 3 – External Noise Level (Traffic Noise)

Location	Time Period	Traffic Noise Level
Future Northern Façade (High Street)	Day	63dB(A) L_{Aeq} (15hr)
	Night	59dB(A) L_{Aeq} (9hr)

4.2.1 Glazing Construction

The recommended glazing assemblies are indicated in the table below. The glazing thicknesses recommended are those needed to satisfy acoustic requirements and do not take into account other requirements such as structural, safety or other considerations. These additional considerations may require the glazing thickness to be increased beyond the acoustic requirement.

Table 4 – Building 2 - Glazing Requirements

Façade	Room	Glazing Thickness	Acoustic Seals
High Street	Bedroom	10.38mm laminated glass	Yes
	Living Room	6.38mm laminated glass	Yes
Eastern / Western	Bedroom	6.38mm laminated glass	Yes
	Living Room	6.38mm laminated glass	Yes
Facing Building 1	Bedroom	6mm glass	Yes
	Living Room	6mm glass	Yes

Table 5 – Building 1 - Glazing Requirements

Façade	Room	Glazing Thickness	Acoustic Seals
Union Road	Bedroom	6.38mm laminated glass	Yes
	Living Room	6.38mm laminated glass	Yes
Eastern	Bedroom	6mm glass	Yes
	Living Room	6mm glass	Yes
Western	Bedroom	6.38mm laminated glass	Yes
	Living Room	6.38mm laminated glass	Yes
Facing Building 2 (north)	Bedroom	6.38mm laminated glass	Yes
	Living Room	6.38mm laminated glass	Yes

Table 6 – Retail / Commercial

Façade	Room	Glazing Thickness	Acoustic Seals
High Street	Retail	6mm toughened	Yes
	Commercial	10mm toughened	Yes
All Others	Retail	6mm toughened	Yes
	Commercial	6mm toughened	Yes

Note: Glazing to be reviewed at CC stage based on construction drawings.

In addition to complying with the minimum scheduled glazing thickness, the R_w rating of the glazing fitted into operable frames and fixed into the building opening should not be lower than the values listed in the table below.

Where nominated, this will require the use of acoustic seals equal to Schlegel Q-Ion series (*acoustic bulb seal*) around the full perimeter of operable frames. The frame will need to be sealed into the building opening using a flexible 100% polyurethane sealant equal to Bostik Seal N' Flex. Note that mohair seals and/or mohair/plastic fin combination seals in windows and doors are **not** acceptable where acoustic seals are required.

It is recommended that only window systems have test results indicating compliance with the required ratings obtained in a certified laboratory be used where windows with acoustic seals have been recommended.

Table 7 – Minimum R_w of Glazing Requirements

Glazing Assembly	Acoustic Seals	Minimum R_w of Installed Window
6mm toughened	Yes	29
6.38mm laminated	Yes	31
10mm toughened	Yes	33
10.38mm laminated	Yes	35

4.2.2 External Walls

For external walls of masonry construction, no acoustic upgrade is required. There should be no vents on the internal skin of external walls. All penetrations in the internal skin of external walls should be acoustically sealed. In the event lightweight external constructions are used, these are to be reviewed at CC stage.

4.2.3 Roof/Ceiling Construction

The proposed concrete slab roof does not require any acoustic upgrade. Penetrations in ceilings (such as for light fittings etc.) must be sealed gap free with a flexible sealant. Any ventilation openings in the ceilings would need to be acoustically treated to maintain the acoustic performance of the ceiling construction.

4.2.4 External Doors

Any glass doors should be constructed using glazing thickness set out in Table 4-6. Full perimeter acoustic seals around the doors are required.

4.3 MECHANICAL VENTILATION

As internal levels cannot be achieved with windows open, it is required that an alternative outside air supply system or air conditioning be installed to meet AS 1668.2 requirements.

Any mechanical ventilation system that is installed should be acoustically designed such that the acoustic performance of the recommended constructions is not reduced by any duct or pipe penetrating the wall/ceiling/roof.

Noise emitted to the property boundaries by any ventilation system shall comply with EPA or Local Council guidelines.

5 NOISE EMISSION ASSESSMENT

The external noise emission criteria are set up in this section of the report to ensure that the amenities of nearby land users are not adversely affected.

5.1 BACKGROUND NOISE MONITORING

A long-term unattended monitor was used for background noise measurements supplemented with attended measurements at the boundaries of the site.

Table 8 – Measured Background Noise Levels

Location	Period/Time	Background Noise Level dB(A) L ₉₀ (period)
Surrounding Residential Receivers	Day (7am-6pm)	50
	Evening(6pm-10pm)	43
	Night(10pm-7am)	37

5.2 NOISE EMISSION OBJECTIVES – GENERAL OPERATION AND MECHANICAL PLANT

The following documents are used to establish the noise emission criteria for the development site:

- Penrith City Council Development Control Plan 2014;
- EPA Noise Policy for Industry; and
- Protection of Environmental Operation Act Regulation

5.2.1 Penrith City Council Development Control Plan 2014

Penrith Council Development Control Plan does not contain any explicit noise criteria for noise emissions. Therefore, the typically adopted NSW EPA Noise Policy for Industry will be adopted.

5.3 EPA - NOISE POLICY FOR INDUSTRY (NPfi)

Noise sources covered by this code include mechanical services noise (the identified potential noise emission source from the site). Both the Intrusiveness and the Project Amenity criteria (as set out below) must be complied with.

5.3.1 NPfi - Intrusiveness Noise Goals

Intrusiveness criteria permit noise generation to be no more than 5dB(A) above existing background noise levels. The criteria are as follows:

Table 9 - EPA Intrusiveness Criteria

Location	Time of Day	Background noise Level - dB(A) L_{90}	Project Trigger Noise Level dB(A) $L_{eq(15min)}$ (Background + 5dB)
Residences Surrounding the Site	Day Time (7am - 6pm)	50	55
	Evening (6pm - 10pm)	43	48
	Night (10pm - 7am)	37	42

5.3.2 INP – Project Amenity Goals

Project amenity criteria are determined based on the land use in the area (residential/commercial/industrial). The residential land use is then further categorised into rural, sub-urban and urban areas. For the purpose of this assessment the existing residential dwellings will be considered urban .

Table 10 -EPA Project Amenity Criteria

Noise Receiver	Project Trigger Noise Level – dB(A) $L_{Aeq(15min)}$		
	Daytime	Evening	Night
Existing Residential (Urban)	58	48	43

5.4 SLEEP AROUSAL ASSESSMENT

Potential sleep arousal impacts should be considered for noise generated after 10pm.

Sleep arousal is a function of both the noise level and the duration of the noise.

As recommended in the NPfI, to assess potential sleep arousal impacts, a two-stage test is carried out:

- Step 1 – Section 2.5 *Maximum noise level event assessment* from the NPfI states the following:

Where the subject development/premises night-time noise levels at a residential location exceed:

- $L_{Aeq,15min}$ 40dB(A) or the prevailing RBL plus 5 dB, whichever is the greater, and/or
 - L_{AFmax} 52 dB(A) or the prevailing RBL plus 15 dB, whichever is greater,
- a detailed maximum noise level event assessment should be undertaken.*

Based on the above the following noise objectives apply:

Table 11– Sleep Arousal Criteria (Maximum/ L_{Max} Noise Events)

Location	Rating Background Level dB(A)L_{90}	Rating Background Level + 15dB(A)	Governing Criteria dB(A)$L_{(Max)}$
Surrounding Residential Receivers	37	52	52

- Step 2 - If there are noise events that could exceed the average/maximum criteria detailed in the tables above, then an assessment of sleep arousal impact is required to be carried out taking into account the level and frequency of noise events during the night, existing noise sources, etc. This test takes into account the noise level and number of occurrences of each event with the potential to create a noise disturbance. As is recommended in the explanatory notes of the EPA Industrial Noise Policy, this more detailed sleep arousal test is conducted using the guidelines in the EPA Road Noise Policy. Most relevantly, the Road Noise Policy states:

For the research on sleep disturbance to date it can be concluded that:

- *Maximum internal noise levels below 50-55dB(A) are unlikely to awaken people from sleep.*
- *One to two noise events per night with maximum internal noise levels of 65-70dB(A) are not likely to affect health and wellbeing significantly.*

5.5 ASSESSMENT OF NOISE EMISSIONS

5.5.1 Mechanical plant

Detailed review of all external mechanical plant should be undertaken at construction certificate stage (once plant selections and locations are finalised). Acoustic treatments should be determined in order to control plant noise emissions to the levels set out in section 5 of this report.

While compliance with noise emission requirements will be achievable with appropriate acoustic treatment, it is highly likely that any roof top equipment which operates 24 hours per day (such as refrigeration plant) will require either enclosure in plant rooms or acoustic screens to provide a line of sight break between the equipment and any future residences.

Other equipment external items (fans) would be expected to be capable of compliance through use of internal duct lining and/or in-duct attenuators.

5.5.2 Podium Car Park

The following development controls should be incorporated to ensure that the noise emissions from the car park comply with the nominated criteria.

- The car park pavement shall be smooth and level to ensure minimal vertical displacement and potential for noise generated by wheel to concrete impacts. The surface finish shall be of a type that minimises squealing of car tyres.
- Concrete to have a broom finish or similar, to prevent tyre squeal.
- Traffic calming devices should be applied to control vehicle speeds 10km/Hour.
- No speed humps are to be installed within the car park.
- Grates and any cover plates are to be fixed flush and tight. Any cover plate are to be smooth and level with the slab (ie no humps).

5.5.3 Retail

In the event that café tenants propose late night use of outdoor dining areas, we assume this would be part of a separate development application where detailed review of operating times and patron numbers (and the associated noise generated) would be assessed with reference to Council and (if necessary) Office of Liquor Gaming and Racing acoustic criteria.

5.5.4 Garbage Collection

Recommendations are as follows:

- All bins' handling is to be conducted within the garbage collection area (ie within the covered area)
- Baler to be vibration isolated from the building structure.

6 CONCLUSION


This report presents our acoustic assessment for the proposed Stage 1 mixed-use development at 634-652 High Street & 87 – 91 Union Road, Penrith

Noise intrusion impact from traffic noise onto the future occupants of the development has been assessed in accordance with State of Environment Planning Policy (Infrastructure) and Penrith Council DCP. The acoustic treatments in principle necessary to achieve these guidelines have been set presented within this report.

Noise emission criteria for the development site have been determined based on the site noise logging and NSW EPA Noise Policy for Industry and Protection of the Environmental Operation Act Regulation. These requirements have been presented in Section 5.

We trust this information is satisfactory. Please contact us should you have any further queries.

Yours faithfully,

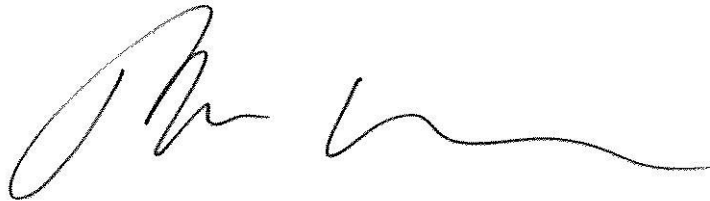
A handwritten signature in black ink, appearing to read 'Tom Aubusson', with a long horizontal flourish extending to the right.

Tom Aubusson MAAS


Appendix 1

Noise Logging Data


High Street, Penrith: Thursday 08 February, 2018

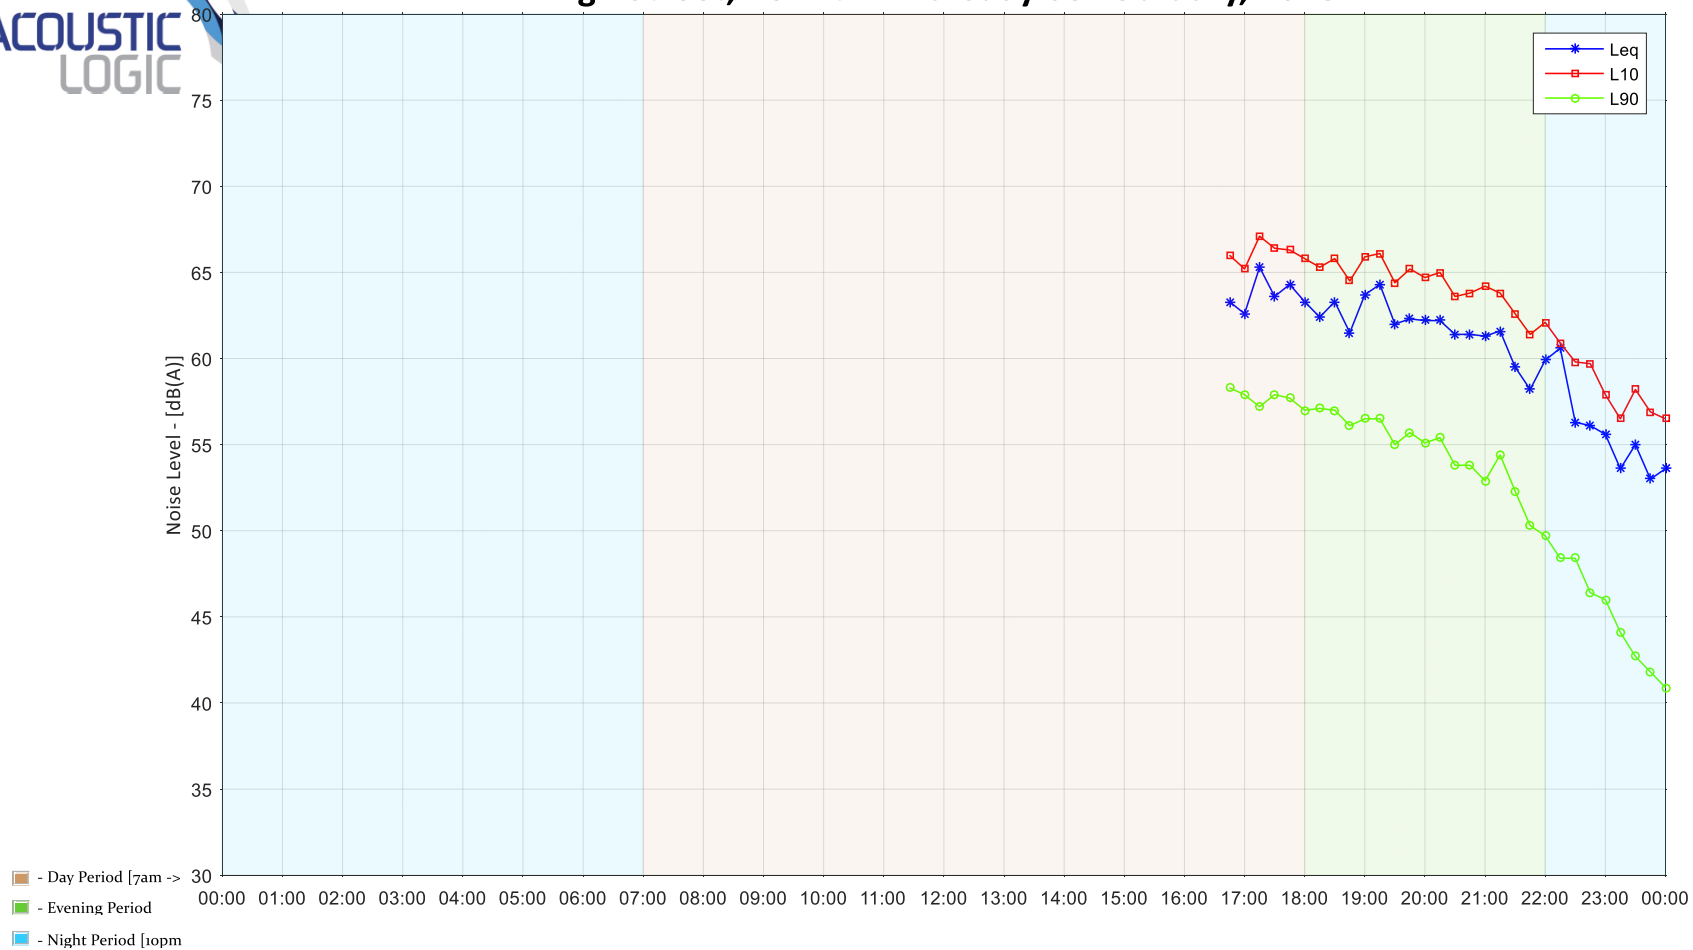


High Street, Penrith: Friday 09 February, 2018

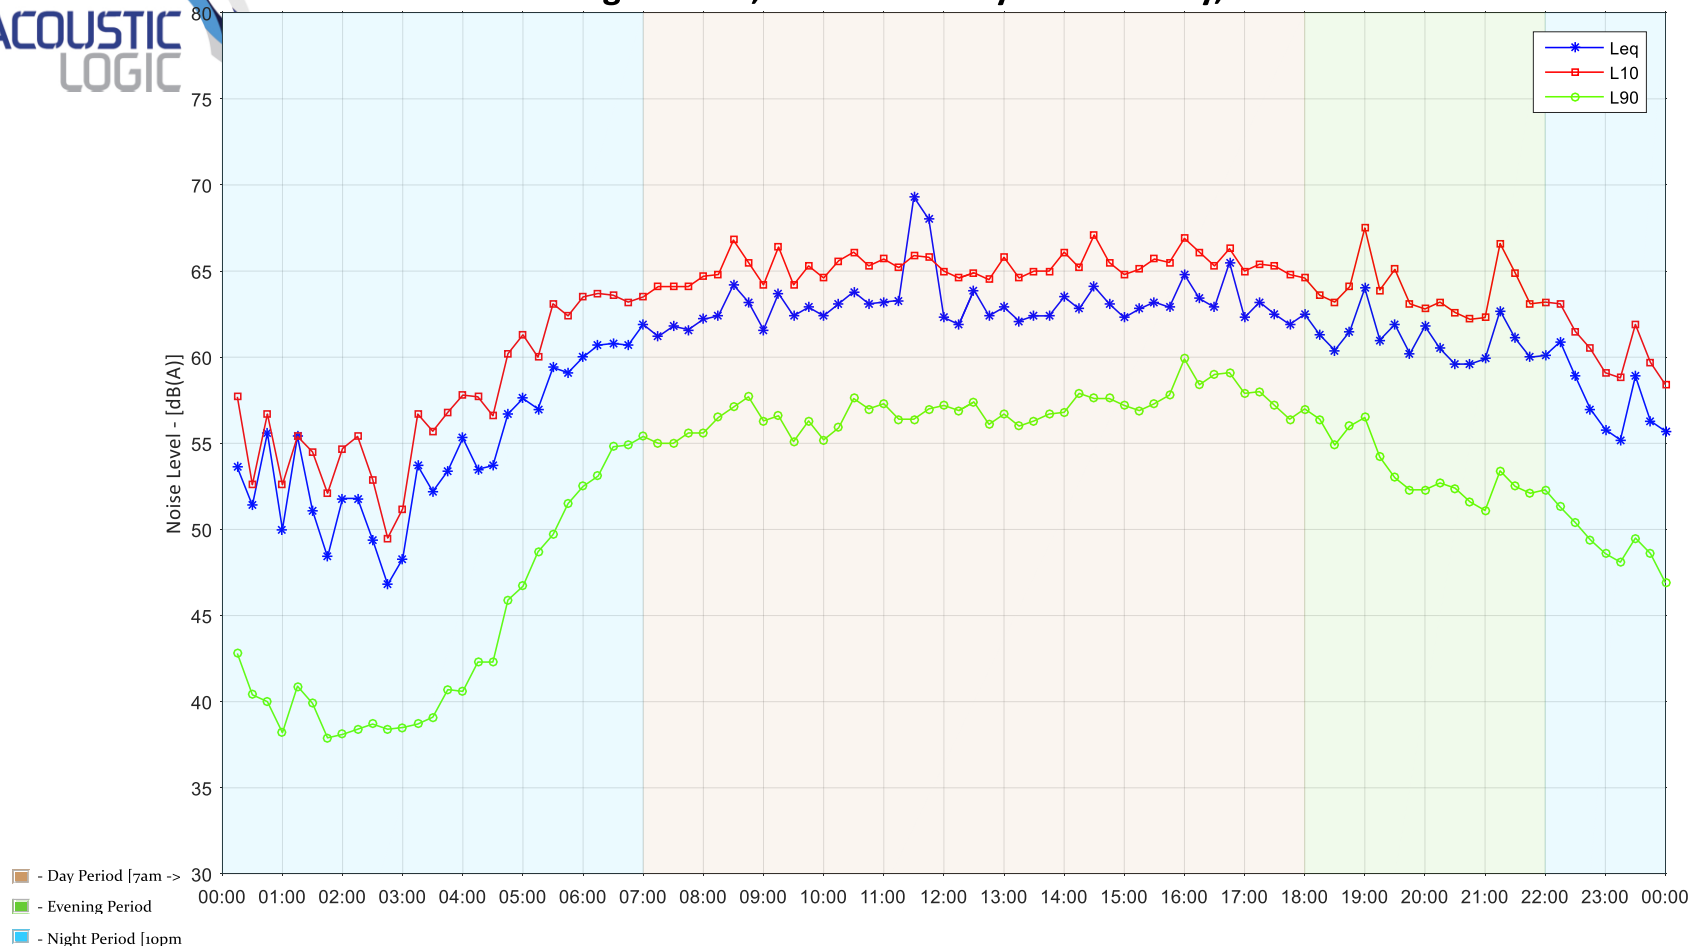


High Street, Penrith: Saturday 10 February, 2018

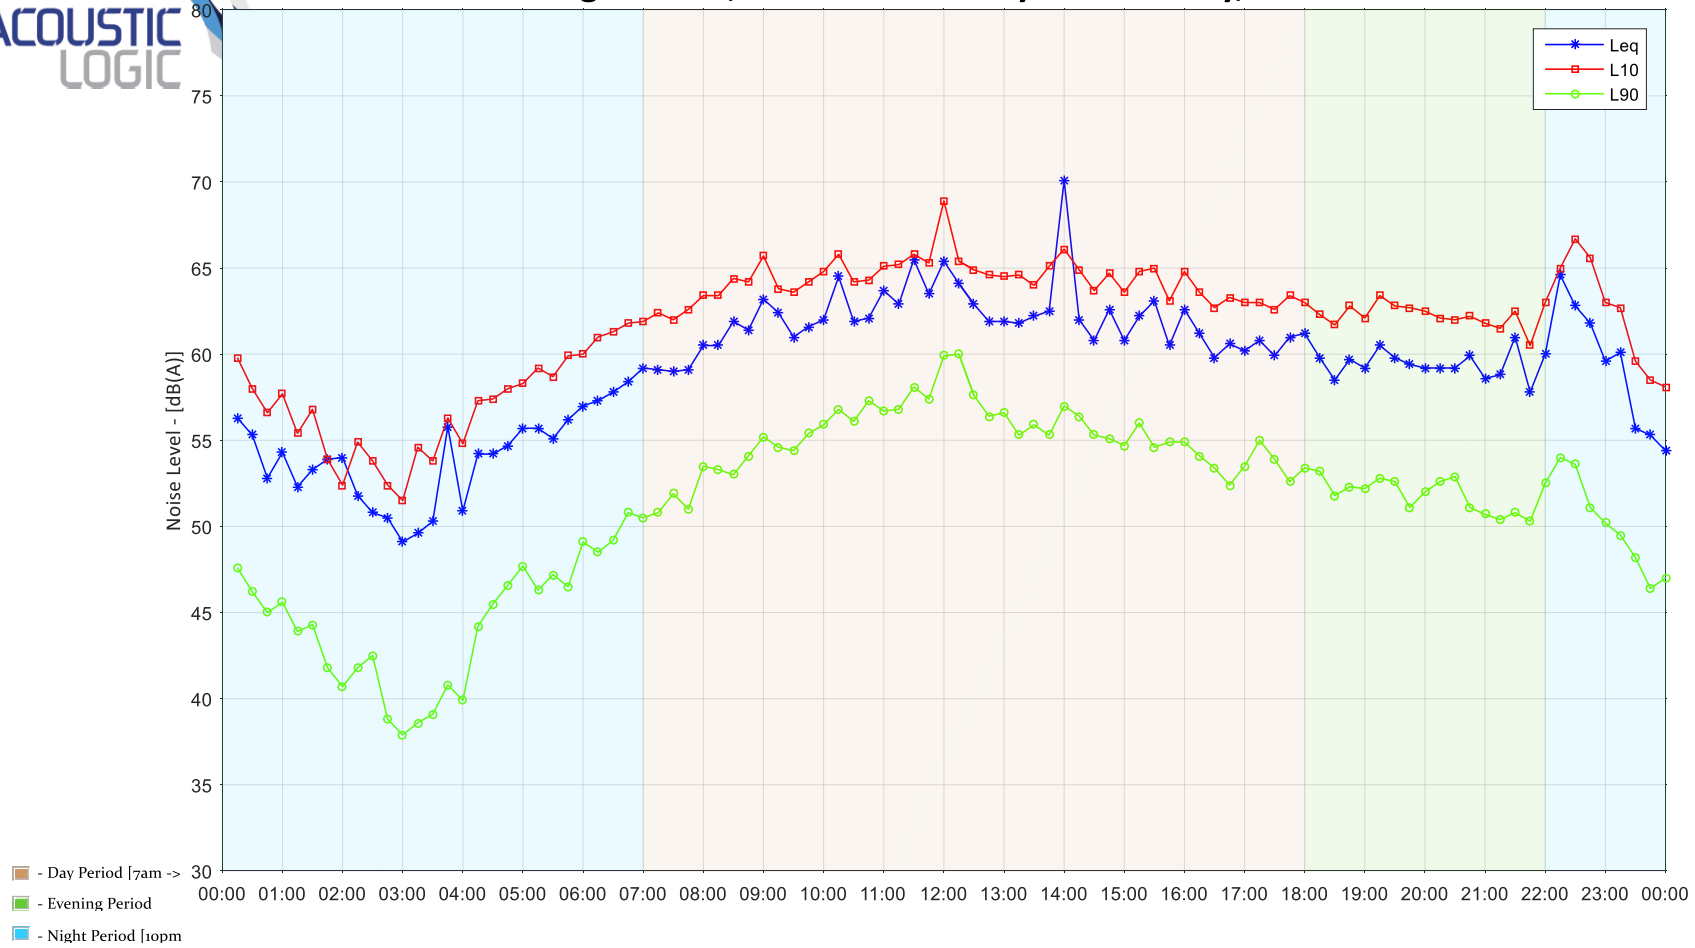

High Street, Penrith: Sunday 11 February, 2018

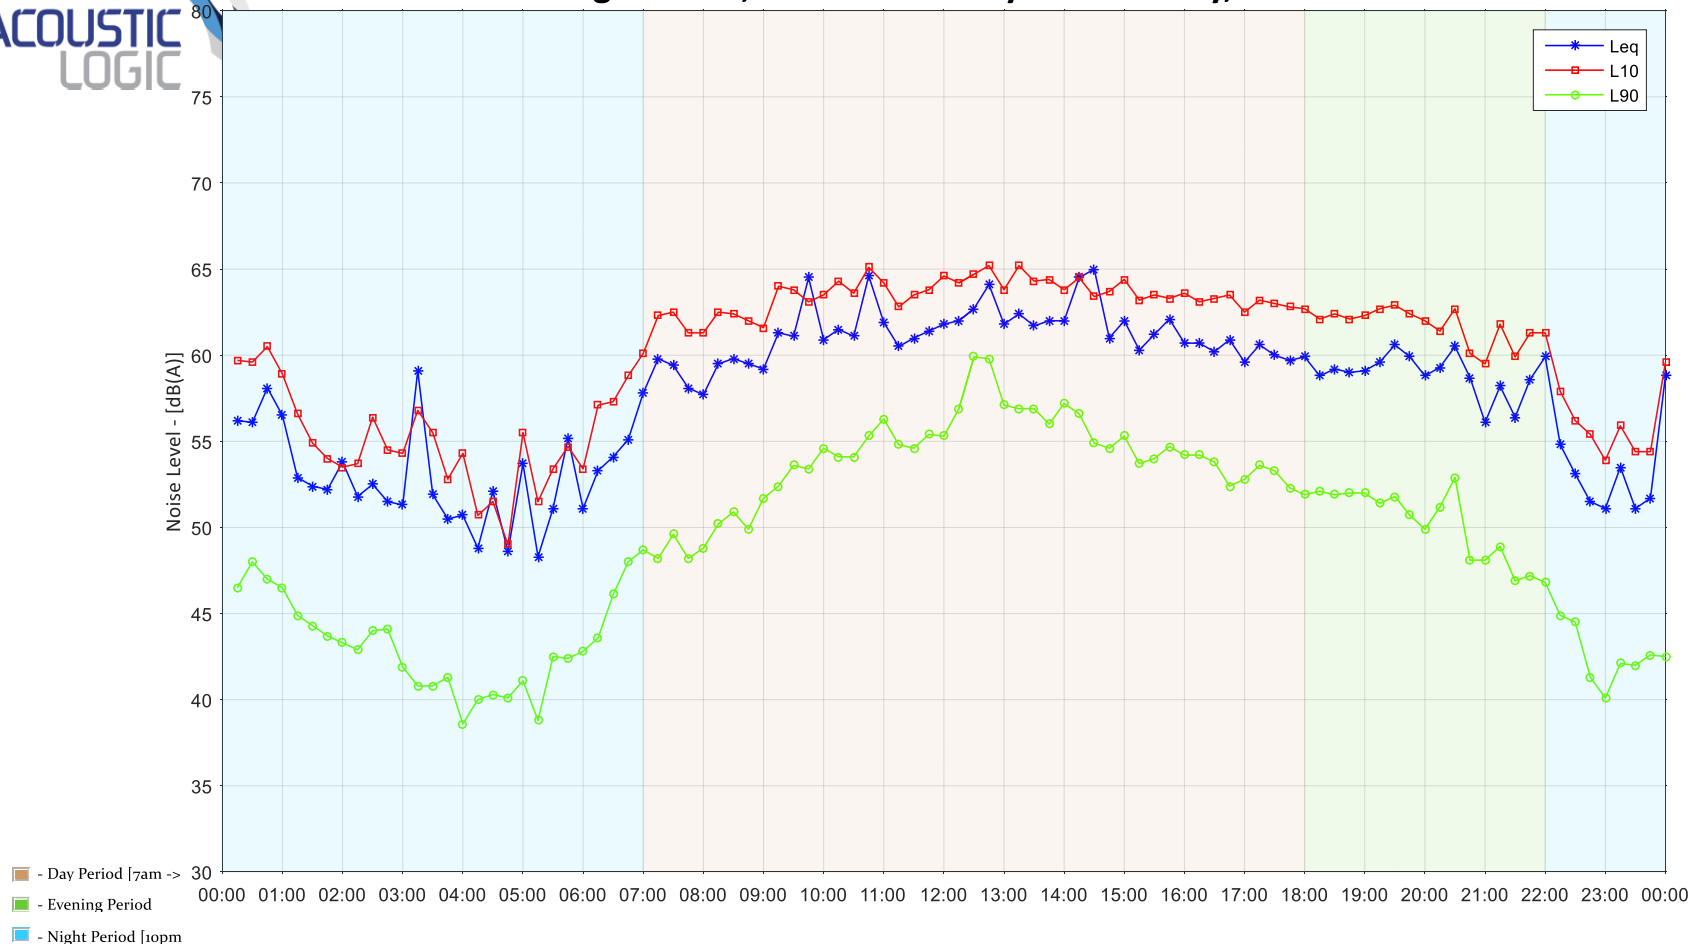


High Street, Penrith: Monday 12 February, 2018

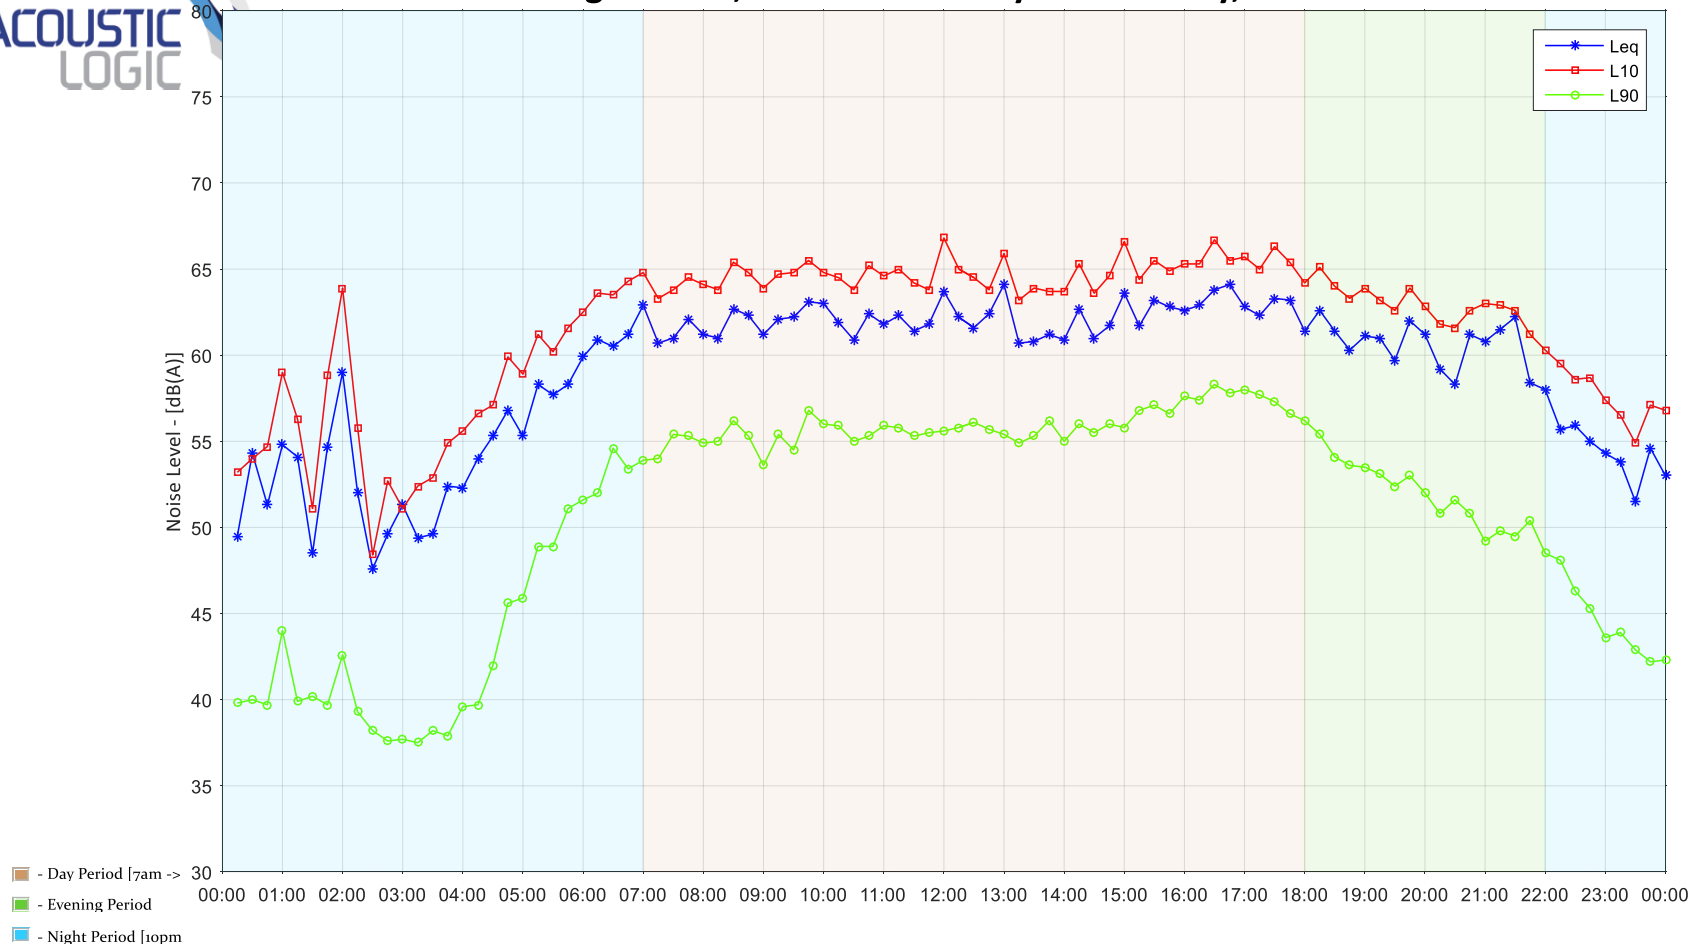




High Street, Penrith: Tuesday 13 February, 2018

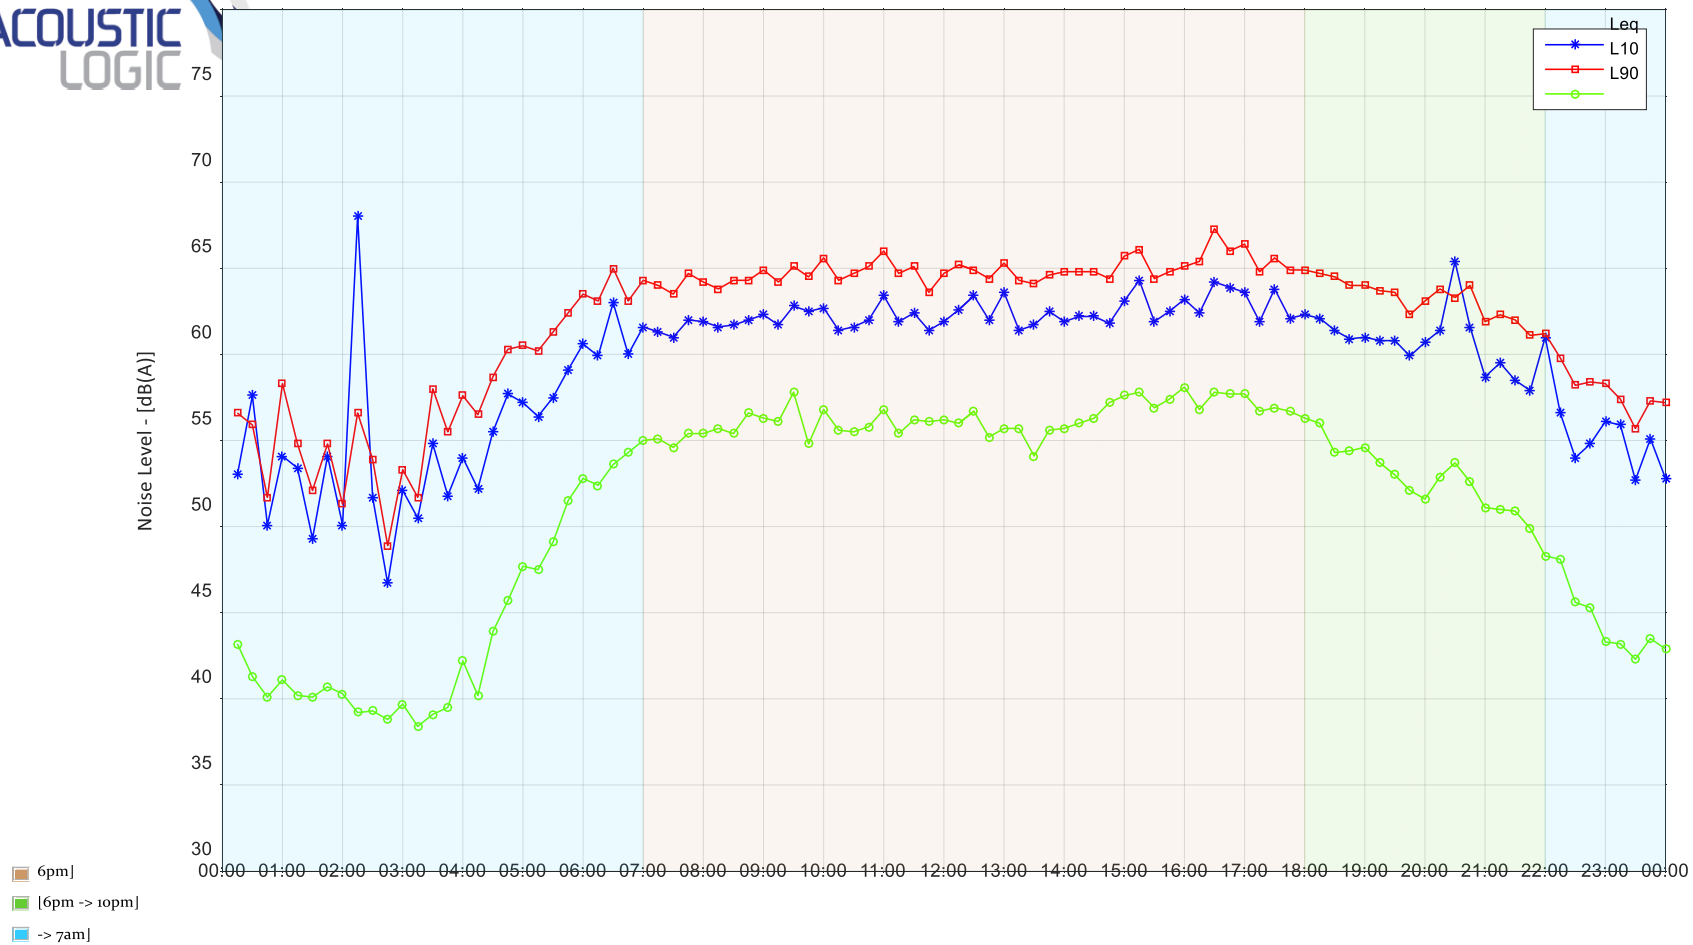


High Street, Penrith: Wednesday 14 February, 2018

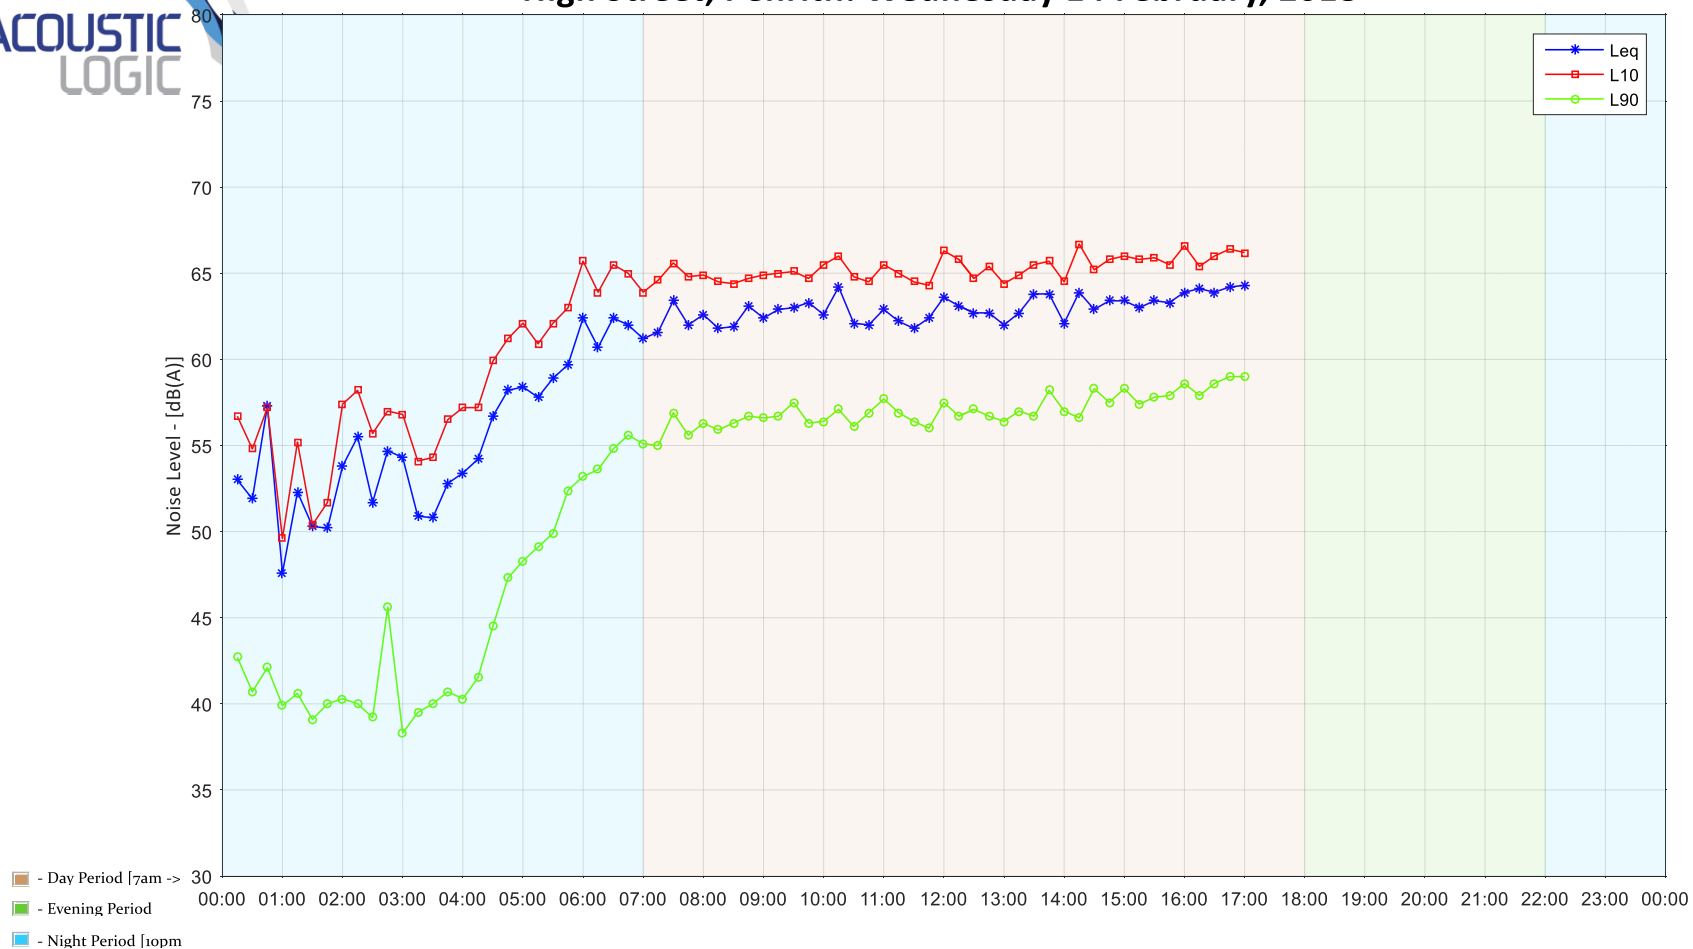





Toga Penrith: Thursday 08 February, 2018

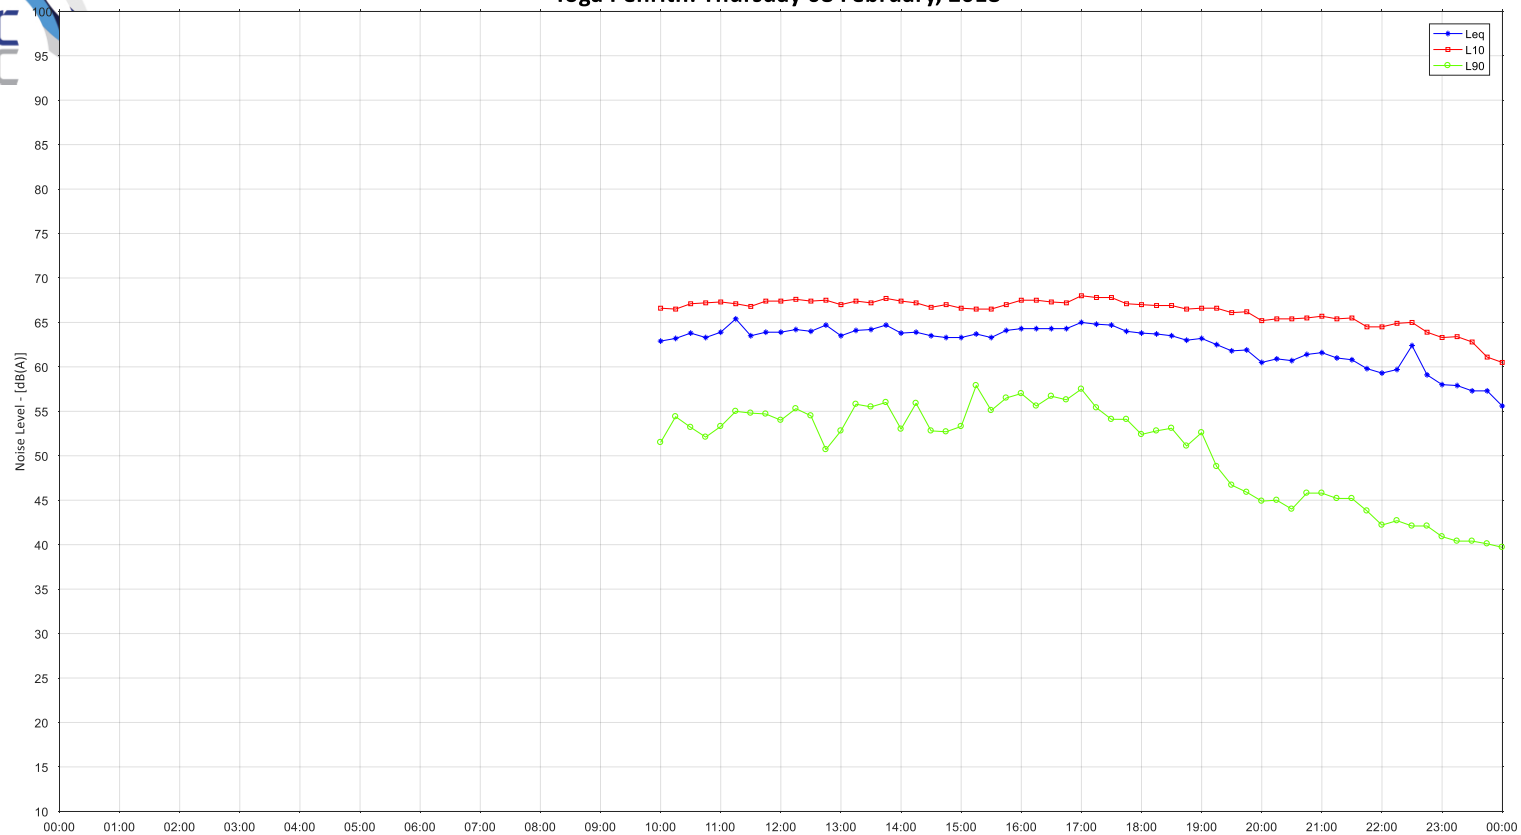


Toga Penrith: Friday 09 February, 2018

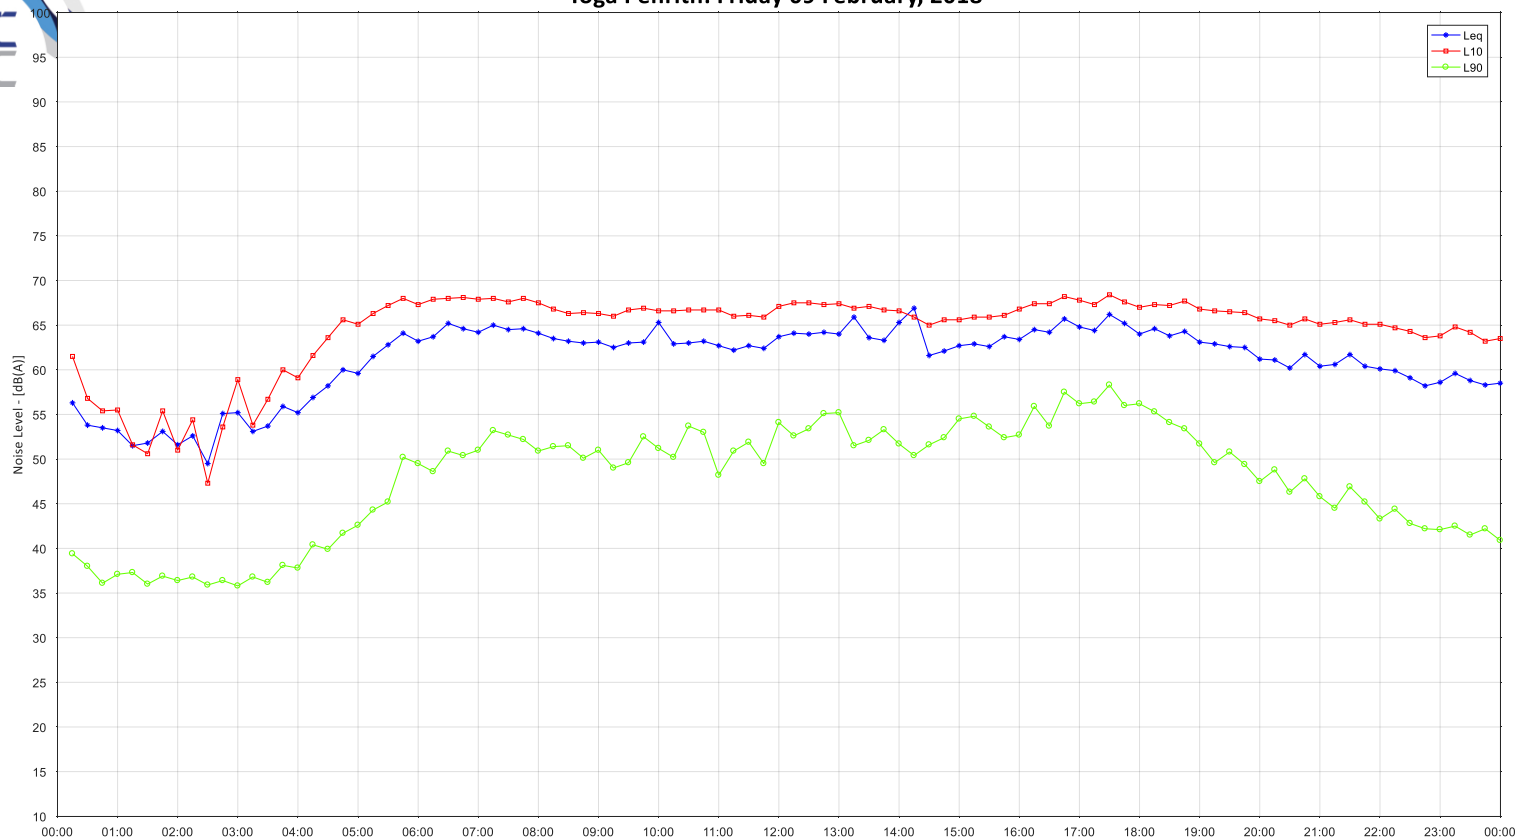


Toga Penrith: Saturday 10 February, 2018

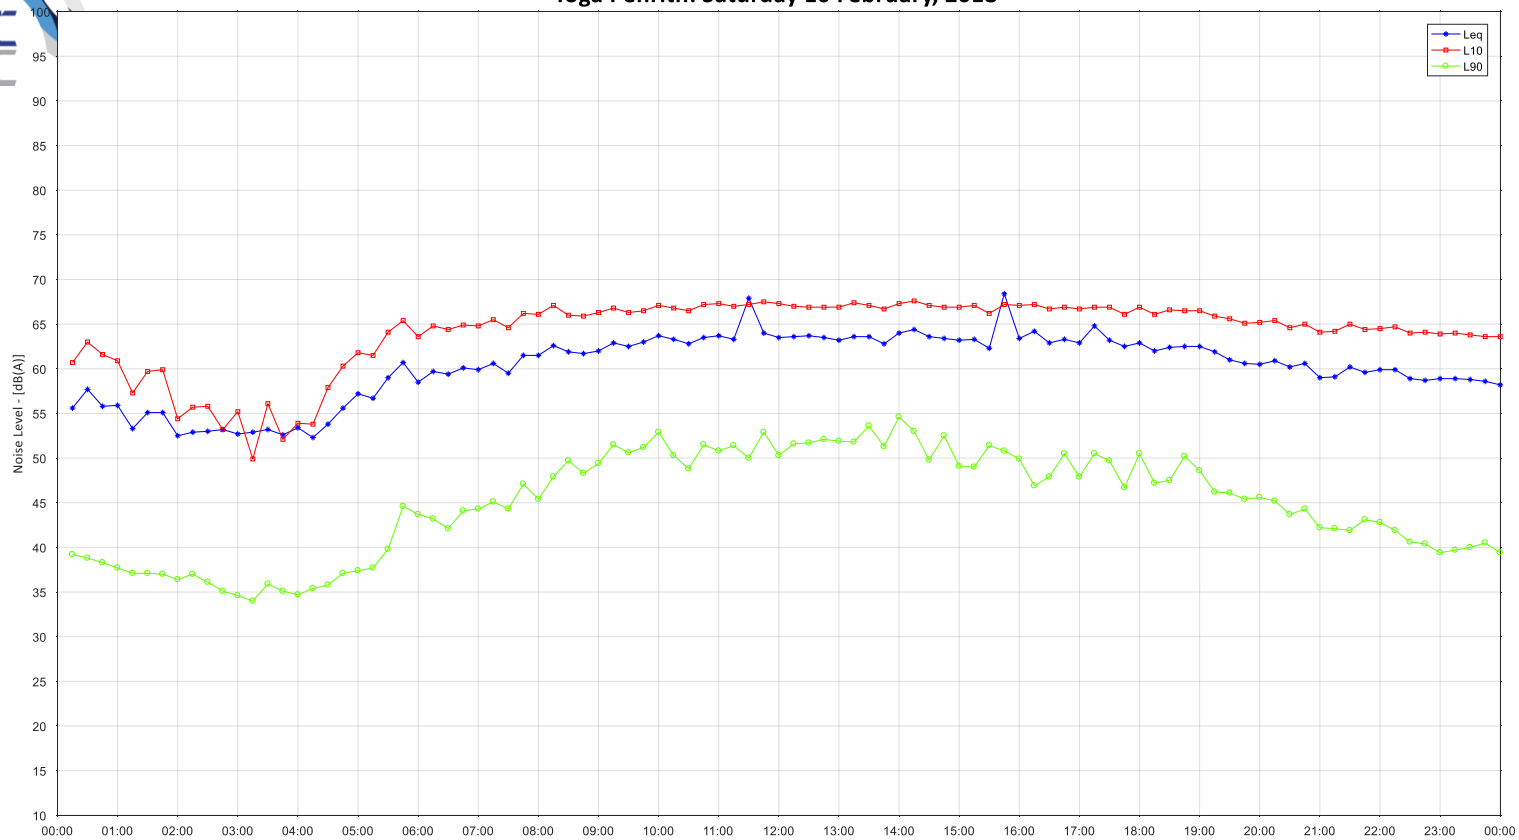


Toga Penrith: Sunday 11 February, 2018

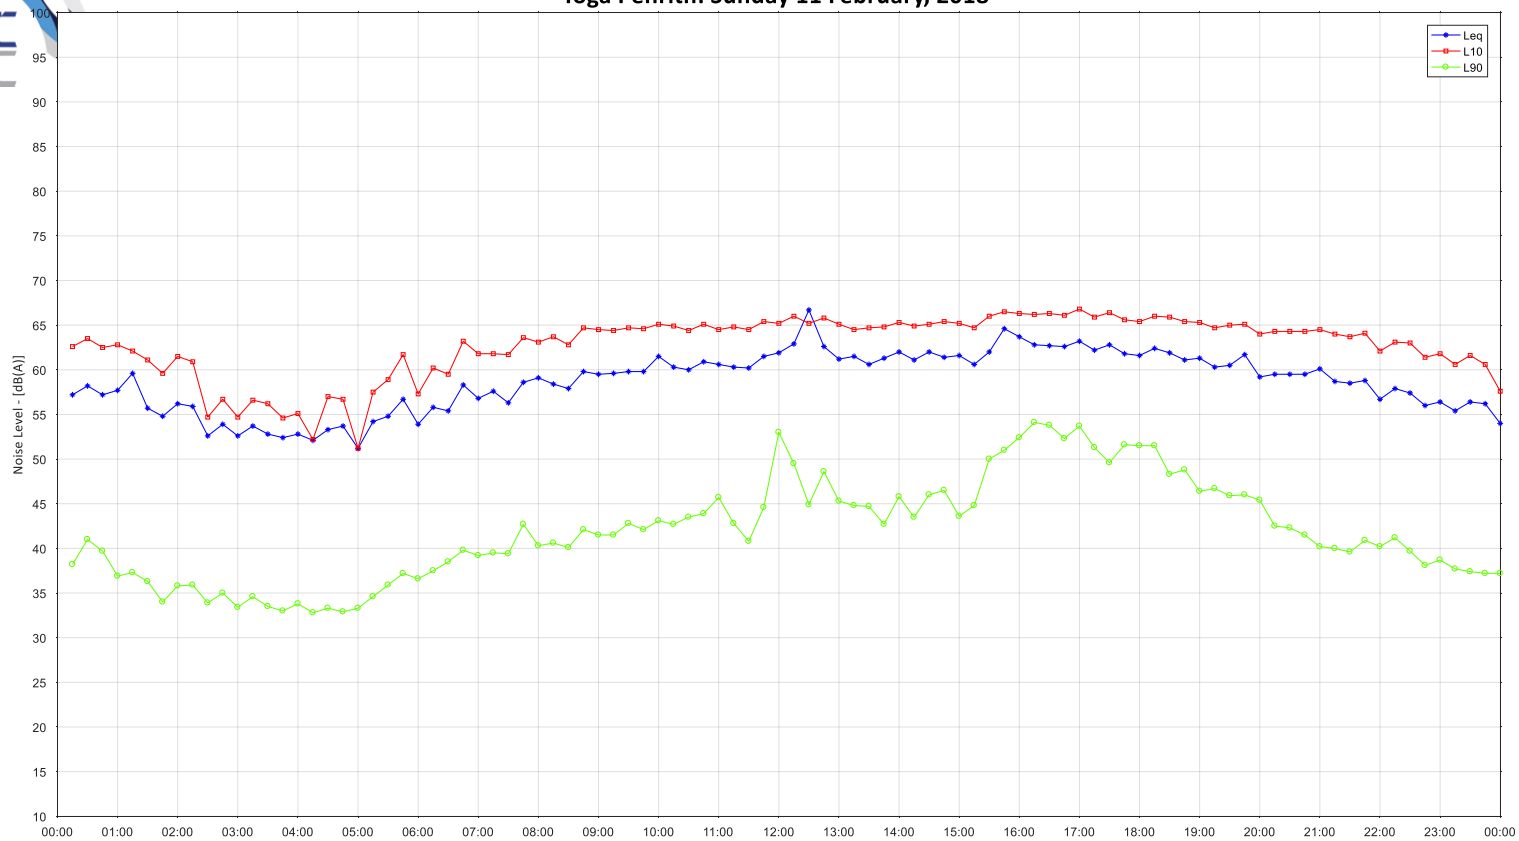


Toga Penrith: Monday 12 February, 2018

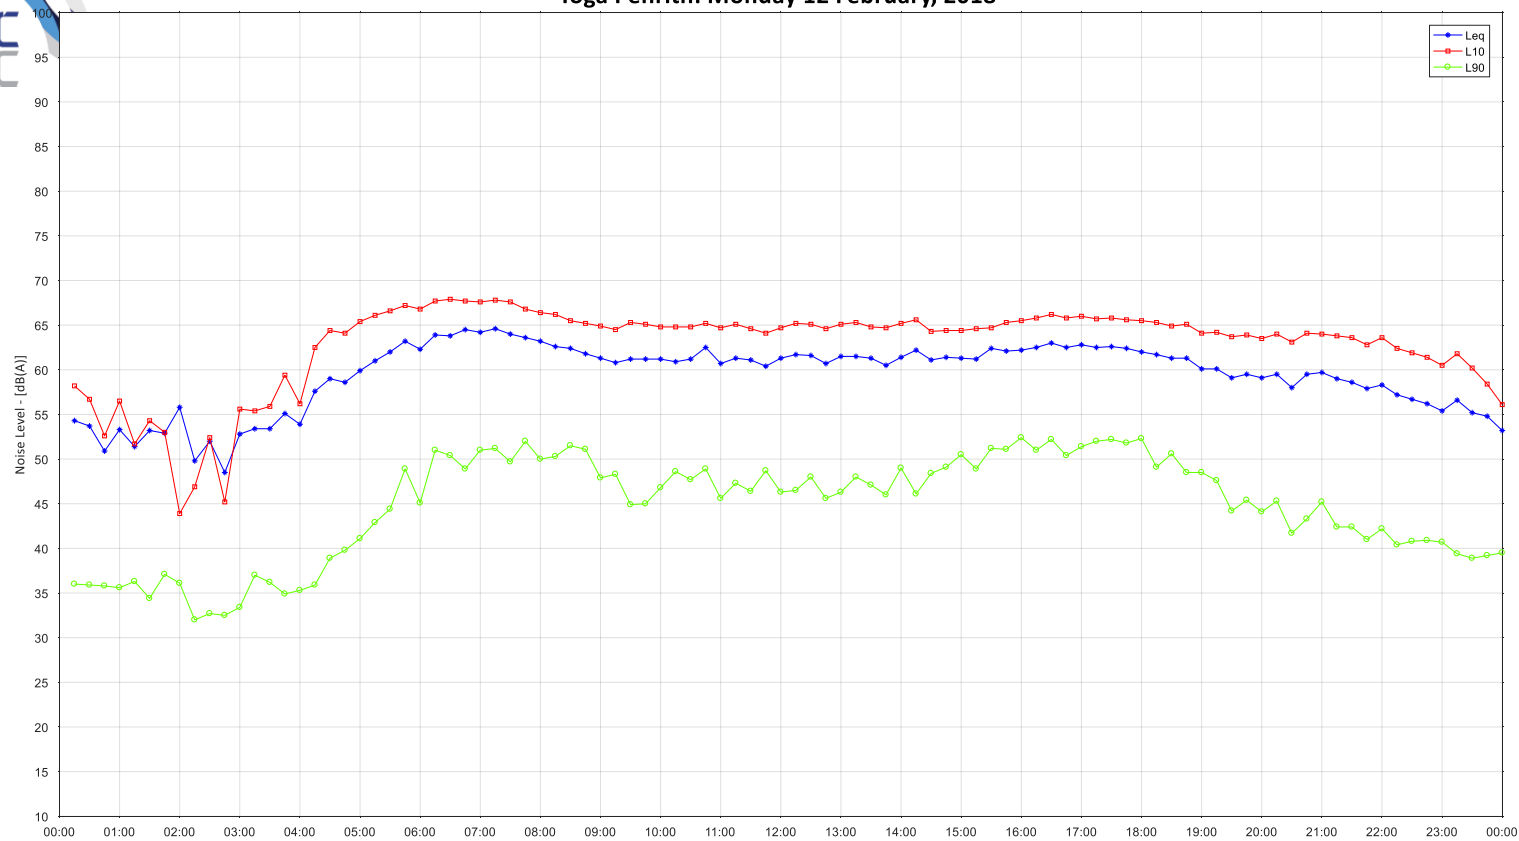

Toga Penrith: Tuesday 13 February, 2018

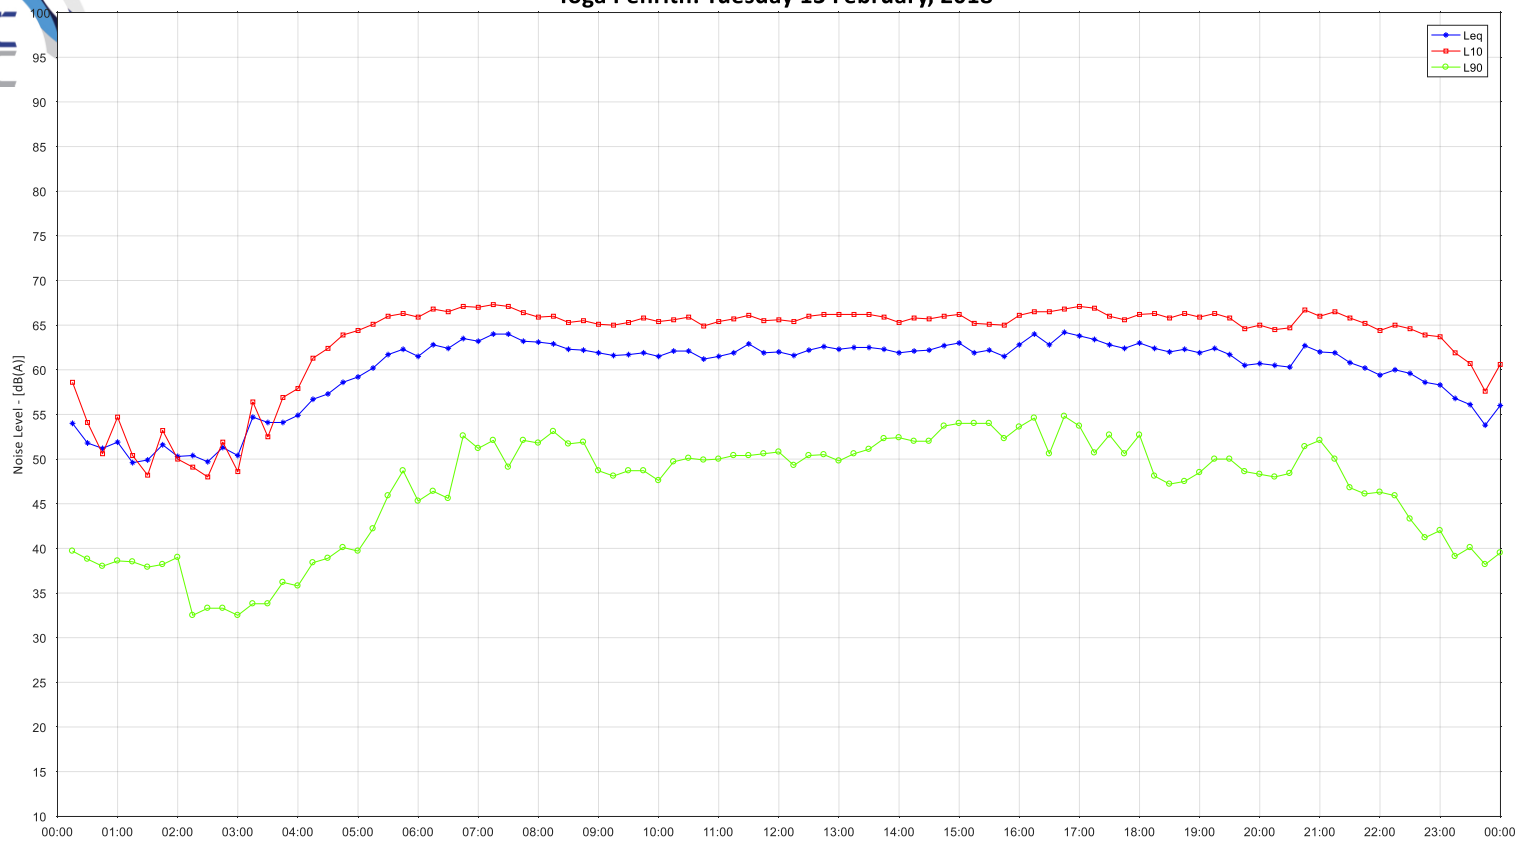

Toga Penrith: Wednesday 14 February, 2018

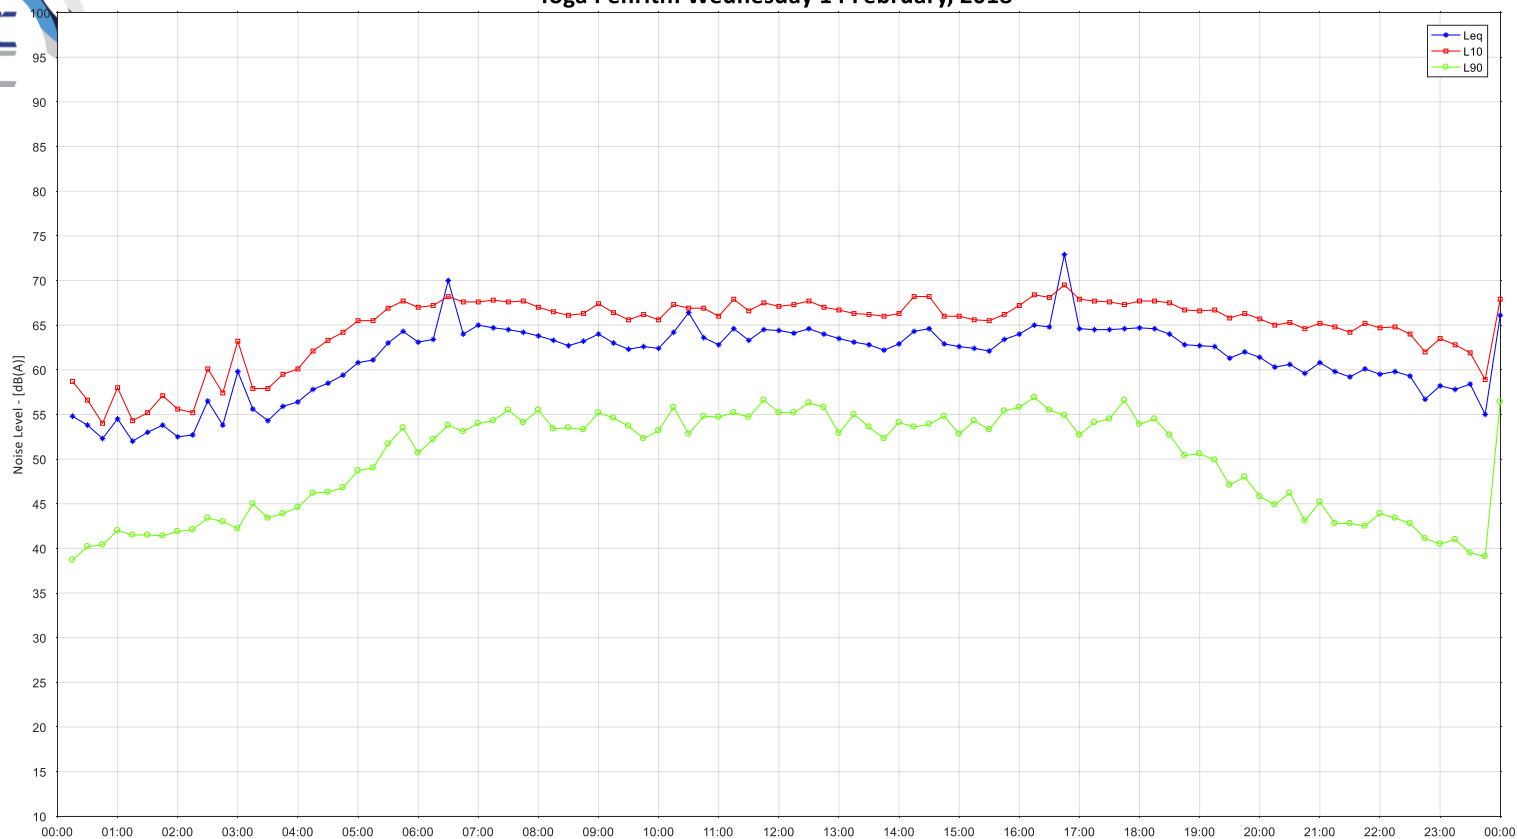



Toga Penrith: Thursday 15 February, 2018

