



## **GREENTECH NO.3 SOLAR FARM: NOISE & VIBRATION IMPACT ASSESSMENT**

**Project ID: 14362**

**20/10/2022**

**Release: R2**



**Prepared For:**

**ACEnergy Pty Ltd**

**Assured Environmental**



## DOCUMENT CONTROL PAGE

Project Title: GREENTECH NO.3 SOLAR FARM: NOISE & VIBRATION IMPACT ASSESSMENT

Project Reference ID: 14362

**Report Prepared by:**

Assured Environmental  
Unit 7, 142 Tennyson Memorial Avenue  
Tennyson, QLD, 4105

**Report Prepared for:**

ACEnergy  
502, 689 Burke Road  
Camberwell, VIC, 3124

Author: Phoebe Griffiths

Reviewer: Aiden Allen

**Table 1: History of Revisions**

Revision	Date	Issued to	Changes
R0	17/06/2022	J. Bai	Initial Release
R1	1/07/2022	J. Bai	Client Comments
R2	20/10/2022	J. Bai	Client Comments

### DISCLAIMER

Assured Environmental acts in all professional matters as a faithful advisor to the Client and exercises all reasonable skill and care in the provision of its professional services.

Reports are commissioned by and prepared for the exclusive use of the Client. They are subject to and issued in accordance with the agreement between the Client and Assured Environmental. Assured Environmental is not responsible for any liability and accepts no responsibility whatsoever arising from the misapplication or misinterpretation by third parties of the contents of its reports.

Except where expressly stated, Assured Environmental does not attempt to verify the accuracy, validity or comprehensiveness of any information supplied to Assured Environmental for its reports.

Reports cannot be copied or reproduced in whole or part for any purpose without the prior written agreement of Assured Environmental.

Where site inspections, testing or fieldwork have taken place, the report is based on the information made available by the client or their nominees during the visit, visual observations, and any subsequent discussions with regulatory authorities. The validity and comprehensiveness of supplied information has not been independently verified and, for the purposes of this report, it is assumed that the information provided to Assured Environmental is both complete and accurate. It is further assumed that normal activities were being undertaken at the site on the day of the site visit(s), unless explicitly stated otherwise.



---

## TABLE OF CONTENTS

<b>GLOSSARY .....</b>	<b>5</b>
<b>ABBREVIATIONS .....</b>	<b>5</b>
<b>1 INTRODUCTION .....</b>	<b>6</b>
1.1 SCOPE OF ASSESSMENT .....	6
1.2 THIS REPORT .....	6
<b>2 PROPOSED DEVELOPMENT SITE .....</b>	<b>7</b>
2.1 DEVELOPMENT SITE .....	7
2.2 NEARBY SENSITIVE RECEPTORS .....	7
2.3 TERRAIN .....	7
<b>3 CONSTRUCTION NOISE ASSESSMENT .....</b>	<b>10</b>
3.1 CONSTRUCTION WORKS .....	10
3.2 INTERIM CONSTRUCTION NOISE GUIDELINE .....	10
3.3 CONSTRUCTION NOISE SOURCES .....	12
3.4 ASSESSMENT OF IMPACTS .....	13
3.5 MITIGATION OF CONSTRUCTION NOISE LEVELS .....	13
<b>4 OPERATIONAL NOISE ASSESSMENT .....</b>	<b>15</b>
4.1 OPERATIONAL NOISE CRITERIA .....	15
4.1.1 Overview .....	15
4.1.2 Intrusiveness Noise Criteria .....	15
4.1.3 Amenity Criteria .....	15
4.1.4 Project Trigger Levels .....	16
4.1.5 Sleep Disturbance .....	16
4.2 PREDICTIVE MODELLING .....	16
4.3 NOISE MODELLING METHODOLOGY .....	19
4.4 MODEL CONFIGURATION .....	19
4.5 PREDICTIVE OPERATION RESULTS .....	20
<b>5 ROAD TRAFFIC NOISE ASSESSMENT .....</b>	<b>21</b>
5.1 INTRODUCTION .....	21
5.2 ASSESSMENT CRITERIA .....	21
5.3 NOISE MODELLING METHODOLOGY .....	22
<b>6 VIBRATION ASSESSMENT .....</b>	<b>23</b>
6.1 INTRODUCTION .....	23
6.2 ASSESSMENT CRITERIA .....	23
6.3 POTENTIAL VIBRATION SOURCES .....	24
6.4 ASSESSMENT OF POTENTIAL IMPACTS .....	24
<b>7 CONCLUSION .....</b>	<b>26</b>
<b>APPENDIX A: PROPOSED PLANS .....</b>	<b>27</b>



---

## LIST OF TABLES

TABLE 1: HISTORY OF REVISIONS .....	2
TABLE 2: NEARBY SENSITIVE RECEPTORS .....	7
TABLE 3: CONSTRUCTION TIMELINE.....	10
TABLE 4: NSW EPA CONSTRUCTION NOISE CRITERIA – RESIDENTIAL RECEPTORS.....	11
TABLE 5: CONSTRUCTION NOISE SOURCES .....	12
TABLE 6: CONSTRUCTION NOISE RESULTS .....	13
TABLE 7: DERIVED INTRUSIVENESS NOISE CRITERIA .....	15
TABLE 8: NPFI AMENITY NOISE LEVELS .....	16
TABLE 9: DETERMINING PROJECT TRIGGER LEVEL .....	16
TABLE 10: OPERATION NOISE SOURCES .....	18
TABLE 11: STANDARD AND NOISE ENHANCING METEOROLOGICAL CONDITIONS .....	19
TABLE 12: MODEL CONFIGURATION .....	19
TABLE 13: SOLAR FARM NO.3 PREDICTED RECEPTOR NOISE LEVELS - OPERATIONAL PHASE, DB(A) .....	20
TABLE 14: ROAD TRAFFIC DATA .....	21
TABLE 15: APPLICABLE ROAD TRAFFIC NOISE CRITERIA .....	22
TABLE 16: PREDICTED $L_{Aeq,15-HOUR}$ NOISE LEVELS - ROAD TRAFFIC NOISE .....	22
TABLE 17: CONTINUOUS & IMPULSIVE VIBRATION CRITERIA FOR RESIDENCES – PEAK VELOCITY .....	23
TABLE 18: INTERMITTENT VIBRATION CRITERIA FOR RESIDENCES .....	23
TABLE 19: TRANSIENT VIBRATION GUIDE VALUES FOR COSMETIC DAMAGE.....	24
TABLE 20: VIBRATION SOURCE LEVELS – PEAK PARTICLE VELOCITY.....	24
TABLE 21: PREDICTED PEAK PARTICLE VELOCITY AT SENSITIVE RECEPTORS (MM/S).....	25

## LIST OF FIGURES

FIGURE 1: SITE OVERVIEW .....	8
FIGURE 2: TERRAIN .....	9
FIGURE 3: SITE LAYOUT .....	27



---

## GLOSSARY

A-Weighting	A response provided by an electronic circuit which modifies sound in such a way that the resulting level is similar to that perceived by the human ear.
dB (decibel)	This is the scale on which sound pressure level is expressed. It is defined as 20 times the logarithm of the ratio between the root-mean-square pressure of the sound field and the reference pressure (0.00002 N/m <sup>2</sup> ).
dB(A) or dBA	This is a measure of the overall noise level of sound across the audible spectrum with a frequency weighting (i.e. 'A' weighting) to compensate for the varying sensitivity of the human ear to sound at different frequencies.
Free-field	Refers to a sound pressure level determined at a point away from reflective surfaces other than the ground with no significant contribution due to sound from other reflective surfaces; generally, as measured outside and away from buildings.
L <sub>Aeq</sub>	This is the equivalent steady sound level in dB(A) containing the same acoustic energy as the actual fluctuating sound level over the given period. Noise levels often fluctuate over a wide range with time. Therefore, when a noise varies over time, the L <sub>Aeq</sub> is the equivalent continuous sound which would contain the same sound energy as the time varying sound. Many studies show that human reaction to level-varying sounds tends to relate closer to the L <sub>Aeq</sub> noise level than any other descriptor.
L <sub>A10</sub> , L <sub>A90</sub> , L <sub>An</sub>	Noise level exceeded for n% of the measurement period with A-weighted, calculated by statistical analysis - where n is between 0.01% and 99.99%. For example, L <sub>A10</sub> is the noise level just exceeded for 10% of the measurement period, calculated by statistical analysis and used to determine traffic noise and L <sub>A90</sub> is the noise level exceeded for 90% of the measurement period, A-weighted and calculated by statistical analysis and used to determine background noise levels.
L <sub>AFmax</sub>	A-weighted, fast response, maximum, sound level.
L <sub>AFmin</sub>	A-weighted, fast response, minimum, sound level.
RBL	Rating background noise level – the overall single-figure background level representing each assessment period (day/evening/night) over the whole monitoring period.
SWL	Sound Power Level in decibels is ten times the logarithm of the ratio of the sound power to the sound power reference level of 1 pico Watt.

## ABBREVIATIONS

EPA	Environmental Protection Authority (NSW)
ICNG	Interim Construction Noise Guidelines
NPfI	Noise Policy for Industry
BESS	Battery Energy Storage System



---

## 1 INTRODUCTION

### 1.1 Scope of Assessment

Assured Environmental (AE) was appointed by ACEnergy Pty Ltd to undertake a noise and vibration impact assessment for the proposed micro solar farm with battery storage containers (Subject Site) for Greentech Solar Project No.3 Pty. Ltd., located in Tabbita, NSW.

The noise and vibration study has been undertaken to assess the potential impacts of the construction and operation of the Subject Site, on nearby sensitive receptors in accordance with the following NSW policies and guidelines:

- NSW Noise Policy for Industry (NPfI) (EPA, 2017)
- NSW Assessing Vibration: a technical guideline (DEC, 2006);
- NSW Road Noise Policy (DECCW, 2011); and
- Interim Construction Noise Guideline (ICNG) (DECC, 2009).

In accordance with the requirements of the above guidelines, computational modelling and first principle calculations have been undertaken to support the assessment of the potential for adverse amenity impacts as a result of the development.

### 1.2 This Report

This report presents the noise and vibration impact assessment in accordance with the agreed scope of work.



## 2 PROPOSED DEVELOPMENT SITE

### 2.1 Development Site

The proposed development site is located along Tabbita Lane, Tabbita in central New South Wales. Specifically, the proposed Facility is to be constructed on Lot 5 on DP 1210276, shown in Figure 1. The area surrounding the proposed development includes agricultural uses with associated rural dwellings.

### 2.2 Nearby Sensitive Receptors

There are four existing dwellings located in the vicinity of the proposed BESS. Table 2 and Figure 1 provide a summary of selected sensitive receptors to the proposed development and approximate distance to the infrastructure. A detailed site layout is given in Appendix A.

Table 2: Nearby Sensitive Receptors

Receptor ID	Description	Coordinates Zone 55 (UTM)		Distance to infrastructure (m)
		Easting	Northing	
R01	Existing Dwelling	381225	6229329	3300
R02	Existing Dwelling	378906	6225392	5036
R03	Existing Dwelling	382739	6224682	2444
R04	Existing Dwelling	383266	6225229	1781

### 2.3 Terrain

Figure 2 illustrates the local topography, as obtained from a combination of Lidar data at 1 m resolution.

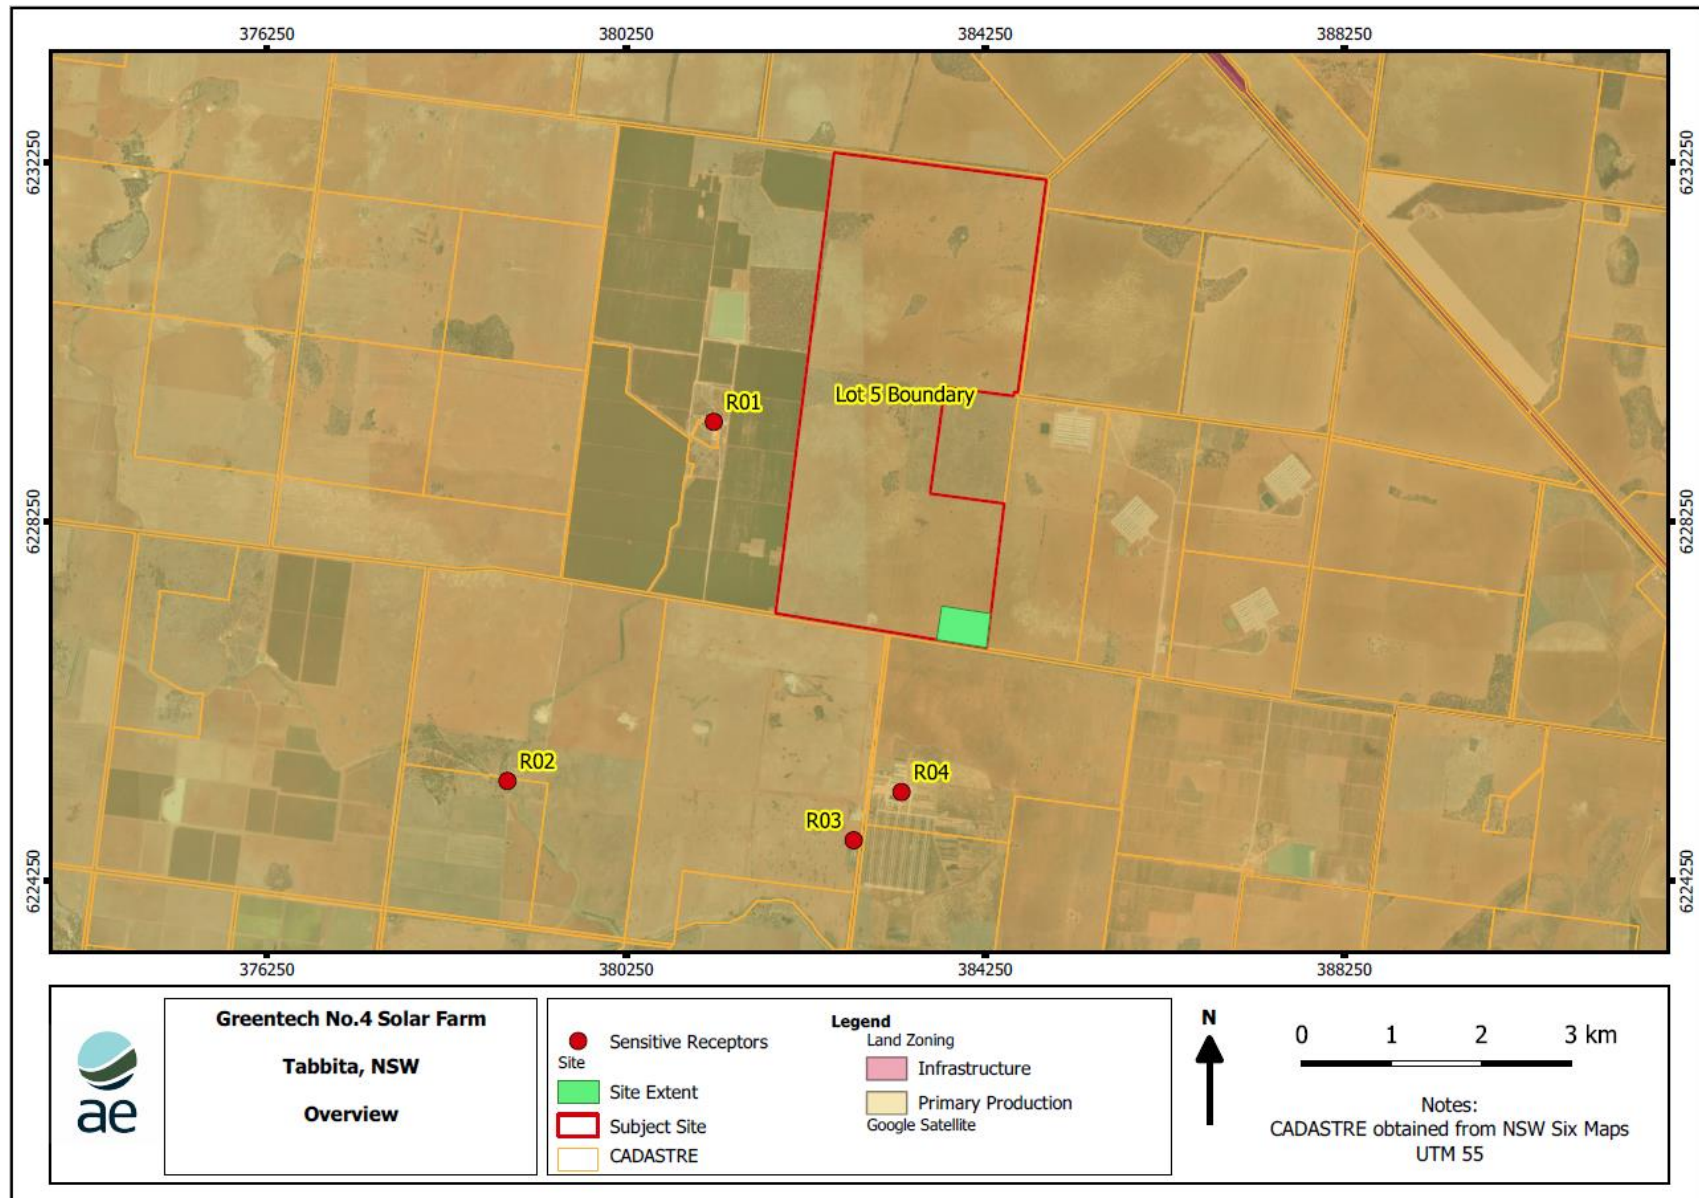


Figure 1: Site Overview



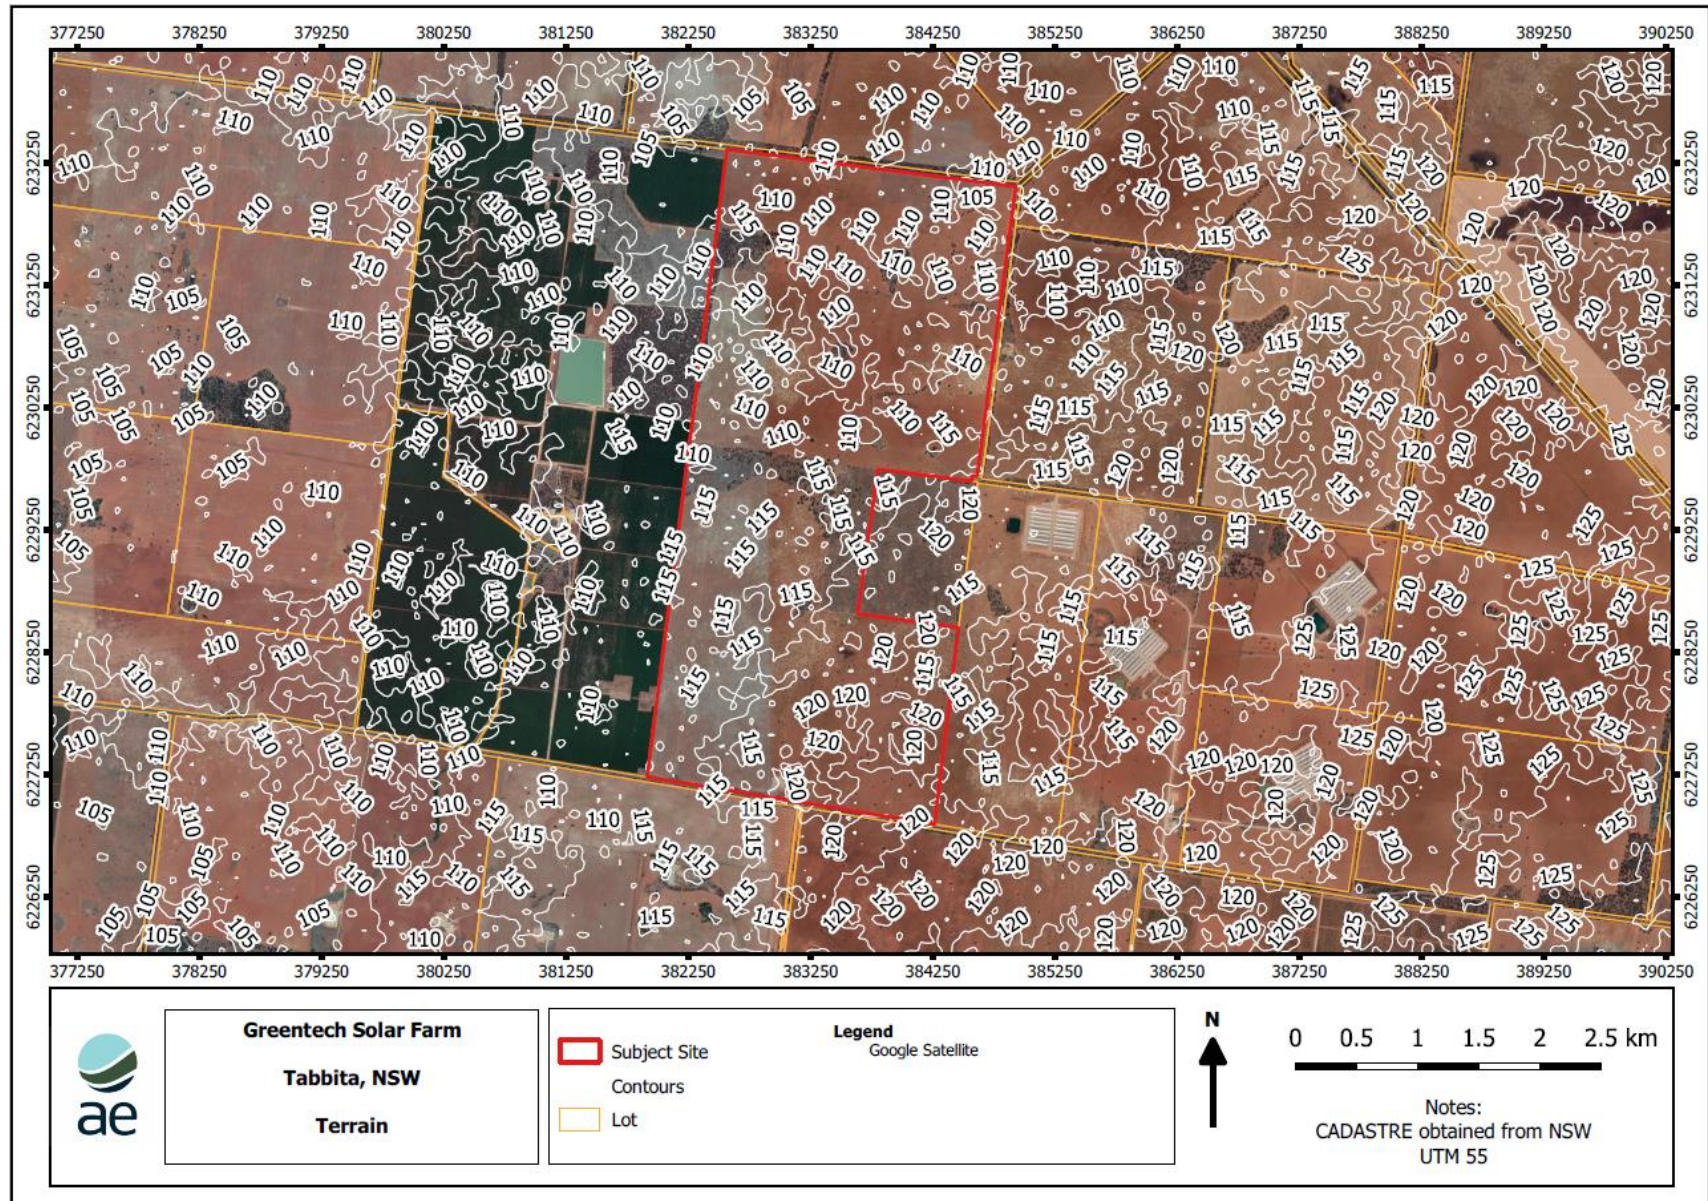


Figure 2: Terrain



### 3 CONSTRUCTION NOISE ASSESSMENT

#### 3.1 Construction Works

The construction of the Facility is expected to take approximately five months, with a number of different activities undertaken over that time as described in Table 3. It has been assumed that all work activities occur separately and there is no overlap.

Construction would be restricted to what the EPA term '*recommended construction hours*' (as described in Table 4 below), which are between 7 am and 6 pm Monday to Friday and 8 am to 1 pm Saturday, with no works on Sundays or Public Holidays.

The assessment has therefore considered the potential for adverse amenity impacts associated with construction during recommended standard hours only.

**Table 3: Construction Timeline**

Timeline	Works Activities
Month 1	Civil earthing works, fencing and landscaping.
Months 2-4	Delivery of long lead materials.
Months 2-4	PV panel and LV cable installation.
Months 4-5	HV station installation, testing, and commissioning.

#### 3.2 Interim Construction Noise Guideline

Guidance on the assessment and management of construction noise in NSW is provided in the Interim Construction Noise Guideline 2009 (ICNG) published by the NSW EPA.

The main objectives of the Guideline are to:

- Promote a clear understanding of ways to identify and minimise noise from construction works;
- Focus on applying all 'feasible' and 'reasonable' work practices to minimise construction noise impacts;
- Encourage construction to be undertaken only during the recommended standard hours, unless approval is given for works that cannot be undertaken during these hours;
- Streamline the assessment and approval stages and reduce time spent dealing with complaints at the project implementation stage;
- Provide flexibility in selecting site-specific feasible and reasonable work practices in order to minimise noise impacts; and
- Provide guidelines for assessing noise generated during the construction phase of developments.

In achieving these objectives, the guideline provides a framework for the qualitative and quantitative assessment of potential construction noise impacts noting that, for major projects, a quantitative assessment is the preferred approach.

Table 4 presents construction noise criteria outlined in the guideline. Noise levels apply at the property boundary that is most exposed to construction noise, and at a height of 1.5 m above ground level. If the property boundary is more than 30 m from the residence, the location for measuring or predicting noise levels is at the most noise-affected point within 30 m of the residence.





**Table 4: NSW EPA Construction Noise Criteria – Residential Receivers**

Time of Day	Management Level (Free-field)	How to Apply
Recommended standard hours: Monday to Friday, 7 am to 6 pm Saturday 8 am to 1 pm No work on Sundays or public holidays	Noise affected RBL + 10 dB	The noise affected level represents the point above which there may be some community reaction to noise.  Where the predicted or measured $L_{Aeq}(15\text{ min})$ is greater than the noise affected level, the proponent should apply all feasible and reasonable work practices to meet the noise affected level.  The proponent should also inform all potentially impacted residents of the nature of works to be carried out, the expected noise levels and duration, as well as contact details.
	Highly noise affected 75 dB(A)	The highly noise affected level represents the point above which there may be strong community reaction to noise.  Where noise is above this level, the relevant authority (consent, determining or regulatory) may require respite periods by restricting the hours that the very noisy activities can occur, taking into account:  times identified by the community when they are less sensitive to noise (such as before and after school for works near schools, or mid-morning or mid-afternoon for works near residences  if the community is prepared to accept a longer period of construction in exchange for restrictions on construction times.
Outside recommended standard hours	Noise affected RBL + 5 dB	A strong justification would typically be required for works outside the recommended standard hours.  The proponent should apply all feasible and reasonable work practices to meet the noise affected level.  Where all feasible and reasonable practices have been applied and noise is more than 5 dB(A) above the noise affected level, the proponent should negotiate with the community.

Where nearby sensitive uses are predicted to be noise affected, the proponent of the project is required to apply reasonable and feasible noise mitigation measures noting that a noise mitigation measure is feasible if it is capable of being put into practice and is practical to build given the project constraints.

Selecting reasonable mitigation measures from those that are feasible involves making a judgement to determine whether the overall noise benefit outweighs the overall social, economic, and environmental effects.

For construction outside standard hours, the assessment criteria has been determined based on the minimum allowable RBL as provided in the NPfI. That is, for the purposes of the assessment it is assumed that the RBL is 40 dB(A) for daytime periods (standard operating hours) thereby resulting in a noise affected management level of 50 dB(A) and a highly noise affected management level of 75 dB(A).



### 3.3 Construction Noise Sources

It is noted that construction works are expected to progress across the site such that plant and equipment would only be in a single area for a short period of time. Given this, the potential for adverse impacts at any one receptor is expected to only occur for a short period of time.

Table 5 below presents a summary of the plant and equipment likely to be required to complete the on-site construction works. The sound power levels presented have been sourced from published noise emission datasets and the library of source noise levels maintained by Assured Environmental.

**Table 5: Construction Noise Sources**

Work Activities	Construction Stages	Noise Source	Qty	Usage Period (%)	Sound Power Level (dB(A))
Civil earthing works, fencing and landscaping.	Entry crossover	Excavator	1	40	113
		Tamping Rammer	1	50	107
	Access road	Grader	1	40	108
		Water Cart	1	40	98
	Fencing and Landscaping	Excavator	1	40	113
		Water Cart	1	40	98
		Concrete Truck	1	40	110
		Concrete Pump	1	20	103
Delivery of long lead materials.	Delivery of long lead materials.	Truck Movements	5	5/hr	110
		Telehandler	1	16	95
		Forklift	1	40	105
PV panel and LV cable installation.	PV panel and LV cable installation.	Excavator	1	40	113
		Tamping Rammer	1	50	107
		Water Cart	1	40	103
		Impact Piling Rig	1	20	107
		Telehandler	1	16	95
		Powered Hand Tools	6	50	95
		Waste Truck	1	1/hr	110
HV station installation, testing, and commissioning.	HV station installation, testing, and commissioning.	Telehandler	1	16	95
		Powered Hand Tools	6	50	95
		Waste Truck	1	1/hr	110
Site clean-up and demobilisation	Site clean-up and demobilisation.	Private Vehicles.	2	2/hr	92
		Waste Truck	1	1/hr	110



### 3.4 Assessment of Impacts

For the purposes of predicting impacts associated with noise emissions from the Subject Site on nearby sensitive receptors, calculations of the noise impacts from construction activities have been undertaken using first principal calculations based on the distance separation of the receptor and the facility infrastructure (Figure 1).

Construction activities across the site will vary in location and duration; mobile plant will move around the development site throughout the construction phase, whereas activities such as trenching, and piling will slowly move along the line of solar panels. As such, whilst the piling activities are noisy, once each pile is complete, the area is not revisited and therefore the highest predicted noise levels associated with piling will be short-lived for each receptor.

Table 6 presents predicted most affected receptor noise levels taking into consideration the following assumptions:

- All equipment and plant are located in the same area – at the closest point to the Project Area boundary to the receptors. This is considered to be a hypothetical worst-case scenario and unlikely to occur;
- The number of plant at this stage of development are estimates.

It can be seen from Table 6, that the predicted noise levels at all receptors comply with the Noise Affect criteria of 50 dB(A) and the Highly Noise Affect criteria of 75 dB(A) during standard hours. It is recommended that reasonable and feasible mitigation measures such as those presented in Section 3.5 are implemented to reduce the noise impact at all receptors.

**Table 6: Construction Noise Results**

Receptor	Standard Hours Criteria		Scenario Assessed			
	Noise Affected	Highly Noise Affected	Civil earthing works, fencing	Delivery of materials	PV panel and LV cable installation.	HV station installation, testing and commissioning.
R1	50	75	41	41	39	37
R2	50	75	37	37	36	33
R3	50	75	43	43	42	40
R4	50	75	46	46	45	42

### 3.5 Mitigation of Construction Noise Levels

Given the variable and mobile nature of the construction works, the use of permanent or temporary acoustic barriers at source is not considered feasible. Potential controls available to the construction contractor to minimise potential impacts for construction works could include:

- Limiting the type and scale of concurrent activities undertaken close to sensitive receptors where possible;
- Using broad band reversing alarms on all mobile plant and equipment if practical;
- Examine different types of machines that perform the same function and compare the noise level data to select the least noisy machine;



- 
- Operating plant in a quiet and efficient manner;
  - Reduce throttle setting and turn off equipment when not being used; and
  - Regularly inspect and maintain equipment to ensure it is in good working order including checking the condition of mufflers.

It is recommended that during any work generating high noise levels that have impulsive, intermittent, low frequency or tonal characteristics, consultation with sensitive receptors occurs regularly.

As highest predicted noise levels do not exceed the highly affected noise criteria of 75 dB(A) at any receptor, the implementation of additional noise controls (except those listed above) is not considered necessary.



## 4 OPERATIONAL NOISE ASSESSMENT

### 4.1 Operational Noise Criteria

#### 4.1.1 Overview

The acoustic assessment has been completed in accordance with the procedure identified in the NPfI. The NPfI recognises that scientific literature has identified that both the increase in noise level above background levels (that is, intrusiveness of a source), as well as the absolute level of noise are important factors in how a community will respond to noise from industrial sources.

In response to this, the NPfI establishes two separate noise criteria to meet environmental noise objectives: one to account for intrusive noise and the other to protect the amenity of particular land uses. These two criteria are then used to determine project triggers levels against which the proposed development will be assessed. The project noise trigger level is a level that, if exceeded, would indicate a potential noise impact on the community, and so 'trigger' a management response.

The derivation of the two sets of criteria are presented below. For residential dwellings, the noise criteria are assessed at the most-affected point (i.e. highest noise level) on or within the property boundary. Where the property boundary is more than 30 metres from the house, then the criteria applies at the most-affected point within 30 m of the house.

#### 4.1.2 Intrusiveness Noise Criteria

The project intrusiveness noise level is intended to protect against significant changes in noise levels as a result of industrial development. To achieve this, the NPfI describes intrusive noise as noise that exceeds background noise levels (as defined by the Rating Background Level or RBL) by more than 5 dB.

Given the rural location of the site, the impact assessment has assumed baseline noise levels equivalent to the minimum background noise levels provided in the NPfI. Therefore, Table 7 presents the derivation of the intrusiveness criteria based on the minimum background noise level established by the NPfI.

**Table 7: Derived Intrusiveness Noise Criteria**

Receptor	Intrusiveness $L_{Aeq,15\text{-minute}}$ Criteria		
	Day	Evening	Night
All nearby residential receptors <sup>a)</sup>	40 <sup>b)</sup>	35 <sup>b)</sup>	35 <sup>b)</sup>
<i>a) Receptor noise criteria applied at a location 30 m from the dwelling façade.</i>			
<i>a) Minimum background noise level established by the NPfI 2017 + 5 dB.</i>			

#### 4.1.3 Amenity Criteria

The project amenity noise level seeks to protect against cumulative noise impacts from industry and maintain amenity for particular land uses.

**Table 8: NPfl Amenity Noise Levels**

Type of Receiver	Indicative Noise Amenity Area	Time of Day	Recommended $L_{Aeq}$ Noise Level (dB(A))	
			Total Industrial Noise	Project Specific
Residence	Rural	Day	50	45
		Evening	45	40
		Night	40	35

#### 4.1.4 Project Trigger Levels

The project trigger level (i.e. the noise criteria considered by the assessment) is the lower value of the project intrusiveness noise level and the project amenity level, after the conversion to  $L_{Aeq, 15 \text{ min}}$  dB(A) equivalent level. Table 9 presents the standardised intrusiveness noise level and the project amenity level as derived by adding 3 dB to each period of the day.

**Table 9: Determining Project Trigger Level**

Time of Day	Standardised $L_{Aeq, 15 \text{ min}}$ Noise Level (dB)		
	Intrusiveness Criteria	Project Specific ANL	Project Trigger Level
Day	40	$45 + 3 = 48$	40
Evening	35	$40 + 3 = 43$	35
Night	35	$35 + 3 = 38$	35

#### 4.1.5 Sleep Disturbance

NSW EPA have identified a screening assessment for sleep disturbance based on the night-time noise levels at a residential location. Where noise levels at a residential location exceed:

- $L_{Aeq, 15 \text{ min}}$  40 dB(A) or the prevailing RBL plus 5 dB, whichever is greater; and/or
- $L_{AFmax}$  52 dB(A) or the prevailing RBL plus 15 dB whichever is the greater, a detailed maximum noise level event assessment should be undertaken.

As discussed in Section 4.5 the predicted noise levels at residential locations do not exceed 40 dB(A)  $L_{Aeq, 15 \text{ min}}$ , therefore a detailed sleep disturbance assessment is not required. Further, given the noise sources associated with the operation of the BESS are all continuous. As such, consideration of compliance against the  $L_{AFmax}$  sleep disturbance criteria is unwarranted.

### 4.2 Predictive Modelling

It is understood that the equipment and associated noise level data used as the basis for this assessment will be comparable with the final selections for the proposed facility. The primary recommendation will be that a suitably qualified acoustic consultant is engaged during detailed design to ensure that compliance with relevant criteria is achieved at nearby noise sensitive receptors. Should equipment with lower sound power level information than adopted, then the nominated noise control strategies may be amended with approval by a suitably qualified acoustic consultant.

When considering the sound power levels, the following is noted:

- Battery will be located in containers, which will be enclosed; therefore, each enclosure will provide shielding





- All sources operate continuously within any 15-minute period and therefore no duration or impulsive or intermittent adjustment is required; and
- A frequency spectrum was obtained for the battery façade, which is the façade with the cooling fan. Review of the 1/3 octave frequency confirmed that a +5dB adjustments was applied to this façade

Table 10 provides a summary of the noise sources adopted for this assessment and the operational details of each source. Where annoying noise characteristics have been identified the adjustment has been included in the  $L_{Aeq}$  column. The sound power levels have been taken from the following sources:

- manufacturers information for plant item *Solar tracker* as per the specification datasheet *NEXTracker Motor Sound Test Summary* sent 18 May 2022
- manufacturers information for plant item *ST2752UX liquid cooling BESS Container* as per the specification datasheet *Noise testing report of Liquid Cooling BESS\_202112\_VO1* sent 18 May 2022
- manufacturers information for plant item *SG4950HV Inverter* as per the specification datasheet *Noise testing report of SUNGROW Noise Test Report for SG2475HV* sent 18 May 2022

The following plans have been used to determine source heights and layout given in Appendix A:

- G-1.1\_000530\_FA-C\_SITE PLAN 1 OF 2– dated 19/10/2022.



**Table 10: Operation Noise Sources**

Activity	Noise Source	Qty	Height (m)	Usage Period (%)			Sound Power Level (dB(A))		Noise Characteristics (as per the NPfl)
				Day	Evening	Night	L <sub>Aeq</sub>	L <sub>Amax</sub> <sup>a)</sup>	
Operation	ST2752UX liquid cooling BESS Container	4	2.6	100	100	100	Three facades have a SPL of 54dB(A) at 5 m. One façade has a SPL of 53 dB(A) at 5m	-	+5 for tonality at the location of the fan
	SG4950HV Inverter	1	1.5	100	100	100	87	-	+5 dB adjustment Low frequency
	Solar Tracker	192	1.4	100	0	0	49	-	-
	Light Vehicle <sup>a)</sup>		1.5	1/h	1/hr	1/h	88	-	

*a) Light vehicles will only travel to site irregularly for maintenance. As such it will not be included in the assessment*



### 4.3 Noise Modelling Methodology

For the purposes of predicting impacts associated with noise emissions from the Subject Site on nearby sensitive receptors, noise modelling of the sources was completed using the proprietary software CadnaA (2022 MR2 build 189.5221) developed by DataKustik. CadnaA incorporates the influence of meteorology, terrain, ground type and air absorption in addition to source characteristics to predict noise impacts at receptor locations. All predictions have been undertaken in accordance with CONCAWE.

The model is utilised to assess the potential noise emissions from the Subject Site under a range of operating scenarios and meteorological conditions. The noise modelling also allows investigation of possible noise management solutions, in the event that non-compliance with the assessment criterion is predicted.

The NPfI presents guidelines for the consideration of meteorological effects on noise propagation, specifically, temperature inversions and/or gradient winds. NPfI provides two options for assessing meteorological effects as detailed in Table 11.

**Table 11: Standard and Noise Enhancing Meteorological Conditions**

Meteorological Conditions	Meteorological Parameters
Standard conditions	Day/evening/night: stability categories A-D with wind speed up to 0.5 m/s at 10 m AGL.
Noise enhancing conditions	Day/evening: stability categories A-D with light winds (up to 3 m/s at 10 m AGL).
	Night: stability categories A-D with light winds (up to 3 m/s at 10 m AGL). And/or stability category F with light winds (up to 2 m/s at 10 m AGL).

The following conditions have been modelled:

- Day Periods – Stability class D at 3 m/s;
- Evening Periods – Stability class D at 3 m/s; and
- Night period - Stability class F at 2 m/s.

### 4.4 Model Configuration

Table 12 summarises the model configuration used for the modelling.

**Table 12: Model Configuration**

Parameter	Approach
Standards	CONCAWE
Time Periods	Day (07:00 – 18:00 hours)
	Evening (18:00 – 22:00 hours)
	Night (22:00 – 07:00 hours)
Digital Terrain	Lidar at 1 m resolution. Triangulation calculation applied.
Ground Absorption	Default absorption for soft surface. Aerial mapping used to include hard ground.



#### 4.5 Predictive Operation Results

Table 13 below presents predicted receptor noise levels for Solar Farm No.3 during the operational phase of the proposed Facility. Review of the predicted noise levels confirms that compliance with the intrusive noise criteria established in accordance with the NPfI can be achieved for all receptors for both day, evening, and night periods under worst-case meteorological conditions.

Table 13: Solar Farm No.3 Predicted Receptor Noise Levels - Operational Phase, dB(A)

Receptor	Predicted Operational Noise Levels, L <sub>Aeq, 15min</sub>			Intrusive Noise Criteria			Comply (Y/N)
	Day	Eve	Night	Day	Eve	Night	
R01	<10	<10	<10	40	35	35	Y Y Y
R02	<10	<10	<10	40	35	35	Y Y Y
R03	<10	<10	<10	40	35	35	Y Y Y
R04	6	6	6	40	35	35	Y Y Y



## 5 ROAD TRAFFIC NOISE ASSESSMENT

### 5.1 Introduction

Noise impacts associated with vehicle movements during the operational phase of the Facility are expected to be negligible as no staff will be permanently based on-site. Visitation will be limited to periodic maintenance and infrequent plant and equipment replacements. During construction and any future decommissioning of the farm however, traffic movements will be more significant.

Construction is expected to be completed over a five-month period and it is anticipated that up to 50 workers would be on-site daily. It is anticipated that 10 light vehicles and 3 heavy vehicles will access the subject site daily during the peak construction period. However, a conservative assumption of 16 light vehicles and 4 heavy vehicles will travel to and from site daily.

Given this, the assessment has considered the potential impacts associated with noise emissions from a conservative 16 light and 4 heavy vehicle movements from the site entry northwest along Kidman Way.

Following additional assumptions have been made with a summary of road traffic data presented in Table 14.

- It has been assumed that 4 heavy vehicles per day would arrive spread out across the 11-hour workday.
- All movements are expected to occur during standard construction hours (7 am to 6 pm Monday to Friday and 8 am to 1 pm Saturday).

**Table 14: Road Traffic Data**

Road Segment	Vehicle Type	Vehicle Speed <sup>b)</sup>	Number of Movements (per peak hour)	
			Day (7 am to 6 pm)	Night (Peak 1-hour)
Kidman Way	Light	100 km/hr	16	16
	Heavy		1	1
Tabbita Lane	Light	50 km/hr	16	16
	Heavy		1	1

*a) Assumes all truck deliveries to site occur during standard construction hours (7 am to 6 pm Monday to Friday and 8 am to 1 pm Saturday)*

*b) Assumed speed based on road type*

### 5.2 Assessment Criteria

The ICNG does not provide criteria for the assessment of construction road traffic during the project. Given this, reference is made to the noise criteria provided in the NSW Road Noise Policy (RNP). Based on the type of roadway, Table 15 below presents the applicable road traffic noise criteria for existing residences affected by traffic on existing roadways generated by land use developments.



**Table 15: Applicable Road Traffic Noise Criteria**

Road Category	Type of Project & Land Use	Assessment Criteria
Local roads	Existing residences affected by additional traffic on existing local roads generated by land use developments	Day: $L_{Aeq,1 \text{ hour}}$ 55 dB(A) Night: $L_{Aeq,1 \text{ hour}}$ 50 dB(A) (external)
Freeway/ arterial/ sub-arterial roads	Existing residences affected by additional traffic on existing freeways/arterial/sub-arterial roads generated by land use developments	Day: $L_{Aeq,1 \text{ hour}}$ 60 dB(A) Night: $L_{Aeq,1 \text{ hour}}$ 55 dB(A) (external)

### 5.3 Noise Modelling Methodology

For the purposes of predicting impacts associated with road traffic noise emissions was completed using the proprietary software CadnaA (2022 MR2 build 189.5221) developed by DataKustik. The model incorporates the influence of terrain, ground type and air absorption in addition to source characteristics to predict noise impacts at receptor locations. All predictions have been undertaken in accordance with Calculation of Road Traffic Noise (CRTN) methodology developed by the UK Department of Transport. In accordance with the requirements of the RNP, the predictive noise modelling incorporated the following assumptions:

- $L_{Aeq}$  values were calculated from the  $L_{A10}$  values predicted by the CRTN methodology using the approximation  $L_{Aeq,1 \text{ hour}} = L_{A10,1 \text{ hour}} - 3$ .
- Noise source heights were set at 0.5 m above road level for cars, 1.5 m for heavy vehicle engines and 3.6 m for heavily vehicle exhausts.
- Noise from heavy vehicle exhausts is 8 dB lower than the steady continuous engine noise; and
- Corrections established for Australian conditions applied through a negative correction to the CRTN predictions of -1.7 dB for façade-corrected levels (Samuels and Saunders, 1982).

Review of the predicted noise level presented in Table 16 below confirms that compliance with the RNP is achieved at the closest receptors to each potential route.

**Table 16: Predicted  $L_{Aeq,15\text{-hour}}$  Noise Levels - Road Traffic Noise**

Sensitive Receptor	Setback from Roadway	Period	Parameter	Criteria	Predicted Noise Level	Comply (Y/N)
Kidman Way	30m	Day	$L_{Aeq,1 \text{ hour}}$	60	49	Y
		Night	$L_{Aeq,1 \text{ hour}}$	55	49	Y
Tabbita Lane	1km	Day	$L_{Aeq,1 \text{ hour}}$	55	16	Y
		Night	$L_{Aeq,1 \text{ hour}}$	50	16	Y

## 6 VIBRATION ASSESSMENT

### 6.1 Introduction

A review of the proposal indicates there is potential for impacts as a result of vibration generated by plant and equipment during the construction phase. Given this, an assessment of the potential for vibration impacts has been undertaken. In particular, the assessment has considered the potential for impacts on both human comfort and structural damage for the nearest residence to the construction works.

### 6.2 Assessment Criteria

The vibration criteria presented in the Environmental Noise Management – *Assessing Vibration: A Technical Guideline* (2006) published by the NSW Department of Environment and Conservation (DEC) have been adopted for the assessment. The technical guide provides vibration criteria associated with amenity impacts (human annoyance) for the three categories of vibration:

- Continuous vibration (e.g. road traffic, continuous construction activity);
- Impulsive vibration includes less than 3 distinct vibration events in an assessment period (e.g. occasional dropping of heavy equipment); and
- Intermittent vibration includes interrupted periods of continuous vibration (e.g. drilling), repeated periods of impulsive vibration (e.g. pile driving) or continuous vibration that varies significantly in amplitude.

Table 17 and Table 18 present the criteria for continuous and impulsive vibration and intermittent vibration, respectively.

**Table 17: Continuous & Impulsive Vibration Criteria for Residences – Peak Velocity**

Location	Vibration Type	Preferred Limit (mm/s)	Maximum Limit (mm/s)
Residences	Continuous	0.28	0.56
Residences	Impulsive	8.6	17

**Table 18: Intermittent Vibration Criteria for Residences**

Location	Assessment Period	Preferred Value (m/s <sup>1.75</sup> )	Maximum Value (m/s <sup>1.75</sup> )
Residences	Day-time	0.20	0.40

The above criteria are suitable for assessing human annoyance in response to vibration levels. In order to assess potential damage to buildings, reference has been made to British Standard *BS 7385-2: 1993 Evaluation and measurement of vibration in buildings – Part 2: Guide to damage levels from ground borne vibration*. Table 19 presents vibration criteria for assessing the potential for building damage.

**Table 19: Transient Vibration Guide Values for Cosmetic Damage**

Type of Building	Peak Particle Velocity (mm/s)	
	4 Hz to 15 Hz	15 Hz and above
Unreinforced or light framed structures – residential or light commercial type buildings	15 mm/s at 4 Hz increasing to 20 mm/s at 15 Hz	20 mm/s at 15 Hz increasing to 50 mm/s at 40 Hz and above

### 6.3 Potential Vibration Sources

Table 20 identifies the vibration source levels for the equipment likely to be used for the construction of the BESS.

**Table 20: Vibration Source levels – Peak Particle Velocity**

Equipment Item	PPV at 10 metres (mm/s)	Source
Piling (press-in method)	1 – 2	Rockhill, D.J. et. al. <sup>b)</sup>
Roller	5 – 6	DEC
7 tonne compactor	5 – 7	DEC
Loaded trucks (rough surface)	5	USA DT <sup>a)</sup>
Loaded trucks (smooth surface)	1 – 2	USA DT <sup>a)</sup>
Excavator	2.5 – 4	DEC

<sup>a)</sup> *Transit Noise and Vibration Impact Assessment, US Department of Transportation, May 2006*  
<sup>b)</sup> *Rockhill, D.J., Bolton, M.D. & White, D.J. (2003) 'Ground-borne vibrations due to press-in piling operations'*

### 6.4 Assessment of Potential Impacts

Based on the vibration source levels at 10 metres (presented in Table 20), peak particle velocities have been predicted at various separation distances. The NSW DEC indicates that in predicting vibration levels, it can be assumed that the vibration level is inversely proportional to distance (with the relationship varying between  $d^{-0.8}$  to  $d^{-1.6}$  based on field data).

The US Department of Transportation's Transit Noise and Vibration Impact Assessment (May 2006) presents the following construction vibration propagation formula assuming an inverse relationship:

$$PPV@d_2 = PPV@d_1 \times (d_1/d_2)^{1.5}$$

where:  $d_1$  = distance 1 (reference distance for source data) (m)

$d_2$  = distance 2 (separation distance for predicted PPV) (m)

PPV = peak particle velocity (mm/s)



The above formula has been considered for predicted PPVs at various distances from construction equipment. Based on the above information, Table 21 presents PPV predictions for the various construction equipment.

**Table 21: Predicted Peak Particle Velocity at Sensitive Receptors (mm/s)**

Distance from Source (m)	Predicted Peak Particle Velocity (mm/s)				
	Roller	7 tonne compactor	Excavator	Loaded trucks (rough surfaces)	Loaded trucks (smooth surfaces)
10	6.00	7.00	4.00	5.00	1 – 2
20	2.12	2.47	1.41	1.77	0.35 – 0.71
30	1.15	1.35	0.77	0.96	0.19 – 0.38
40	0.75	0.88	0.50	0.63	0.13 – 0.25
50	0.54	0.63	0.36	0.45	0.09 – 0.18
60	0.41	0.48	0.27	0.34	0.07 – 0.14
70	0.32	0.38	0.22	0.27	0.06 – 0.11
80	0.27	0.31	0.18	0.22	0.05 – 0.09
90	0.22	0.26	0.15	0.19	0.04 – 0.07
100	0.19	0.22	0.13	0.16	0.03 – 0.06
150	0.1	0.12	0.07	0.09	0.02 – 0.03
Type	Continuous			Intermittent	
Nuisance Criteria	Residential 0.28 (preferred) / 0.56 (max)			Residential 0.20 (preferred) / 0.40 (max)	
Building Criteria	Residential 15 mm/s at 4 Hz increasing to 20 mm/s at 15 Hz 20 mm/s at 15 Hz increasing to 50 mm/s at 40 Hz and above				

The predicted vibration levels presented in Table 21 indicate compliance with the continuous maximum vibration nuisance criteria for locations at a separation distance of 50-60 metres. Compliance with the building damage criteria is predicted at 10 metres from construction for each source. Therefore, as the closest receptor is 1781 m from the nearest vibration source, there will be no adverse impact

For intermittent vibration associated with haul vehicles, it is difficult to provide an appropriate comparison with the relevant criteria (which is presented as a Vibration Dose Value (VDV) in  $m/s^{1.75}$ ). The calculation of a VDV requires both the overall weighted RMS (root mean square) acceleration ( $m/s^2$ ) typically obtained from on-site measurements and the estimated time period for vibration events.

It is noted, however, that the compactor PPV at distances of 300 m (the distance to the nearest sensitive receptor from potential piling) is predicted to be within the maximum continuous criteria of 0.56 mm/s. This comparison with the continuous criteria (as a conservative approach) indicates that vibration levels associated with compactor are not considered to be significant (which is expected given the significant separation distances).



---

## 7 CONCLUSION


ACEnergy propose to develop a Solar farm and associated BESS in Tabbita, NSW. The impact assessment has considered the potential for adverse impacts resulting from noise (construction, road traffic and operational) and vibration (construction) emissions on nearby residential uses.

The assessment of potential noise impacts has considered the construction phase should occur during standard hours only. For construction during standard hours, adverse amenity impacts during construction are considered unlikely and compliance with applicable criteria is expected to be achieved.

For the operational phase of the project, adverse amenity impacts are considered unlikely and compliance with applicable criteria is expected to be achieved.

Overall, based on the results of the assessment, the risk of residual adverse impacts as a result of the proposed Facility is considered to be low with noise and vibration emissions complying with the applicable criteria. Hence, from an acoustic and vibrational perspective, the proposed development site is considered acceptable for the proposed use.

## APPENDIX A: PROPOSED PLANS

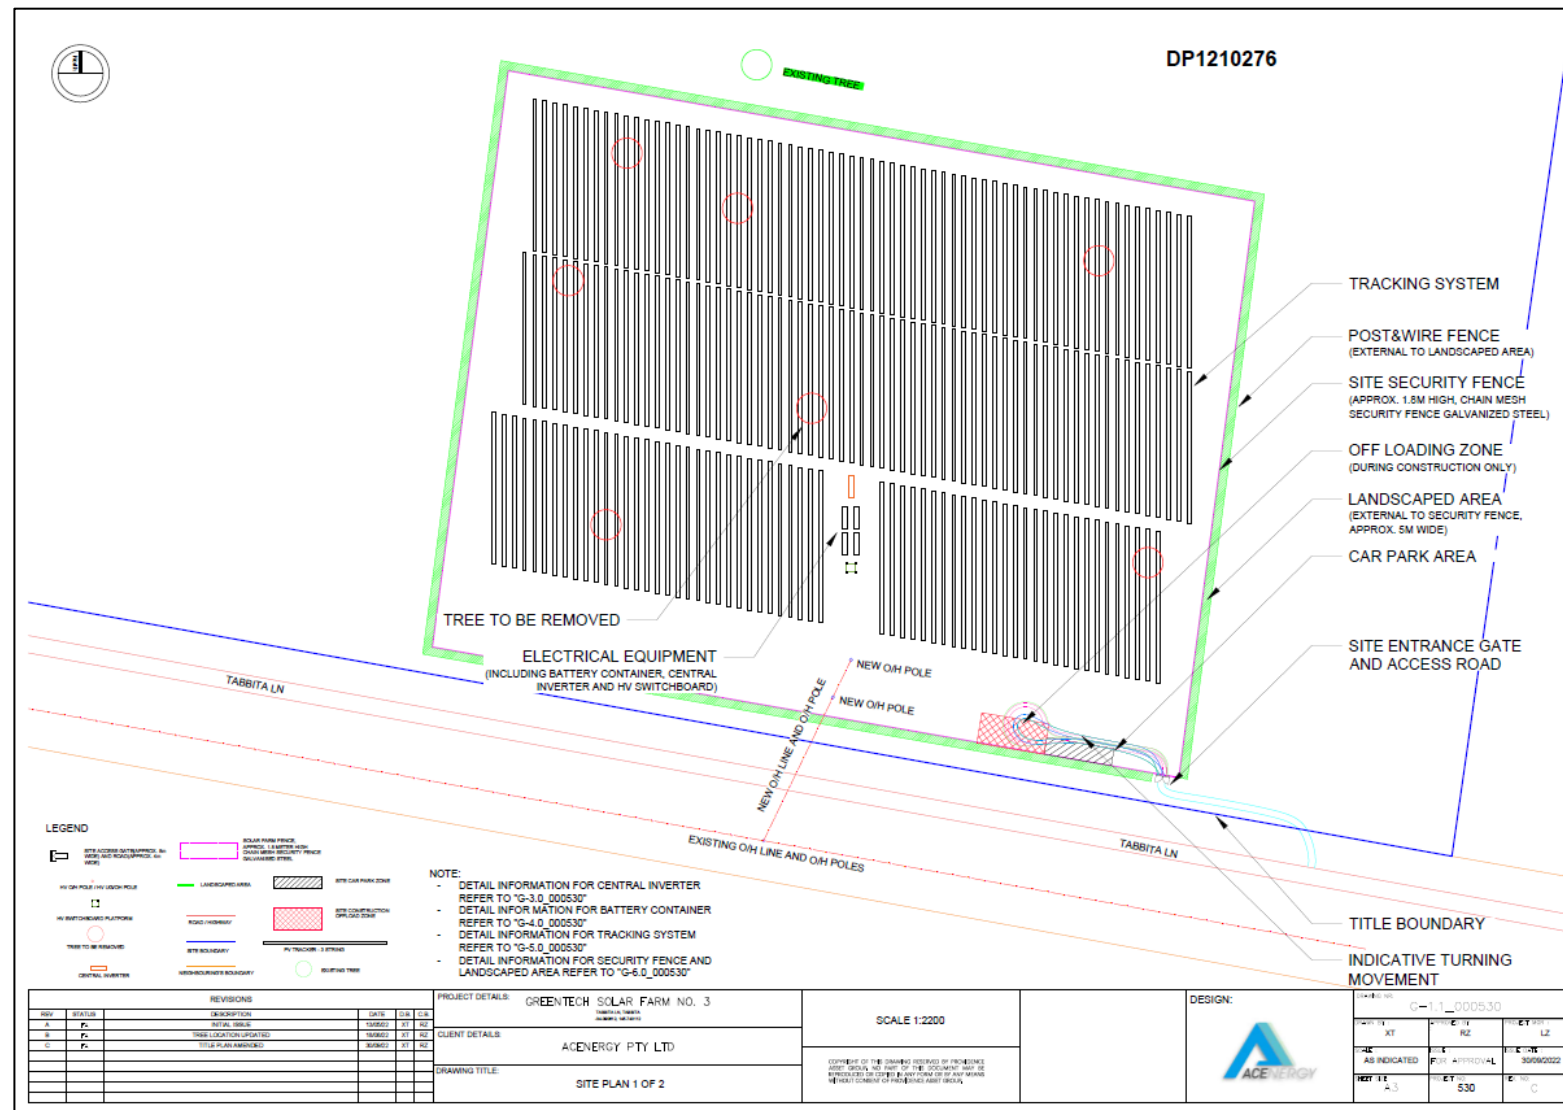

### Figure 3: Site Layout