

**Monterey Equity Pty Limited
c/- Heymann-Cohen Pty Ltd
Level 1/14 Martin Place
SYDNEY NSW 2000**

Project 85348.00
4 March 2016
R.001.Rev0
PAV:dh

Attention: Mr Richard Pajor

Email: richard.pajor@dcwc.com.au

Dear Sirs

**Geotechnical Assessment of Nominal Absorption Rate
Proposed Residential Development
119 Barton Street, Monterey**

1. Introduction

This letter report describes the results of a geotechnical assessment undertaken by Douglas Partners Pty Ltd (DP) at 119 Barton Street, Monterey. The investigation was commissioned by Monterey Equity Pty Limited.

It is understood that the proposed development will include the construction of townhouses, which will include a stormwater management system.

The assessment included eight boreholes and constant-head permeability tests to assess the subsurface profile and soil permeability at potential locations of the absorption pits. The permeability testing was carried out in accordance with the requirements of Section 5.2 of Rockdale City Council's Technical Specification: Stormwater Management, dated 2011. Details of the field work are provided together with comments on stormwater management.

2. Site Description and Geology

The site is currently occupied by Francis Drake Bowling Club, which includes a single-storey building (club house), two synthetic grass bowling greens, grassed areas, garden beds and an on-grade asphaltic concrete car park. One and two-storey buildings surround the site, except where the car park adjoins Barton Street.

The ground surface slopes gently down from the site boundaries towards the central area of the site, with reduced levels ranging from approximately RL 4.9 m to RL 3.7 m relative to Australian Height Datum (AHD).

Reference to the Sydney 1:100 000 Geological Series Sheet indicates that the site is located in an area underlain by wind-blown sand (Aeolian), with some silt and shells also present.

3. Field Work

3.1 Field Work Methods

The field work for the investigation comprised:

- Eight boreholes drilled to 3 m depth or prior refusal or hole collapse using a 100 mm diameter hand-auger. The boreholes were located at the possible locations for absorption pits, as nominated by Heymann-Cohen Pty Ltd;
- Logging and collection of soil samples and observation of the soil moisture condition;
- Eight constant-head permeability tests at depths of 0.5 m or 0.55 m within each borehole and carried out in accordance with Australian Standard *AS 1547 On site domestic waste water management - 2012 - Appendix G*. For the constant-head test, the borehole was initially filled with water to saturate the soil prior to testing. A water-filled standpipe (permeameter) was then inserted into the water-filled borehole to maintain a constant head of 0.3 – 0.35 m above the base of the borehole. The water level in the standpipe was measured and recorded at regular time intervals until total water loss from the permeameter had occurred.

Surface levels at the test locations were interpolated from Survey Drawing No. B1968-1, dated 11 September 2015, by Project Surveyors Pty Ltd. The locations of the tests are shown on the attached Drawing No. 1.

3.2 Field Work Results

The detailed borehole logs and permeability test results are attached, together with notes defining classification methods and descriptive terms.

3.2.1 Boreholes

The ground conditions encountered in the boreholes can be summarised as follows:

- **Artificial Grass** – 0.01 m thick in BH1 and BH2;
- **Filling (Topsoil)** – 0.1 m thick root-affected silty sand topsoil layer in BH5 to BH8;
- **Filling** – predominantly sand and silty sand filling extending to depths of between 0.6 m and 1.2 m in all boreholes. Gravel and cobble sized inclusions of sandstone, charcoal and slag were encountered in the filling. Borehole BH4 was discontinued at 1.2 m depth due to practical refusal of the hand auger on buried concrete;

- **Sand/Sandy Gravel** – medium to coarse grained sand with traces of shells extending to the final depths (i.e. 2.7 m to 3 m) of boreholes BH1, BH3 and BH5 to BH8. Borehole BH2 had sand to 2.4 m depth underlain by sandy gravel, with auger refusal at 2.5 m depth.

Above the groundwater table, the moisture condition of the filling and natural soil was variably humid to wet, with the degree of saturation generally increasing with depth. Free groundwater was observed in BH1, BH3 and BH5 to BH8 at depths of between 2.5 m and 2.8 m.

3.2.2 Permeability Tests

The saturated hydraulic conductivity (K_{sat}) results of the eight constant-head permeability tests are summarised in Table 1.

Table 1: Results of Constant Head Permeability Tests

Permeability Test Location	Hydraulic Conductivity (K_{sat}) (m/s)
BH1	4.2×10^{-4}
BH2	1.1×10^{-3}
BH3	8.7×10^{-5}
BH4	3.5×10^{-4}
BH5	4.2×10^{-4}
BH6	7.0×10^{-4}
BH7	2.3×10^{-4}
BH8	7.0×10^{-4}

4. Comments

4.1 Proposed Development

It is understood that the proposed development will include the construction of townhouses, which will include a stormwater management system. The feasibility and potential locations of absorption pits for the stormwater system is being assessed for the development.

4.2 Soil Category and Nominal Absorption Rate

Based on the results of the constant-head tests, the 'soil category' has been correlated in accordance with Table 5.1 of AS 1547 – 2012. For all eight tests, the soil texture correlates to 'Gravels and Sands' and the (soil horizon) structure correlates to 'Structureless (Massive)'.

In accordance with Section 5.2 of Rockdale City Council's Technical Specification: Stormwater Management, dated 2011, the hydraulic conductivity for each permeability test has been calculated in terms of a nominal absorption rate (litres/square metre/second), as shown in Table 2. The nominal absorption rate has been calculated by assuming a hydraulic gradient of 1 for sandy soil. The calculated results have been rounded to the nearest 0.1 of a decimal place.

Table 2: Nominal Absorption Rate

Permeability Test Location	Nominal Absorption Rate (L/s/m²)
BH1	0.4
BH2	1.1
BH3	0.1
BH4	0.4
BH5	0.4
BH6	0.7
BH7	0.2
BH8	0.7

5. Conclusion

Council's Specification indicates that absorption may not be practical where the nominal absorption rate is less than 0.05 L/s/m² or where physical limitations such as a high water table, bedrock close to ground surface or contaminated soils exist.

It should be noted that the hydraulic conductivity is dependent on the density and the degree of saturation of the soil, and therefore, it is likely to decrease with depth and vary according to weather conditions. The nominal absorption rate is also dependent upon the hydraulic gradient, that is, the rate will change with changes of the depth to the underlying water table.

Based on the permeability test results, the nominal absorption rates are greater than Council's nominal absorption rate of 0.05 L/s/m² and as such the use of on-site absorption pits is considered to be feasible from a hydrogeological point of view. It is noted that an impermeable layer such as bedrock was not encountered within the depths of the boreholes (up to 3 m deep). A relatively shallow groundwater table, however, was encountered 2.5 m to 2.8 m below the current ground surface levels. DP has not carried out a contamination assessment of soils for this site.

6. Limitations

Douglas Partners Pty Ltd (DP) has prepared this report for this project at 119 Barton Street, Monterey in accordance with DP's proposal (SYD160043.P.001.Rev1 dated 1 February 2016 and acceptance received from Monterey Equity Pty Limited dated 9 February 2016. The work was carried out under DP's Conditions of Engagement. This report is provided for the exclusive use of Monterey Equity Pty Limited and their agents for this project only and for the purposes as described in the report. It should not be used by or relied upon for other projects or purposes on the same or other site or by a third party. Any party so relying upon this report beyond its exclusive use and purpose as stated above, and without the express written consent of DP, does so entirely at its own risk and without recourse to DP for any loss or damage. In preparing this report DP has necessarily relied upon information provided by the client and/or their agents.

The results provided in the report are indicative of the sub-surface conditions on the site only at the specific sampling and/or testing locations, and then only to the depths investigated and at the time the work was carried out. Sub-surface conditions can change abruptly due to variable geological processes and also as a result of human influences. Such changes may occur after DP's field testing has been completed.

DP's advice is based upon the conditions encountered during this investigation. The accuracy of the advice provided by DP in this report may be affected by undetected variations in ground conditions across the site between and beyond the sampling and/or testing locations. The advice may also be limited by budget constraints imposed by others or by site accessibility.

This report must be read in conjunction with all of the attached notes and should be kept in its entirety without separation of individual pages or sections. DP cannot be held responsible for interpretations or conclusions made by others unless they are supported by an expressed statement, interpretation, outcome or conclusion stated in this report.

This report, or sections from this report, should not be used as part of a specification for a project, without review and agreement by DP. This is because this report has been written as advice and opinion rather than instructions for construction.

The scope for work for this investigation/report did not include the assessment of surface or sub-surface materials or groundwater for contaminants, within or adjacent to the site. Should evidence of filling of unknown origin be noted in the report, and in particular the presence of building demolition materials, it should be recognised that there may be some risk that such filling may contain contaminants and hazardous building materials.

The contents of this report do not constitute formal design components such as are required, by the Health and Safety Legislation and Regulations, to be included in a Safety Report specifying the hazards likely to be encountered during construction and the controls required to mitigate risk. This design process requires risk assessment to be undertaken, with such assessment being dependent upon factors relating to likelihood of occurrence and consequences of damage to property and to life. This, in turn, requires project data and analysis presently beyond the knowledge and project role respectively of DP. DP may be able, however, to assist the client in carrying out a risk assessment of

potential hazards contained in the Comments section of this report, as an extension to the current scope of works, if so requested, and provided that suitable additional information is made available to DP. Any such risk assessment would, however, be necessarily restricted to the geotechnical components set out in this report and to their application by the project designers to project design, construction, maintenance and demolition.

Please contact the undersigned if you have any questions on this matter.

Yours faithfully


Douglas Partners Pty Ltd



Peter Valenti
Geotechnical Engineer

Attachments: About this Report
 Borehole Logs
 Constant Head Test Results
 Drawing No. 1 – Location of Tests

Reviewed by

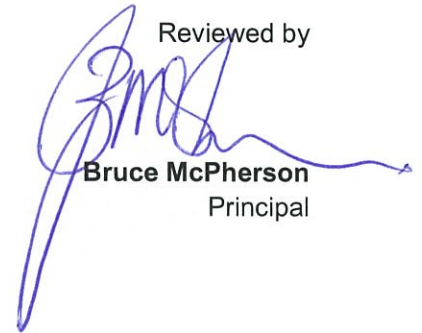

Bruce McPherson
Principal

About this Report

Douglas Partners



Introduction

These notes have been provided to amplify DP's report in regard to classification methods, field procedures and the comments section. Not all are necessarily relevant to all reports.

DP's reports are based on information gained from limited subsurface excavations and sampling, supplemented by knowledge of local geology and experience. For this reason, they must be regarded as interpretive rather than factual documents, limited to some extent by the scope of information on which they rely.

Copyright

This report is the property of Douglas Partners Pty Ltd. The report may only be used for the purpose for which it was commissioned and in accordance with the Conditions of Engagement for the commission supplied at the time of proposal. Unauthorised use of this report in any form whatsoever is prohibited.

Borehole and Test Pit Logs

The borehole and test pit logs presented in this report are an engineering and/or geological interpretation of the subsurface conditions, and their reliability will depend to some extent on frequency of sampling and the method of drilling or excavation. Ideally, continuous undisturbed sampling or core drilling will provide the most reliable assessment, but this is not always practicable or possible to justify on economic grounds. In any case the boreholes and test pits represent only a very small sample of the total subsurface profile.

Interpretation of the information and its application to design and construction should therefore take into account the spacing of boreholes or pits, the frequency of sampling, and the possibility of other than 'straight line' variations between the test locations.

Groundwater

Where groundwater levels are measured in boreholes there are several potential problems, namely:

- In low permeability soils groundwater may enter the hole very slowly or perhaps not at all during the time the hole is left open;

- A localised, perched water table may lead to an erroneous indication of the true water table;
- Water table levels will vary from time to time with seasons or recent weather changes. They may not be the same at the time of construction as are indicated in the report; and
- The use of water or mud as a drilling fluid will mask any groundwater inflow. Water has to be blown out of the hole and drilling mud must first be washed out of the hole if water measurements are to be made.

More reliable measurements can be made by installing standpipes which are read at intervals over several days, or perhaps weeks for low permeability soils. Piezometers, sealed in a particular stratum, may be advisable in low permeability soils or where there may be interference from a perched water table.

Reports

The report has been prepared by qualified personnel, is based on the information obtained from field and laboratory testing, and has been undertaken to current engineering standards of interpretation and analysis. Where the report has been prepared for a specific design proposal, the information and interpretation may not be relevant if the design proposal is changed. If this happens, DP will be pleased to review the report and the sufficiency of the investigation work.

Every care is taken with the report as it relates to interpretation of subsurface conditions, discussion of geotechnical and environmental aspects, and recommendations or suggestions for design and construction. However, DP cannot always anticipate or assume responsibility for:

- Unexpected variations in ground conditions. The potential for this will depend partly on borehole or pit spacing and sampling frequency;
- Changes in policy or interpretations of policy by statutory authorities; or
- The actions of contractors responding to commercial pressures.

If these occur, DP will be pleased to assist with investigations or advice to resolve the matter.

About this Report

Site Anomalies

In the event that conditions encountered on site during construction appear to vary from those which were expected from the information contained in the report, DP requests that it be immediately notified. Most problems are much more readily resolved when conditions are exposed rather than at some later stage, well after the event.

Information for Contractual Purposes

Where information obtained from this report is provided for tendering purposes, it is recommended that all information, including the written report and discussion, be made available. In circumstances where the discussion or comments section is not relevant to the contractual situation, it may be appropriate to prepare a specially edited document. DP would be pleased to assist in this regard and/or to make additional report copies available for contract purposes at a nominal charge.

Site Inspection

The company will always be pleased to provide engineering inspection services for geotechnical and environmental aspects of work to which this report is related. This could range from a site visit to confirm that conditions exposed are as expected, to full time engineering presence on site.



Sampling

Sampling is carried out during drilling or test pitting to allow engineering examination (and laboratory testing where required) of the soil or rock.

Disturbed samples taken during drilling provide information on colour, type, inclusions and, depending upon the degree of disturbance, some information on strength and structure.

Undisturbed samples are taken by pushing a thin-walled sample tube into the soil and withdrawing it to obtain a sample of the soil in a relatively undisturbed state. Such samples yield information on structure and strength, and are necessary for laboratory determination of shear strength and compressibility. Undisturbed sampling is generally effective only in cohesive soils.

Test Pits

Test pits are usually excavated with a backhoe or an excavator, allowing close examination of the in-situ soil if it is safe to enter into the pit. The depth of excavation is limited to about 3 m for a backhoe and up to 6 m for a large excavator. A potential disadvantage of this investigation method is the larger area of disturbance to the site.

Large Diameter Augers

Boreholes can be drilled using a rotating plate or short spiral auger, generally 300 mm or larger in diameter commonly mounted on a standard piling rig. The cuttings are returned to the surface at intervals (generally not more than 0.5 m) and are disturbed but usually unchanged in moisture content. Identification of soil strata is generally much more reliable than with continuous spiral flight augers, and is usually supplemented by occasional undisturbed tube samples.

Continuous Spiral Flight Augers

The borehole is advanced using 90-115 mm diameter continuous spiral flight augers which are withdrawn at intervals to allow sampling or in-situ testing. This is a relatively economical means of drilling in clays and sands above the water table. Samples are returned to the surface, or may be collected after withdrawal of the auger flights, but they are disturbed and may be mixed with soils from the sides of the hole. Information from the drilling (as distinct from specific sampling by SPTs or undisturbed samples) is of relatively low

reliability, due to the remoulding, possible mixing or softening of samples by groundwater.

Non-core Rotary Drilling

The borehole is advanced using a rotary bit, with water or drilling mud being pumped down the drill rods and returned up the annulus, carrying the drill cuttings. Only major changes in stratification can be determined from the cuttings, together with some information from the rate of penetration. Where drilling mud is used this can mask the cuttings and reliable identification is only possible from separate sampling such as SPTs.

Continuous Core Drilling

A continuous core sample can be obtained using a diamond tipped core barrel, usually with a 50 mm internal diameter. Provided full core recovery is achieved (which is not always possible in weak rocks and granular soils), this technique provides a very reliable method of investigation.

Standard Penetration Tests

Standard penetration tests (SPT) are used as a means of estimating the density or strength of soils and also of obtaining a relatively undisturbed sample. The test procedure is described in Australian Standard 1289, Methods of Testing Soils for Engineering Purposes - Test 6.3.1.

The test is carried out in a borehole by driving a 50 mm diameter split sample tube under the impact of a 63 kg hammer with a free fall of 760 mm. It is normal for the tube to be driven in three successive 150 mm increments and the 'N' value is taken as the number of blows for the last 300 mm. In dense sands, very hard clays or weak rock, the full 450 mm penetration may not be practicable and the test is discontinued.

The test results are reported in the following form.

- In the case where full penetration is obtained with successive blow counts for each 150 mm of, say, 4, 6 and 7 as:
4,6,7
N=13
- In the case where the test is discontinued before the full penetration depth, say after 15 blows for the first 150 mm and 30 blows for the next 40 mm as:
15, 30/40 mm

Sampling Methods

The results of the SPT tests can be related empirically to the engineering properties of the soils.

Dynamic Cone Penetrometer Tests / Perth Sand Penetrometer Tests

Dynamic penetrometer tests (DCP or PSP) are carried out by driving a steel rod into the ground using a standard weight of hammer falling a specified distance. As the rod penetrates the soil the number of blows required to penetrate each successive 150 mm depth are recorded. Normally there is a depth limitation of 1.2 m, but this may be extended in certain conditions by the use of extension rods. Two types of penetrometer are commonly used.

- Perth sand penetrometer - a 16 mm diameter flat ended rod is driven using a 9 kg hammer dropping 600 mm (AS 1289, Test 6.3.3). This test was developed for testing the density of sands and is mainly used in granular soils and filling.
- Cone penetrometer - a 16 mm diameter rod with a 20 mm diameter cone end is driven using a 9 kg hammer dropping 510 mm (AS 1289, Test 6.3.2). This test was developed initially for pavement subgrade investigations, and correlations of the test results with California Bearing Ratio have been published by various road authorities.



Description and Classification Methods

The methods of description and classification of soils and rocks used in this report are based on Australian Standard AS 1726, Geotechnical Site Investigations Code. In general, the descriptions include strength or density, colour, structure, soil or rock type and inclusions.

Soil Types

Soil types are described according to the predominant particle size, qualified by the grading of other particles present:

Type	Particle size (mm)
Boulder	>200
Cobble	63 - 200
Gravel	2.36 - 63
Sand	0.075 - 2.36
Silt	0.002 - 0.075
Clay	<0.002

The sand and gravel sizes can be further subdivided as follows:

Type	Particle size (mm)
Coarse gravel	20 - 63
Medium gravel	6 - 20
Fine gravel	2.36 - 6
Coarse sand	0.6 - 2.36
Medium sand	0.2 - 0.6
Fine sand	0.075 - 0.2

The proportions of secondary constituents of soils are described as:

Term	Proportion	Example
And	Specify	Clay (60%) and Sand (40%)
Adjective	20 - 35%	Sandy Clay
Slightly	12 - 20%	Slightly Sandy Clay
With some	5 - 12%	Clay with some sand
With a trace of	0 - 5%	Clay with a trace of sand

Definitions of grading terms used are:

- Well graded - a good representation of all particle sizes
- Poorly graded - an excess or deficiency of particular sizes within the specified range
- Uniformly graded - an excess of a particular particle size
- Gap graded - a deficiency of a particular particle size with the range

Cohesive Soils

Cohesive soils, such as clays, are classified on the basis of undrained shear strength. The strength may be measured by laboratory testing, or estimated by field tests or engineering examination. The strength terms are defined as follows:

Description	Abbreviation	Undrained shear strength (kPa)
Very soft	vs	<12
Soft	s	12 - 25
Firm	f	25 - 50
Stiff	st	50 - 100
Very stiff	vst	100 - 200
Hard	h	>200

Cohesionless Soils

Cohesionless soils, such as clean sands, are classified on the basis of relative density, generally from the results of standard penetration tests (SPT), cone penetration tests (CPT) or dynamic penetrometers (PSP). The relative density terms are given below:

Relative Density	Abbreviation	SPT N value	CPT qc value (MPa)
Very loose	vl	<4	<2
Loose	l	4 - 10	2 - 5
Medium dense	md	10 - 30	5 - 15
Dense	d	30 - 50	15 - 25
Very dense	vd	>50	>25

Soil Descriptions

Soil Origin

It is often difficult to accurately determine the origin of a soil. Soils can generally be classified as:

- Residual soil - derived from in-situ weathering of the underlying rock;
- Transported soils - formed somewhere else and transported by nature to the site; or
- Filling - moved by man.

Transported soils may be further subdivided into:

- Alluvium - river deposits
- Lacustrine - lake deposits
- Aeolian - wind deposits
- Littoral - beach deposits
- Estuarine - tidal river deposits
- Talus - scree or coarse colluvium
- Slopewash or Colluvium - transported downslope by gravity assisted by water. Often includes angular rock fragments and boulders.

Symbols & Abbreviations

Douglas Partners



Introduction

These notes summarise abbreviations commonly used on borehole logs and test pit reports.

Drilling or Excavation Methods

C	Core Drilling
R	Rotary drilling
SFA	Spiral flight augers
NMLC	Diamond core - 52 mm dia
NQ	Diamond core - 47 mm dia
HQ	Diamond core - 63 mm dia
PQ	Diamond core - 81 mm dia

Water

▷	Water seep
▽	Water level

Sampling and Testing

A	Auger sample
B	Bulk sample
D	Disturbed sample
E	Environmental sample
U ₅₀	Undisturbed tube sample (50mm)
W	Water sample
pp	pocket penetrometer (kPa)
PID	Photo ionisation detector
PL	Point load strength Is(50) MPa
S	Standard Penetration Test
V	Shear vane (kPa)

Description of Defects in Rock

The abbreviated descriptions of the defects should be in the following order: Depth, Type, Orientation, Coating, Shape, Roughness and Other. Drilling and handling breaks are not usually included on the logs.

Defect Type

B	Bedding plane
Cs	Clay seam
Cv	Cleavage
Cz	Crushed zone
Ds	Decomposed seam
F	Fault
J	Joint
Lam	lamination
Pt	Parting
Sz	Sheared Zone
V	Vein

Orientation

The inclination of defects is always measured from the perpendicular to the core axis.

h	horizontal
v	vertical
sh	sub-horizontal
sv	sub-vertical

Coating or Infilling Term

cln	clean
co	coating
he	healed
inf	infilled
stn	stained
ti	tight
vn	veneer

Coating Descriptor

ca	calcite
cbs	carbonaceous
cly	clay
fe	iron oxide
mn	manganese
slt	silty

Shape

cu	curved
ir	irregular
pl	planar
st	stepped
un	undulating

Roughness

po	polished
ro	rough
sl	slickensided
sm	smooth
vr	very rough

Other

fg	fragmented
bnd	band
qtz	quartz

Symbols & Abbreviations

Graphic Symbols for Soil and Rock

General



Asphalt



Road base



Concrete




Filling


Soils




Topsoil




Peat



Clay



Silty clay



Sandy clay




Gravelly clay



Shaly clay



Silt




Clayey silt




Sandy silt



Sand




Clayey sand



Silty sand



Gravel



Sandy gravel



Cobbles, boulders



Talus

Sedimentary Rocks




Boulder conglomerate



Conglomerate




Conglomeratic sandstone




Sandstone



Siltstone




Laminite



Mudstone, claystone, shale




Coal




Limestone


Metamorphic Rocks



Slate, phyllite, schist




Gneiss




Quartzite


Igneous Rocks




Granite




Dolerite, basalt, andesite



Dacite, epidote



Tuff, breccia






Porphyry

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 3.7 AHD
EASTING: 329004
NORTHING: 6239143
DIP/AZIMUTH: 90°/--

BORE No: 1
PROJECT No: 85348.00
DATE: 15/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Well Construction Details	
				Type	Depth	Sample			
	0.01	ARTIFICIAL GRASS		A	0.05				
		FILLING - brown, fine, gravelly, medium to coarse sand filling, humid			0.1				
		0.07m: becoming light yellow-brown		A	0.3				
	0.45	0.22m: becoming grey		A	0.4				
		FILLING - dark brown, medium to coarse silty sand filling with some fine to medium gravel, damp		A	0.45				
		0.8m: with some medium to coarse slag gravel			0.5				
	1.0	SAND - brown, medium to coarse sand with some silt, damp		A	1.1				
					1.2				
				A	1.9				
	2.3	SAND - light grey-brown and orange, medium to coarse sand, wet becoming saturated		A	2.4				
					2.5				
	2.75	Bore discontinued at 2.75m - hole collapsed							

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 2.75m

WATER OBSERVATIONS: Free groundwater observed at 2.55m

REMARKS: Permeability test carried out at 0.55m

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	G	Gas sample
B	Bulk sample	P	Piston sample
BLK	Block sample	U	Tube sample (x mm dia.)
C	Core drilling	W	Water sample
D	Disturbed sample	W	Water seep
E	Environmental sample	W	Water level
		PID	Photo ionisation detector (ppm)
		PL(A)	Point load axial test (s(50) (MPa)
		PL(D)	Point load diametral test (s(50) (MPa)
		pp	Pocket penetrometer (kPa)
		S	Standard penetration test
		V	Shear vane (kPa)






Douglas Partners
Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 3.7 AHD
EASTING: 328999
NORTHING: 6239113
DIP/AZIMUTH: 90°/--

BORE No: 2
PROJECT No: 85348.00
DATE: 15/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
	0.01	ARTIFICIAL GRASS		A	0.05					
		FILLING - brown, fine, gravelly, medium to coarse sand filling, humid			0.1					
		0.07m: becoming light yellow-brown								
		0.22m: becoming grey		A	0.4					
	0.6	SAND - brown, medium to coarse sand with some fine gravel and silt, damp		A	0.5					
					0.6					
					0.7					
		1.4m: becoming light grey-brown								
				A	1.5					
					1.6					
	1.8	SAND - light brown, medium to coarse sand, damp								
				A	2.1					
					2.2					
	2.4	SANDY GRAVEL - dark grey and brown, medium to coarse, sandy, fine to medium gravel with some shells		A	2.4					
	2.5	Bore discontinued at 2.5m - practical refusal on medium to coarse gravel			2.5					

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 2.5m

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Permeability test carried out at 0.5m

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	G	Gas sample
B	Bulk sample	P	Piston sample
BLK	Block sample	U	Tube sample (x mm dia.)
C	Core drilling	W	Water sample
D	Disturbed sample	W	Water seep
E	Environmental sample	W	Water level
		PID	Photo ionisation detector (ppm)
		PL(A)	Point load axial test (s(50) (MPa)
		PL(D)	Point load diametral test (s(50) (MPa)
		pp	Pocket penetrometer (kPa)
		S	Standard penetration test
		V	Shear vane (kPa)








Douglas Partners
Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 4.1 AHD
EASTING: 328935
NORTHING: 6239114
DIP/AZIMUTH: 90°/--

BORE No: 3
PROJECT No: 85348.00
DATE: 15/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
4	0.0	FILLING - dark brown-grey, medium to coarse silty sand filling with some rootlets, humid 0.3m: with some fine to medium sandstone and charcoal gravel 0.4m: becoming moist		A	0.1					
					0.2					
					0.5					
					0.6					
1	1.0	SAND - brown, medium to coarse sand with some shells, moist		A	1.0					
					1.1					
					1.4					
					1.5					
2	2.0			A	1.9					
					2.0					
2.6	2.6	SAND - light brown, medium to coarse sand, wet becoming saturated		A						
3	3.0	Bore discontinued at 3.0m - target depth reached			3.0					

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 3.0m

WATER OBSERVATIONS: Free groundwater observed at 2.7m

REMARKS: Permeability test carried out at 0.55m

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	G	Gas sample	PID	Photo ionisation detector (ppm)
B	Bulk sample	P	Piston sample	PL(A)	Point load axial test Is(50) (MPa)
BLK	Block sample	U	Tube sample (x mm dia.)	PL(D)	Point load diametral test Is(50) (MPa)
C	Core drilling	W	Water sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	W	Water seep	S	Standard penetration test
E	Environmental sample	W	Water level	V	Shear vane (kPa)




Douglas Partners
 Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 4.3 AHD
EASTING: 328935
NORTHING: 6239105
DIP/AZIMUTH: 90°/--

BORE No: 4
PROJECT No: 85348.00
DATE: 15/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
1		FILLING - dark brown-grey, medium to coarse silty sand filling with some rootlets, humid 0.8m: with some charcoal gravel 0.9m: becoming light brown		A	0.1					
					0.2					
				A	0.4					
					0.5					
				A	0.9					
					1.0					
					1.1					
				A	1.2					
	1.2	Bore discontinued at 1.2m - refusal on buried concrete								
2										
3										
4										

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 1.2m

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Permeability test carried out at 0.5m

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	G	Gas sample	PID	Photo ionisation detector (ppm)
B	Bulk sample	P	Piston sample	PL(A)	Point load axial test Is(50) (MPa)
BLK	Block sample	U	Tube sample (x mm dia.)	PL(D)	Point load diametral test Is(50) (MPa)
C	Core drilling	W	Water sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	W	Water seep	S	Standard penetration test
E	Environmental sample	W	Water level	V	Shear vane (kPa)



Douglas Partners
 Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 4.2 AHD
EASTING: 328922
NORTHING: 6239137
DIP/AZIMUTH: 90°/--

BORE No: 5
PROJECT No: 85348.00
DATE: 16/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
4		FILLING - dark brown, silty, fine to medium sand filling with trace of rootlets, humid (topsoil to 0.1m) 0.5m: becoming grey-brown		A	0.1					
					0.2					
					0.5					
					0.6					
1	1.0	SAND - pale brown, medium to coarse sand with trace of shells, moist		A	1.1				1	
					1.2					
2									2	
	2.5	SAND - dark brown mottled red-brown, medium to coarse sand with trace of shells, saturated		A	2.5					
	2.7	Bore discontinued at 2.7m - hole collapsed			2.6					
3									3	
4									4	

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 2.7m

WATER OBSERVATIONS: Free groundwater observed at 2.5m

REMARKS: Permeability test carried out at 0.55m

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	G	Gas sample	PID	Photo ionisation detector (ppm)
B	Bulk sample	P	Piston sample	PL(A)	Point load axial test Is(50) (MPa)
BLK	Block sample	U	Tube sample (x mm dia.)	PL(D)	Point load diametral test Is(50) (MPa)
C	Core drilling	W	Water sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	>	Water seep	S	Standard penetration test
E	Environmental sample	≡	Water level	V	Shear vane (kPa)



Douglas Partners
 Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 4.0 AHD
EASTING: 328927
NORTHING: 6239160
DIP/AZIMUTH: 90°/--

BORE No: 6
PROJECT No: 85348.00
DATE: 16/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
		FILLING - dark brown, silty, fine to medium sand filling with trace of rootlets, humid (topsoil to 0.1m)		A	0.1					
					0.2					
		0.5m: becoming grey-brown								
	0.8			A	0.8					
		SAND - pale brown, medium to coarse sand with traces of shells, moist			0.9					
		1.4m: becoming grey		A	1.4					
					1.5					
		2.4m: becoming pale brown mottled red								
	2.8									
		SAND - pale brown mottled red, medium to coarse sand with trace of shells, saturated								
	3.0	Bore discontinued at 3.0m - target depth reached								

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 3.0m

WATER OBSERVATIONS: Free groundwater observed at at 2.8m

REMARKS: Permeability test carried out at 0.5m

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	G	Gas sample	PID	Photo ionisation detector (ppm)
B	Bulk sample	P	Piston sample	PL(A)	Point load axial test Is(50) (MPa)
BLK	Block sample	U	Tube sample (x mm dia.)	PL(D)	Point load diametral test Is(50) (MPa)
C	Core drilling	W	Water sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	W	Water seep	S	Standard penetration test
E	Environmental sample	W	Water level	V	Shear vane (kPa)



Douglas Partners
 Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 4.0 AHD
EASTING: 328951
NORTHING: 6239158
DIP/AZIMUTH: 90°/--

BORE No: 7
PROJECT No: 85348.00
DATE: 16/2/2016
SHEET 1 OF 1

[illegible]

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 3.0m

WATER OBSERVATIONS: Free groundwater observed at 2.7m

REMARKS: Permeability test carried out at 0.5m

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	G	Gas sample
B	Bulk sample	P	Piston sample
BLK	Block sample	U	Tube sample (x mm dia.)
C	Core drilling	W	Water sample
D	Disturbed sample	W	Water seep
E	Environmental sample	W	Water level
		PID	Photo ionisation detector (ppm)
		PL(A)	Point load axial test (s(50) (MPa)
		PL(D)	Point load diametral test (s(50) (MPa)
		pp	Pocket penetrometer (kPa)
		S	Standard penetration test
		V	Shear vane (kPa)






Douglas Partners
Geotechnics | Environment | Groundwater

BOREHOLE LOG

CLIENT: Monterey Equity Pty Ltd
PROJECT: Proposed Residential Development
LOCATION: 119 Barton Street, Monterey

SURFACE LEVEL: 3.9 AHD
EASTING: 328977
NORTHING: 6239157
DIP/AZIMUTH: 90°/--

BORE No: 8
PROJECT No: 85348.00
DATE: 16/2/2016
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
		FILLING - dark brown, silty, fine to medium sand filling with trace of rootlets, humid (topsoil to 0.1m) 0.2m: with some fine to medium sandstone gravel and brick fragments 0.4m: becoming grey-brown		A	0.1 0.2					
	0.8	SAND - brown, medium to coarse sand, moist		A	0.8 0.9					
	1									
	2	1.3m: becoming light brown grey								
	2									
	2.5			A	2.5 2.6					
	2.8	SAND - light brown-grey, medium to coarse sand, saturated								
	3	Bore discontinued at 3.0m - target depth reached								
	3									
	4									
	4									

RIG: Hand tools

DRILLER: MB/JS

LOGGED: MB/JS

CASING: Uncased

TYPE OF BORING: Hand augered to 3.0m

WATER OBSERVATIONS: Free groundwater observed at 2.8m

REMARKS: Permeability test carried out at 0.5m

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	G	Gas sample	PID	Photo ionisation detector (ppm)
B	Bulk sample	P	Piston sample	PL(A)	Point load axial test Is(50) (MPa)
BLK	Block sample	U	Tube sample (x mm dia.)	PL(D)	Point load diametral test Is(50) (MPa)
C	Core drilling	W	Water sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	>	Water seep	S	Standard penetration test
E	Environmental sample	≡	Water level	V	Shear vane (kPa)



Douglas Partners
 Geotechnics | Environment | Groundwater

Constant Head Permeameter Test Report [AS1547:2012 App G]


Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	15/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB

Test Location	Test No.	BH1
Description: Bowling Green	Easting:	329004 m
Material type: Sand Filling	Northing	6239143 m
Condition of ground surface before test: Artificial Grass	Surface Level:	3.7 m AHD
Weather during test: 29°, Cloudy		

Details of Bore Installation			
Depth of augered hole	550 mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	350 mm	Time from filling to start	0 minutes
Diameter of hole	100 mm		

Test Results

Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)
0.00	300		
0.08	200	785	9817
0.17	120	628	6981
0.25	30	707	8836
0.33	0	236	2945
Average		589	7145

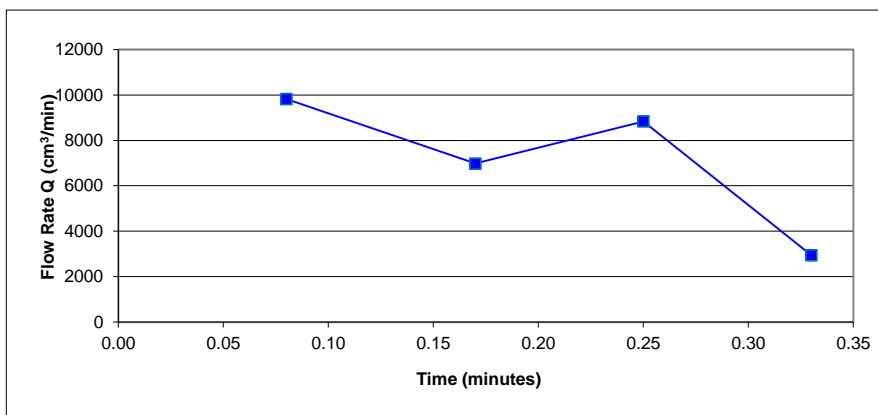

Saturated Hydraulic Conductivity - Over total duration of test

$$\begin{aligned}
 k &= 2.54\text{E}+00 \text{ cm/min} & \text{where } K &= 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{(r/H^2)+0.25}] + r/H/2\pi H^2 \\
 &= 4.23\text{E}-04 \text{ m/sec} & & \text{ref. AS1547-2012 App G} \\
 &= 36.56 \text{ m/day}
 \end{aligned}$$

Constant Head Permeameter Test Report [AS1547:2012 App G]

Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	15/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB


Test Location	Test No.	BH2
Description: Bowling Green	Easting:	328999 m
Material type: Sand Filling	Northing	6239113 m
Condition of ground surface before test: Artificial Grass	Surface Level:	3.7 m AHD
Weather during test: 29°, Cloudy		

Details of Bore Installation			
Depth of augered hole	500 mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	300 mm	Time from filling to start	0 minutes
Diameter of hole	100 mm		

Test Results

Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)
0.00	300		
0.08	60	1885	23562
0.17	0	471	5236

Average 1178 14399

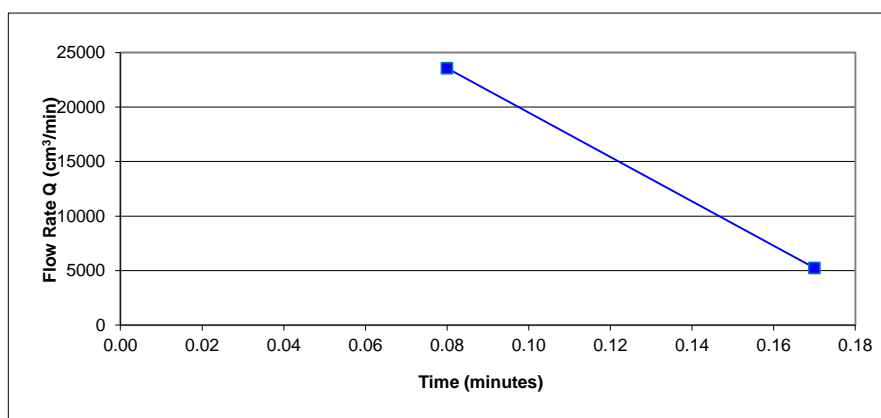

Saturated Hydraulic Conductivity - Over total duration of test

$$\begin{aligned}
 k &= 6.39\text{E}+00 \text{ cm/min} & \text{where } K &= 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{(r/H^2)+0.25}] + r/H/2\pi H^2 \\
 &= 1.07\text{E}-03 \text{ m/sec} & & \text{ref. AS1547-2012 App G} \\
 &= 92.02 \text{ m/day}
 \end{aligned}$$

Constant Head Permeameter Test Report [AS1547:2012 App G]

Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	15/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB


Test Location	Test No.	BH3
Description: Lawn	Easting:	328935 m
Material type: Silty Sand Filling	Northing	6239114 m
Condition of ground surface before test: Topsoil	Surface Level:	4.1 m AHD
Weather during test: 29°, Cloudy		

Details of Bore Installation			
Depth of augered hole	550 mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	350 mm	Time from filling to start	0 minutes
Diameter of hole	100 mm		

Test Results

Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)
0.00	300		
0.25	245	432	1728
0.50	190	432	1728
0.75	145	353	1414
1.00	100	353	1414
1.25	60	314	1257
1.50	20	314	1257

Average 367 1466

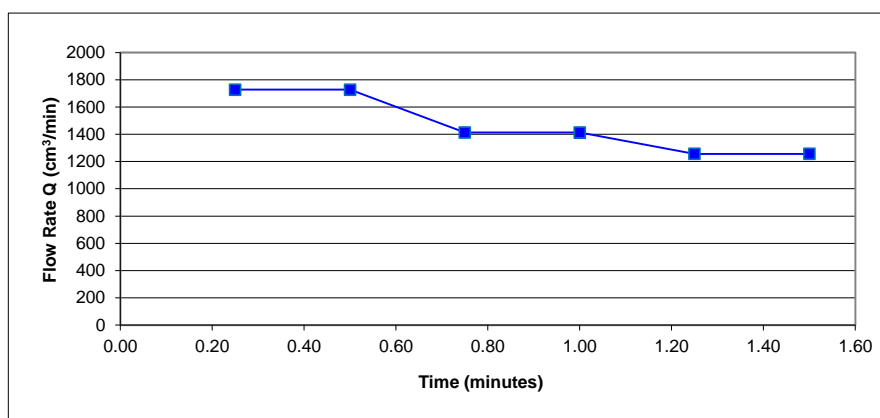

Saturated Hydraulic Conductivity - Over total duration of test

$$\begin{aligned}
 k &= 5.21\text{E-}01 \text{ cm/min} & \text{where } K &= 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{(r/H^2) + 0.25}] + r/H / 2\pi H^2 \\
 &= 8.68\text{E-}05 \text{ m/sec} & & \text{ref. AS1547-2012 App G} \\
 &= 7.50 \text{ m/day}
 \end{aligned}$$

Constant Head Permeameter Test Report [AS1547:2012 App G]

Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	15/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB


Test Location	Test No.	BH4
Description: Lawn	Easting:	328935 m
Material type: Silty Sandy Filling	Northing	6239105 m
Condition of ground surface before test: Topsoil	Surface Level:	4.3 m AHD
Weather during test: 29°, Cloudy		

Details of Bore Installation			
Depth of augered hole	500 mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	300 mm	Time from filling to start	0 minutes
Diameter of hole	100 mm		

Test Results

Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)
0.00	300		
0.08	250	393	4909
0.17	205	353	3927
0.25	152	416	5203
0.33	95	448	5596
0.42	45	393	4363
0.50	0	353	4418

Average 393 4736

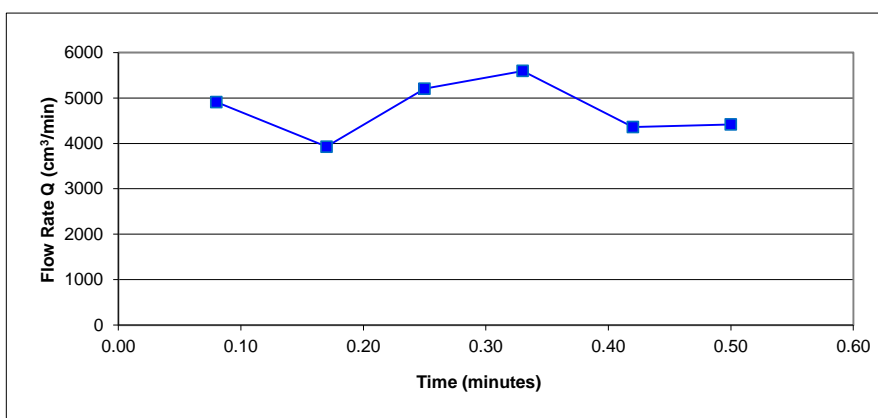

Saturated Hydraulic Conductivity - Over total duration of test

$$\begin{aligned}
 k &= 2.10\text{E}+00 \text{ cm/min} & \text{where } K &= 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{(r/H^2)+0.25}] + r/H/2\pi H^2 \\
 &= 3.50\text{E}-04 \text{ m/sec} & & \text{ref. AS1547-2012 App G} \\
 &= 30.27 \text{ m/day}
 \end{aligned}$$

Constant Head Permeameter Test Report [AS1547:2012 App G]


Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	16/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB

Test Location	Test No.	BH5
Description: Lawn	Easting:	328922 m
Material type: Silty Sandy Filling	Northing	6239137 m
Condition of ground surface before test: Topsoil	Surface Level:	4.2 m AHD
Weather during test: 28°, Sunny		

Details of Bore Installation			
Depth of augered hole	550 mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	350 mm	Time from filling to start	0 minutes
Diameter of hole	100 mm		

Test Results

Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)
0.00	300		
0.08	220	628	7854
0.17	130	707	7854
0.25	50	628	7854
0.33	0	393	4909
Average		589	7118

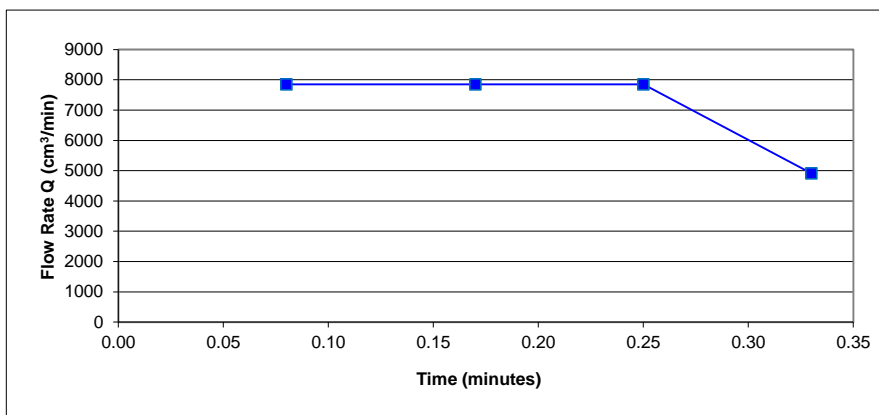
Saturated Hydraulic Conductivity - Over total duration of test

$$\begin{aligned}
 k &= 2.53\text{E}+00 \text{ cm/min} & \text{where } K &= 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{(r/H^2)+0.25}] + r/H/2\pi H^2 \\
 &= 4.22\text{E}-04 \text{ m/sec} & & \text{ref. AS1547-2012 App G} \\
 &= 36.42 \text{ m/day}
 \end{aligned}$$

Constant Head Permeameter Test Report [AS1547:2012 App G]

Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	16/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB


Test Location	Test No.	BH6
Description: Lawn	Easting:	328927 m
Material type: Silty Sandy Filling	Northing	6239160 m
Condition of ground surface before test: Topsoil	Surface Level:	4 m AHD
Weather during test: 28°, Sunny		

Details of Bore Installation			
Depth of augered hole	500 mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	300 mm	Time from filling to start	0 minutes
Diameter of hole	100 mm		

Test Results

Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)
0.00	300		
0.08	195	825	10308
0.17	100	746	8290
0.25	0	785	9817


Average 785 9472

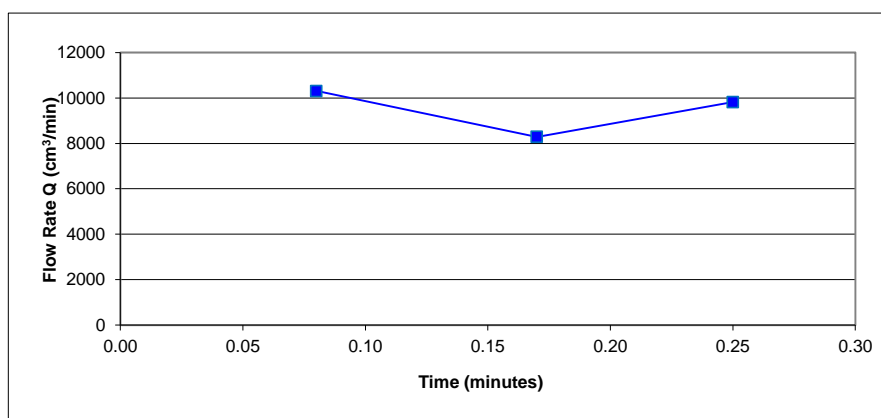

Saturated Hydraulic Conductivity - Over total duration of test

$$\begin{aligned}
 k &= 4.20\text{E}+00 \text{ cm/min} & \text{where } K &= 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{(r/H^2)+0.25}] + r/H/2\pi H^2 \\
 &= 7.01\text{E}-04 \text{ m/sec} & & \text{ref. AS1547-2012 App G} \\
 &= 60.53 \text{ m/day}
 \end{aligned}$$

Constant Head Permeameter Test Report [AS1547:2012 App G]

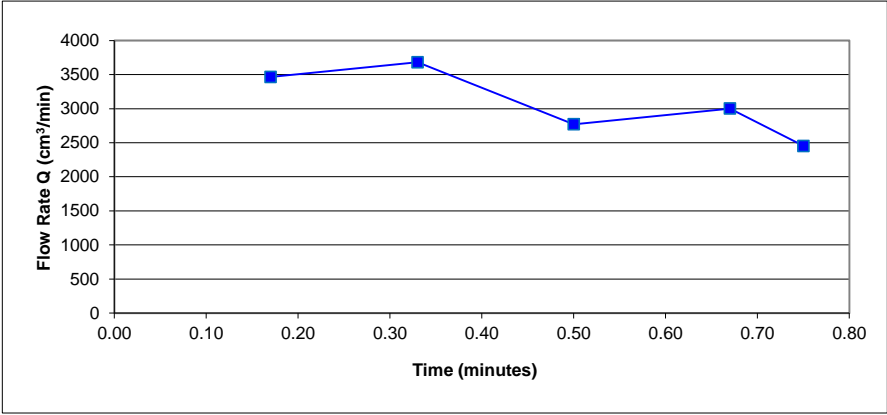Client: Monterey Equity Pty Ltd Project: Proposed Residential Development Location: 119 Barton Street, Monterey	Project No: 85348 Date: 16/2/16 Tested by: MB																																																				
Test Location Description: Lawn Material type: Silty Sandy Filling Condition of ground surface before test: Topsoil Weather during test: 28°, Sunny																																																					
Test No. BH7 Easting: 328951 m Northing: 6239158 m Surface Level: 4 m AHD																																																					
Details of Bore Installation Depth of augered hole: 500 mm Depth of constant water below permeameter: 300 mm Diameter of hole: 100 mm Depth to impermeable layer: >3 m Time from filling to start: 0 minutes																																																					
Test Results <table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th>Time (minutes)</th> <th>Level below top (mm)</th> <th>Flow Volume (cm³)</th> <th>Rate of Loss [Q] (cm³/min)</th> </tr> </thead> <tbody> <tr><td>0.00</td><td>300</td><td></td><td></td></tr> <tr><td>0.17</td><td>225</td><td>589</td><td>3465</td></tr> <tr><td>0.33</td><td>150</td><td>589</td><td>3682</td></tr> <tr><td>0.50</td><td>90</td><td>471</td><td>2772</td></tr> <tr><td>0.67</td><td>25</td><td>511</td><td>3003</td></tr> <tr><td>0.75</td><td>0</td><td>196</td><td>2454</td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr> <td colspan="2" style="text-align: center;">Average</td> <td style="text-align: center;">471</td> <td style="text-align: center;">3075</td> </tr> </tbody> </table> <div style="margin-top: 20px;">  </div>		Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)	0.00	300			0.17	225	589	3465	0.33	150	589	3682	0.50	90	471	2772	0.67	25	511	3003	0.75	0	196	2454																					Average		471	3075
Time (minutes)	Level below top (mm)	Flow Volume (cm ³)	Rate of Loss [Q] (cm ³ /min)																																																		
0.00	300																																																				
0.17	225	589	3465																																																		
0.33	150	589	3682																																																		
0.50	90	471	2772																																																		
0.67	25	511	3003																																																		
0.75	0	196	2454																																																		
Average		471	3075																																																		
Saturated Hydraulic Conductivity - Over total duration of test <div style="display: flex; justify-content: space-between;"> <div> k = 1.36E+00 cm/min = 2.27E-04 m/sec = 19.65 m/day </div> <div> where $K = 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{[(r/H)^2 + 0.25]} + r/H] / 2\pi H^2$ ref. AS1547-2012 App G </div> </div>																																																					

Constant Head Permeameter Test Report [AS1547:2012 App G]

Client:	Monterey Equity Pty Ltd	Project No:	85348
Project:	Proposed Residential Development	Date:	16/2/16
Location:	119 Barton Street, Monterey	Tested by:	MB


Test Location	Test No.	BH8
Description: Flower Bed	Easting:	328977 m
Material type: Silty Sandy Filling	Northing	6239157 m
Condition of ground surface before test: Topsoil	Surface Level:	3.9 m AHD
Weather during test: 28°, Sunny		

Details of Bore Installation				
Depth of augered hole	500	mm	Depth to impermeable layer	>3 m
Depth of constant water below permeameter	300	mm	Time from filling to start	0 minutes
Diameter of hole	100	mm		

Test Results

[illegible]

Average	785	9418
---------	-----	------

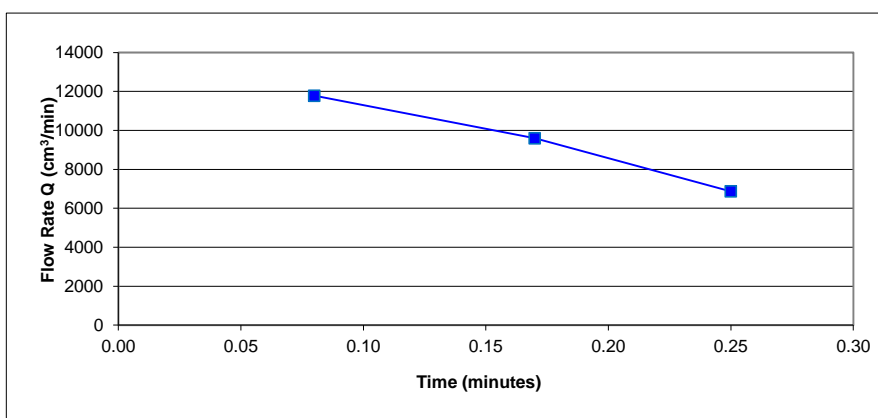

Saturated Hydraulic Conductivity - Over total duration of test

k = 4.18E+00 cm/min where $K = 4.4Q[0.5 \sinh^{-1}(H/2r) - \sqrt{[(r/H^2)+0.25]+r/H}/2\pi H^2$
= 6.97E-04 m/sec ref. AS1547-2012 App G
= 60.18 m/day



Locality Plan

NOTE:

- 1: Base drawing from Project Surveyors (Dwg B1968-1, dated 11.9.2015)
- 2: Test locations are approximate only and are shown with reference to existing features.

LEGEND

- Borehole and Soil Permeability Test Location

	CLIENT: Monterey Equity Pty Limited		TITLE: Location of Tests Proposed Residential Development 119 Barton Street, Monterey		PROJECT No: 85348.00
	OFFICE: Sydney	DRAWN BY: PSCH			DRAWING No: 1
	SCALE: 1:800 @ A3	DATE: 22.2.2016			REVISION: 0